

\\John\Manteca Courthouse_1007\Drawings\Sheets\Phase 1\T.1 - Title Sheet.dwg, 6/20/2011 3:08:15 PM, PDF995

SUPERIOR COURT OF CALIFORNIA

COUNTY OF SAN JOAQUIN

MANTECA BRANCH

SITE AND BUILDING IMPROVEMENTS

PHASE 1

OCCM PROJECT NUMBER FY 39-09

CSFM FILE NUMBER: 01-39-11-0065

GENERAL NOTES

- ALL WORK SHALL COMPLY WITH THE MINIMUM STANDARDS OF THE FOLLOWING CODES:
 - 2010 BUILDING STANDARDS ADMINISTRATIVE CODE, PART 1, TITLE 24 C.C.R.
 - 2010 CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24 C.C.R.
 - (2009) INTERNATIONAL BUILDING CODE AND 2010 CALIFORNIA AMENDMENTS)
 - 2010 CALIFORNIA ELECTRICAL CODE (CEC), PART 3, TITLE 24 C.C.R.
 - (2008 NATIONAL ELECTRICAL CODE AND 2010 CALIFORNIA AMENDMENTS)
 - 2010 CALIFORNIA MECHANICAL CODE (CMC) PART 4, TITLE 24 C.C.R.
 - (2009 UNIFORM MECHANICAL CODE AND 2010 CALIFORNIA AMENDMENTS)
 - 2010 CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24 C.C.R.
 - (2009 UNIFORM PLUMBING CODE AND 2010 CALIFORNIA AMENDMENTS)
 - 2010 CALIFORNIA FIRE CODE, PART 9, TITLE 23 C.C.R.
 - (2009 INTERNATIONAL FIRE CODE AND 2010 CALIFORNIA AMENDMENTS)
 - 2010 CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN), PART 11, TITLE 24 C.C.R.
 - 2010 CALIFORNIA REFERENCED STANDARDS, PART 12, TITLE 24 C.C.R.
 - TITLE 19 C.C.R. PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS.
 - NFPA 13 AUTOMATIC SPRINKLER SYSTEMS w/ CA AMENDMENTS 2010 EDITION
 - NFPA 14 STANDPIPE SYSTEMS w/ CA AMENDMENTS 2007 EDITION
 - NFPA 17a WET CHEMICAL SYSTEMS 2002 EDITION
 - NFPA 20 STATIONARY PUMPS 2007 EDITION
 - NFPA 24 PRIVATE FIRE MAINS w/ CA AMENDMENTS 2010 EDITION
 - NFPA 72 NATIONAL FIRE ALARM CODE w/ CA AMENDMENTS 2010 EDITION
 - NFPA 2001 CLEAN AGENT FIRE EXTINGUISHING SYSTEMS w/ CA AMENDMENTS 2008 EDITION
 - REFERENCE CODE SECTION FOR NFPA STANDARDS ARE IN 2010 CBC CHAPTER 35 OR 2010 CFC CHAPTER 47. SEE CHAPTER 35 FOR STATE OF CALIFORNIA AMENDMENTS TO NFPA STANDARDS.
 - ALL ACCUMULATIVE SUPPLEMENTS TO THE ABOVE CODES
 - ALL APPLICABLE STANDARDS, ORDINANCES AND REGULATIONS OF THE AGENCIES WITH JURISDICTION OVER THE WORK
- THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS FOR DIMENSION, GRADE, CONFIGURATION, AND OTHER ASPECTS OF COMPATIBILITY WITH THE WORK DESCRIBED IN THESE CONSTRUCTION DOCUMENTS. ANY CONDITIONS WHICH INTERFERE WITH THE WORK SHALL IMMEDIATELY BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND THE WORK SHALL NOT PROCEED IN THE AREAS OF CONFLICT UNTIL SUCH CONFLICTS HAVE BEEN RESOLVED.
 - THE DESIGN PRECLUDES THE USE OR STORAGE OF HAZARDOUS MATERIALS IN EXCESS OF THE QUANTITIES LISTED IN UBC TABLE 3D AND 3E.
 - WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER DRAWING SCALE OR PROPORTION.
 - THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF A COMPLETE FIRE SUPPRESSION SYSTEM IN ALL AREAS; TO MEET THE STANDARDS OF NFPA NFPA 13 2010 FOR COMMON AREAS AND STATE FIRE MARSHAL POLICIES. A SEPARATE FIRE SPRINKLER PERMIT AND PLAN APPROVAL SHALL BE OBTAINED FROM THE STATE FIRE MARSHAL PRIOR TO INSTALLATION OF THE FIRE SPRINKLER SYSTEM. SPRINKLER HEAD PLACEMENT SHALL ONLY BE AS APPROVED BY THE ARCHITECT AND THE SAN JOAQUIN COUNTY FIRE DEPARTMENT.
 - THE FIRE SPRINKLER SYSTEM SHALL BE SUPERVISED FOR WATER FLOW AND TAMPER BY AN APPROVED CENTRAL, PROPRIETARY OR REMOTE STATION SERVICE, AND SHALL BE PROVIDED WITH LOCAL ALARMS WHICH WILL ISSUE AN AUDIBLE SIGNAL AT A CONSTANTLY ATTENDED LOCATION. ALL WORK SHALL BE DONE BY A CALIFORNIA LICENSED ALARM CONTRACTOR.
 - FIRE EXTINGUISHERS SHALL TYPE 2A10BC AND SHALL BE LOCATED AS APPROVED BY THE STATE FIRE MARSHAL, NO MORE THAN 60 INCHES AND NO LESS THAN 4 INCHES ABOVE THE FINISHED FLOOR, AND AT AN INTERVAL OF NO FURTHER THAN 75 FEET OF TRAVEL.
 - ENCROACHMENT PERMITS SHALL BE OBTAINED FROM THE MANTECA PUBLIC WORKS DEPARTMENT FOR ANY CONSTRUCTION ACTIVITIES WITHIN THE PUBLIC RIGHT-OF-WAY, BARRICADES, SIGNAGE, AND PROTECTIVE DEVICES SHALL BE AS REQUIRED BY THE CITY.
 - A COMPLETE AND OPERABLE FIRE ALARM SYSTEM SHALL BE PROVIDED, INCLUDING BUT NOT LIMITED TO SMOKE AND/OR HEAT DETECTORS, MANUAL PULL STATIONS, FIRE ALARM CONTROL PANE, GRAPHIC ANNUNCIATOR, FIRE SUPPRESSION SPRINKLER SYSTEM CONNECTIONS, AUDIBLE AND VISUAL ALARM DEVICES, WIRING, ACCESSORIES, AND CONNECTION TO BUILDING POWER. ALL COMPONENTS SHALL COMPLY WITH STATE FIRE MARSHAL AND NFPA 72 (2010 EDITION) REQUIREMENTS, AND BE U.L.APPROVED.

DIRECTORY

OWNER:

SUPERIOR COURT OF CALIFORNIA
JUDICIAL COUNCIL OF CALIFORNIA,
ADMINISTRATIVE OFFICE OF THE COURTS
OFFICE OF COURTS CONSTRUCTION
AND MANAGEMENT
2860 GATEWAY OAKS DRIVE
SACRAMENTO, CA 95833
T: 916-643-8009 F: 916-263-2342
www.courtinfo.ca.gov

CONTRACTOR:

CHAMBLIN-LANDES CONSTRUCTION INC.
1345 RIVERSIDE AVENUE
PASO ROBLES, CA 93446
T: 805-239-0490 F: 805-239-0797
mlandes@chamblin-landes.com

ARCHITECT:

FRASER SEIPLE ARCHITECTS
971 OSOS STREET
SAN LUIS OBISPO, CA 93401
T: 805-544-6161 F: 805-544-6183
bruce@fraserseiplearchitects.com

STRUCTURAL ENGINEER:

LAMPMAN & SMITH
805 AEROVISTA PLACE, SUITE 204
SAN LUIS OBISPO, CA 93401
T: 805-544-9173 F: 805-543-2830
mep@lampsmith.com

MECHANICAL ENGINEER:

JVA MECHANICAL ENGINEERING
979 OSOS STREET
SAN LUIS OBISPO, CA 93401
T: 805-543-3190 F: 805-543-3165
tyler@jvamech.com

CIVIL ENGINEER:

KEITH V. CROWE, P.E.
P.O. BOX 832
ATASCADERO, CA 93423
T: 805-464-0975 F: 805-464-0978
kwcrowe@charter.net

PROJECT DATA

SEE SHEET T.5 FOR BUILDING ANALYSIS DATA. SEE SHEET T.1 FOR DEFERRED APPROVAL ITEMS AND FIRE SAFETY REQUIREMENTS.

SCOPE OF WORK:

Demolition of public ramp, sally port, and interior walls. Relocation of modular office building. Remodel of public lobby and installation of storefront infill to increase lobby floor area by 215 s.f. Addition of 664 s.f. including (3) holding cells and a secure sally port entrance.

ADDRESS:

315 E Center St. Manteca, CA 95336

APN:

223-093-020

SITE AREA:

39,435 S.F.

EXISTING BUILDING AREA:

7,188 S.F.

AREA OF REMODELING IN EXISTING BUILDING:

989 S.F.

AREA OF ADDITIONS TO EXISTING BUILDING:

882 S.F.

CBC CONSTRUCTION TYPE:

TYPE V A


CBC OCCUPANCY:

B (OFFICE), A-3 (ASSEMBLY), I-3 (HOLDING)

CBC OCCUPANT LOAD:

(E) COURTROOM (ACTUAL):	106
(E) HOLDING CELLS (ACTUAL):	45
(E) OFFICE, SUPPORT:	45
(N) LOBBY ADDITION:	3
(N) HOLDING CELLS (ACTUAL):	25
TOTAL:	224

VICINITY MAP CITY OF MANTECA

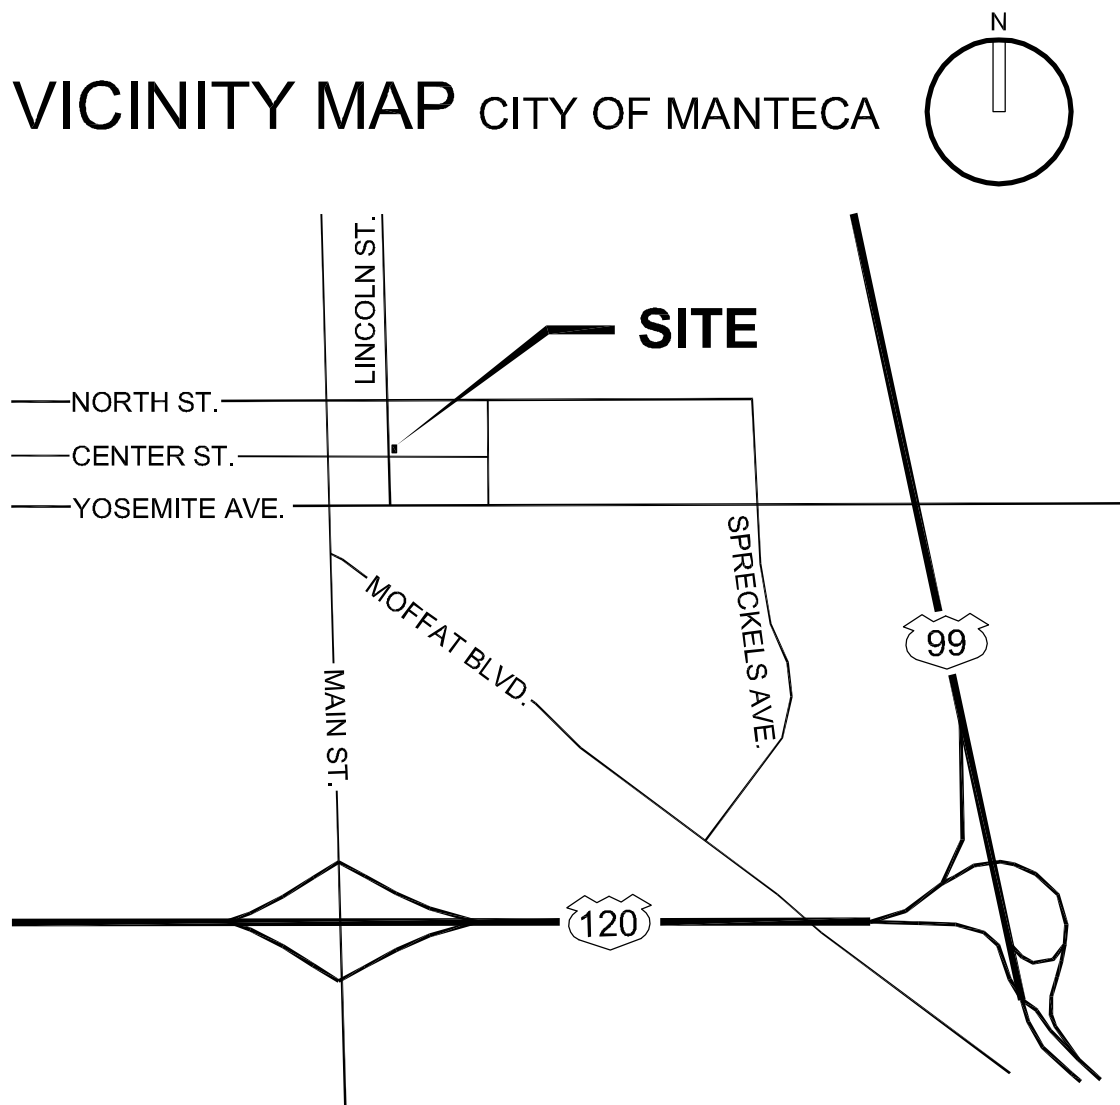

SHEET INDEX

T.0	TITLE SHEET
T.1	NOTES, SYMBOLS, ABBREVIATIONS
T.2	TOPOGRAPHICAL SURVEY
T.3	PHASE I AND PHASE II COMPOSITE REFERENCE SITE PLAN
T.4	PHASE I AND PHASE II COMPOSITE REFERENCE FLOOR PLAN
T.5	PHASE I AND PHASE II CODE ANALYSIS, ABBREVIATIONS

C1	PHASE I GRADING, DRAINAGE AND UTILITY PLAN
C2	CONSTRUCTION DETAILS

D.1	PHASE I SITE DEMOLITION PLAN
D.2	PHASE I DEMOLITION FLOOR PLAN
D.3	PHASE I DEMOLITION ELEVATIONS, SECTIONS

A0.1	ENVELOPE TITLE 24 COMPLIANCE FORMS
------	------------------------------------

A1.1	PHASE I SITE PLAN
A1.2	PHASE I SITE DETAILS
A1.3	PHASE I SITE DETAILS
A2.1	PHASE I DESCRIPTIVE FLOOR PLAN
A2.2	PHASE I DIMENSIONED FLOOR PLAN
A2.3	PHASE I CONSTRUCTION AND RELOCATION STAGING PLAN
A3.1	PHASE I ROOF PLAN
A4.1	PHASE I REFLECTED CEILING PLAN
A5.1	PHASE I EXTERIOR ELEVATIONS
A6.1	PHASE I BUILDING SECTIONS
A6.2	PHASE I WALL SECTIONS
A6.3	PHASE I WALL SECTIONS
A6.4	PHASE I WALL SECTIONS
A7.1	PHASE I INTERIOR ELEVATIONS
A8.1	PHASE I SCHEDULES
A8.2	PHASE I STOREFRONT, DOOR, WINDOW DETAILS
A8.3	PHASE I SUSPENDED CEILING DETAILS
A8.4	PHASE I WALL TYPES
A9.1	PHASE I ARCHITECTURAL DETAILS
A9.2	PHASE 1 ARCHITECTURAL DETAILS

SS.1	PHASE I AND PHASE II SIGNAGE FLOOR PLAN
SS.2	PHASE I SIGN GRAPHICS

S1.0	GENERAL STRUCTURAL NOTES
S1.1	GENERAL STRUCTURAL NOTES, ABBREVIATIONS
S1.2	SPECIAL INSPECTIONS
S2.1	FOUNDATION PLAN
S3.1	ROOF FRAMING PLAN
S4.1	STRUCTURAL DETAILS
S4.2	STRUCTURAL DETAILS
S4.3	STRUCTURAL DETAILS

MP1.1	PHASE I GENERAL NOTES, LEGENDS, ABBREVIATIONS AND SPECIFICATIONS
MP2.1	PHASE I SCHEDULES AND DETAILS
MP3.1	PHASE I MECHANICAL ROOF AND FLOOR PLANS
MP4.1	PHASE I PLUMBING ROOF AND FLOOR PLANS

E1.0	GENERAL NOTES, LEGEND AND ABBREVIATIONS
E2.0	ELECTRICAL DEMOTION FLOOR PLAN
E2.1	ELECTRICAL LIGHTING FLOOR PLAN
E2.2	ELECTRICAL POWER FLOOR PLAN
E3.0	ELECTRICAL DETAILS
E4.0	ELECTRICAL SCHEDULES
E5.0	INTERIOR TITLE 24 COMPLIANCE FORMS
E5.1	EXTERIOR TITLE 24 COMPLIANCE FORMS

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

FRASER
SEIPLE
ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

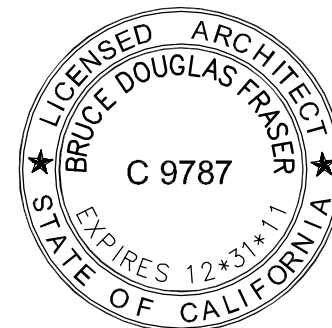

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

TITLE SHEET

SHEET #

T.0

ABBREVIATIONS

# &	POUND OR NUMBER AND	ENTR.	ENTRANCE	OPNG.	OPENING
A.	AIR	EQ.	EQUAL	P.C.D.	PAPER CUP DISPENSER
A.B.	ANCHOR BOLT	EQUIP.	EQUIPMENT	P.L.	PROPERTY LINE
A.D.	AREA DRAIN	EXP.	EXPANSION	P.LAM.	PLASTIC LAMINATE
A.C.	AIR CONDITIONING	EXP. BT.	EXPANSION BOLT	P.T.D.	PAPER TOWEL DISPENSER
A.C.T.	ACOUSTICAL CEILING TILE	EXT.	EXTERIOR	P.T.D.R.	PAPER TOWEL DISPENSER AND RECEPTACLE
A.F.C.	ABOVE FINISHED COUNTER	F.A.	FIRE ALARM	P.T.R.	PAPER TOWEL RECEPTACLE
A.F.F.	ABOVE FINISHED FLOOR	F.A.A.P.	FIRE ALARM ANNUNCIATOR PANEL	P.V.C	POLYVINYL CHLORIDE
A.F.G.	ABOVE FINISHED GRADE	F.D.	FLOOR DRAIN	PAV.	PAVING
A.F.S.	ABOVE FINISHED SLAB	F.D.C.	FIRE DEPARTMENT CONNECTION	PL.	PLATE
ACOUS.	ACOUSTIC	F.E.	FIRE EXTINGUISHER	PLAS.	PLASTER
ACOUS. INSUL.	ACOUSTICAL INSULATION	F.E.C.	FIRE EXTINGUISHER CABINET	PLEBS.	PLYWOOD
ACOUS. PNL.	ACOUSTICAL PANEL	F.F.	FIRE HOSE CABINET	PLYWD.	PLYWOOD
ACS. DR.	ACCESS DOOR	F.H.C.	FINISH	PNL.	PANEL
ACS. FLR.	ACCESS FLOOR	FIN.	FINISH	POL.	POLISHED
ACS. PNL.	ACCESS PANEL	FIXT.	FIXTURE	PR.	PAIR
ADJ.	ADJUSTABLE	FLR.	FLOOR	PROCAST.	PROJECTION
ALT.	ALTERNATE	FLASH.	FLASHING	PROJ.	PROJ.
ALUM.	ALUMINUM	FLEX.	FLEXIBLE	PT.	PAINT
ANR.	ANCHOR	FLUOR.	FLUORESCENT	PTN.	PARTITION
ARCH.	ARCHITECTURAL	F.O.	FACE OF	Q.T.	QUARRY TILE
ASPH.	ASPHALT	F.O.C.	FACE OF CONCRETE	QTY.	QUANTITY
ATCH.	ATTACHMENT	F.O.F.	FACE OF FINISH	R.	RISER OR RADIUS
AUTO.	AUTOMATIC	F.O.S.	FACE OF STUD	R.B.	RUBBER BASE
AV.	AUDIOVISUAL	F.T.	FIRE TREATED	R.C.P.	REFLECTED CEILING PLAN
B.O.	BOTTOM OF	FP.	FIREPROOFING	R.D.	ROOF DRAIN
B.O.S.	BOTTOM OF STEEL	FT.	FOOT/FEET	R.H.	ROBE HOOK
B.P.	BUILDING PAPER	FT.G.	FOOTING	R.O.	ROUGH OPENING
B.S.	BOTH SIDES	FURR.	FURRING	R.W.L.	RAIN WATER LEADER
B.U.R.	BUILT-UP ROOFING	FUTURE	FUTURE	RECT.	RECTANGULAR
BD.	BOARD	G.B.	GRAB BAR	REF.	REFERENCE OR REFRIGERATOR
BITUM.	BITUMINOUS	G.F.R.C.	GLASS FIBER REINFORCED CONCRETE	REINF.	REINFORCING OR REINFORCED
BKG.	BACKING	G.F.R.G.	GLASS FIBER REINFORCED GYPSUM	RESIL.	RESILIENT
BLDG.	BUILDING	G.F.R.P.	GLASS FIBER REINFORCED PLASTER	RM.	ROOM
BLK.	BLOCK	G.M.U.	GLASS MASONRY UNIT	RND.	ROUND
BLKG.	BLOCKING	GA.	GAUGE	RUB.	RUBBER
BLST.	BALLAST	GALV.	GALVANIZED	S.	SOUTH
BMI.	BEAM	GL.	GLASS	S.C.R.	SHOWER CURTAIN ROD
BRCG.	BRACING	GLU. LAM.	GLUED LAMINATED WOOD	S.D.	SOAP DISPENSER
BRZ.	BRONZE	GND.	GROUND	S.F.	SQUARE FEET
C.	CHANNEL	GR.	GRADE	S.R.	SHEET RUBBER
C.B.	CATCH BASIN	GROM.	GROMMET	S.N.D.	SAN. NAPKIN DISPENSER
C.B.BD.	CEMENTITIOUS BACKER BOARD	GYP.	GYPSUM	S.S.D.	SEE STRUCTURAL DRAWING
C.C.T.V.	CLOSED CIRCUIT TELEVISION	G.W.B.	GYPSUM BOARD	S.SK.	SERVICE SINK
C.F.	CONTRACTOR FURNISHED	H.	HIGH	S.ST.	STAINLESS STEEL
C.G.	CORNER GUARD	H.B.	HOSE BIBB	S.V.	SHEET VINYL
C.H.	COAT HOOK	H.M.	HOLLOW METAL	SCHED.	SCHEDULE OR SCHEDULED
C.I.	CAST IRON	H.P.	HIGH POINT	SECT.	SECTION
C.J.	CONTROL JOINT	H.V.A.C.	HEATING VENTILATION AND AIR CONDITIONING	SECUR.	SECURITY
C.L.	CENTER LINE	H.W.	HOT WATER	SHR.	SHOWER
C.M.U.	CONCRETE MASONRY UNIT	HC.	HANDICAPPED ACCESSIBLE	SHT.	SHEET
C.O.	CASED OPENING	HDW.	HARDWARE	SHTHG.	SHEATHING
CO2	CARBON DIOXIDE	HNDRL.	HANDRAIL	SIM.	SIMILAR
C.R.	CHAIR RAIL	HORIZ.	HORIZONTAL	SLD.	SOLID
C.T.	CERAMIC TILE	HR.	HOUR	SPEC.	SPECIFICATION
CAB.	CABINET	HT.	HEIGHT	SPKR.	SPEAKER
C-C	CENTER TO CENTER	I.D.	INSIDE DIAMETER	SPKLR.	SPRINKLER
CEM.	CEMENT	IN.	INCH	SQ.	SQUARE
CEM. PLAS.	CEMENT PLASTER	INSUL.	INSULATION	STA.	STATION
CEM. PLAS. CLG.	CEMENT PLASTER CEILING	INT.	INTERIOR	STD.	STANDARD
CHBD.	CHALKBOARD	INV.	INVERT	STL.	STEEL
CIRC.	CIRCULAR	J.C.	JANITOR CLOSET	STR.	STORAGE
CLDG.	CLADDING	JT.	JOINT	STN.	STONE
CLG. HT.	CEILING HEIGHT	K.B.	KNEE BRACE	STRCT.	STRUCTURAL
CLO.	CLOSET	K.P.	KICK PLATE	STRUCT.	STRUCTURE
CLR.	CLEAR	KIT.	KITCHEN	S.T.S.	SELF-TAPPING SCREW
CNTR.	COUNTER	L.	ANGLE	SUSP.	SUSPENDED
COL.	COLUMN	L.L.	LEAD LINED	SYM.	SYMMETRICAL
CONC.	CONCRETE	L.	LONG	T.	TREAD
CONC. FLR.	CONCRETE FLOOR	L.L.	LEAD LINED	T.&G.	TONGUE AND GROOVE
CONC. OPNG.	CONCRETE OPENING	LAM.	LAMINATED	T.B.	TOWEL BARTTIE BACK
CONF.	CONFERENCE	LAM. GL.	LAMINATED GLASS	T.C.	TOP OF CURB
CONN.	CONNECTION	LAUN.	LAUNDRY	T.O.	TOP OF
CONT.	CONTINUOUS	LAV.	LAVATORY	T.O.B.	TOP OF BEAM
CORR.	CORRIDOR	LKR.	LOCKER	T.O.C	TOP OF CONCRETE
CPT.	CARPET	LN.	LINOLEUM	T.O.P	TOP OF PARAPET
CTR.	CENTER	L.P.T.	LOW POINT	T.P.	TOP OF PAVEMENT
D.	DEEP	L.S. PLAS.	LIMESTONE PLASTER	T.P.D.	TOILET PAPER DISPENSER
D.F.	DRINKING FOUNTAIN	L.T.	LIGHT	T.V.	TELEVISION
D.T.	DRAPERY TRACK	LVR.	LOUVER	T.O.W.	TOP OF WALL
D.W.	DISH WASHER	M.D.F.	MEDIUM DENSITY FIBERBOARD	T.S.	TUBE STEEL
DBL.	DOUBLE	M.D.O.	MEDIUM DENSITY OVERLAY	TEL.	TELEPHONE
DEMO.	DEMOLITION	M.O.	MASONRY OPENING	TER.	TERRAZZO
DEPT.	DEPARTMENT	MACH.	MACHINE	THK.	THICK
DETT.	DETAIL	MATL.	MATERIAL	THRES.	THRESHOLD
DIA.	DIAMETER	MATL.	MATERIAL	TKBD.	TACKBOARD
DIA.	DIAGONAL	MATL.	MATERIAL	TYP.	TYPICAL
DIM.	DIMENSION	MATL.	MATERIAL	U.N.O.	UNLESS NOTED OTHERWISE
DISP.	DISPENSER	MATL.	MATERIAL	U.N.	UNLESS OTHERWISE NOTED
DMPF.	DAMP PROOFING	MATL.	MATERIAL	U.O.N.	UNLESS OTHERWISE NOTED
DN.	DOWN	MATL.	MATERIAL	URIN.	URINAL
DR.	DOOR	MATL.	MATERIAL	V.B.	VAPOR BARRIER
DS.	DOWNSPOUT	MATL.	MATERIAL	V.C.T.	VINYL COMPOSITION TILE
DWG.	DRAWING	MATL.	MATERIAL	V.G.	VERTICAL GRAIN
DWR.	DRAWER	MATL.	MATERIAL	V.I.F.	VERTICAL IN FIELD
(E)	EXISTING	MATL.	MATERIAL	V.PLAS.	VENER PLASTER
E.	EAST	MATL.	MATERIAL	VAC.	VACUUM
E.H.D.	ELECTRICAL HAND DRYER	MATL.	MATERIAL	VENT.	VENTILATION
E.I.F.S.	EXTERIOR INSULATION AND FINISH SYSTEM	MATL.	MATERIAL	VERT.	VERTICAL
E.J.	EXPANSION JOINT	MATL.	MATERIAL	VEST.	VESTIBULE
E.P.	ELECTRICAL PANELBOARD	MATL.	MATERIAL	W.	WEST OR WIDE
E.S.	ELASTOMERIC OR EXPOSED STRUCTURE	MATL.	MATERIAL	W.	WITH
E.W.C.	ELECTRICAL WATER COOLER	MATL.	MATERIAL	W.B.	WALL BUMPER
EA.	EACH	MATL.	MATERIAL	W.C.	WATER CLOSET
EL.	ELEVATION	MATL.	MATERIAL	W.G.	WALL GUARD
ELAST.	ELASTOMERIC	MATL.	MATERIAL	W.O.	WHERE OCCURS
ELEC.	ELECTRICAL	MATL.	MATERIAL	W.W.M.	WELDED WIRE MESH
ELEV.	ELEVATOR OR ELEVATION	MATL.	MATERIAL	WD.	WOOD
EMER.	EMERGENCY	MATL.	MATERIAL	WP.	WATERPROOF OR WATERPROOFING
ENCL.	ENCLOSURE	MATL.	MATERIAL	WSCT.	WAINSCOT
ENGR.	ENGINEER	MATL.	MATERIAL	WT.	WEIGHT

ARCHITECTURAL SYMBOLS

GRID LINES		
BUILDING SECTION		
WALL SECTION		
ELEVATION		
INTERIOR ELEVATION		
ENLARGED PLAN OR ELEVATION		
DETAIL		
ROOM TITLE & NUMBER		
DOOR NUMBER		
CEILING HEIGHT		
WINDOW TYPE		
KEY NOTES		
ELEVATION REFERENCE		
ELEVATION ABOVE PROJECT DATUM		
NORTH ARROW		
REVISION		
OTHER		
PARTITION SYMBOL		
SEE SHEET A2.1 FOR PARTITION LOCATIONS		
SEE SHEET A8.4 FOR PARTITION TYPES		

FIRE SAFETY REQUIREMENTS

- ALL HYDRANTS MUST BE INSTALLED AND IN OPERABLE CONDITION PRIOR TO STARTING ANY COMBUSTIBLE CONSTRUCTION.
- FIRE PROTECTION EQUIPMENT AND SYSTEMS SHALL BE INSTALLED AND MAINTAINED DURING CONSTRUCTION/DEMOLITION, IN ACCORDANCE WITH CHAPTER 14, CALIFORNIA FIRE CODE..
- ANY PERSON USING A TORCH OR OTHER FLAME-PRODUCING DEVICE FOR SWEATING PIPE JOINTS FROM OR IN ANY BUILDING OR STRUCTURE SHALL PROVIDE ONE APPROVED FIRE EXTINGUISHER ON THE PREMISES WHERE SAID BURNING OPERATION IS PERFORMED. COMBUSTIBLE MATERIAL IN THE CLOSE PROXIMITY OF OPEN FLAME SHALL BE PROTECTED AGAINST IGNITION BY SHIELDING, WETTING OR OTHER MEANS. IN ALL CASES, A FIRE WATCH SHALL BE MAINTAINED IN THE VICINITY OF THE OPERATION FOR ONE-HALF HOUR AFTER THE TORCH OR FLAME-PRODUCING DEVICE HAS BEEN USED.
- EXIT OBSTRUCTIONS, INCLUDING STORAGE, SHALL NOT BE PLACED IN THE REQUIRED WIDTH OF AN EXIT, EXCEPT PROJECTIONS AS PERMITTED BY THE BUILDING CODE.

REQUIRED SPECIAL INSPECTIONS

REFER TO SHEET S1.2 FOR SPECIAL INSPECTION REQUIREMENTS

DEFERRED APPROVAL ITEMS

SUBMITTAL DOCUMENTS FOR DEFERRED SUBMITTAL ITEMS SHALL BE DELIVERED TO THE ARCHITECT OR ENGINEER OF RECORD, WHO SHALL REVIEW THEM AND FORWARD THEM TO THE BUILDING OFFICIAL WITH A NOTATION INDICATING THAT THE DEFERRED SUBMITTAL DOCUMENTS HAVE BEEN REVIEWED AND THAT THEY HAVE BEEN FOUND TO BE IN GENERAL CONFORMANCE WITH THE DESIGN OF THE WORK. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THEIR DESIGN AND SUBMITTAL DOCUMENTS HAVE BEEN APPROVE BY THE STATE FIRE MARSHAL. DEFERRED SUBMITTAL ITEMS INCLUDE BUT ARE NOT NECESSARILY LIMITED TO:

- DEFERRED SUBMITTALS FOR DESIGN BUILD PERMITS SHALL BE SUBMITTED BY OTHERS INCLUDING FIRE SPRINKLER AND ALARM SYSTEMS. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR HIRING LICENSED PROFESSIONALS AS REQUIRED TO DESIGN AND BUILD THE SYSTEM AS WELL AS PROVIDE SERVICES TO INCLUDE THE PREPARATION OF DRAWINGS AS REQUIRED FOR PERMIT AND PLAN REVIEW BY CALIFORNIA STATE FIRE MARSHAL HAVING JURISDICTION OVER THE PROJECT. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR SUBMITTING THE DRAWINGS AUTHORITIES' HAVING JURISDICTION OVER THE PROJECT FOR REVIEW AND APPROVAL. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THE DESIGN AND SUBMITTAL DOCUMENTS HAVE BEEN APPROVED BY THE OFFICE OF THE STATE FIRE MARSHAL.
- FIRE SUPPRESSION SPRINKLER AND STANDPIPE SYSTEM CALCULATIONS, SHOP DRAWINGS AND PRODUCT DATA
- FIRE ALARM SYSTEM CALCULATIONS, SHOP DRAWINGS AND PRODUCT DATA

Approval for elements of the design listed below is deferred under the provisions of CBC 107.3.4.2: (Do not fabricate or install any of the listed items until approval from jurisdiction(s) having authority is obtained.)	Subcontractor: Specialty engineer must stamp and wet-sign drawings and supporting calculations.	General Contractor: Affix shop drawing stamp indicating coordination between the deferred submittal and approved drawings is complete.	Architect and/or Engineer of Record: Affix shop drawing stamp indicating submittal has been reviewed and found to be in general conformance to the design.	State Fire Marshal (fire life safety)	Corrections Standards Authority	Division of the State Architect (access compliance)	AOC Consulting Plan Review Firm (structural, MEP)	Cal OSHA	(For use by Inspector only.) Review process complete
Fire alarm system	x			x					
Fire sprinklers	x			x					
Equipment anchorage							x		
Storefront and curtain wall assemblies							x		
Detention wall and ceiling assemblies					x		x		
Prefabricated Roof Trusses	x		x				x		

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

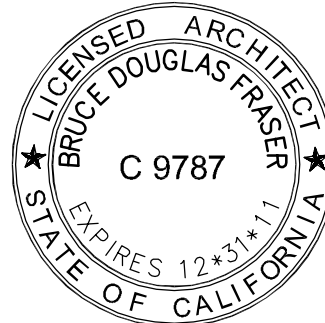

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.



Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

















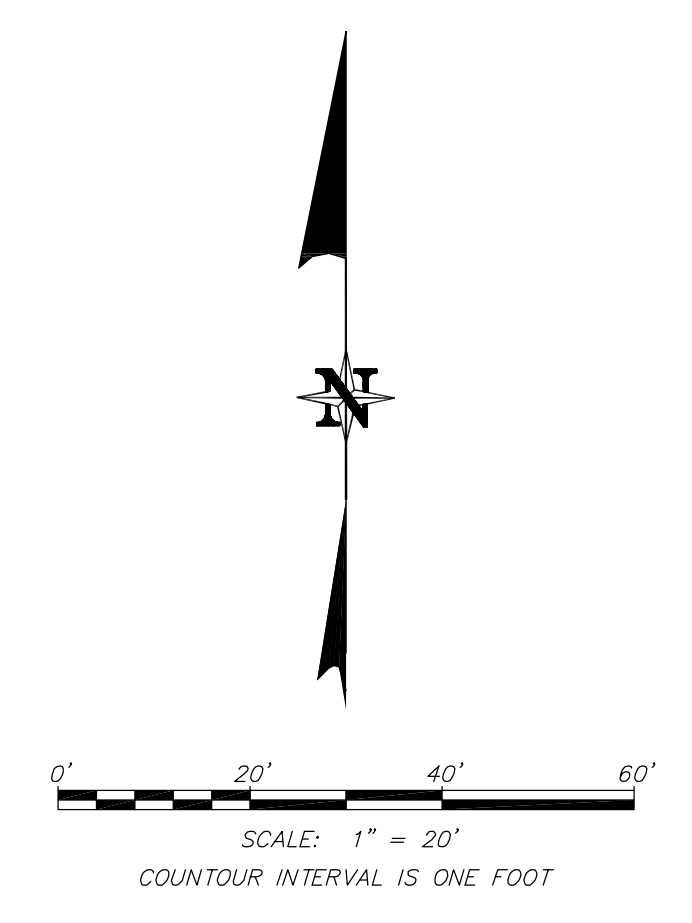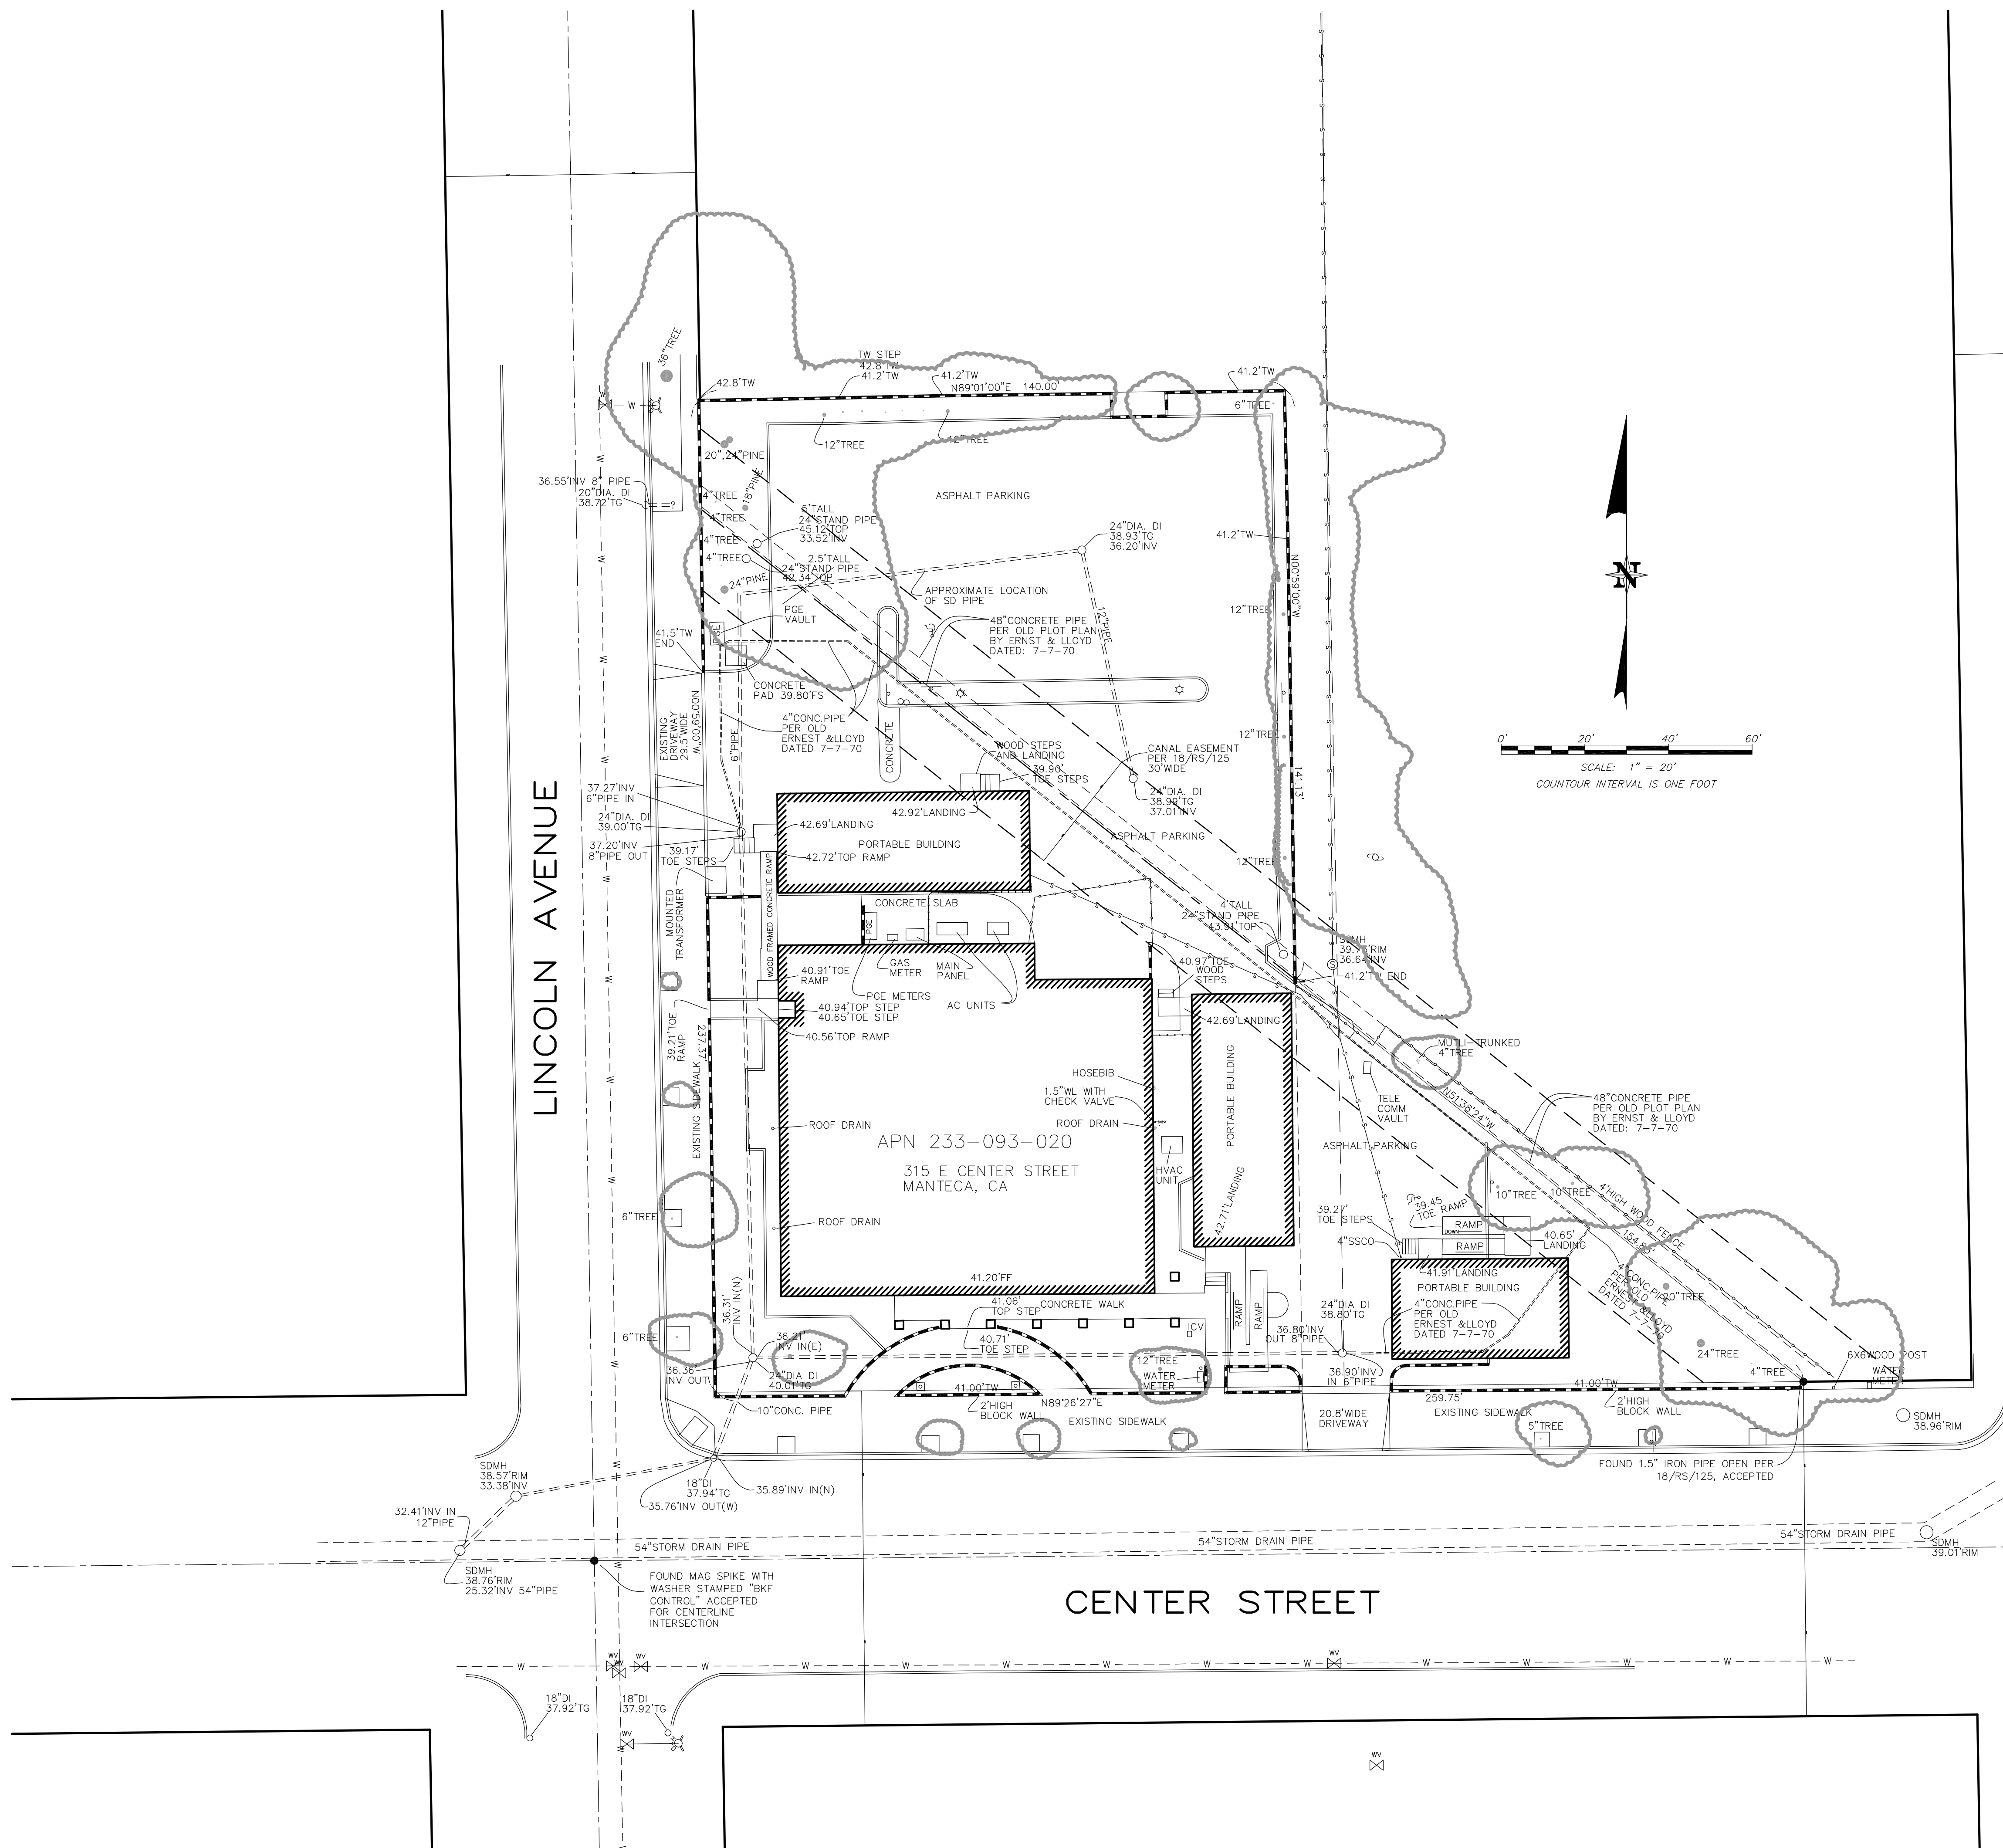

























**GENERAL NOTES,
SYMBOLS AND
ABBREVIATIONS**

SHEET #

T.1



SYMBOL LEGEND:

<p>— X — FENCE LINE</p> <p>— SS — SEWER MAIN</p> <p>— W — WATER MAIN</p> <p>— G — GAS MAIN</p> <p>— EHE — ELEC. TELEPHONE/CABLE OVERHEAD ELECTRIC</p> <p>— — — EDGE OF PAVEMENT</p> <p> DROP INLET AT CURB</p> <p> DRAIN INLET</p> <p> STORM DRAIN MANHOLE</p> <p> FIRE HYDRANT</p> <p> WATER WELL</p> <p> WATER VALVE</p> <p> WATER METER</p> <p> SEWER MANHOLE</p> <p>OCO SEWER CLEANOUT</p>	<div style="text-align: center; margin-bottom: 10px;">  </div> <p style="text-align: center;"><i>RETAINING WALL</i></p> <table border="0" style="width: 100%;"> <tr> <td style="width: 30%; text-align: center;"></td> <td>P&GE BOX</td> </tr> <tr> <td style="text-align: center;"></td> <td>GAS METER</td> </tr> <tr> <td style="text-align: center;"></td> <td>TELEPHONE BOX</td> </tr> <tr> <td style="text-align: center;"></td> <td>SIGNAL BOX</td> </tr> <tr> <td style="text-align: center;"></td> <td>CABLE T.V. BOX</td> </tr> <tr> <td style="text-align: center;"></td> <td>ELECTRIC BOX</td> </tr> <tr> <td style="text-align: center;"></td> <td>TELEPHONE MANHOLE</td> </tr> <tr> <td style="text-align: center;"></td> <td>STREET LIGHT</td> </tr> <tr> <td style="text-align: center;"></td> <td>JOINT POLE</td> </tr> <tr> <td style="text-align: center;"></td> <td>WATER POLE</td> </tr> <tr> <td style="text-align: center;"></td> <td>GUY WIRE</td> </tr> </table>		P&GE BOX		GAS METER		TELEPHONE BOX		SIGNAL BOX		CABLE T.V. BOX		ELECTRIC BOX		TELEPHONE MANHOLE		STREET LIGHT		JOINT POLE		WATER POLE		GUY WIRE
	P&GE BOX																						
	GAS METER																						
	TELEPHONE BOX																						
	SIGNAL BOX																						
	CABLE T.V. BOX																						
	ELECTRIC BOX																						
	TELEPHONE MANHOLE																						
	STREET LIGHT																						
	JOINT POLE																						
	WATER POLE																						
	GUY WIRE																						

ABBREVIATIONS			
AC	ASPH-AGT CONCRETE	IP	IFON PIPE
AP	ARG. POINT	GP	GRADE PPEAK
EM	EMERG. MARK	GM	GAZ METER
EDG	EDGE LINDG	HP	HIGH POINT
FCW	FLOW RATE OF W/A	T	TOE
CR	CATCH BASIN	MP	MARK-ONE
CF	CURFACE	SP	SPREAD POLE
CO	CORNER CUT	PC	PERMANENT PIPE
CO	CORNER	PP	PEEP
CO	CORNER	PCP	PREPARED CONCRETE PIPE
CONC	CONCRETE	P-C	CARCON, PAVES
CHP	CHOP-GATED META. PIPE	SC	STEEL CORNER
CH	CONCRETE MANHOLE INT.	SP	SPREAD POLE
COV	COVER OF STREET	SS	SEWER
DI	DIAMETER	STP	STREET
EG	EXISTING GRADE	STP	STAIRS
EP	EDGE OF PAVEMENT	TOP	TOP OF SLOPE
FO	FOUND	TOE	TOE OF SLOPE
FOW	FLOW RATE	TW	TWO
F	FINISH FLOW	W	WATER
FCW	FLOW RATE OF W/A	WM	WATER
MS	MUSE COF	WM	WATER METER
GF	GRASS	WN	WATER WARE
GM	GAZ METER		
IP	IFON PIPE	DI+GSP	TOP OF GRATE + W/O FLOW IN

SURVEYOR'S STATEMENT:

THIS MAP REPRESENTS A FIELD SURVEY OF
SURFACE FEATURES AND ELEVATIONS
PERFORMED ON JANUARY 10TH AND 11TH
OF 2003.

2-9-2011

NICHOLAS D. PASQUINI, PLS 7618 DATE _____

SURVEYOR'S NOTES _____

1. NO TITLE SEARCH (TITLE REPORT) WAS PROVIDED TO THE SUPERVISOR. EASEMENTS WHICH MAY AFFECT THE SUBJECT PROPERTY HAVE NOT BEEN PLOTTED.

2. ONLY THE SURFACE EVIDENCE OF UNDERGROUND UTILITIES HAVE BEEN MEASURED IN THE FIELD ON THIS SURVEY. IF APPROPRIATE, UNDERGROUND ALIGNMENTS ARE SO OWN, I HAVE NO WARRANTIES AS TO THE ACTUAL LOCATION, TYPE OR DEPTH OF THESE UNDERGROUND UTILITIES. CALIFORNIA UNDERGROUND SERVICE, A EST. 1941 AT 142-2444 TO VERIFY ACTUAL LOCATION OF ANY UTILITIES PRIOR TO ANY EXCAVATION. THIS SERVICE ALSO HAS MADE NO INVESTIGATION AS TO SURFACE ENVIRONMENTAL CONDITIONS THAT WOULD AFFECT THE USE OR DEVELOPMENT OF THIS PROPERTY.

3. IT WILL BE THE ARCHITECT'S RESPONSIBILITY TO VERIFY SETBACK AND HEIGHT RESTRICTIONS WITH THE LOCAL GOVERNING AGENCY.

4. THE SIGNED AND SEALED ORIGINAL DRAWING OF THIS MAP CONSTITUTES THE FINAL WORK PRODUCT. MRS. AND SURVEYS WILL NOT BE LIABLE FOR ELECTRONIC VERSIONS OF THIS MAP PROVIDED TO OTHER PARTIES.

5. THE BOUNDARY LINES SHOWN HEREON WERE COMPILED FROM RECORD INFORMATION, I.E. RECORDED MAPS OF DEEDS AND ARE NOT INTENDED TO REPRESENT THE TRUE OR ACTUAL BOUNDARY LINES OF THE PLOT OF LAND. IT IS ESTIMATED THAT ACTUAL BOUNDARY LINES OF THE PLOT WILL BE FOUND TO BE CLOSE TO THOSE SHOWN. THE SETTING OF PROPERTY MONUMENTS AND THE PLACING OF A CORNER RECORD OF RECORD SHOWN IN CONFORMANCE WITH STATE LAW, ACT 1972, AS AMENDED, WILL BE THE RESPONSIBILITY OF THE BOUNDARY SURVEYOR TO BE EMPLOYED TO LOCATE AND SET THE CORNER RECORDS. MONUMENTS, MARKS, OR SETTING OF CORNER RECORDS, SHALL BE DEEMED AS LOCATING THE FINISHED WORK. CORNER WHICH IS PLOTTED AT THE SCALE INDICATED, HOWEVER, DIMENSIONAL TIES FROM A CORNER TO A PLANNED OR EXISTING BOUNDARY LINE SHALL BE USED AS LOCATIONS AND CANNOT BE USED, FOR PURPOSES OF DETERMINING BOUNDARY SETBACKS OR THE PLACEMENT OF ANY PROPOSED NEW CONSTRUCTION. THE LOCATION OF NEW CONSTRUCTION CAN ONLY BE PLANNED OR DETERMINED BY THE USE OF A PLANNED OR EXISTING BOUNDARY LINES OF THE PLOT. OTHERWISE, MODIFICATIONS TO THE SETBACK MAY BE NECESSARY DURING CONSTRUCTION TO COMPLY WITH AGENCY SETBACK REQUIREMENTS.

BENCH MARK:
LOS BENCH MARK DESIGNATION = 083
PID = #30209
BEING AN REASSAY DISK STAMPED TO BE "300 38.474" SET IN
BUILDING STEPS OF THE REGION HALL ON YOSEMITE AVENUE, LOCATED
0.3 MILE EAST OF THE CROSSING OF THE SOUTH-FORK PACIFIC
RAILROAD WITH YOSEMITE AVENUE.
ELEVATION = 40.38 MARS

BASIS OF BEARINGS

THE BASIS OF BEARINGS FOR THE PROJECT IS BASED ON FOUND MONUMENTS ALONG THE CENTERLINE OF LINCOLN AVENUE.
BEARING N 00° 53' 00" W REF 3/MAPS/25.

SITE DATA:

ASSESSOR'S PARCEL NO. APN 233-043-020

TOPOGRAPHIC MAP

OF A PORTION OF BLOCK 3 OF OF THE MAP OF THE PARK ADDITION
TO THE TOWN OF MANTECA CALIF. AS SHOWN ON MAP FILED IN BOOK 5
OF MAPS AT PAGE 25, IN THE CITY OF MANTECA, COUNTY OF SAN
JOAQUIN, CALIFORNIA

AT THE REQUEST OF ROB CARNES

FEBRUARY 9 2011 SCALE: 1"=20'


MBS
LAND SURVEYS

MICHAEL B. STANTON, PLS 5702
2146 PARKER STREET, SUITE A-1
SAN LAUIS OBISPO, CA 93401
805-594-1960

JOB No. 10-139


T.2

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\T.3 - Phase I and Phase II Composite Reference Site Plan.dwg, 5/3/2011 8:37:13 AM, PDF995

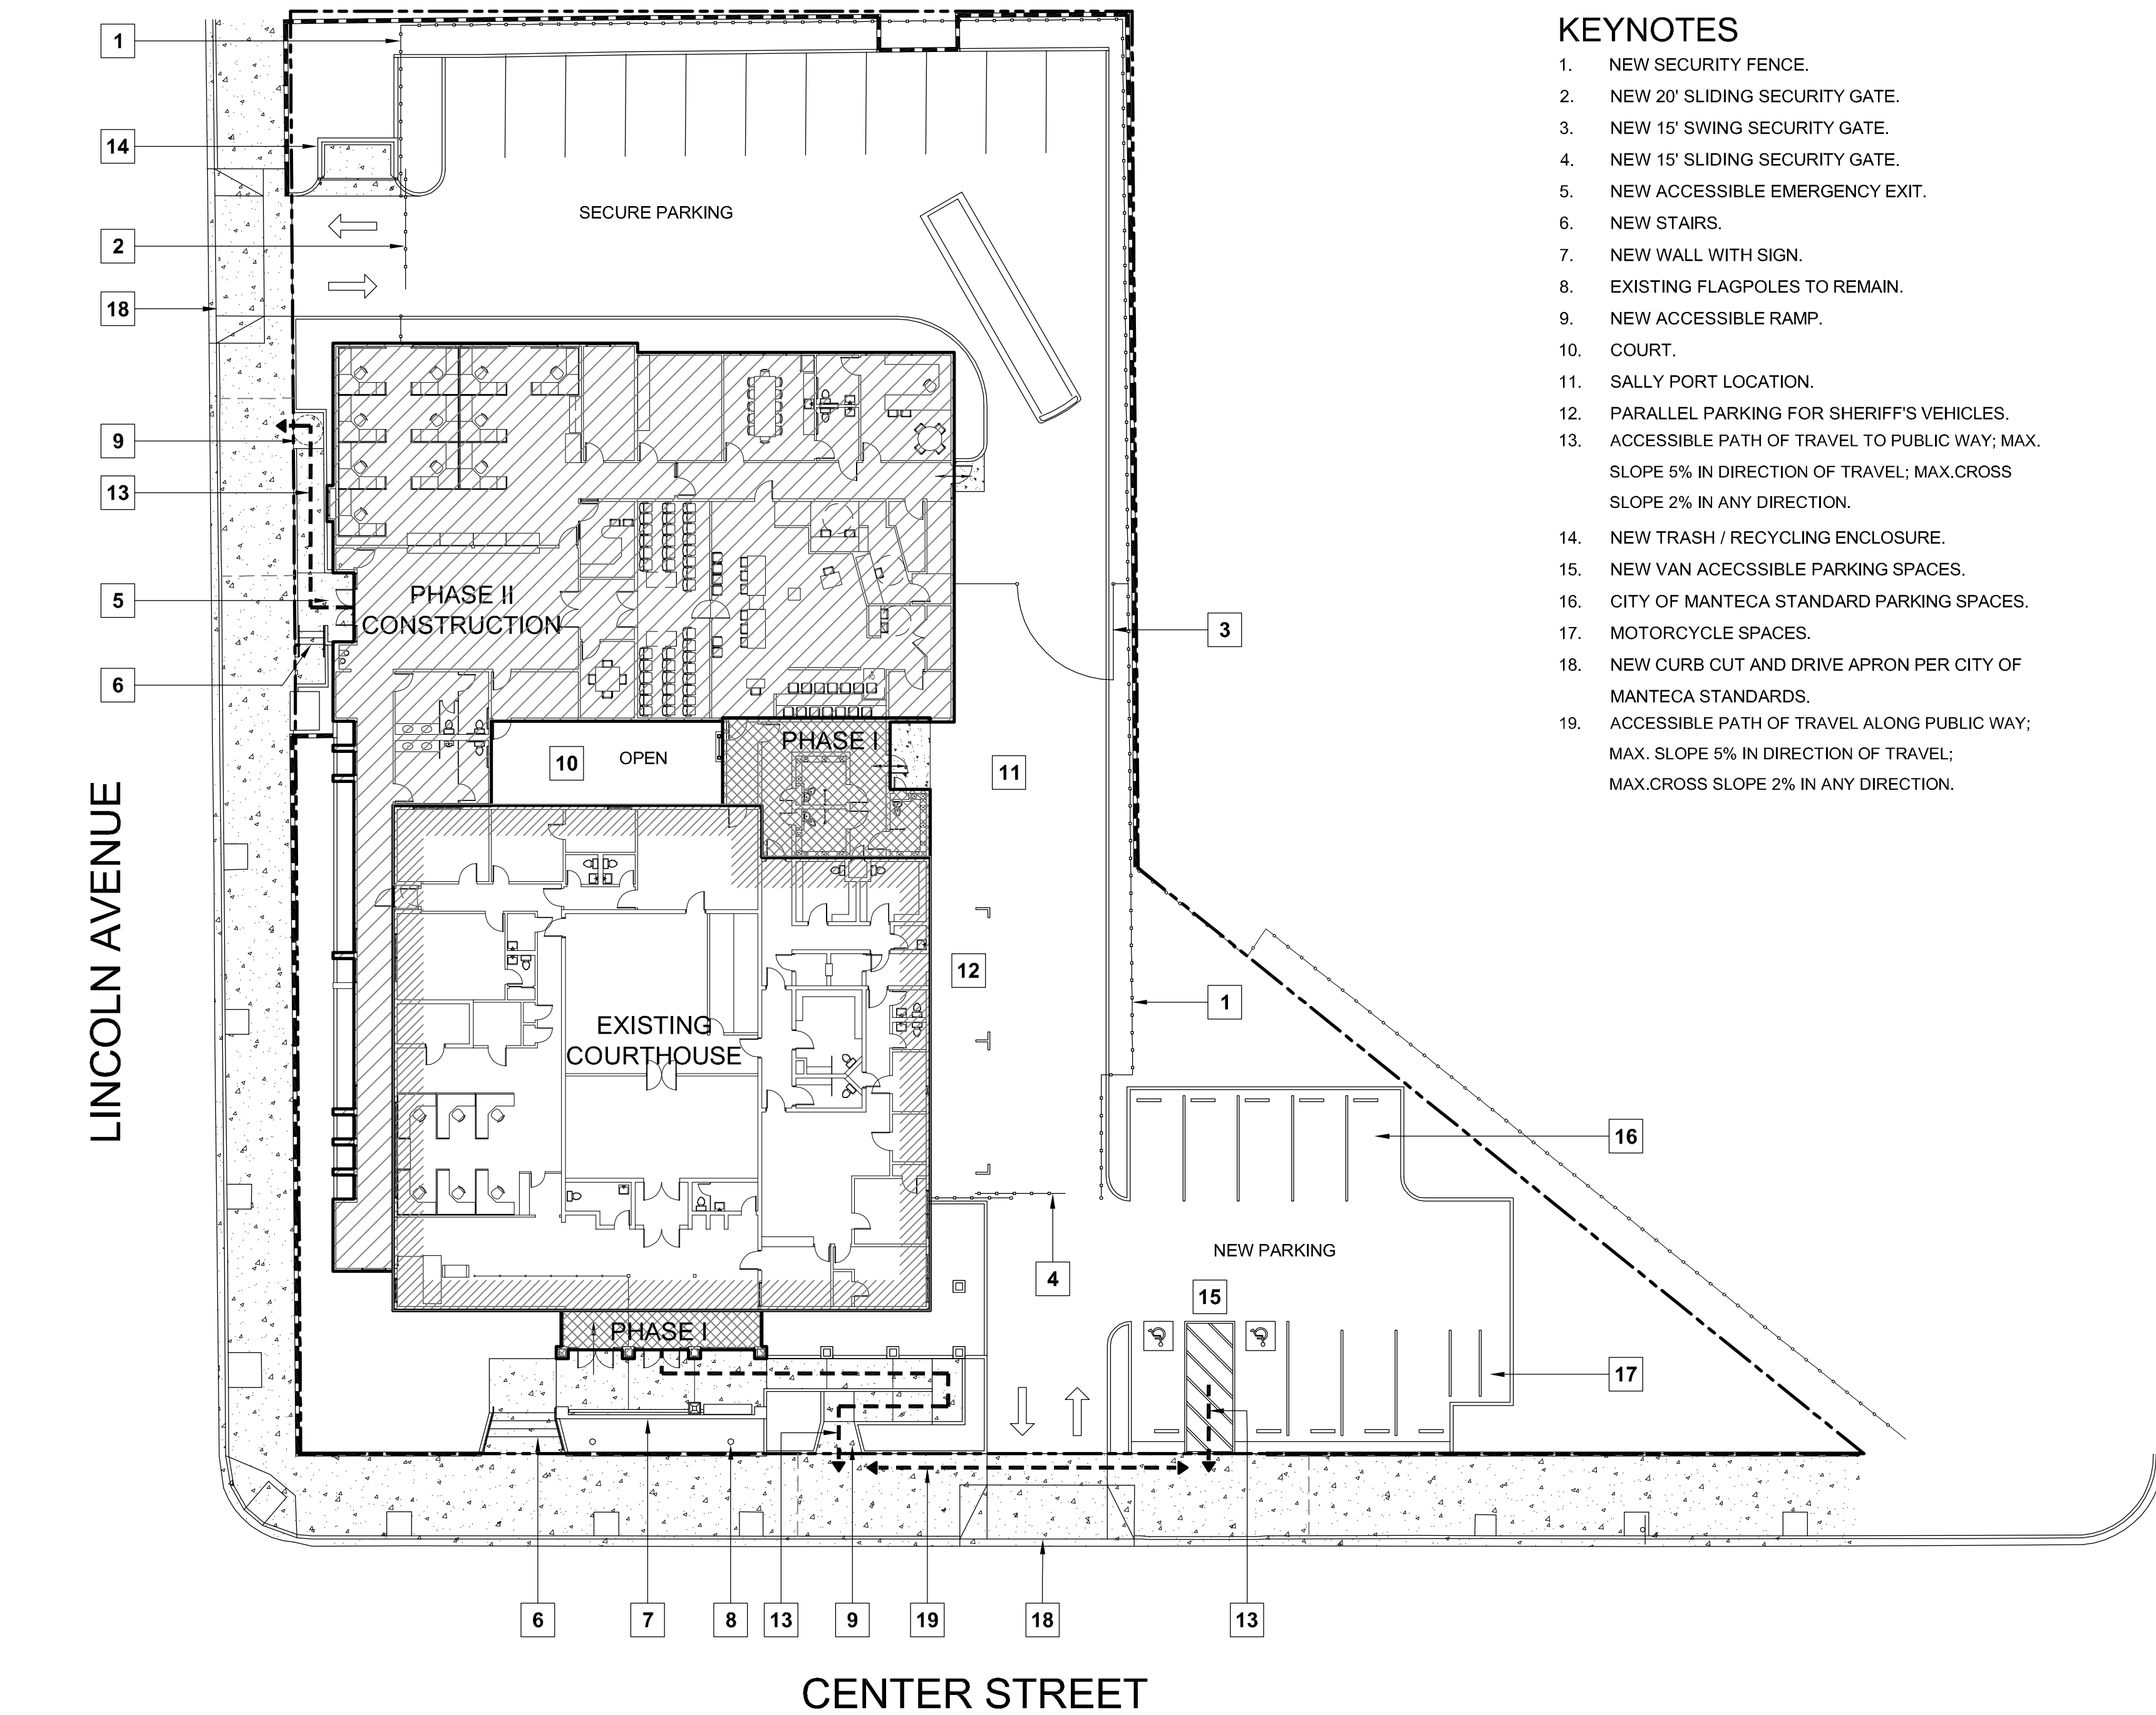

KEYNOTES

1. NEW SECURITY FENCE.
2. NEW 20' SLIDING SECURITY GATE.
3. NEW 15' SWING SECURITY GATE.
4. NEW 15' SLIDING SECURITY GATE.
5. NEW ACCESSIBLE EMERGENCY EXIT.
6. NEW STAIRS.
7. NEW WALL WITH SIGN.
8. EXISTING FLAGPOLES TO REMAIN.
9. NEW ACCESSIBLE RAMP.
10. COURT.
11. SALLY PORT LOCATION.
12. PARALLEL PARKING FOR SHERIFF'S VEHICLES.
13. ACCESSIBLE PATH OF TRAVEL TO PUBLIC WAY; MAX. SLOPE 5% IN DIRECTION OF TRAVEL; MAX. CROSS SLOPE 2% IN ANY DIRECTION.
14. NEW TRASH / RECYCLING ENCLOSURE.
15. NEW VAN ACESSIBLE PARKING SPACES.
16. CITY OF MANTECA STANDARD PARKING SPACES.
17. MOTORCYCLE SPACES.
18. NEW CURB CUT AND DRIVE APRON PER CITY OF MANTECA STANDARDS.
19. ACCESSIBLE PATH OF TRAVEL ALONG PUBLIC WAY; MAX. SLOPE 5% IN DIRECTION OF TRAVEL; MAX. CROSS SLOPE 2% IN ANY DIRECTION.



PHASE I & PHASE II COMPOSITE REFERENCE SITE PLAN

SCALE: 1" = 20'

PHASE II IS NOT A PART OF THIS APPROVAL
AND IS SHOWN FOR REFERENCE ONLY

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

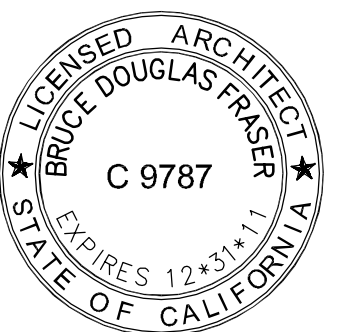

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I & PHASE II
COMPOSITE
REFERENCE SITE
PLAN**

SHEET #

T.3


\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\T-4 - Phase I and Phase II Composite Reference Floor Plan.dwg, 6/15/2011 5:09:33 PM, PDF995

FIXTURE KEYNOTES

1. TOILET PAPER HOLDER
2. ADA COMPLIANT TOILET
4. WALL MOUNTED LIGHT FIXTURE
5. MIRROR
6. GRAB BAR(S), PROVIDE BLOCKING
7. OPEN BELOW FOR ACCESS
8. MEDICINE CABINET
9. NOT USED.
10. PIPE PROTECTION
11. ADA COMPLIANT FAUCET

ACCESSORIES GENERAL NOTES


1. MINIMUM 30"x 48" CLEAR FLOOR OR GROUND SPACE IS PROVIDED TO ALLOW FORWARD OR PARALLEL APPROACH TO ACCESSORIES.
2. ONE FULL UNOBSTRUCTED SIDE OF THE CLEAR OR GROUND SPACE ADJOINS OR OVERLAPS AN ACCESSIBLE ROUTE OR ADJOINS ANOTHER WHEELCHAIR CLEAR FLOOR SPACE.
3. MIRROR(S) MOUNTED WITH THE BOTTOM EDGE NO HIGHER THAN 40" ABOVE FLOOR.
4. OPERABLE PARTS (INCLUDING COIN SLOTS) OF ALL FIXTURES OR ACCESSORIES ARE LOCATED A MAXIMUM OF 40" ABOVE FLOOR: SOAP DISPENSERS, TOWELS, TOILET SEAT COVERS, AUTO DRYERS, SANITARY NAPKIN DISPENSERS, WASTE RECEPTACLES . CONTROLS AND OPERATING MECHANISMS ARE OPERABLE WITH ONE HAND AND DO NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST.
6. THE FORCE REQUIRED TO ACTIVATE CONTROLS IS 5 LBF, MAXIMUM.
7. COAT HOOKS AND SHELVING ARE LOCATED WITHIN APPROPRIATE REACH RANGES 48" MAX. ABOVE FLOOR .
8. IF MEDICINE CABINETS ARE PROVIDED, AT LEAST ONE SHALL HAVE A USABLE SHELF NO HIGHER THAN 44" ABOVE FLOOR.

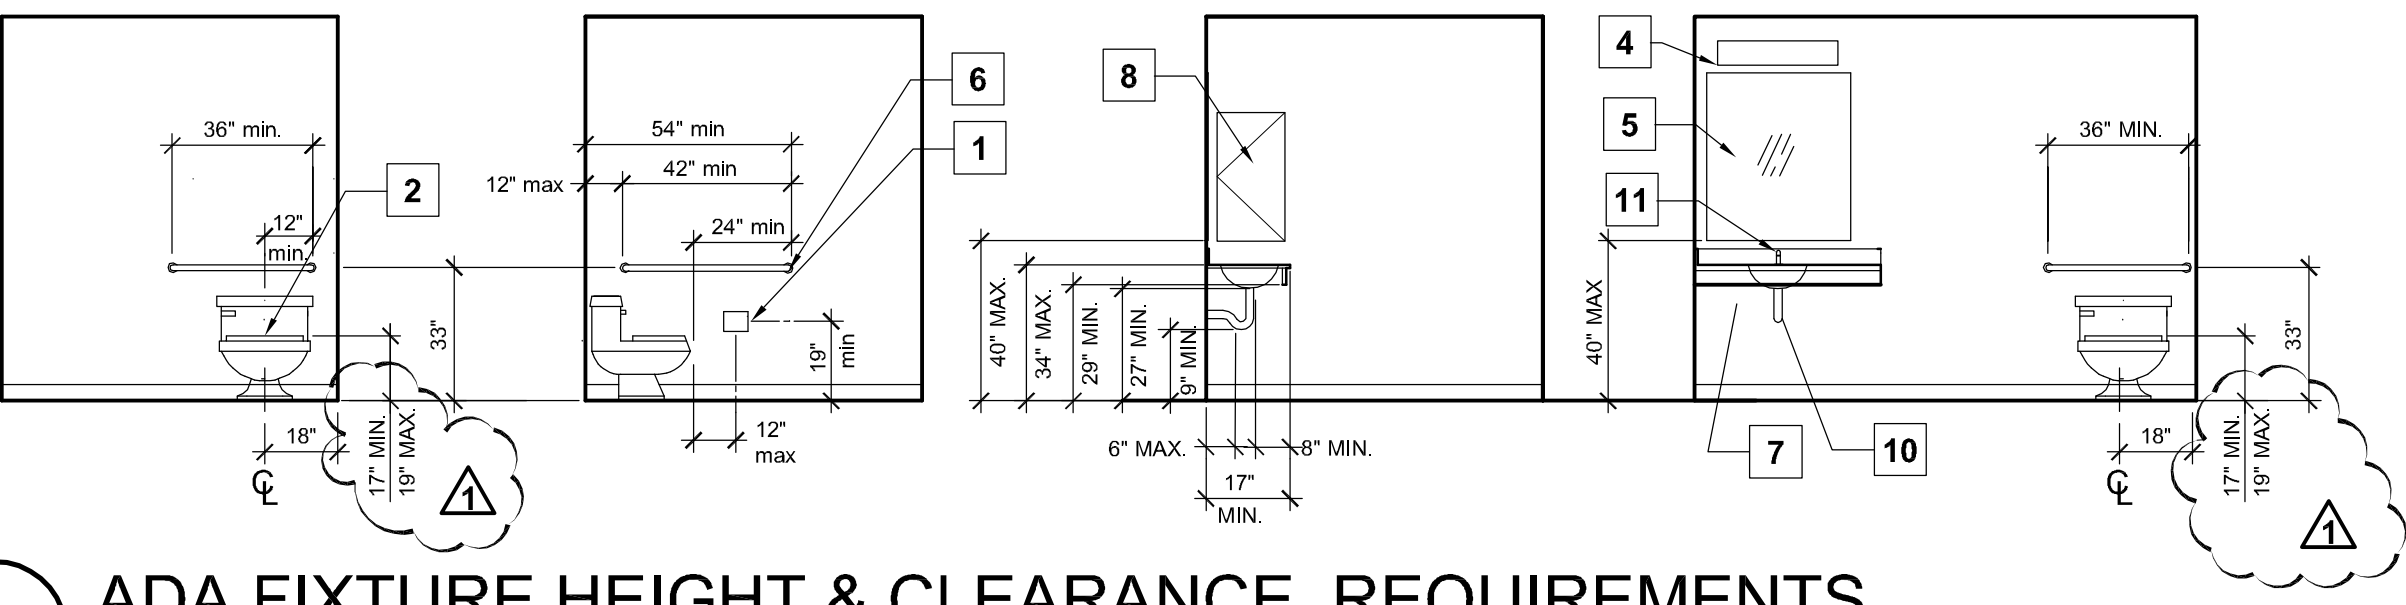

54


ADA FIXTURE HEIGHT & CLEARANCE REQUIREMENTS

1/4"= 1'-0"



PHASE I & PHASE II COMPOSITE REFERENCE FLOOR PLAN

SCALE: 1/8" = 1'-0"

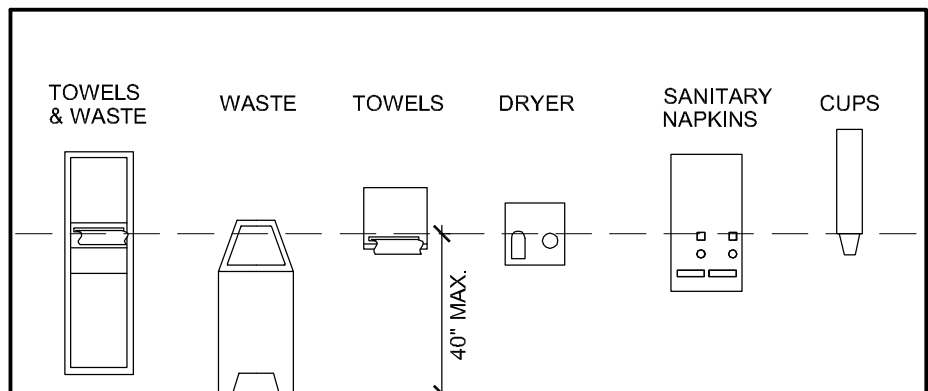

PLUMBING FIXTURE COUNTS			
PLUMBING FIXTURES (NEW HOLDING CELLS)			
2010 CPC TABLE 4-1			
WATER CLOSETS:	FACTOR	REQUIRED	AS DESIGNED
1 PER CELL	7	7	7
LAVATORIES:	1 PER CELL	7	7
SHOWERS:	NONE	NONE	NONE
URINALS:	NONE	NONE	NONE
PLUMBING FIXTURES (EXISTING ASSEMBLY FOR PUBLIC USE)			
AS DESIGNED			
MENS WATER CLOSETS:	1-100	1	1
MENS URINALS:	1-100	1	0
MENS LAVATORIES:	1-100	1	1
WOMENS WATER CLOSETS:	3 FOR 1-100	3	1+2 SHARED = 3
WOMENS LAVATORIES:	1-100	1	1
PLUMBING FIXTURES (EXISTING OFFICE FOR EMPLOYEE USE)			
AS DESIGNED			
MENS WATER CLOSETS:	16-35	2	2
MENS URINALS:	10-50	1	0
MENS LAVATORIES:	1 PER 40	1	2
WOMENS WATER CLOSETS:	16-35	3	2+1 SHARED = 3
WOMENS LAVATORIES:	1-100	1	2
PLUMBING FIXTURES (EXISTING JUDGE'S CHAMBERS)			
REQUIRED AS DESIGNED			
WATER CLOSETS:		1	1
LAVATORIES:		1	1
NOTE: ABOVE CALCULATIONS DEMONSTRATE THAT THE HOLDING CELL ADDITION COMPLIES WITH THE MINIMUM REQUIRED PLUMBING FIXTURE COUNT. ALTHOUGH THE EXISTING BUILDING DOES NOT COMPLY WITH CURRENT PLUMBING FIXTURE COUNT STANDARDS, SUBSTANTIAL COMPLIANCE HAS BEEN DEMONSTRATED ALLOWING FOR SHARED PUBLIC / EMPLOYEE USE OF THE FACILITIES LOCATED WITHIN THE B OCCUPANCY PORTION OF THE BUILDING.			

LEGEND

- EXISTING WALL TO REMAIN AND PROTECT
- NEW WALL - PHASE 1
- NEW WALL - PHASE 2
- EXISTING - FLOOR AREA
TOTAL = 7,189 s.f.
- PHASE 1 - ADDITIONAL FLOOR AREA
LOBBY = 218 s.f.
HOLDING CELLS = 684 s.f.
TOTAL = 882 s.f.
- PHASE 1 - EXISTING TO BE REMODELED
TOTAL = 989 s.f.
- PHASE 2 - ADDITIONAL FLOOR AREA
TOTAL = 7,253 s.f.
- COMBINED OVERALL FLOOR AREA
EXISTING = 7,189 s.f.
PHASE 1 = 882 s.f.
PHASE 2 = 7,253 s.f.
TOTAL = 15,324 s.f.

PHASE II IS NOT A PART OF THIS APPROVAL
AND IS SHOWN FOR REFERENCE ONLY

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com


PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

06/20/11

SIGNED

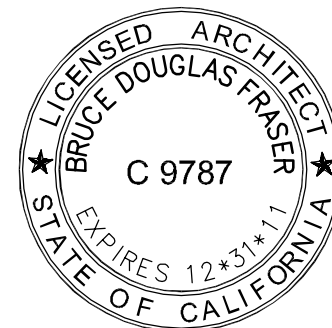

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I & PHASE II
COMPOSITE
REFERENCE
FLOOR PLAN**


SHEET #

T.4

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\T-5 - Phase I and Phase II Composite Reference Code Compliance, Abb. Symbols.dwg, 6/15/2011 1:44:08 PM, PDF995

PROJECT DATA					
ASSESSOR'S PARCEL NUMBER	223-093-020				
ADDRESS	315 EAST CENTER STREET, MANTECA, CA 95336				
LEGAL DESCRIPTION	PORTION OF BLOCK 3 OF THE MAP OF THE PARK ADDITION TO THE TOWN OF MANTECA, CA, AS SHOWN ON MAP FILED IN BOOK 9 OF MAPS AT PAGE 25, IN THE CITY OF MANTECA, COUNTY OF SAN JOAQUIN, CA.				
SITE AREA	39,435 s.f. = .91 Acres				
BUILDING AREA	EXISTING (CONSTRUCTED IN 1970)	7,188 s.f.			
	ADDITIONS	882 s.f.			
	COMBINED TOTAL:	8,070 s.f.			
AREA OF REMODELING IN EXISTING BUILDING:		989 s.f.			
USE AND OCCUPANCY CLASSIFICATION (CHAPTER 3)					
BUILDING COMPONENT	OCCUPANCY CLASSIFICATION (SECTION 304)	OCCUPANT LOAD (TABLE 1004.1.1)			
(E) OFFICE + STORAGE / MECH.	8 - BUSINESS	(4,278 / 100) + (381 / 300) =	45		
(E) COURTROOM + FIXED SEATING	A-3 - ASSEMBLY	(865 / 44) + 84 SEATS =	106		
(E) HOLDING CELLS	I-3 - HOLDING	68 FT. OF BENCH / 1.5 =	45		
(E) TOTAL OCCUPANT LOAD			196		
(N) LOBBY ADDITION	8 - BUSINESS	219 / 100 =	3		
(N) HOLDING CELL ADDITION	I-3 - HOLDING	37 FT. OF BENCH / 1.5 =	25		
(N) ADDITION OCCUPANT LOAD			28		
COMBINED TOTAL OCCUPANT LOAD			224		
CONSTRUCTION TYPE (TABLE 601)					
CONSTRUCTION TYPE	FIRE RATING	FIRE SPRINKLERS (CHAPTER 9)			
TYPE VA NON-RATED	NON-RATED	YES			
BUILDING LIMITS					
BUILDING HEIGHT	ALLOWED:	STORIES	HT	AS DESIGNED:	STORIES
(TABLE 503 - TYPE VA WITH SEC. 504.2 - SPRINKLER SYSTEM INCREASE)					
GROUP B	3+1 = 4	60'x20'-0"	1	15'-10"	
GROUP A-3 - MOST RESTRICTIVE	2+1 = 3	40'x20'-0"	1	15'-10"	
GROUP I-3 - PER 408.1.1	1	20'-0"	1	19'-6"	
BUILDING AREA	ALLOWED:	AREA (s.f.)	AS DESIGNED:	AREA (s.f.)	
(TABLE 503 - TYPE VA WITH SEC. 506.3 - SPRINKLER SYSTEM INCREASE)					
GROUP B		18,000 + (18,000x300%) = 72,000 s.f.	5,065		
GROUP A-3 - MOST RESTRICTIVE		11,500 + (11,500x300%) = 46,000 s.f.	1,408		
GROUP I-3		5,200 s.f. MAX. w/ 2 HR FIRE SEPARATION	1,597		
TOTAL BUILDING AREA		46,000 x 3 = 138,000 s.f. >	8,070 OKAY		
EGRESS					
EGRESS WIDTH CALCULATIONS	INCHES/PERSON	OCCUPANTS SERVED	MIN. WIDTH (INCHES)	WIDTH PROVIDED (IN)	
WORST CASE	0.15	224	33.6	44 MIN	
MINIMUM NUMBER OF EXITS	PERSONS PER STORY	MINIMUM REQUIRED EXITS	EXITS PROVIDED		
(TABLE 1019.1)					
GROUP B	1-500	2	3		
GROUP A-3	1-500	2	2		
GROUP I-3	1-500	2	2		

FIRE PROTECTION			
	PROVIDED	TYPE	
FIRE SPRINKLERS?	YES	NFPA 13	
FIRE ALARM?	YES	AUTOMATIC	
SMOKE CONTROL SYSTEM?	YES	AUTOMATIC SHUTOFF	
HIGH FIRE HAZARD SEVERITY ZONE?	NO		
OCCUPANCY SEPARATION (TABLE 508.3.3)		SEPARATION REQUIRED	
B / A-3		1 HOUR	
B / I-3		2 HOUR	
I-3 / A-3		2 HOUR	
NOTE: RATED CORRIDORS IN A-3 AND B OCCUPANCY NOT REQUIRED WITH SPRINKLER SYSTEM PER TABLE 1018.1			
FIRE RESISTANCE REQUIREMENTS		REQUIRED RATING WITH SPRINKLER SYSTEM	
STRUCTURAL FRAME	0	TABLE 601	
BEARING WALLS - EXTERIOR	1	TABLE 601	
BEARING WALLS - INTERIOR	0	TABLE 601	
NONBEARING INTERIOR WALLS	0	TABLE 601	
FLOOR CONSTRUCTION	0	TABLE 601	
ROOF CONSTRUCTION	0	TABLE 601	
DRAFTSTOPPING IN ATTICS (SECTION 717.4)			
DRAFTSTOPPING SHALL BE INSTALLED IN ATTICS AND CONCEALED ROOF SPACES, SUCH THAT ANY HORIZONTAL AREA DOES NOT EXCEED 3,000 SQUARE FEET.			
EXCEPTIONS: IN OTHER THAN HIGH-RISE BUILDINGS, GROUP A, E, H, I AND L OCCUPANCIES AND OTHER APPLICATIONS LISTED IN SECTION 1111, REGULATED BY THE OFFICE OF THE STATE FIRE MARSHAL, DRAFTSTOPPING IS NOT REQUIRED IN BUILDINGS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH SECTION 903.3.1.1			
LOCATION ON PROPERTY	REQUIRED RATING	DISTANCE TO P.L.	OPENINGS
TABLES 902 & 705.8			
NORTH EXTERIOR WALL	NR	> 30'	NR
EAST EXTERIOR WALL	NR	> 30'	NR
SOUTH EXTERIOR WALL	1 HOUR	15' x X < 20'	Unprotected, Sprinklered
WEST EXTERIOR WALL	1 HOUR	15' x X < 20'	Unprotected, Sprinklered

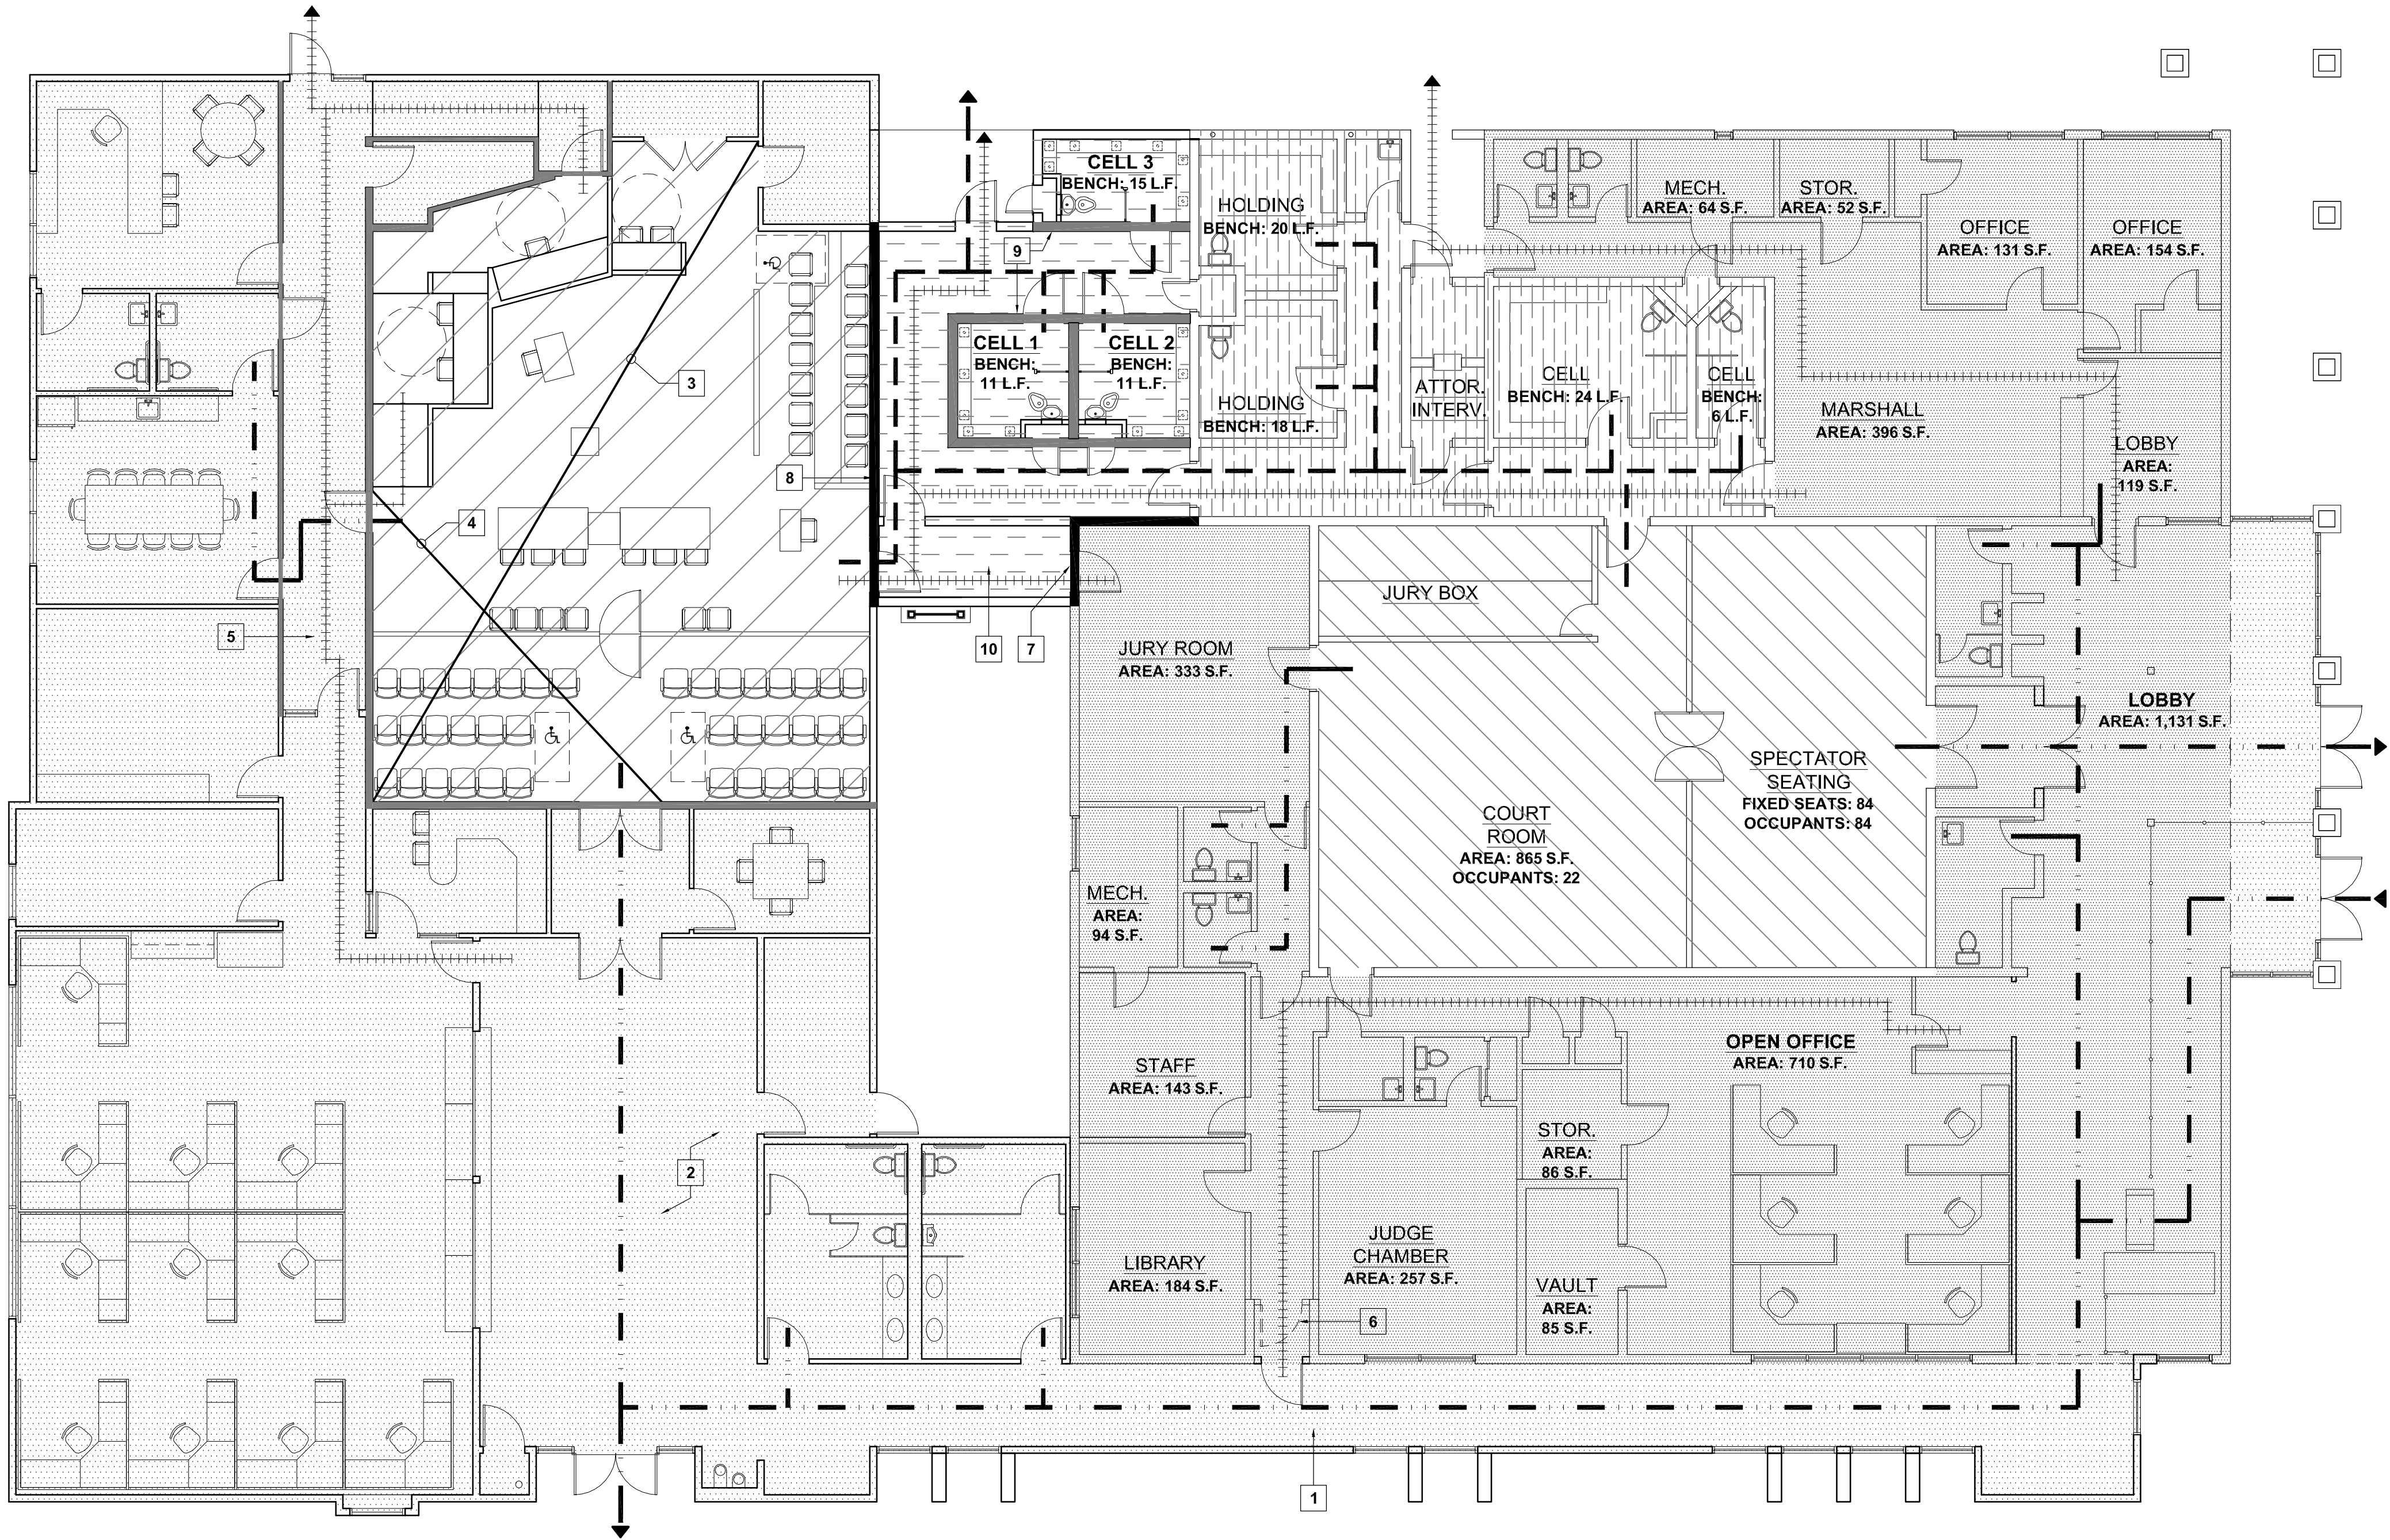

PHASE I & PHASE II CODE ANALYSIS

SCALE: 1/8" = 1'-0"

ACCESSIBILITY NOTES

- THE PATH OF TRAVEL (P.O.T.) AS INDICATED IS A BARRIER FREE ACCESSIBLE ROUTE AT LEAST 48 INCHES WIDE WITHOUT ANY ABRUPT VERTICAL CHANGES EXCEEDING 1/2" AT 1:2 MAXIMUM SLOPE, EXCEPT THAT LEVEL CHANGES DO NOT EXCEED 1/4" VERTICAL. MAXIMUM CROSS-SLOPE 2% TYPICAL AND MAXIMUM SLOPE IN THE DIRECTION OF TRAVEL IS 5% OR LESS, UNLESS OTHERWISE NOTED. P.O.T. SHALL BE MAINTAINED FREE OF OVERHEAD OBSTRUCTIONS TO 80" MINIMUM (CBC 1133B8.2) AND SIDE OBJECTS PROTRUDING GREATER THAN 4" INTO P.O.T. BETWEEN 27 AND 80 INCHES ABOVE THE FINISHED FLOOR (CBC 1133B8.6).
- ALL DOORS ON INDICATED P.O.T.'S SHALL COMPLY WITH APPLICABLE PROVISIONS OF CBC 1133B, INCLUDING:
 - THE UNLATCHING OF ANY EXIT DOOR SHALL NOT REQUIRE MORE THAN ONE OPERATION.
 - ALL EXIT DOORS SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE.
 - ACCESSIBLE DOOR HARDWARE SHALL BE CENTERED BETWEEN 30 AND 44 INCHES ABOVE THE FINISH FLOOR OR LANDING, AND SHALL BE OPERATED WITH SINGLE PUSH-PULL ACTIVATING BARS OR OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE WITHOUT REQUIRING THE ABILITY TO GRASP THE OPENING HARDWARE.
 - INTERIOR AND EXTERIOR THRESHOLDS SHALL MEET THE LEVEL CHANGE LIMITATIONS OF ITEM #1 ABOVE.
 - ON INTERIOR AND EXTERIOR DOORS THAT HAVE CLOSERS THE CLOSER PRESSURE SHALL NOT EXCEED 5 POUNDS.
 - THE BOTTOM 10 INCHES OF ALL ACCESSIBLE DOORS SHALL HAVE A SMOOTH UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST.
 - PROVIDE A LEVEL AND CLEAR LANDING ON BOTH SIDES OF ACCESSIBLE DOORS, A MINIMUM OF 60" DEEP ON THE PULL SIDE AND 48" DEEP ON THE PUSH SIDE, AND EXTENDING A MINIMUM OF 18" BEYOND THE LATCH JAMB ON THE PULL SIDE OF INTERIOR DOORS (24" AT EXTERIOR DOORS), AND A MINIMUM OF 12" BEYOND THE LATCH JAMB ON THE PUSH SIDE, UNLESS THE DOOR IS NOT EQUIPPED WITH A LATCH AND CLOSER.

EGRESS KEYNOTES

- COMMUNICATING HALLWAY, NOT PART OF REQUIRED EGRESS SYSTEM.
- INTERVENING SPACE IN COMPLIANCE WITH CBC 1014.2
- GREATEST DIAGONAL OF COURTROOM: 54'-8"
- SEPARATION OF COURTROOM EXITS: 30'-6" (>54'-8"/2; OK)
- ONE HOUR RATED EXIT CORRIDOR.
- PHASE ONE SECONDARY EXIT.
- EXISTING 2-HOUR RATED FULL HEIGHT CMU WALL.
- NEW 2-HOUR RATED CMU WALL TO EXTEND TO TOP OF PARAPET.
- REQUIRED 1-HOUR CMU WALLS TO EXTEND TO UNDERSIDE OF 6" CONCRETE LID (REQUIRED 2-HOUR HORIZONTAL BARRIER).
- 6" CAST-IN-PLACE CONCRETE LID EXCEEDS REQUIRED 4 1/2" MIN. FOR 2-HOUR HORIZONTAL BARRIER AT RATED PENETRATIONS.
- SEE SHEET A8.4 FOR PARTITION TYPES AND RATED PENETRATION DETAILS.

LEGEND

- | | |
|--|---|
| | EXISTING A-3 OCCUPANCY |
| | EXISTING B OCCUPANCY |
| | EXISTING I-3 OCCUPANCY |
| | NEW A-3 OCCUPANCY |
| | NEW B OCCUPANCY |
| | NEW I-3 OCCUPANCY, EXTENT OF CBC REQUIRED 2-HOUR HORIZONTAL BARRIER |
| | PUBLIC PATH OF TRAVEL (INCLUDING ATTORNEYS AND JURORS) |
| | IN-CUSTODY PATH OF TRAVEL |
| | STAFF / SHERIFF PATH OF TRAVEL |
| | EXTENT OF NEW CBC REQUIRED 2-HOUR VERTICAL BARRIER. |
| | EXTENT OF NEW CBC REQUIRED 1-HOUR VERTICAL BARRIER. |

(PHASE II OCCUPANCY TYPES, FIRE SEPARATIONS AND PATHS OF TRAVEL SHOWN TO ADEQUATELY DESCRIBE LIFE AND SAFETY DESIGN INTENT FOR PHASE I)

PHASE II IS NOT A PART OF THIS APPROVAL AND IS SHOWN FOR REFERENCE ONLY

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com


PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

06/20/11

SIGNED

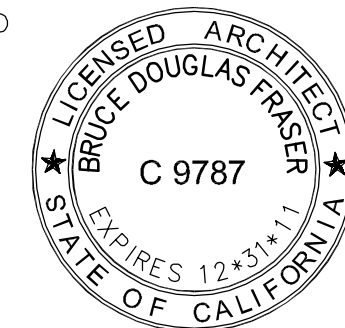

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I & PHASE II
CODE ANALYSIS**

SHEET #

T.5

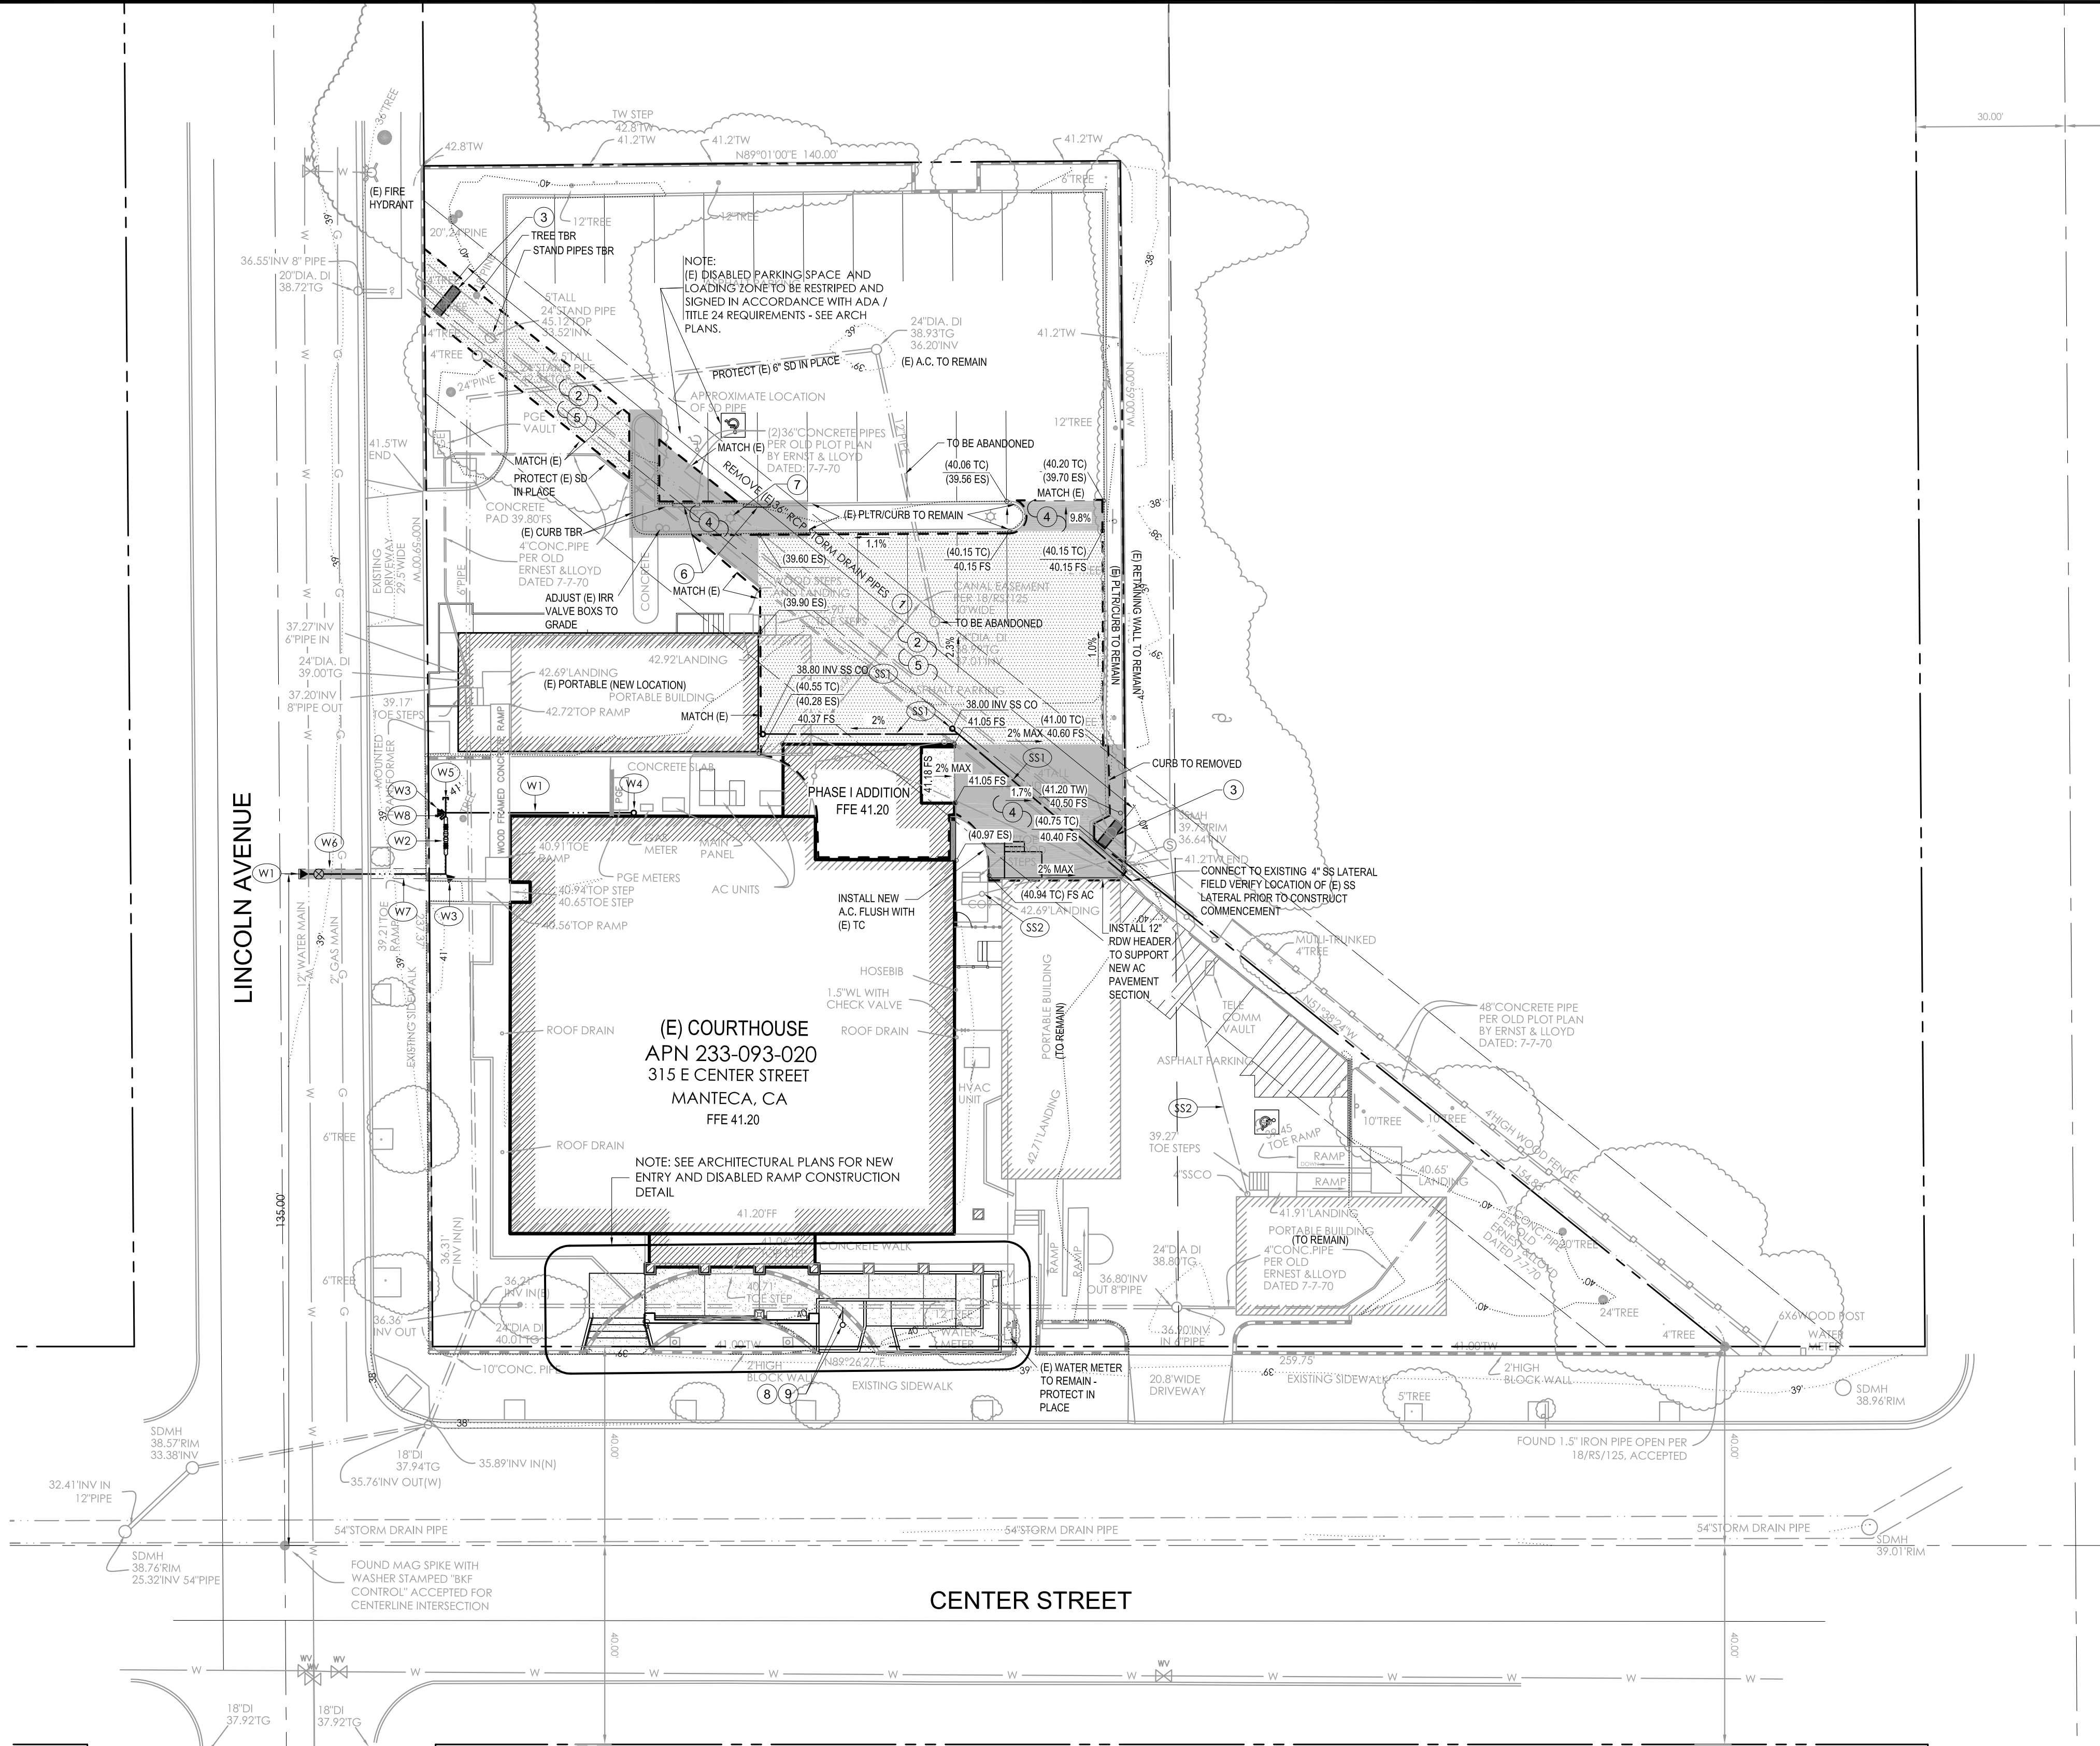

LEGEND:

NEW CLASS II BASE SECTION

NEW AC PAVEMENT SECTION

LIMITS OF AC PAVEMENT REMOVAL

PROPERTY LINE / ROW

ABBREVIATIONS:

AC - ASPHALT CONCRETE
BLDG - BUILDING
CONC - CONCRETE
ES - EXISTING SURFACE
TC - TOP OF CURB
(E) - EXISTING
FFE - FINISHED FLOOR ELEVATION
FG - FINISHED GRADE
FL - FLOWLINE
FS - FINISHED SURFACE
SD - STORM DRAIN
TYP - TYPICAL
TBR - TO BE REMOVED

- GENERAL NOTES:**
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ITEMS SHOWN ON THE PLANS.
 - NO CONSTRUCTION SHALL BE STARTED WITHOUT PLANS APPROVED BY THE CITY. THE CITY SHALL BE NOTIFIED AT LEAST 2 WORKING DAYS PRIOR TO STARTING CONSTRUCTION. ANY CONSTRUCTION DONE WITHOUT APPROVED PLANS OR PRIOR NOTIFICATION TO THE CITY WILL BE REJECTED AND WILL BE DONE AT THE CONTRACTOR'S AND/OR OWNER'S RISK AND EXPENSE.
 - THE CITY INSPECTOR, ACTING ON BEHALF OF THE CITY MAY REQUIRE REVISIONS IN THE PLANS TO SOLVE UNFORESEEN PROBLEMS THAT MAY ARISE IN THE FIELD. ALL REVISIONS SHALL BE SUBJECT TO THE APPROVAL OF THE OWNER'S ENGINEER.
 - THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR PLACEMENT OF SAFETY DEVICES SUCH AS FENCING, BARRICADES, SAFETY TAPE, ETC., AND SHALL FOLLOW ALL APPLICABLE INDUSTRIAL SAFETY REGULATIONS. THE CITY AND ITS OFFICIALS, THE ENGINEER, AND THE OWNER SHALL NOT BE RESPONSIBLE FOR ENFORCING SAFETY REGULATIONS.
 - ANY DEVIATION FROM THESE PLANS WITHOUT PRIOR APPROVAL FROM THE DESIGN ENGINEER SHALL BE AT THE CONTRACTOR'S OWN RISK AND EXPENSE.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE GROUND ELEVATIONS AND OVERALL TOPOGRAPHY OF THE SITE PRIOR TO START OF CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY KEITH V. CROWE, P.E. IMMEDIATELY, AND IN WRITING, OF ANY DIFFERENCES IN TOPOGRAPHY FROM THAT SHOWN ON THIS PLAN, WHICH MAY REQUIRE CHANGES IN DESIGN AND/OR AFFECT THE EARTHWORK QUANTITIES.
 - THE CONTRACTOR SHALL COMPLY WITH ALL GOVERNMENT ORDINANCES AND REGULATIONS RELATING TO THE WORK SHOWN ON THIS PLAN.
 - ALL CUT AND FILL SLOPES SHALL BE 2:1 OR FLATTER UNLESS OTHERWISE NOTED ON THESE PLANS.
 - NO GRADING SHALL OCCUR WITHIN TWO (2) FEET OF THE PROPERTY LINES UNLESS NOTED OTHERWISE ON THESE PLANS.
 - THESE PLANS DO NOT AUTHORIZE SITE DISTURBANCE BEYOND THE LIMITS OF GRADING OR IMPROVEMENTS SHOWN HEREON. THE CONTRACTOR SHALL OBTAIN PERMISSION TO ENTER UPON ADJOINING PROPERTY TO CONSTRUCT IMPROVEMENTS OR TO GRADE ELSEWHERE PRIOR TO COMMENCING WORK. THE REGULATING AGENCY DOES NOT AUTHORIZE ENTRY PER THESE APPROVED PLANS.
 - ALL GRADING AND SITE WORK SHALL CONFORM TO THE REGULATING AGENCIES GRADING ORDINANCE, STANDARDS, AND SPECIFICATIONS; AND TO THE LATEST EDITION OF THE UNIFORM BUILDING CODE (CHAPTER 33) AND TITLE 24 CALIFORNIA CODE OF REGULATIONS ACCESSIBILITY REQUIREMENTS.
 - A CITY ENCROACHMENT PERMIT IS REQUIRED FOR ALL WORK PERFORMED WITHIN THE RIGHT-OF-WAY AND SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO OBTAIN.
 - THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR PLACEMENT OF SAFETY DEVICES SUCH AS FENCING, BARRICADES, SAFETY TAPE, ETC., AND SHALL FOLLOW ALL APPLICABLE INDUSTRIAL SAFETY REGULATIONS. THE CITY AND ITS OFFICIALS, THE ENGINEER, AND THE OWNER SHALL NOT BE RESPONSIBLE FOR ENFORCING SAFETY REGULATIONS.
 - THE CONTRACTOR IS RESPONSIBLE FOR THE PROTECTION OR PROPER RESETTING OF ALL EXISTING MONUMENTS AND OTHER SURVEY MARKERS. ANY SURVEY MONUMENTS DESTROYED BY THE CONTRACTOR SHALL BE REPLACED IN ACCORDANCE WITH THE STATE LAND SURVEYOR'S ACT AT THE CONTRACTOR'S OWN EXPENSE.
 - IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO CONTACT "UNDERGROUND SERVICE ALERT" AT 1-800-642-2444 FOR LOCATION OF POWER, GAS, OIL, AND TELEPHONE UNDERGROUND FACILITIES. CONTRACTOR WILL ALSO BE RESPONSIBLE FOR CONTACTING THE APPROPRIATE AGENCY FOR THE LOCATION OF ALL UNDERGROUND FACILITIES.

GEOTECHNICAL REPORT

THE SOILS REPORT WAS PREPARED BY EARTHSYSTEMS PACIFIC - "SOILS ENGINEERING AND GEOLOGIC HAZARDS REPORT - MANTECA COURTHOUSE ADDITION EAST CENTER STREET, MANTECA, CA", DATED MAY 3, 2011. PLEASE SEE REPORT FOR GEOTECHNICAL RECOMMENDATIONS.

(E) 36" RCP STORM DRAIN PIPE

(E) 36" RCP STORM DRAIN PIPE

24" MIN

EACH PIPE TO BE PLUGGED WITH CONCRETE (2500 PSI @ 28 DAYS). PIPE TO BE COMPLETELY FILLED AS SHOWN.


(E) STORM DRAIN PLUG DETAIL

Phase 1 - Grading, Drainage and Utility Plan

- CONSTRUCTION NOTES:**
- REMOVE EXISTING 36" RCP STORM DRAIN PIPES TO LIMITS SHOWN. BACKFILL WITH 6" CLASS II BASE (UNLESS OTHERWISE NOTED) AND COMPACT TO EXISTING OR FINISH GRADES PER SOILS REPORT RECOMMENDATIONS.
 - SAWCUT & REMOVE EXISTING A.C. PAVING AND/OR CURB TO LIMITS SHOWN.
 - REMOVE EXISTING STANDPIPES AND CONSTRUCT CONCRETE PLUG AT ENDS OF EXISTING STORM DRAIN TO REMAIN. SEE DETAIL "A" THIS SHEET.
 - CONSTRUCT 2" A.C. PAVEMENT OVER 4" CLASS II BASE TO LIMITS AND GRADES SHOWN.
 - CONSTRUCT 6" CLASS II BASE TO LIMITS AND GRADES SHOWN.
 - INSTALL WHEELSTOP.
 - EXISTING PARKING LOT LIGHT AND BASE TO BE REMOVED. PROVIDE TEMPORARY ELECTRICAL BOX AND RECONNECT CIRCUIT.
 - INSTALL 6" DIA NDS CATCH BASIN WITH NON-TRAFFIC GRATE.
 - INSTALL 3" DIA PVC SD PIPE. CONNECT TO EXISTING 8" SD PIPE. SEE ARCH DETAILS 32 & 24, SHT A1.2 FOR ADDITION DETAIL.

- UTILITY CONSTRUCTION NOTES:**
- W1 PROVIDE AND INSTALL NEW 4" FIRE SERVICE LINE PER CITY STD DETAIL W-11 & W-6. PROVIDE 30" MIN - 36" MAX COVER. VERIFY FIRE SERVICE SIZE WITH FIRE SPRINKLER CONTRACTOR PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 - W2 PROVIDE AND INSTALL 4" DOUBLE CHECK VALVE ASSEMBLY PER CITY STD DETAIL W-15. VERIFY DCV SIZE WITH FIRE SPRINKLER CONTRACTOR PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 - W3 CONSTRUCT THRUST BLOCK PER CITY STD DETAIL W-4.
 - W4 PROVIDE FIRE SPRINKLER RISER PER FIRE SPRINKLER DESIGN. SEE ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION.
 - W5 STUB AND CAP NEW 4" FIRE SERVICE FOR FUTURE EXTENSION. VERIFY FIRE SERVICE SIZE WITH FIRE SPRINKLER CONTRACTOR PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 - W6 CONSTRUCT NEW A.C. TRENCH REPAIR PER CITY STANDARDS AND SPECIFICATIONS.
 - W7 REPAIR CONCRETE SIDEWALK PER CITY STD DETAIL ST-6.
 - W8 PROVIDE AND INSTALL FIRE DEPARTMENT CONNECTION PER CITY STD DETAIL W-15 AND CAL FIRE REQUIREMENTS.
 - SS1 CONSTRUCT NEW 4" SS LATERAL TO NEW PORTABLE BUILDING LOCATION AND INSTALL NEW SS CLEANOUT.
 - SS2 EXISTING 4" SS LATERAL AND CLEANOUT-PROTECT IN PLACE.

- NOTES:**
- SEE ARCHITECTURAL PLANS FOR ADDITIONAL ITEMS OF REMOVAL, RELOCATION, AND CONSTRUCTION.
 - POTHOLE AND VERIFY MATERIAL, LOCATION AND SIZE OF ALL WET AND DRY UTILITIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.
 - SEE SHEET C2 FOR CONSTRUCTION DETAILS.

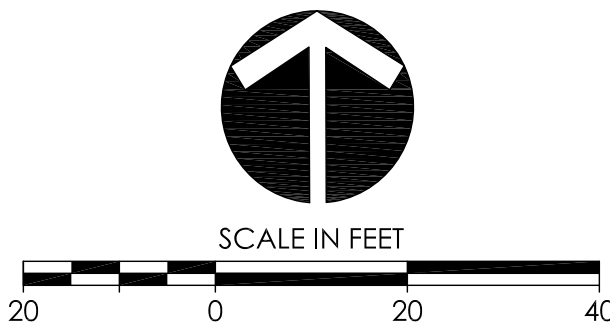

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007



971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

Keith V. Crowe, P.E. Consulting Engineer

P.O. Box 832, Atascadero, CA 93423-0832
Phone & Fax: (805) 464-0975
KVCrowe@Charter.net

PROJECT MANAGER SG

DRAWN BY SG

DATES 05/05/11 SUBITTAL
06/20/11

SIGNED



The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

PHASE I GRADING, DRAINAGE AND UTILITY PLAN

SHEET #

C1

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007



971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

Keith V. Crowe, P.E.
Consulting Engineer

P.O. Box 832, Atascadero, CA 93423-0832
Phone & Fax: (805) 464-0975
KVCrowe@Charter.net

PROJECT MANAGER SG

DRAWN BY SG

DATES 05/05/11 SUBITTAL
06/20/11

SIGNED



The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE
CONSTRUCTION DETAILS

SHEET #

C2

TYPE OF FITTING	90° BEND	45° BEND	1 1/4" OR 2 1/2" BEND
THRUST BLOCK DESCRIPTION			
PIPE SIZE	4" & 6" 4 FT ²	4 FT ²	2 FT ²
	8" 7	4 2	2
	10" 11	6 3	3
	12" 15	8 5	5
	14" 20	11 6	6
	16" 25	14 8	8

NOTES:

- ALL BEARING AREAS SHOWN ARE MINIMUM VALUES FOR A HYDROSTATIC PRESSURE OF 150 PSI, SOIL RESISTANCE OF 2,000 LBS./SQ. FT. AND TWO (2) FOOT MINIMUM COVER.
- ALL THRUST BLOCKS SHALL BE MADE OF CLASS "B" CONCRETE WITH A MINIMUM CRUSHING STRENGTH OF 2,000 PSI AT 28 DAYS.
- ALL BLOCKS TO BE POURED AGAINST UNDISTURBED SOIL. THE BLOCKS SHALL BE PLACED SO THAT JOINTS AND FITTINGS WILL BE ACCESSIBLE FOR REPAIRS.
- FOR VERTICAL BENDS, ALL METALLIC TIE DOWNS SHALL BE ENCASED WITH POLYETHYLENE WRAP (8 MIL. MIN.) AS SPECIFIED IN AWWA C105.
- ALL THRUST BLOCKS SHALL BE A MINIMUM 18" THICK.

NO.	REVISED	BY	REQUIRED BEARING AREA OF THRUST BLOCK	APPROVED BY:
1	FEB. 1992	JK		
DRAWN BY:	J. KOESTER		CITY OF MANTECA	DIRECTOR OF PUBLIC WORKS
CHECKED BY:	J. PODESTA		DEPARTMENT OF PUBLIC WORKS	
SCALE:	NONE			DRAWING NO. W-4
				DATE: FEB 1992

PRINTED ON DIFPO NO. 1000K CLEARPRINT


TYPE OF FITTING	TEE AND DEAD END	CROSS WITH FUTURE EXTENSION	VERTICAL BEND	FIRE HYDRANT
THRUST BLOCK DESCRIPTION				
PIPE SIZE	4" & 6" 4 FT ²	4 FT ²	2 FT 2 1/2" 45° 90°	
	8" 7	7 3	5 8	
	10" 11	11 4	7 13	
	12" 15	15 5	10 18	
	14" 20	20 7	13 25	
	16" 25	25 9	18 32	

NOTES:

- ALL BEARING AREAS SHOWN ARE MINIMUM VALUES FOR A HYDROSTATIC PRESSURE OF 150 PSI, SOIL RESISTANCE OF 2,000 LBS./SQ. FT. AND TWO (2) FOOT MINIMUM COVER.
- ALL THRUST BLOCKS SHALL BE MADE OF CLASS "B" CONCRETE WITH A MINIMUM CRUSHING STRENGTH OF 2,000 PSI AT 28 DAYS.
- ALL BLOCKS TO BE POURED AGAINST UNDISTURBED SOIL. THE BLOCKS SHALL BE PLACED SO THAT JOINTS AND FITTINGS WILL BE ACCESSIBLE FOR REPAIRS.
- FOR VERTICAL BENDS, ALL METALLIC TIE DOWNS SHALL BE ENCASED WITH POLYETHYLENE WRAP (8 MIL. MIN.) AS SPECIFIED IN AWWA C105.
- ALL THRUST BLOCKS SHALL BE A MINIMUM 18" THICK.
- THRUST BLOCKS AT FUTURE EXTENSIONS SHALL NOT EXCEED 24".

NO.	REVISED	BY	REQUIRED BEARING AREA OF THRUST BLOCK	APPROVED BY:
1	FEB. 1992	JK		
DRAWN BY:	J. KOESTER		CITY OF MANTECA	DIRECTOR OF PUBLIC WORKS
CHECKED BY:	J. PODESTA		DEPARTMENT OF PUBLIC WORKS	
SCALE:	NONE			DRAWING NO. W-5
				DATE: FEB 1992

PRINTED ON DIFPO NO. 1000K CLEARPRINT

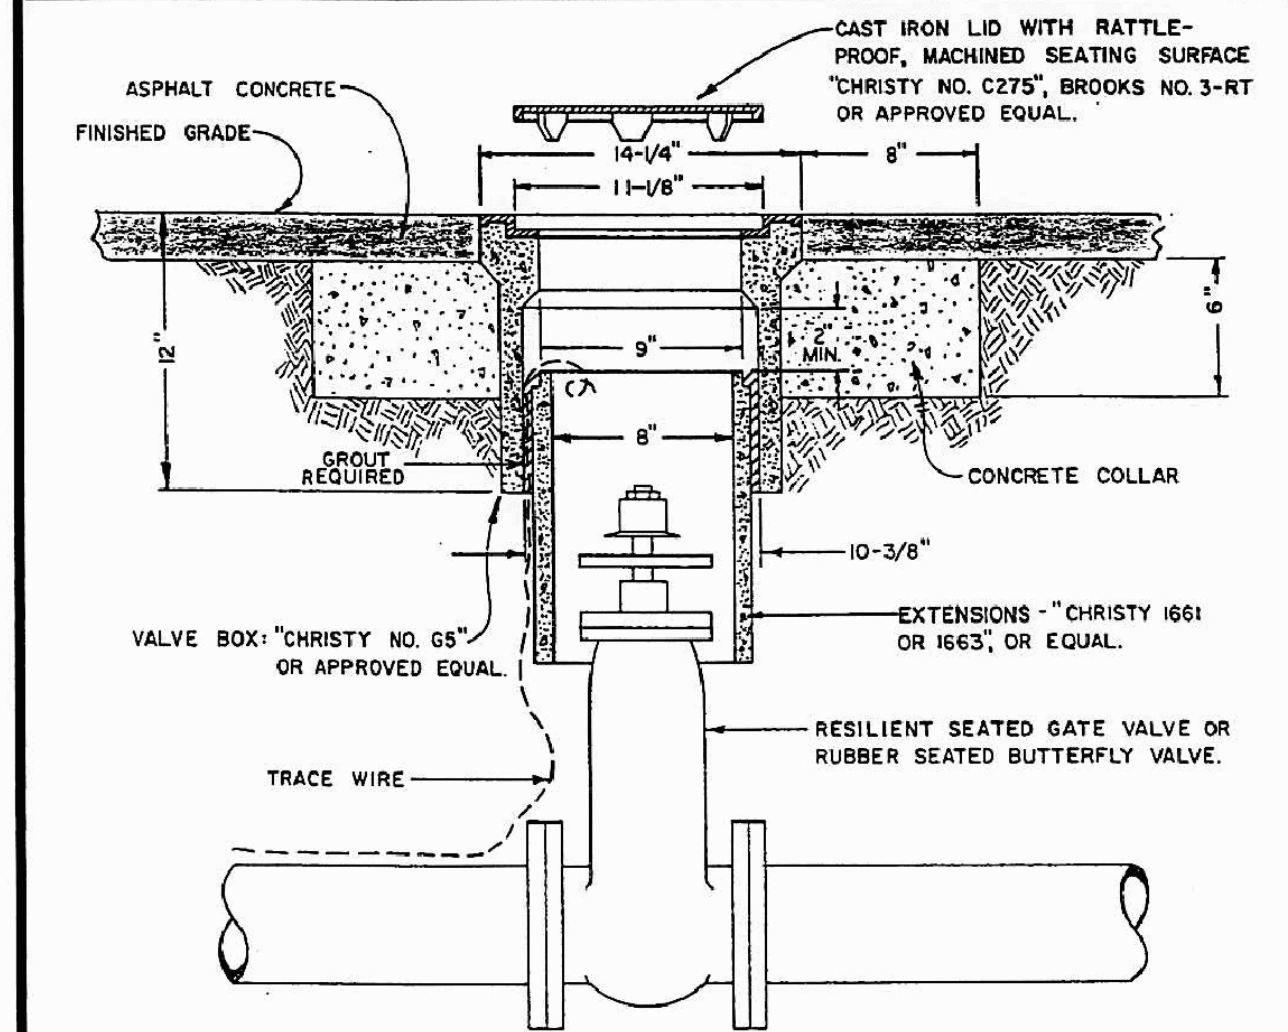


NOTES:

- VALVE BOX AND LID SHALL BE "CHRISTY NO. G5" AND "CHRISTY NO. C275", BROOKS NO. 3-RT, OR EQUALS.
- ALL LIDS SHALL HAVE MACHINE SEATING SURFACES.
- EXTENSIONS SHALL BE AS MANUFACTURED FOR THE VALVE BOX SUPPLIED OR A.C. PIPE OF CORRECT SIZE MAY BE USED.
- CONCRETE COLLAR SHALL BE OF CLASS "B" CONCRETE AND SHALL BE CONSTRUCTED 2 1/2 INCHES BELOW FINISHED GRADE.
- RESILIENT SEATED GATE VALVE SHALL BE MUELLER, KENNEDY, AMERICAN AVK CO., OR APPROVED EQUAL.
- RESILIENT SEATED GATE VALVE SHALL HAVE A NON-RISING STEM AND CONFORM TO A.W.W.A. STANDARD C509 OF LATEST REVISION.
- RUBBER SEATED BUTTERFLY VALVE SHALL BE DRESSER 450, MUELLER B3211 OR APPROVED EQUAL.
- RUBBER SEATED BUTTERFLY VALVE SHALL CONFORM TO A.W.W.A. STANDARD C504 OF LATEST REVISION.
- RUBBER SEATED BUTTERFLY VALVES SHALL BE USED FOR PIPE SIZES LARGER THAN 12 INCHES.

NO.	REVISED	BY	STANDARD VALVE BOX	APPROVED BY:
4	OCT. 2003	JH		
DRAWN BY:	C. SABERTON		CITY OF MANTECA	DIRECTOR OF PUBLIC WORKS
CHECKED BY:	J. PODESTA		DEPARTMENT OF PUBLIC WORKS	
SCALE:	NONE			DRAWING NO. W-6
				DATE: JAN. 1988

PRINTED ON DIFPO NO. 1000K CLEARPRINT

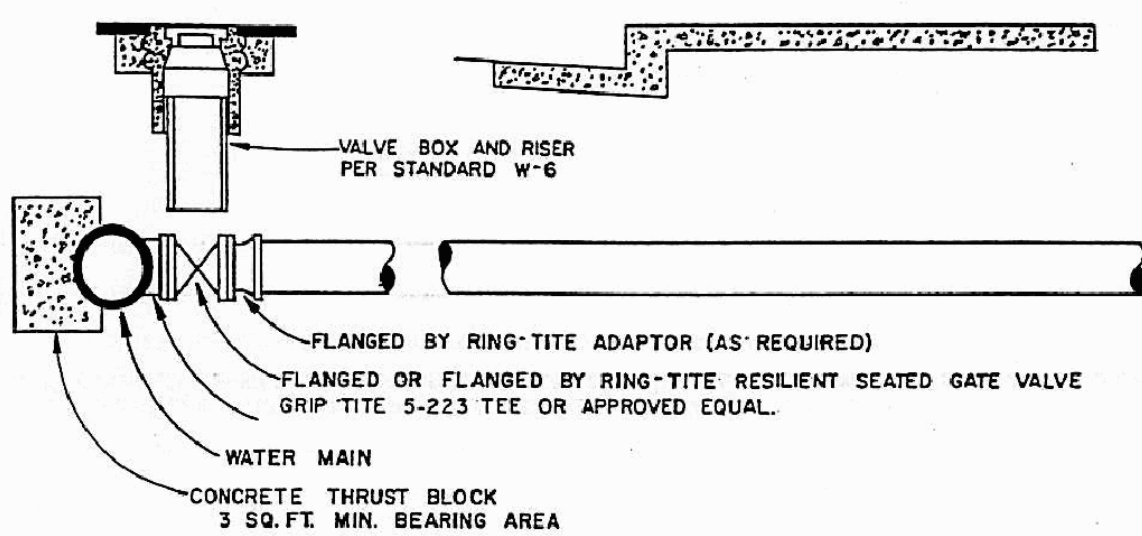

NOTES:

- WATER METER TO BE INSTALLED ABOVE GROUND IN ACCORDANCE WITH CITY STANDARD W-16. WATER METER WILL BE SUPPLIED AND INSTALLED BY CITY.
- RESILIENT SEATED GATE VALVES, PER CITY STANDARD W-6, ARE REQUIRED FOR VALVE SIZES 2 THROUGH 12 INCHES.
- RUBBER SEATED BUTTERFLY VALVES ARE REQUIRED FOR VALVES LARGER THAN 12 INCHES.
- IF C-900 PIPE IS USED, MECHANICAL JOINTS MUST BE USED.
- A FIRE SPRINKLER SERVICE INSTALLATION WILL REQUIRE THE INSTALLATION OF A BACKFLOW PREVENTION DEVICE LOCATED ABOVE GROUND, AND A MAXIMUM OF 12 INCHES BEHIND THE PROPERTY LINE. THE BACKFLOW PREVENTER SHALL BE INSTALLED IN ACCORDANCE WITH CITY STANDARDS AVAILABLE IN THE CITY OF MANTECA'S PUBLIC WORKS DEPARTMENT.
- THE USE OF GALVANIZED PIPE IS NOT PERMITTED.

NO.	REVISED	BY	STANDARD WATER SERVICE INSTALLATION 3" & LARGER	APPROVED BY:
2	FEB. 1992	JK		
DRAWN BY:	J. KOESTER		CITY OF MANTECA	DIRECTOR OF PUBLIC WORKS
CHECKED BY:	J. PODESTA		DEPARTMENT OF PUBLIC WORKS	
SCALE:	NONE			DRAWING NO. W-11
				DATE: JAN. 1988

PRINTED ON DIFPO NO. 1000K CLEARPRINT



APPROVED TAPPING SLEEVES: (STAINLESS STEEL)


- ROMAC SST
- ROCKWELL 663
- FORD FAST
- APPROVED EQUAL

APPROVED TAPPING VALVES: (MUST BE RESILIENT SEAT)

- AMERICAN DARLING CRS-80
- WATEROUS SERIES 500
- APPROVED EQUAL

NO.	REVISED	BY	HOT TAPS	APPROVED BY:
DRAWN BY:	J. KOESTER		CITY OF MANTECA	DIRECTOR OF PUBLIC WORKS
CHECKED BY:	J. PODESTA		DEPARTMENT OF PUBLIC WORKS	
SCALE:	NONE			DRAWING NO. W-14
				DATE: FEB 1992

PRINTED ON DIFPO NO. 1000K CLEARPRINT

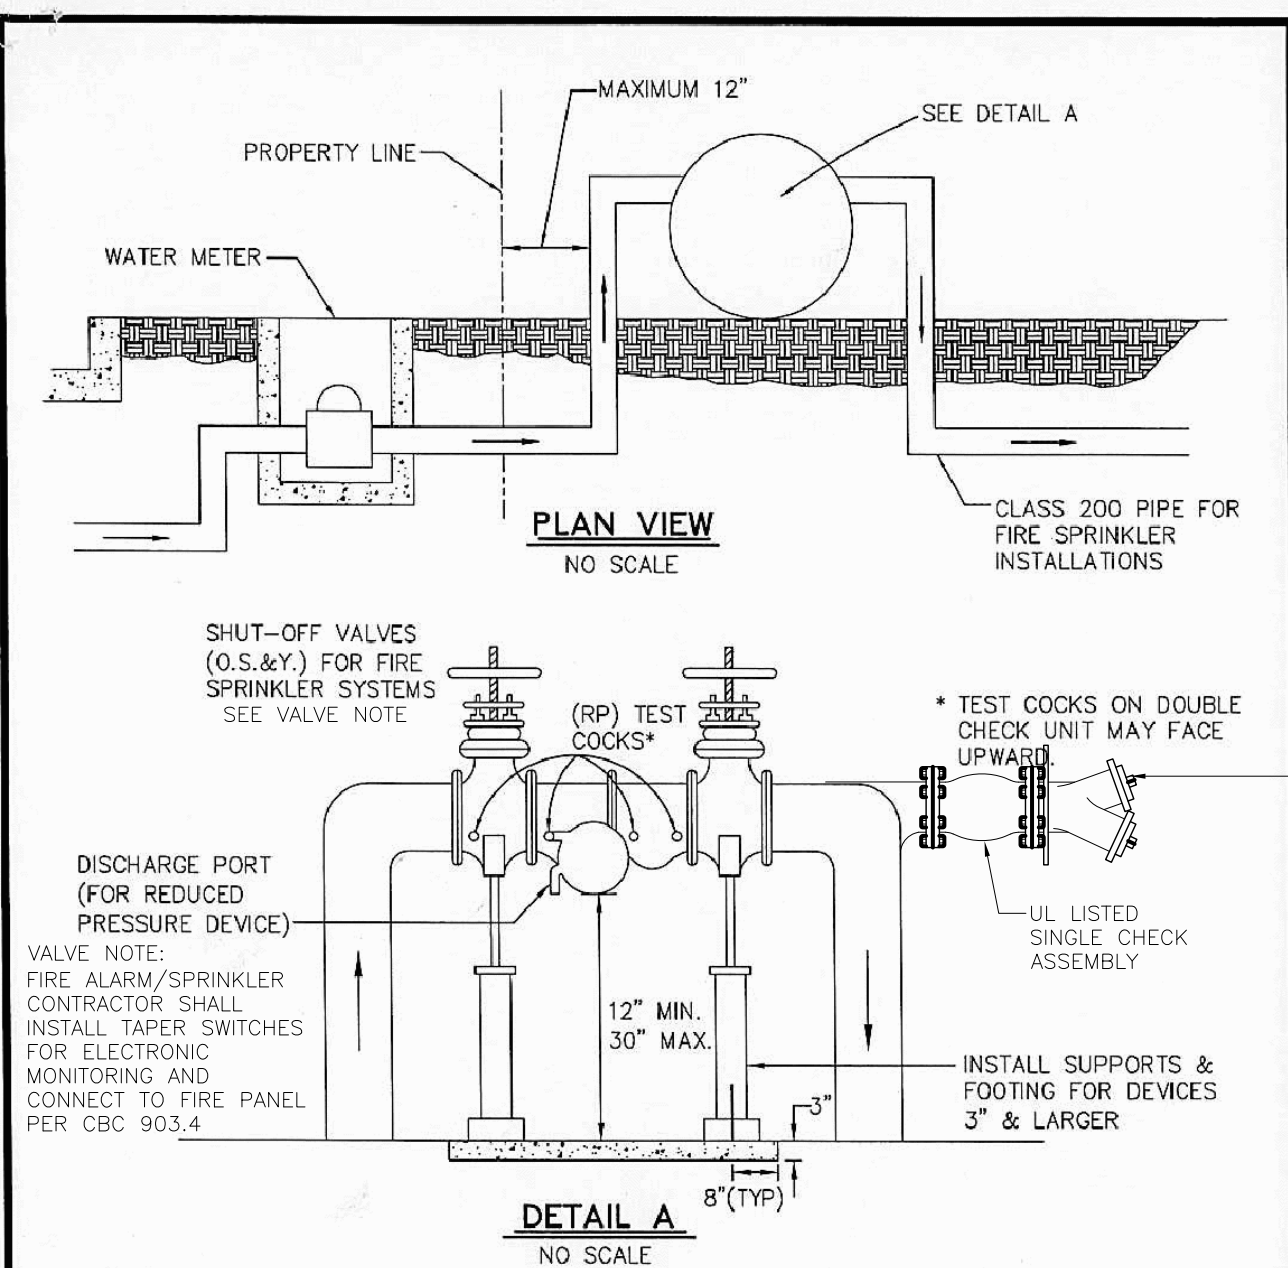


NOTES:

- ALL BACKFLOW DEVICES INSTALLED IN THE CITY OF MANTECA SHALL BE REDUCED PRESSURE ASSEMBLIES WITH THE EXCEPTION OF THOSE INSTALLED ON FIRE SYSTEMS (WITHOUT AUXILIARY SUPPLY) WHICH SHALL BE DOUBLE CHECK VALVE ASSEMBLIES. ALL DEVICES INSTALLED SHALL BE ON THE CITY'S APPROVED BACKFLOW PREVENTION ASSEMBLIES LIST.
- DEVICES MUST BE TESTED AND APPROVED BY A CITY APPROVED CERTIFIED TESTER PRIOR TO CITY ACCEPTANCE.
- TEST COCKS AND SHUT OFF VALVES MUST BE SUPPLIED AS SHOWN.
- THE DISCHARGE PORT MUST BE KEPT CLEAR OF OBSTRUCTION AT ALL TIMES.
- BACKFLOW DEVICES SHALL BE VISIBLE FROM THE STREET.
- DEVIATION FROM THE INSTALLATION SHOWN ABOVE MUST RECEIVE PRIOR CITY APPROVAL.
- FIRE SPRINKLER SYSTEM BACKFLOW DEVICES SHALL HAVE A WORKING PRESSURE OF 175 PSI.
- THE CONCRETE FOOTING SHALL BE FINISHED. CONCRETE MUST BE MIXED IN TRANSIT - NO TRAILER HAULED MIX.
- ONE UNION IS REQUIRED ON ALL NON-FLANGED PLUMBING INSTALLATIONS.


NO.	REVISED	BY	REDUCED PRESSURE/DOUBLE CHECK VALVE BACKFLOW PREVENTION DEVICE INSTALLATION	APPROVED BY:
8	APRIL, 2004	JH		
DRAWN BY:	J. KOESTER		CITY OF MANTECA	DIRECTOR OF PUBLIC WORKS
CHECKED BY:	J. PODESTA		DEPARTMENT OF PUBLIC WORKS	
SCALE:	NONE			DRAWING NO. W-15
				DATE: MAY, 1985

PRINTED ON DIFPO NO. 1000K CLEARPRINT

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\01 - Phase I Site Demolition Plan.dwg, 4/29/2011 3:01:34 PM, R05995

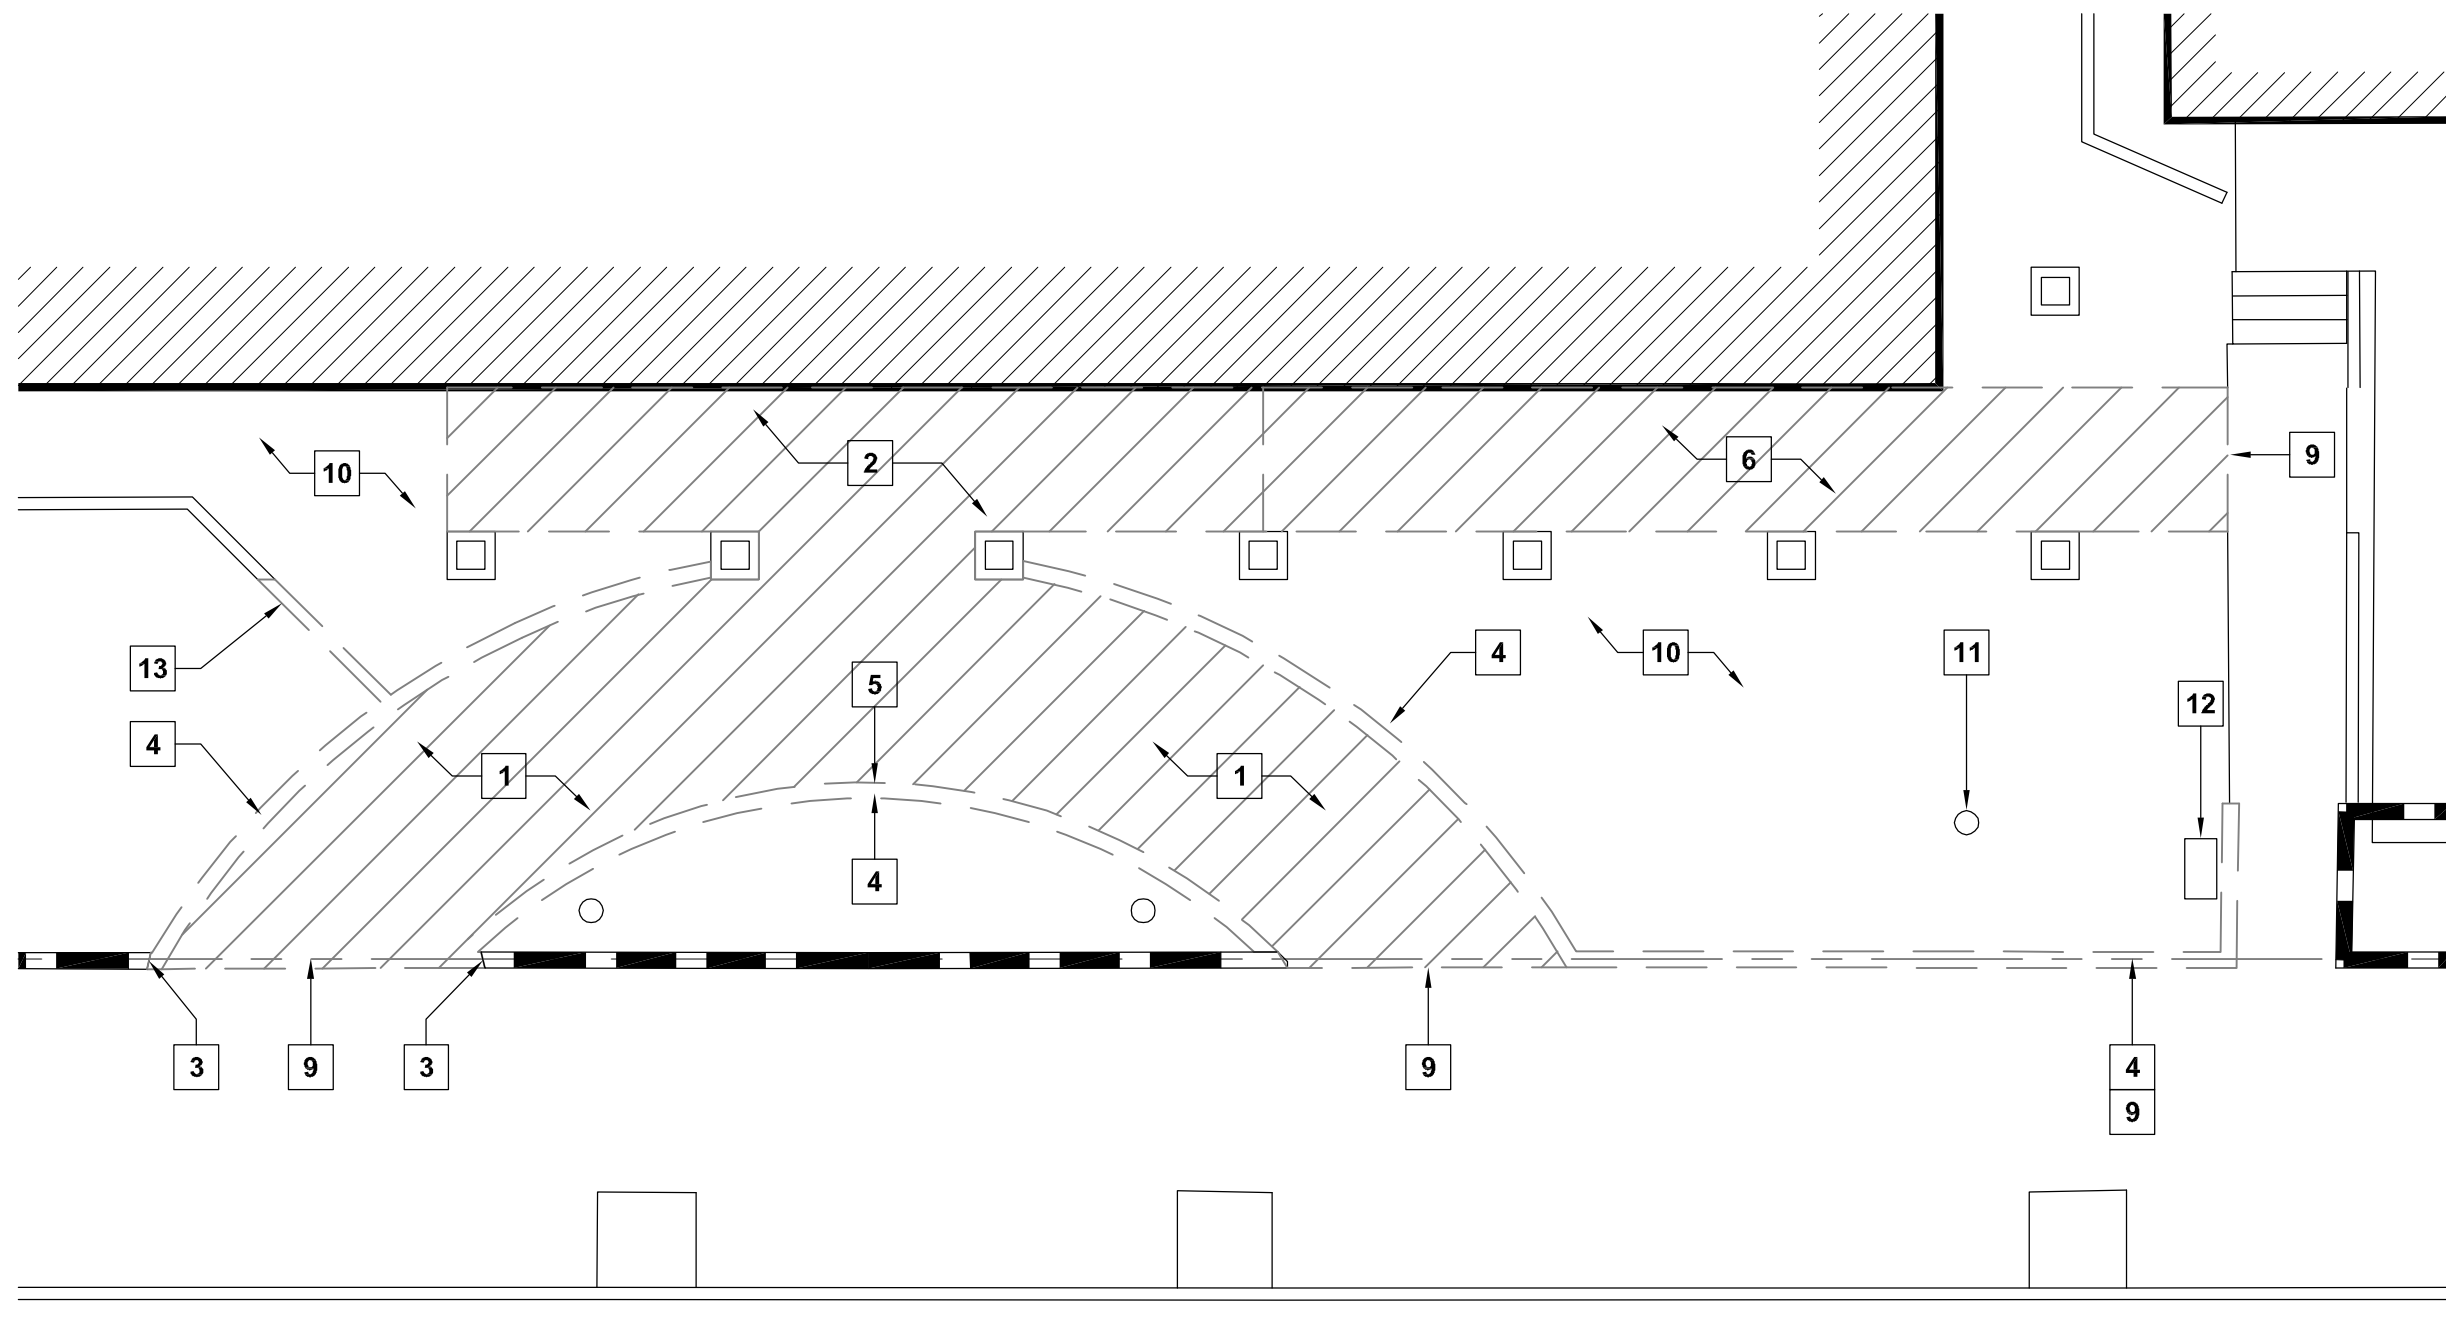

54 ENLARGED SITE DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

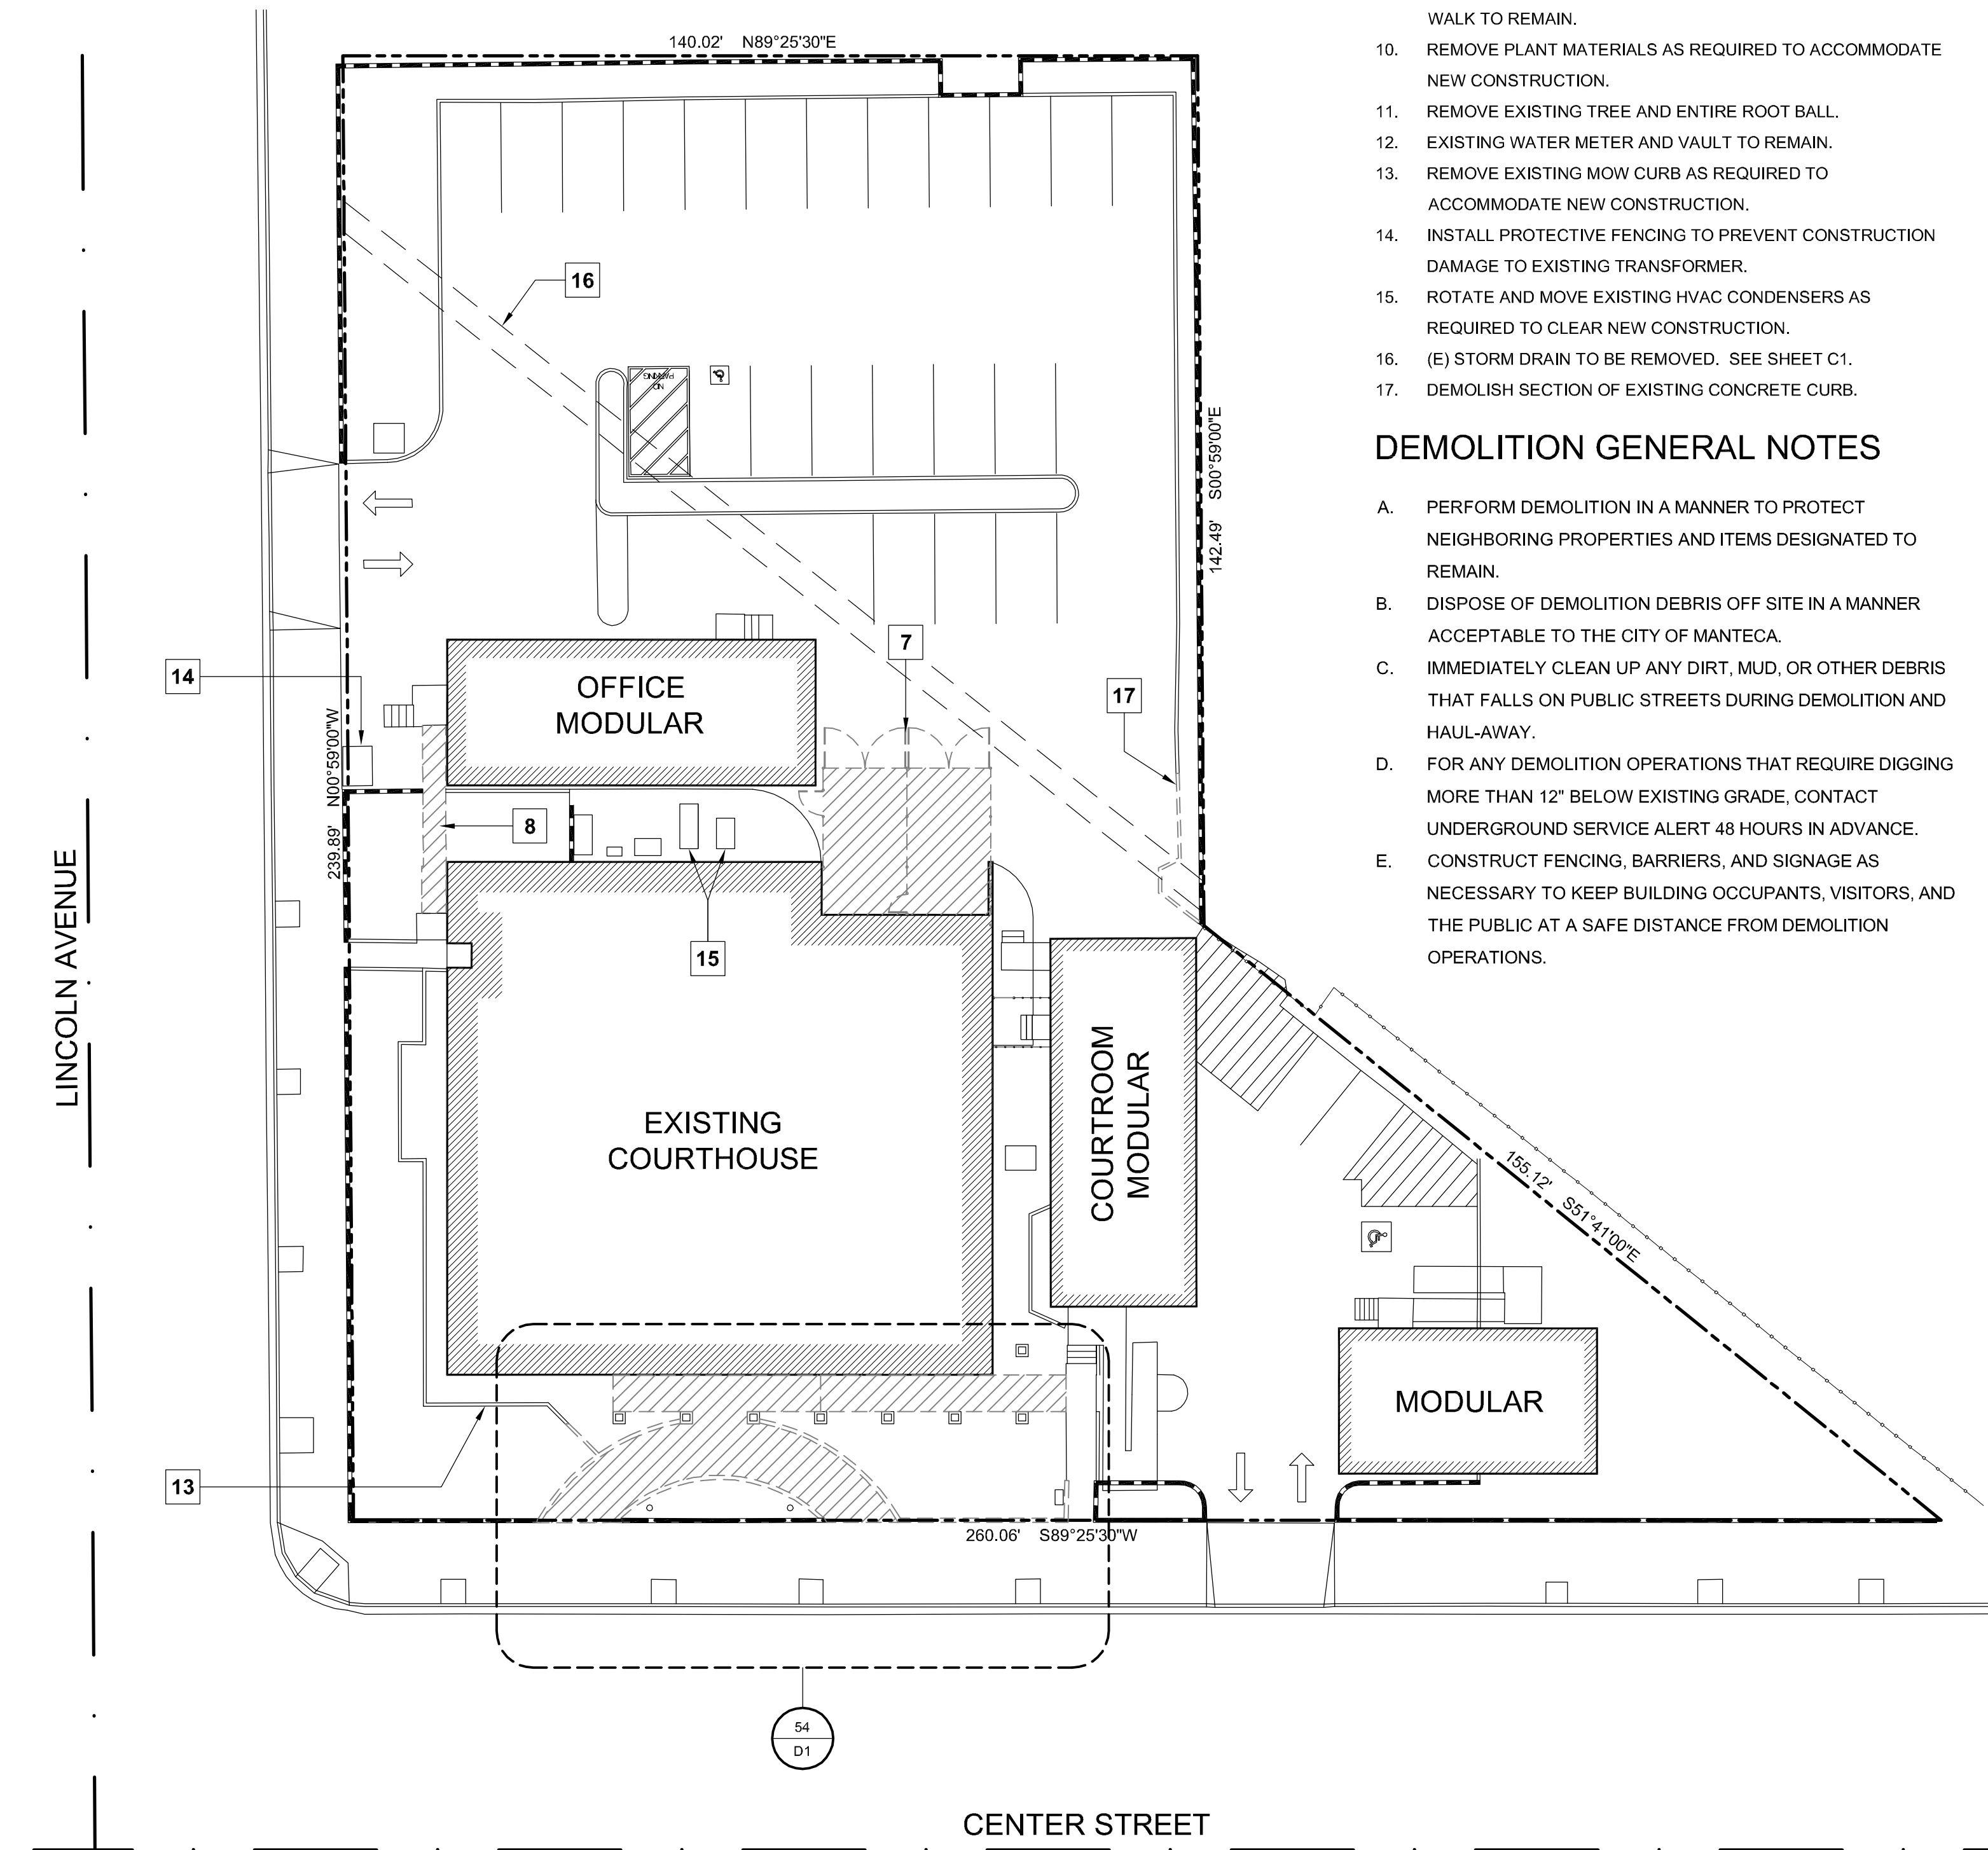

54 SITE DEMOLITION PLAN
SCALE: 1" = 20'-0"

————— EXISTING TO REMAIN
- - - - - EXISTING TO BE DEMOLISHED

DEMOLITION KEYNOTES

1. EXISTING CONCRETE RAMP AND FOOTINGS TO BE DEMOLISHED.
2. EXISTING CONCRETE LANDING AND FOOTINGS TO BE DEMOLISHED (IDENTIFY AND PROTECT COLUMN FOOTINGS).
3. SAWCUT EXISTING RETAINING WALL TO ACCOMMODATE NEW WALL CONSTRUCTION.
4. REMOVE EXISTING RETAINING WALL AND FOOTINGS AS SHOWN.
5. CAREFULLY REMOVE AND PROTECT EXISTING DEDICATION PLAQUE FOR RE-INSTALLATION IN NEW CONSTRUCTION.
6. EXISTING WALK AND FOOTINGS TO BE DEMOLISHED (IDENTIFY AND PROTECT COLUMN FOOTINGS).
7. DISASSEMBLE AND REMOVE EXISTING CHAIN LINK FENCING AT SALLY PORT AREA.
8. DEMOLISH EXISTING WOOD RAMP.
9. SAWCUT IF NECESSARY TO MINIMIZE DAMAGE TO EXISTING WALK TO REMAIN.
10. REMOVE PLANT MATERIALS AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION.
11. REMOVE EXISTING TREE AND ENTIRE ROOT BALL.
12. EXISTING WATER METER AND VAULT TO REMAIN.
13. REMOVE EXISTING MOW CURB AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION.
14. INSTALL PROTECTIVE FENCING TO PREVENT CONSTRUCTION DAMAGE TO EXISTING TRANSFORMER.
15. ROTATE AND MOVE EXISTING HVAC CONDENSERS AS REQUIRED TO CLEAR NEW CONSTRUCTION.
16. (E) STORM DRAIN TO BE REMOVED. SEE SHEET C1.
17. DEMOLISH SECTION OF EXISTING CONCRETE CURB.

DEMOLITION GENERAL NOTES

- A. PERFORM DEMOLITION IN A MANNER TO PROTECT NEIGHBORING PROPERTIES AND ITEMS DESIGNATED TO REMAIN.
- B. DISPOSE OF DEMOLITION DEBRIS OFF SITE IN A MANNER ACCEPTABLE TO THE CITY OF MANTECA.
- C. IMMEDIATELY CLEAN UP ANY DIRT, MUD, OR OTHER DEBRIS THAT FALLS ON PUBLIC STREETS DURING DEMOLITION AND HAUL-AWAY.
- D. FOR ANY DEMOLITION OPERATIONS THAT REQUIRE DIGGING MORE THAN 12" BELOW EXISTING GRADE, CONTACT UNDERGROUND SERVICE ALERT 48 HOURS IN ADVANCE.
- E. CONSTRUCT FENCING, BARRIERS, AND SIGNAGE AS NECESSARY TO KEEP BUILDING OCCUPANTS, VISITORS, AND THE PUBLIC AT A SAFE DISTANCE FROM DEMOLITION OPERATIONS.

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

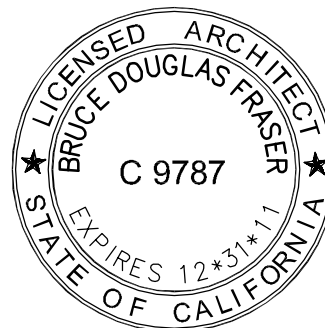

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.



SHEET TITLE

**PHASE I
SITE DEMOLITION
PLAN**

SHEET #



D1

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\02 - Phase 1 Demolition Floor Plan.dwg, 4/29/2011 3:03:54 PM, PDF995

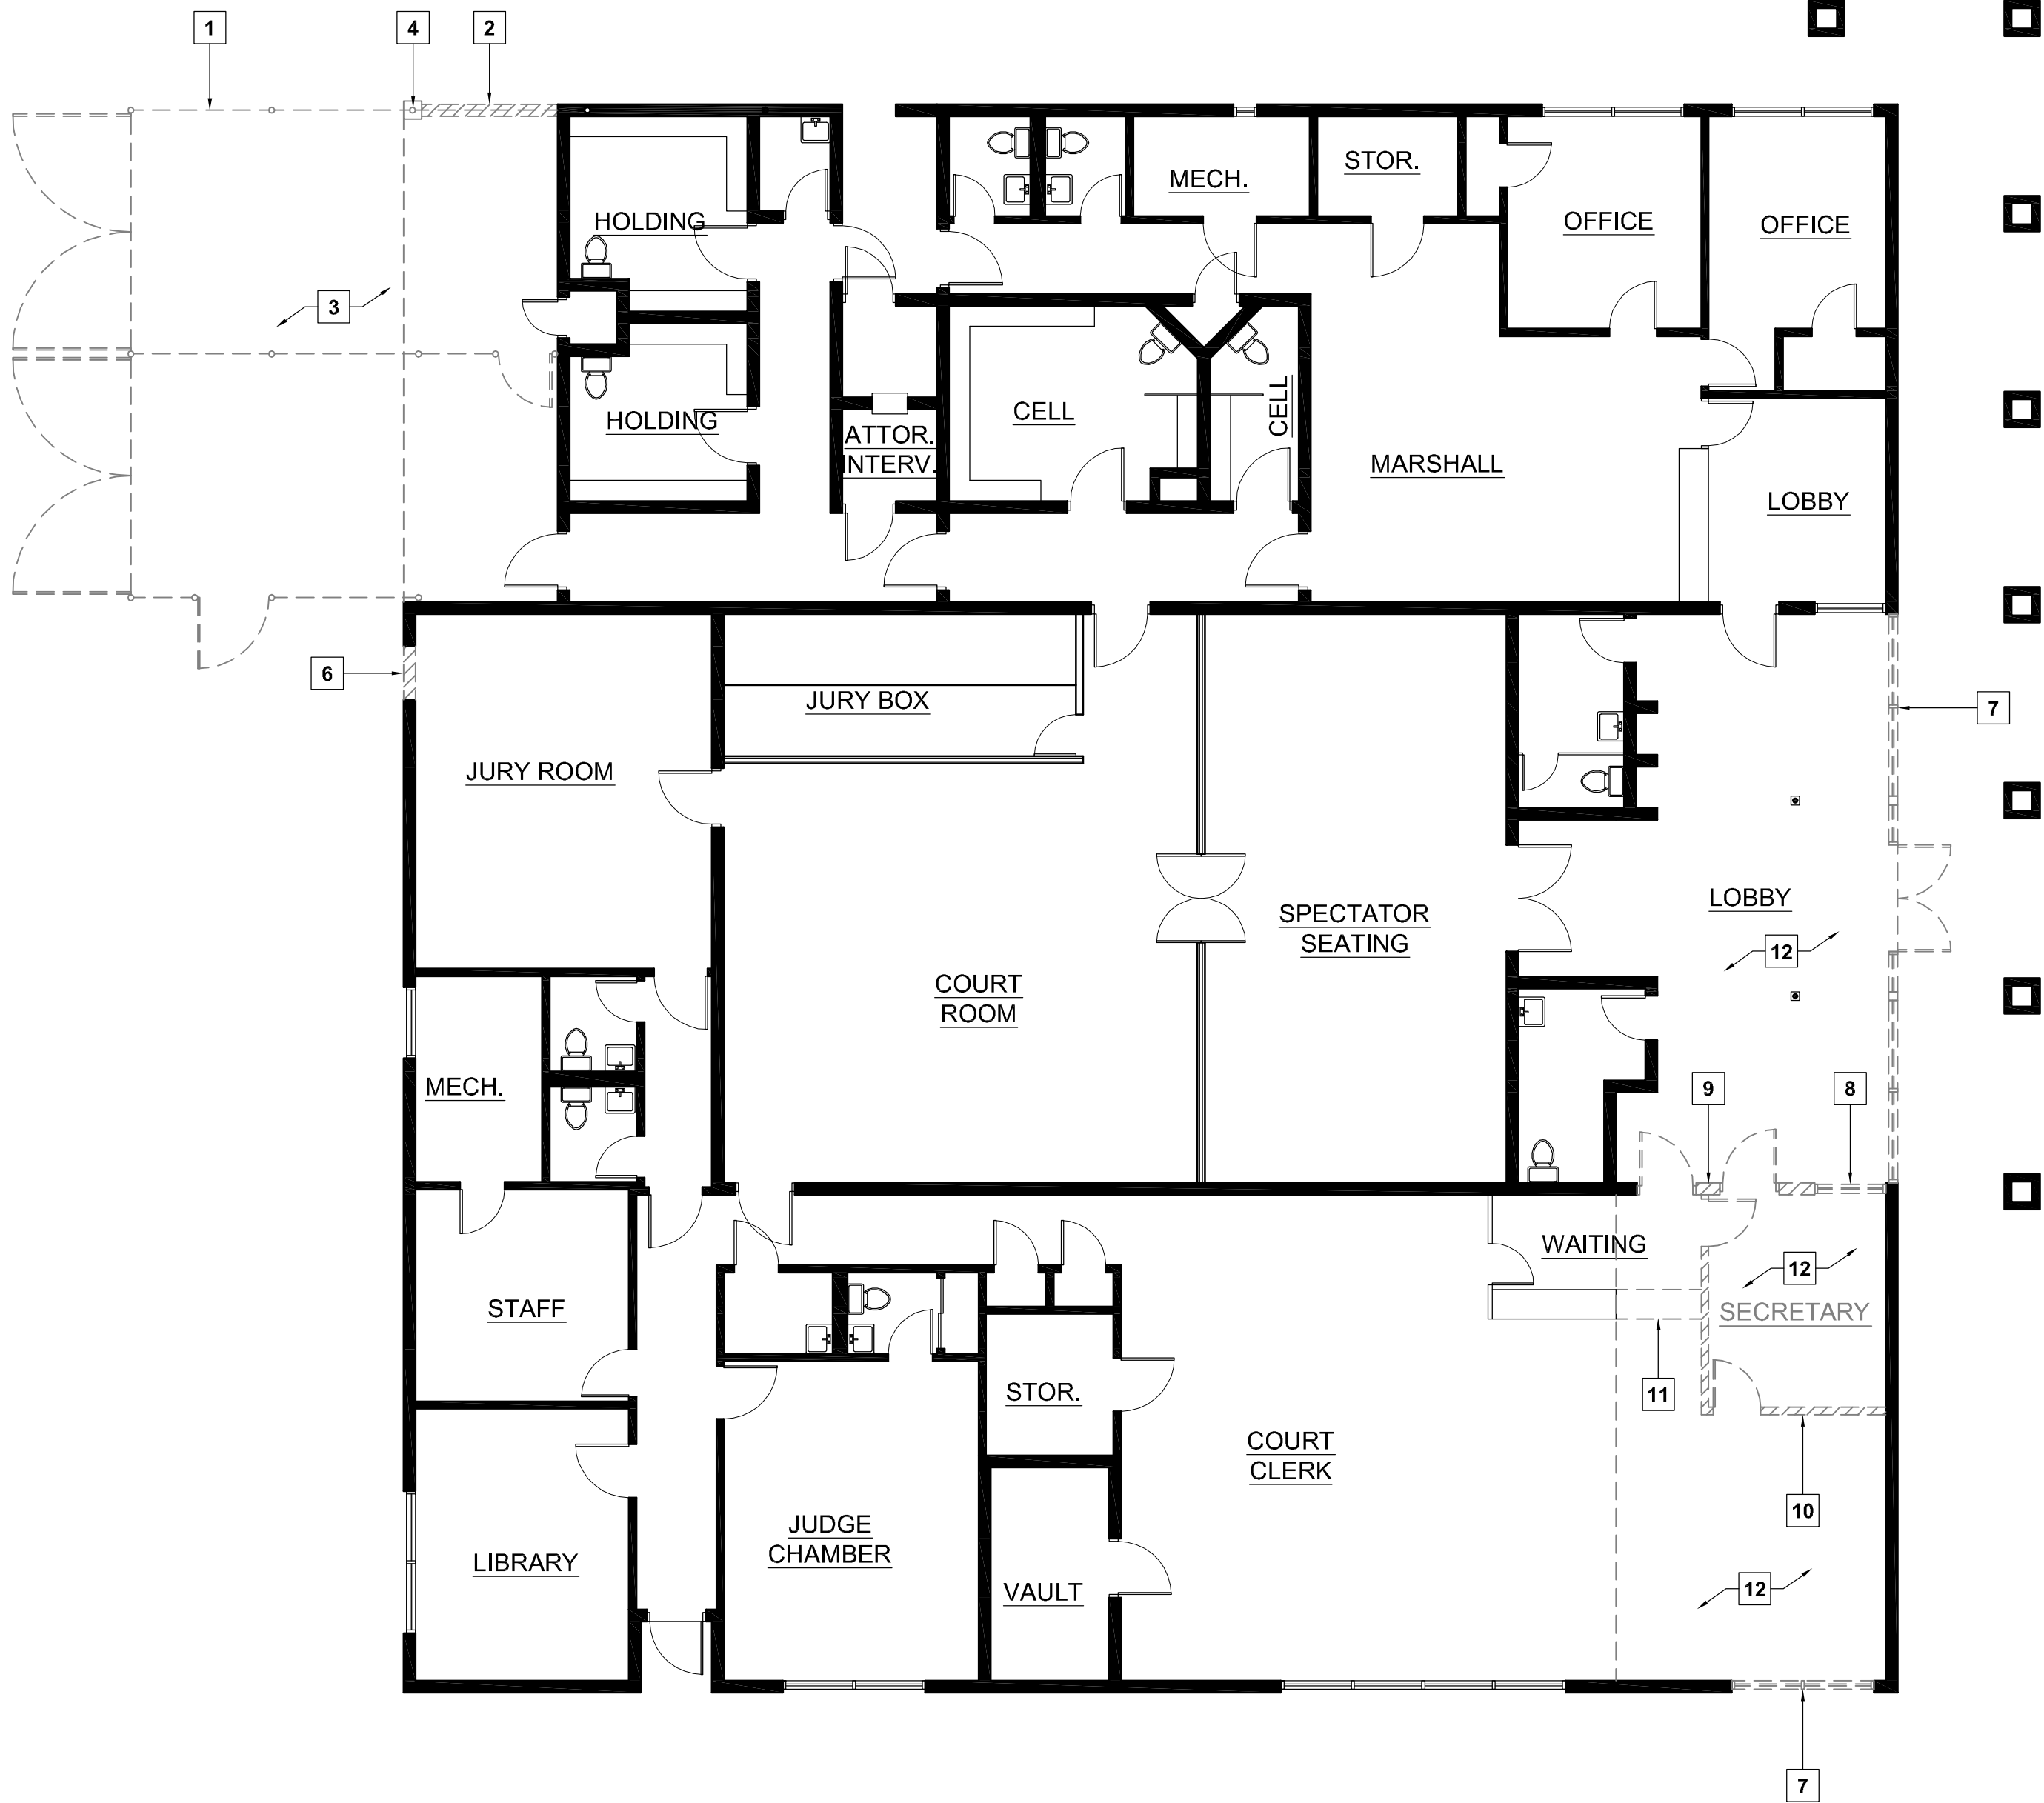

DEMOLITION FLOOR PLAN

SCALE: 1/8" = 1'-0"

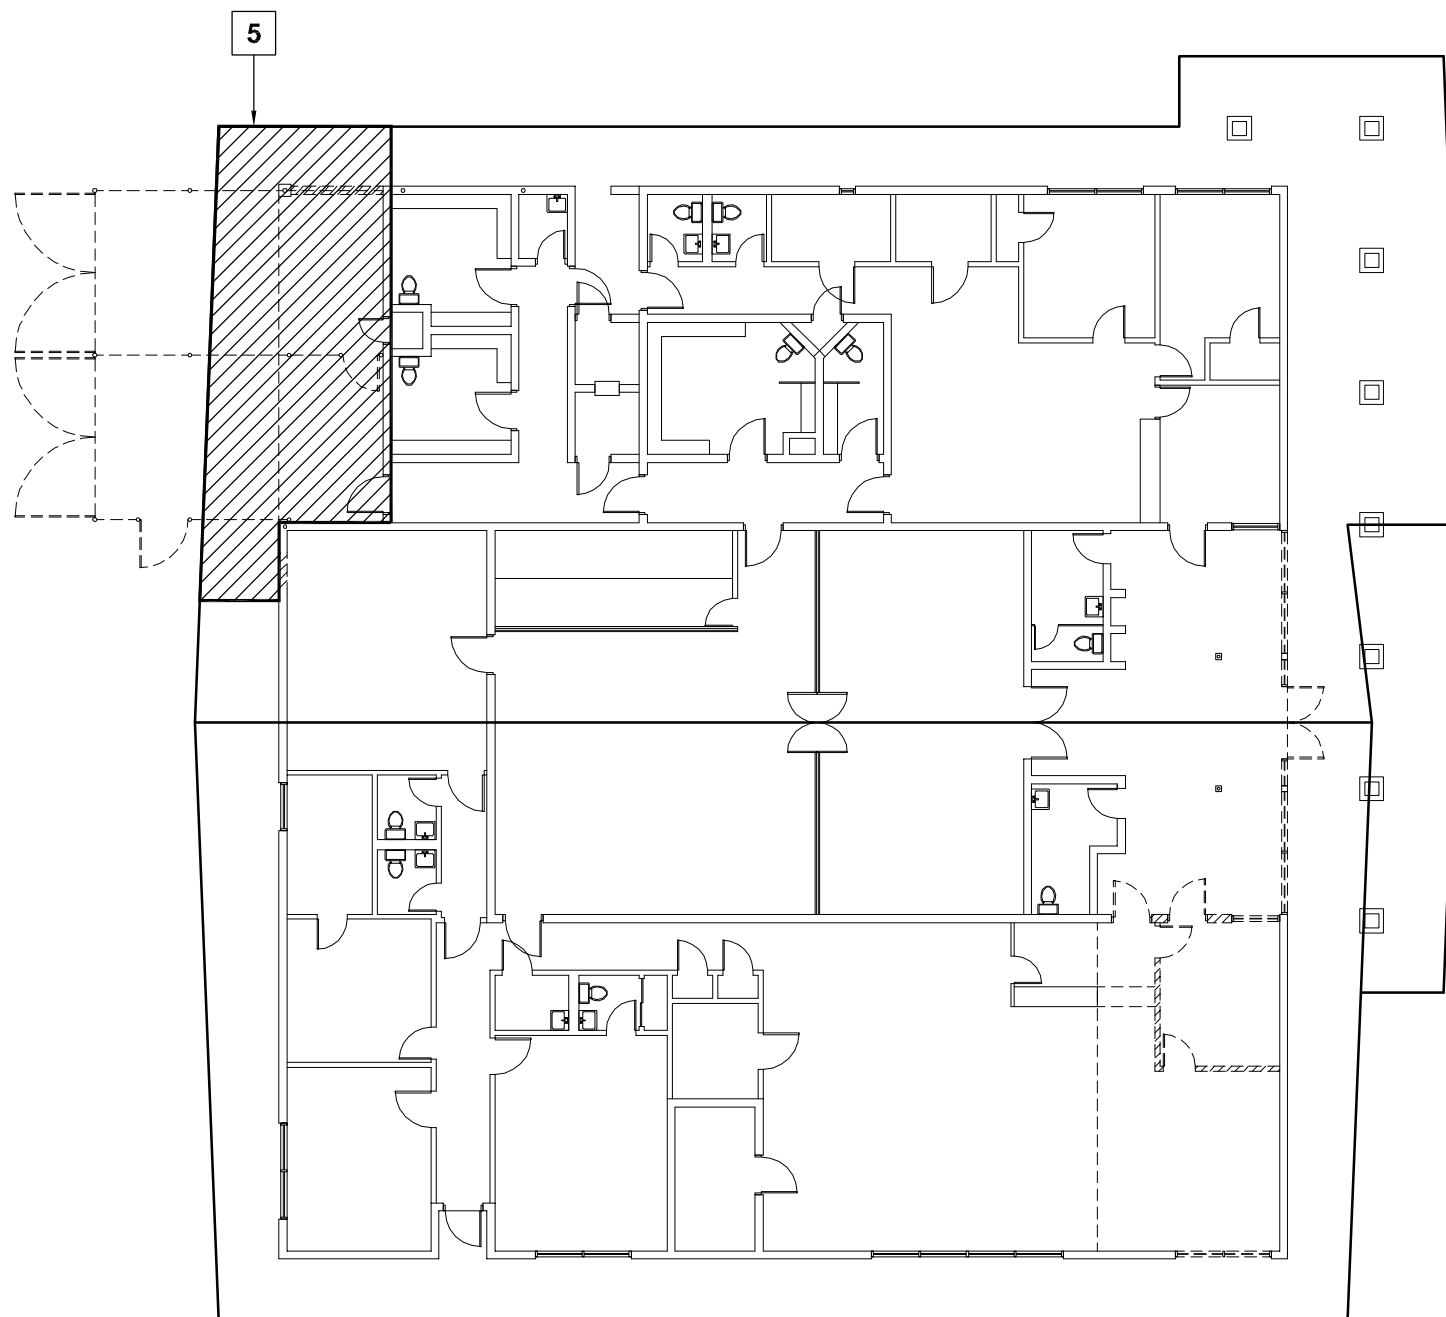

DEMOLITION ROOF PLAN

SCALE: 1/16" = 1'-0"

LEGEND

- EXISTING WALL TO REMAIN AND PROTECT
- EXISTING TO BE REMOVED

KEYNOTES:

- DEMOLISH EXISTING CHAIN LINK SALLYPORT.
- DEMOLISH EXISTING BLOCK WALL AND PERIMETER FOUNDATION.
- DEMOLISH CONCRETE SLAB AT SALLYPORT.
- DEMOLISH EXISTING STRUCTURAL COLUMN AND FOUNDATION.
- PORTION OF EXISTING ROOF TO BE COMPLETELY DEMOLISHED.
- SAWCUT OPENING IN EXISTING BLOCK WALL FOR NEW DOOR.
- DEMOLISH EXISTING STOREFRONT.
- DOORS, WINDOWS, AND FRAMES TO BE REMOVED AND DELIVERED TO THE OWNER AS DIRECTED.
- SAWCUT AND DEMOLISH PORTION OF EXISTING INTERIOR BLOCK WALL.
- EXISTING WOOD FRAMED WALL TO BE DEMOLISHED AND REMOVED FROM SITE; PULL WIRING AND OTHER INSTALLATIONS INTO ATTIC SPACE TO CLEAR NEW CONSTRUCTION.
- CAREFULLY CUT EXISTING COUNTER AND PROVIDE TEMPORARY SUPPORT.
- ALL CEILING TILES AND LIGHT FIXTURES IN THIS AREA TO BE REMOVED AND DELIVERED TO THE OWNER AS DIRECTED. CEILING SUSPENSION SYSTEM AND GYPSUM BOARD CEILING SURFACES TO BE REMOVED FROM SITE.

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

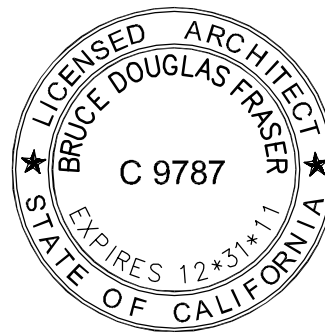

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.



SHEET TITLE

**PHASE I
DEMOLITION
FLOOR PLAN,
ROOF PLAN**

SHEET #

D2

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A1.1 - Phase 1 Site Plan.dwg, 4/29/2011 3:09:52 PM, PDF995

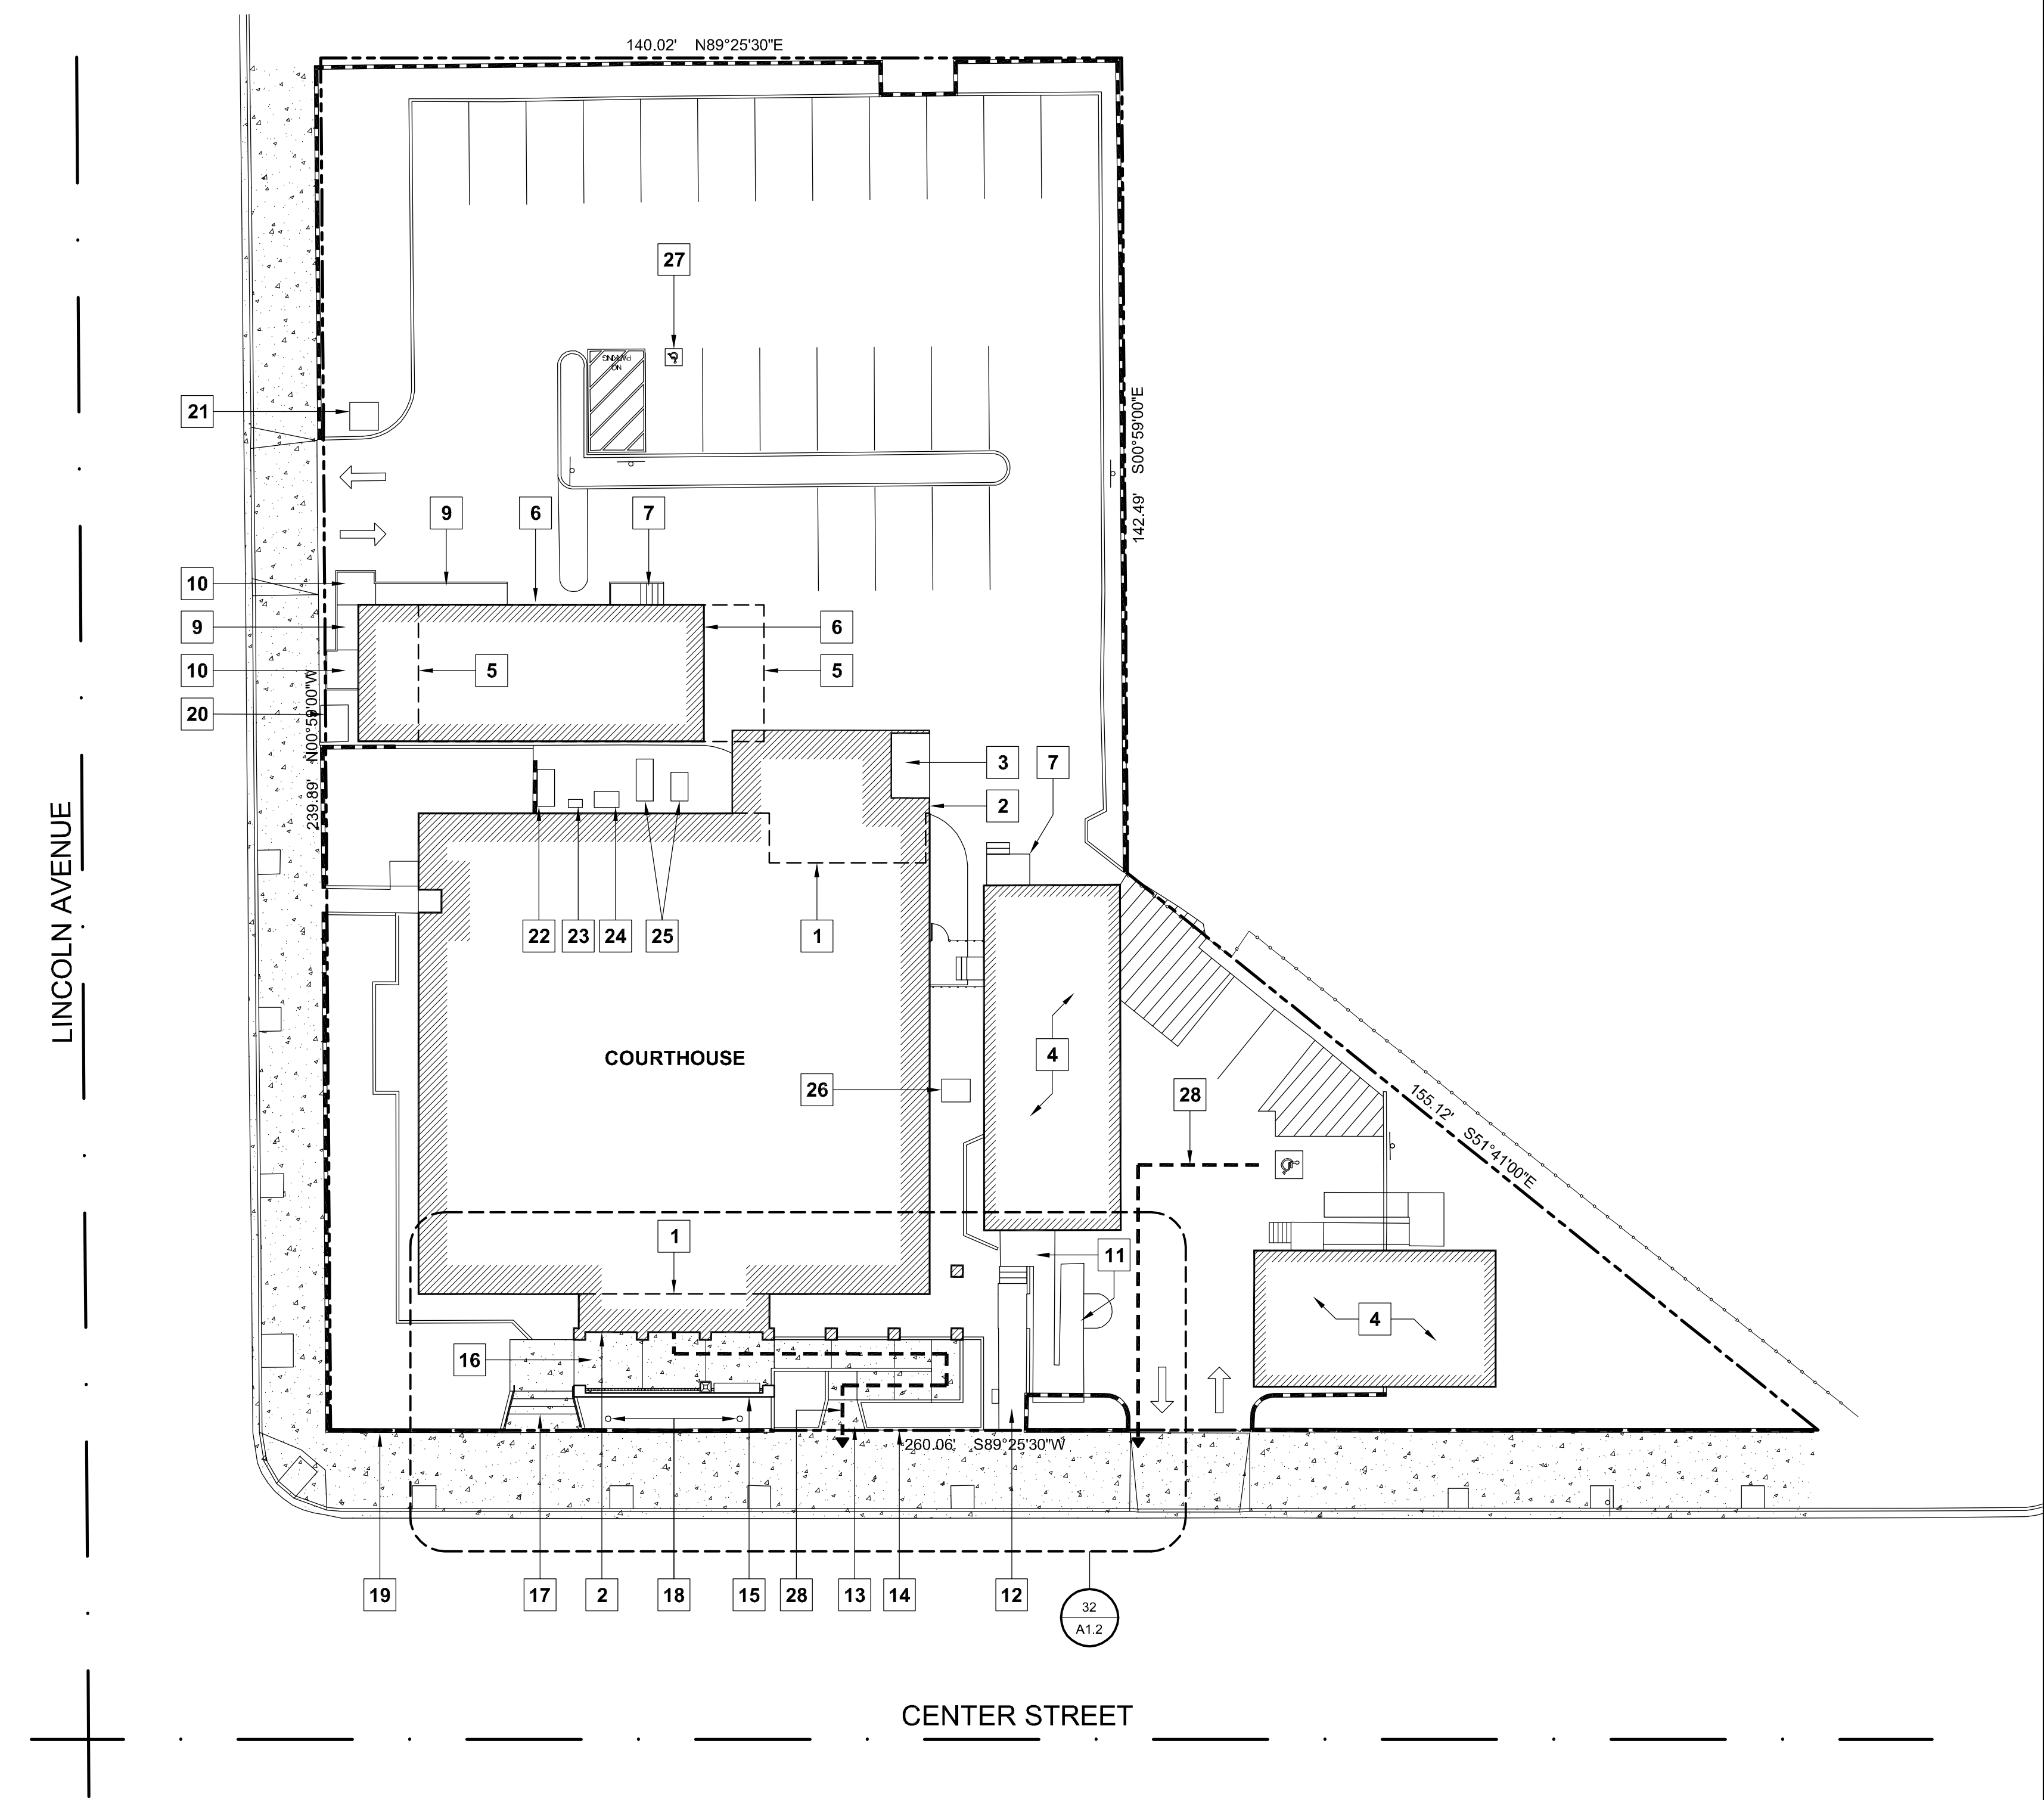

PHASE 1 SITE PLAN

SCALE: 1" = 20'-0"

SITE PLAN KEYNOTES

1. LINE OF EXISTING BUILDING WALL.
2. LINE OF NEW BUILDING WALL.
3. NEW CONCRETE SALLYPORT LANDING.
4. EXISTING PORTABLE BUILDING TO REMAIN.
5. EXISTING LOCATION OF EXISTING PORTABLE BUILDING TO REMAIN.
6. NEW LOCATION OF EXISTING PORTABLE BUILDING TO REMAIN.
7. RELOCATED WOOD STAIR SET.
8. RELOCATED WOOD LANDING.
9. NEW WOOD TEMPORARY RAMP WITH HANDRAIL.
10. NEW WOOD TEMPORARY LANDING WITH HANDRAIL.
11. EXISTING WOOD RAMP, STAIR SET, AND LANDINGS TO REMAIN.
12. EXISTING CONCRETE WALK TO REMAIN.
13. NEW CONCRETE RAMP AND LANDING.
14. NEW CONCRETE CURB.
15. NEW CONCRETE BLOCK WALL/SIGN MONUMENT.
16. NEW CONCRETE LANDING.
17. NEW CONCRETE STAIR SET.
18. EXISTING FLAGPOLES TO REMAIN.
19. EXISTING CONCRETE BLOCK WALLS TO REMAIN.
20. (E) TRANSFORMER.
21. (E) PG&E VAULT.
22. (E) PG&E METER.
23. (E) GAS METER.
24. (E) MAIN ELECTRICAL PANEL.
25. (E) RELOCATED AC UNITS.
26. (E) AC UNIT.
27. RESTRIPE (E) ACCESSIBLE PARKING STALL PER DETAIL 31/A1.3. IF EXISTING SIGNAGE DOES NOT MEET SUBSTANTIAL COMPLIANCE, REPLACE PER DETAILS 42 & 44/A1.3.
28. ACCESSIBLE PATH OF TRAVEL TO PUBLIC WAY; MAX. SLOPE 5% IN DIRECTION OF TRAVEL; MAX. CROSS SLOPE 2% IN ANY DIRECTION.

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

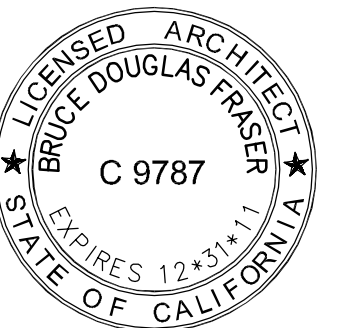

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

PHASE I SITE PLAN

SHEET #

A1.1

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

FRASER
SEIPLE
ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com


PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

06/20/11

SIGNED

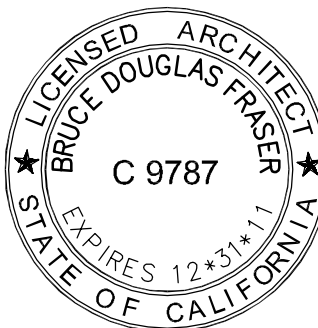

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

PHASE I
SITE DETAILS

SHEET #

A1.2

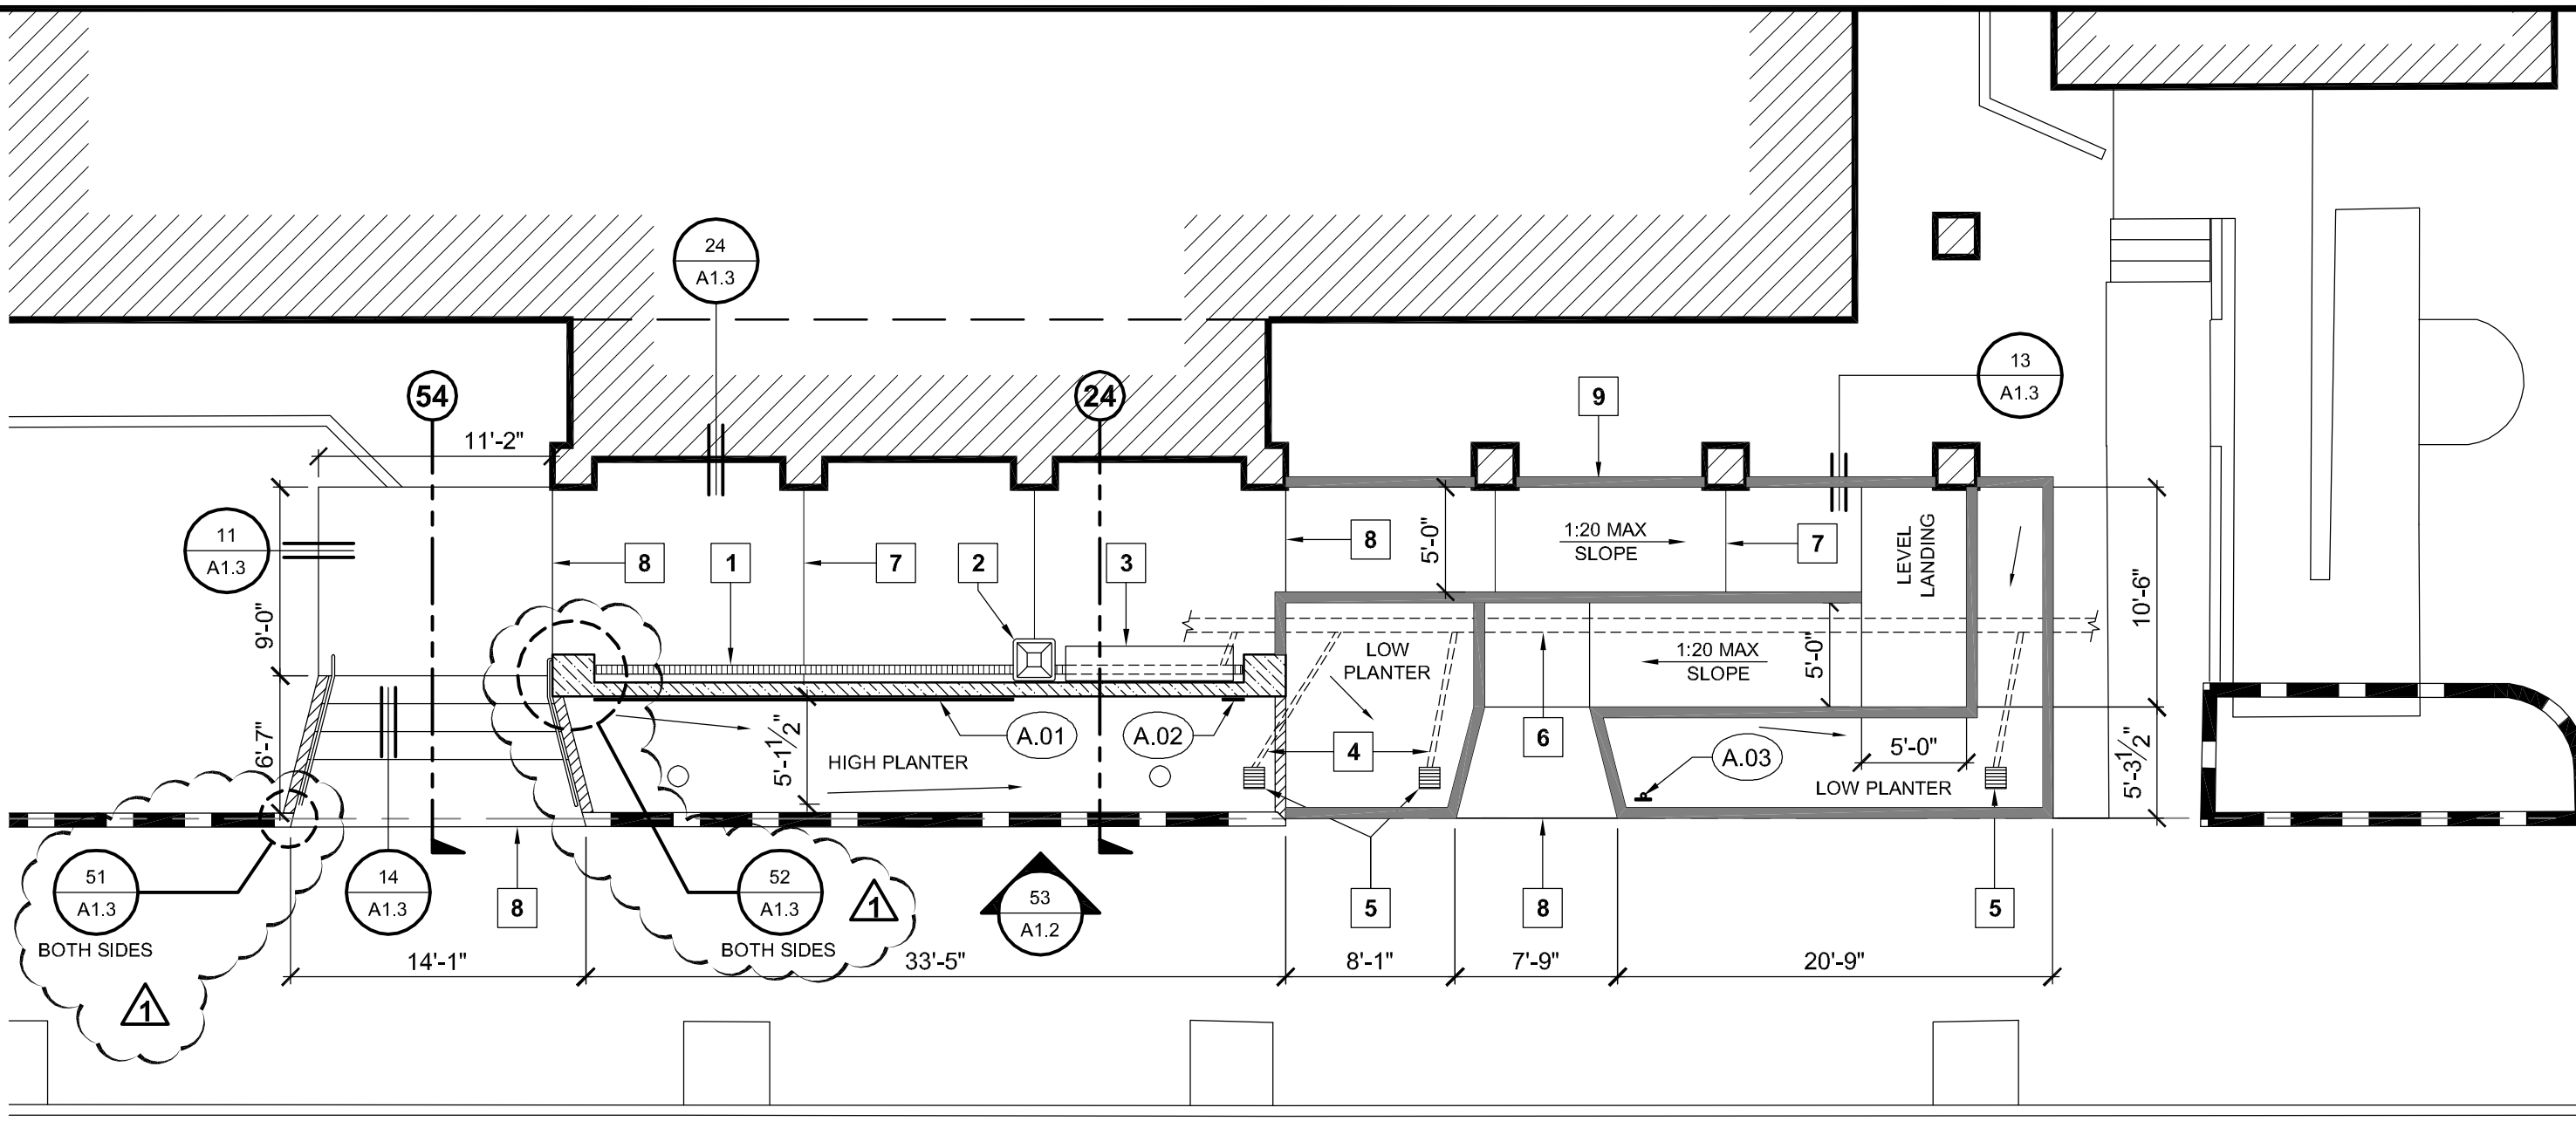

SITE KEYNOTES

1. LINEAR DRAIN w/ IRON GRATE.
2. TRASH RECEPTACLE.
3. BENCH.
4. 3"Ø SCHEDULE 40 PVC DRAIN LINE. CONNECT TO EXISTING STORMWATER PIPE.
5. 12"x12" CONCRETE DROP INLET w/ PLASTIC YARD GRATE.
6. (E) 8"Ø CONCRETE STORMWATER PIPE.
7. CONTROL JOINT, TYP.
8. EXPANSION JOINT PER DETAIL 12/A1.3
9. 6" CONCRETE CURB WALL, SEE NOTE 10 UNDER ELEVATION KEYNOTES.

8x4x16 CONCRETE BLOCK RETAINING WALL, EXISTING

NEW 8" CONCRETE BLOCK RETAINING WALL, TOP AT +102.50


NEW 8" CONC. BLOCK SIGN WALL AND 24" SQ. PILASTERS, TOP AT +106.00

NEW 6" WIDE CONC. WHEEL GUIDE / CURB, 6" ABOVE RAMP / WALK SURFACE

32

PHASE I - ENLARGED SITE PLAN


SCALE: 1/8" = 1'-0"

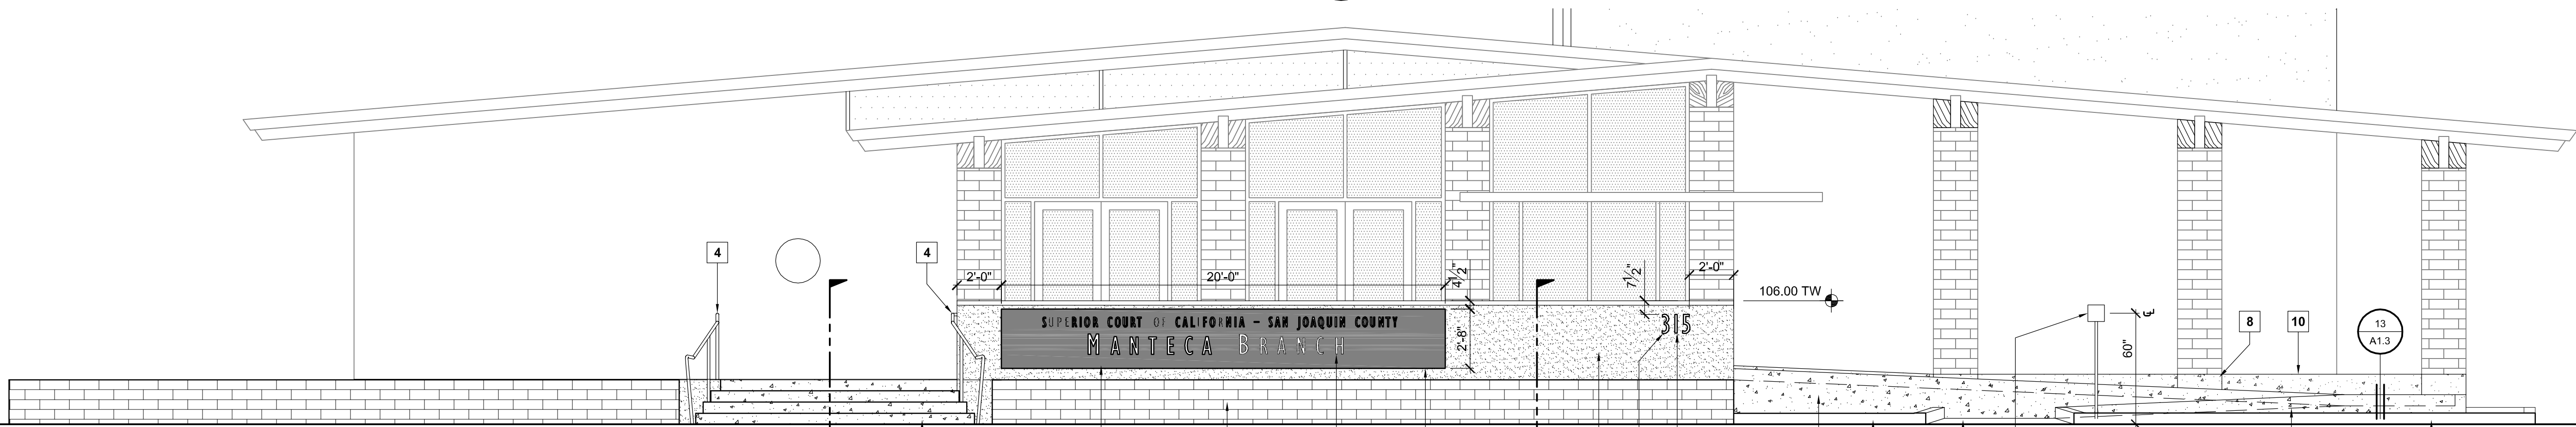

53

SIGN WALL ELEVATION

SCALE: 1/4" = 1'-0"

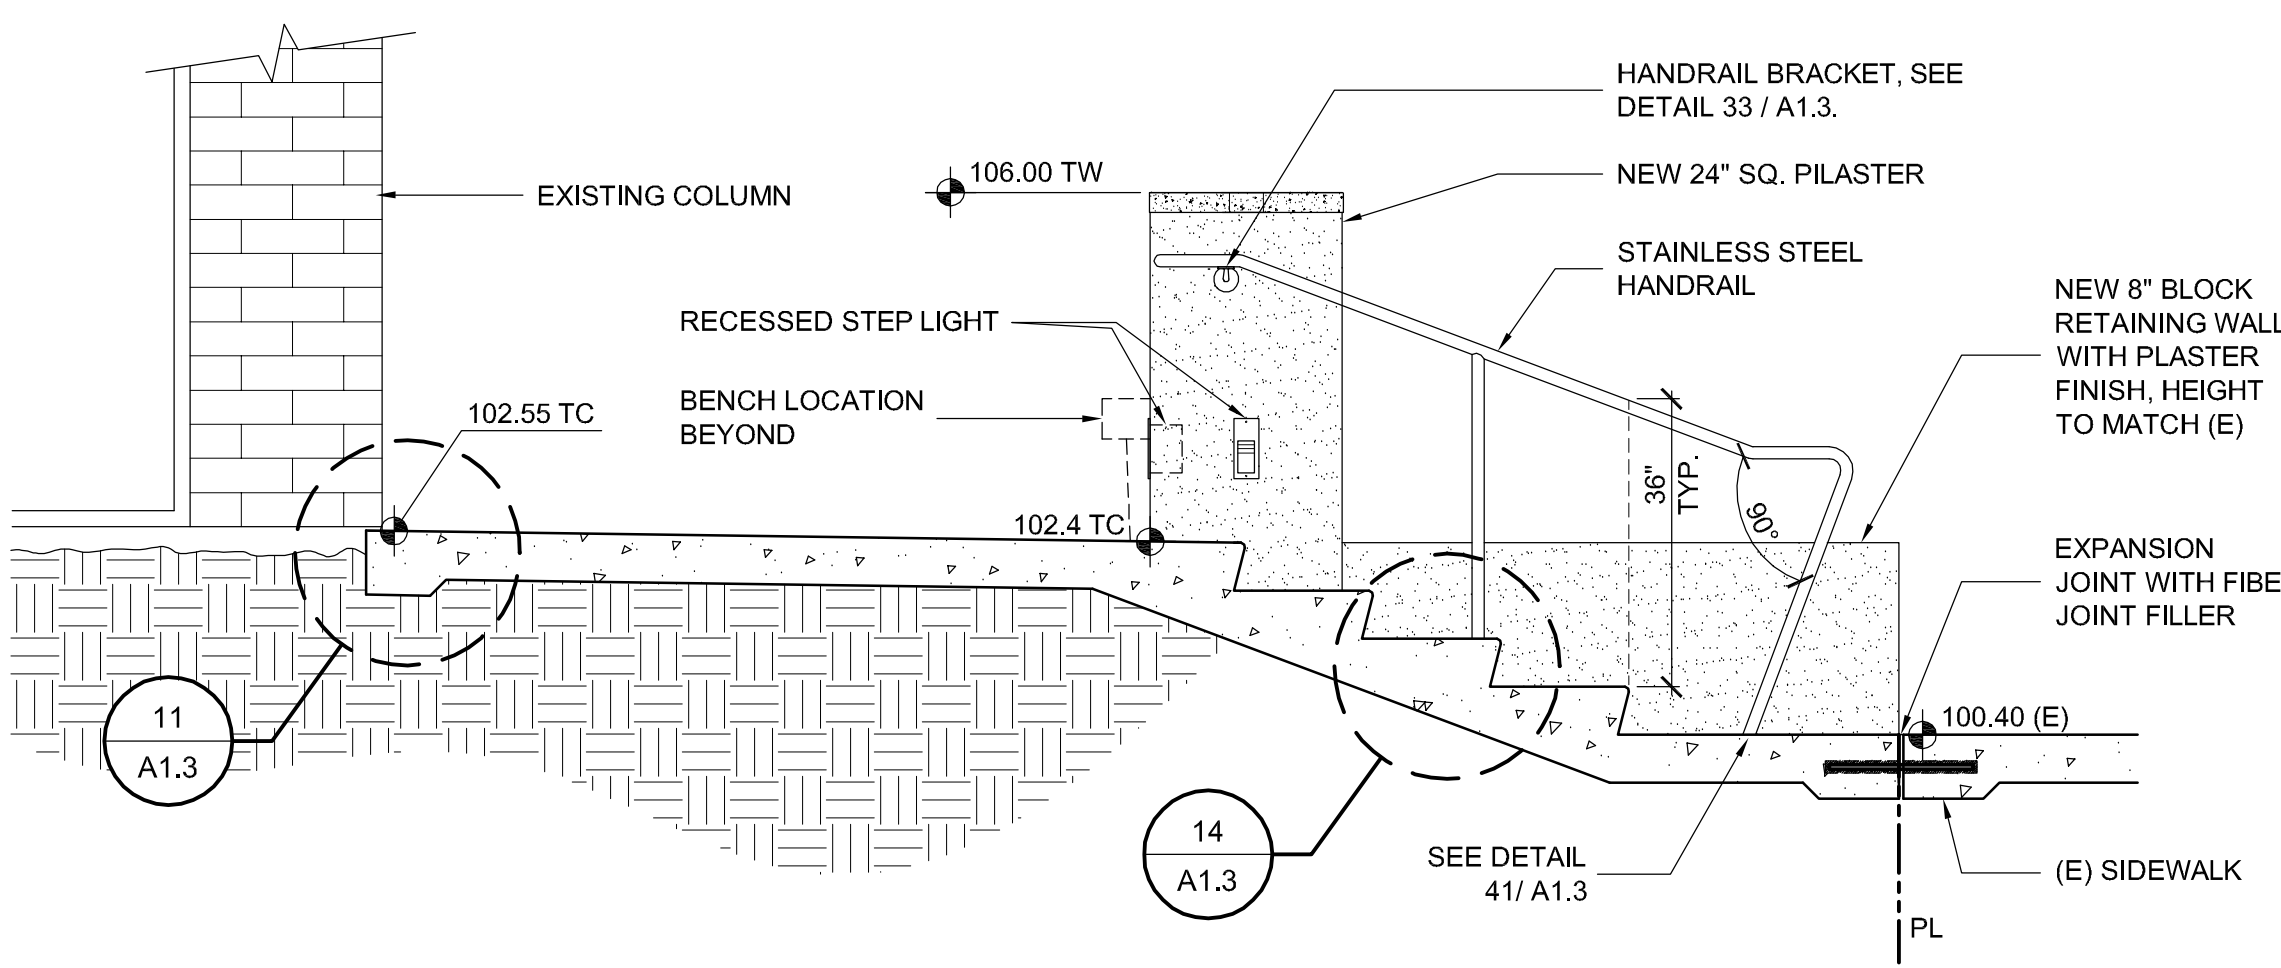


54

STAIR SECTION

SCALE: 1/8" = 1'-0"

ELEVATION KEYNOTES


1. ALUMINUM COMPOSITE SIGNBOARD.
2. RAISED BRUSHED ALUMINUM LETTERS, GILL SANS MT CONDENSED TYPEFACE.
3. NEW BLOCK WALL WITH PLASTER FINISH, COLOR TO MATCH (E) BLOCK WALL.
4. HANDRAIL.
5. NEW CONCRETE STEPS.
6. NEW RAMP AT 5% MAX. SLOPE.
7. LINE OF RAMP BEYOND.
8. 6" CONCRETE CURB AT PLANTER.
9. EXISTING RETAINING WALL TO REMAIN.
10. CONCRETE CURB, HEIGHT TO MATCH BOTTOM OF (E) BLOCK COLUMNS. MAINTAIN HEIGHT OF 6" ABOVE ADJACENT RAMP BETWEEN THE TOP LANDING AND THE FIRST COLUMN.
11. GROUND, SACK AND COAT (E) CONCRETE TO MATCH ADJACENT.
12. 6" CONCRETE CURB WALL, 6" ABOVE SURFACE OF RAMP.

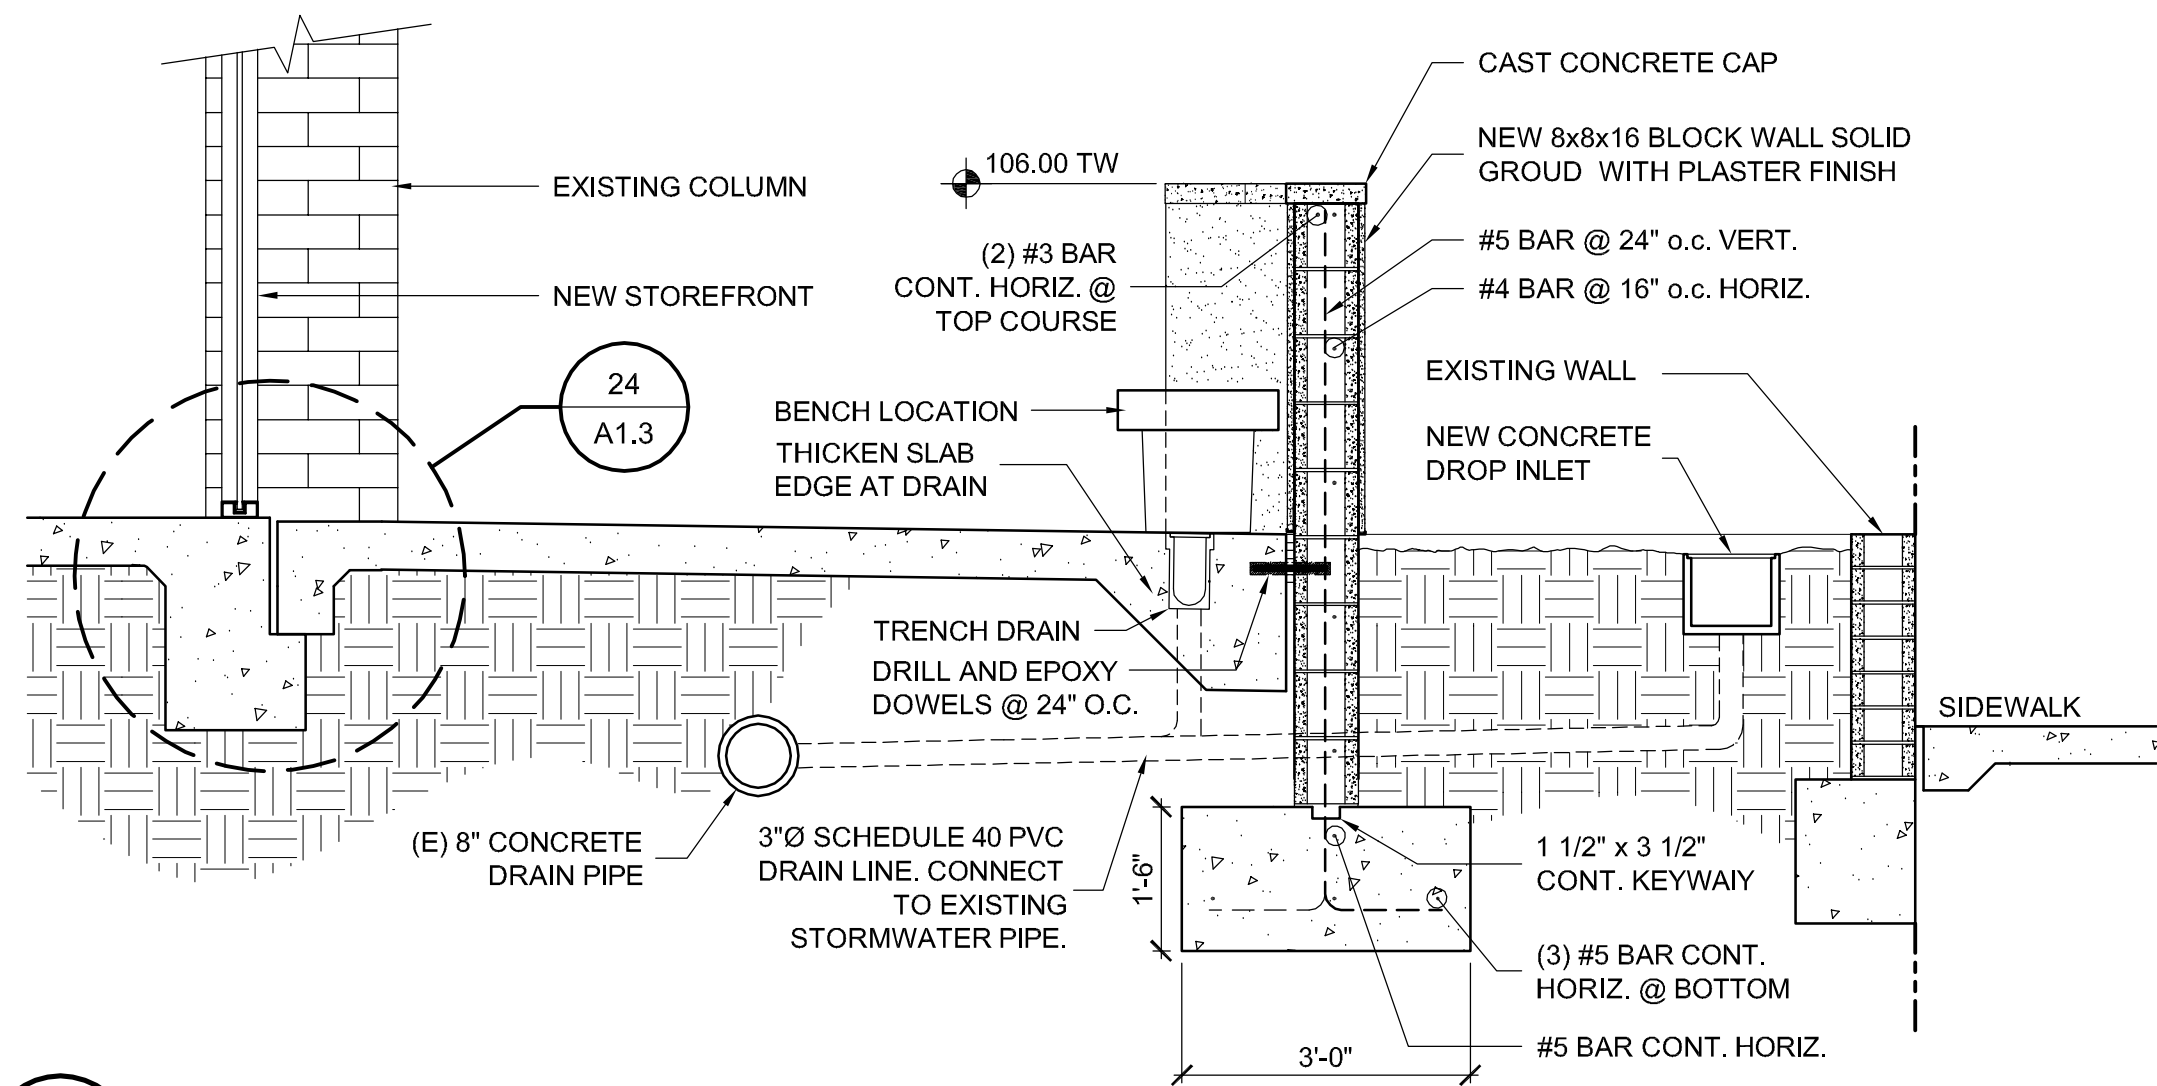

24

SIGN WALL SECTION

SCALE: 1/8" = 1'-0"

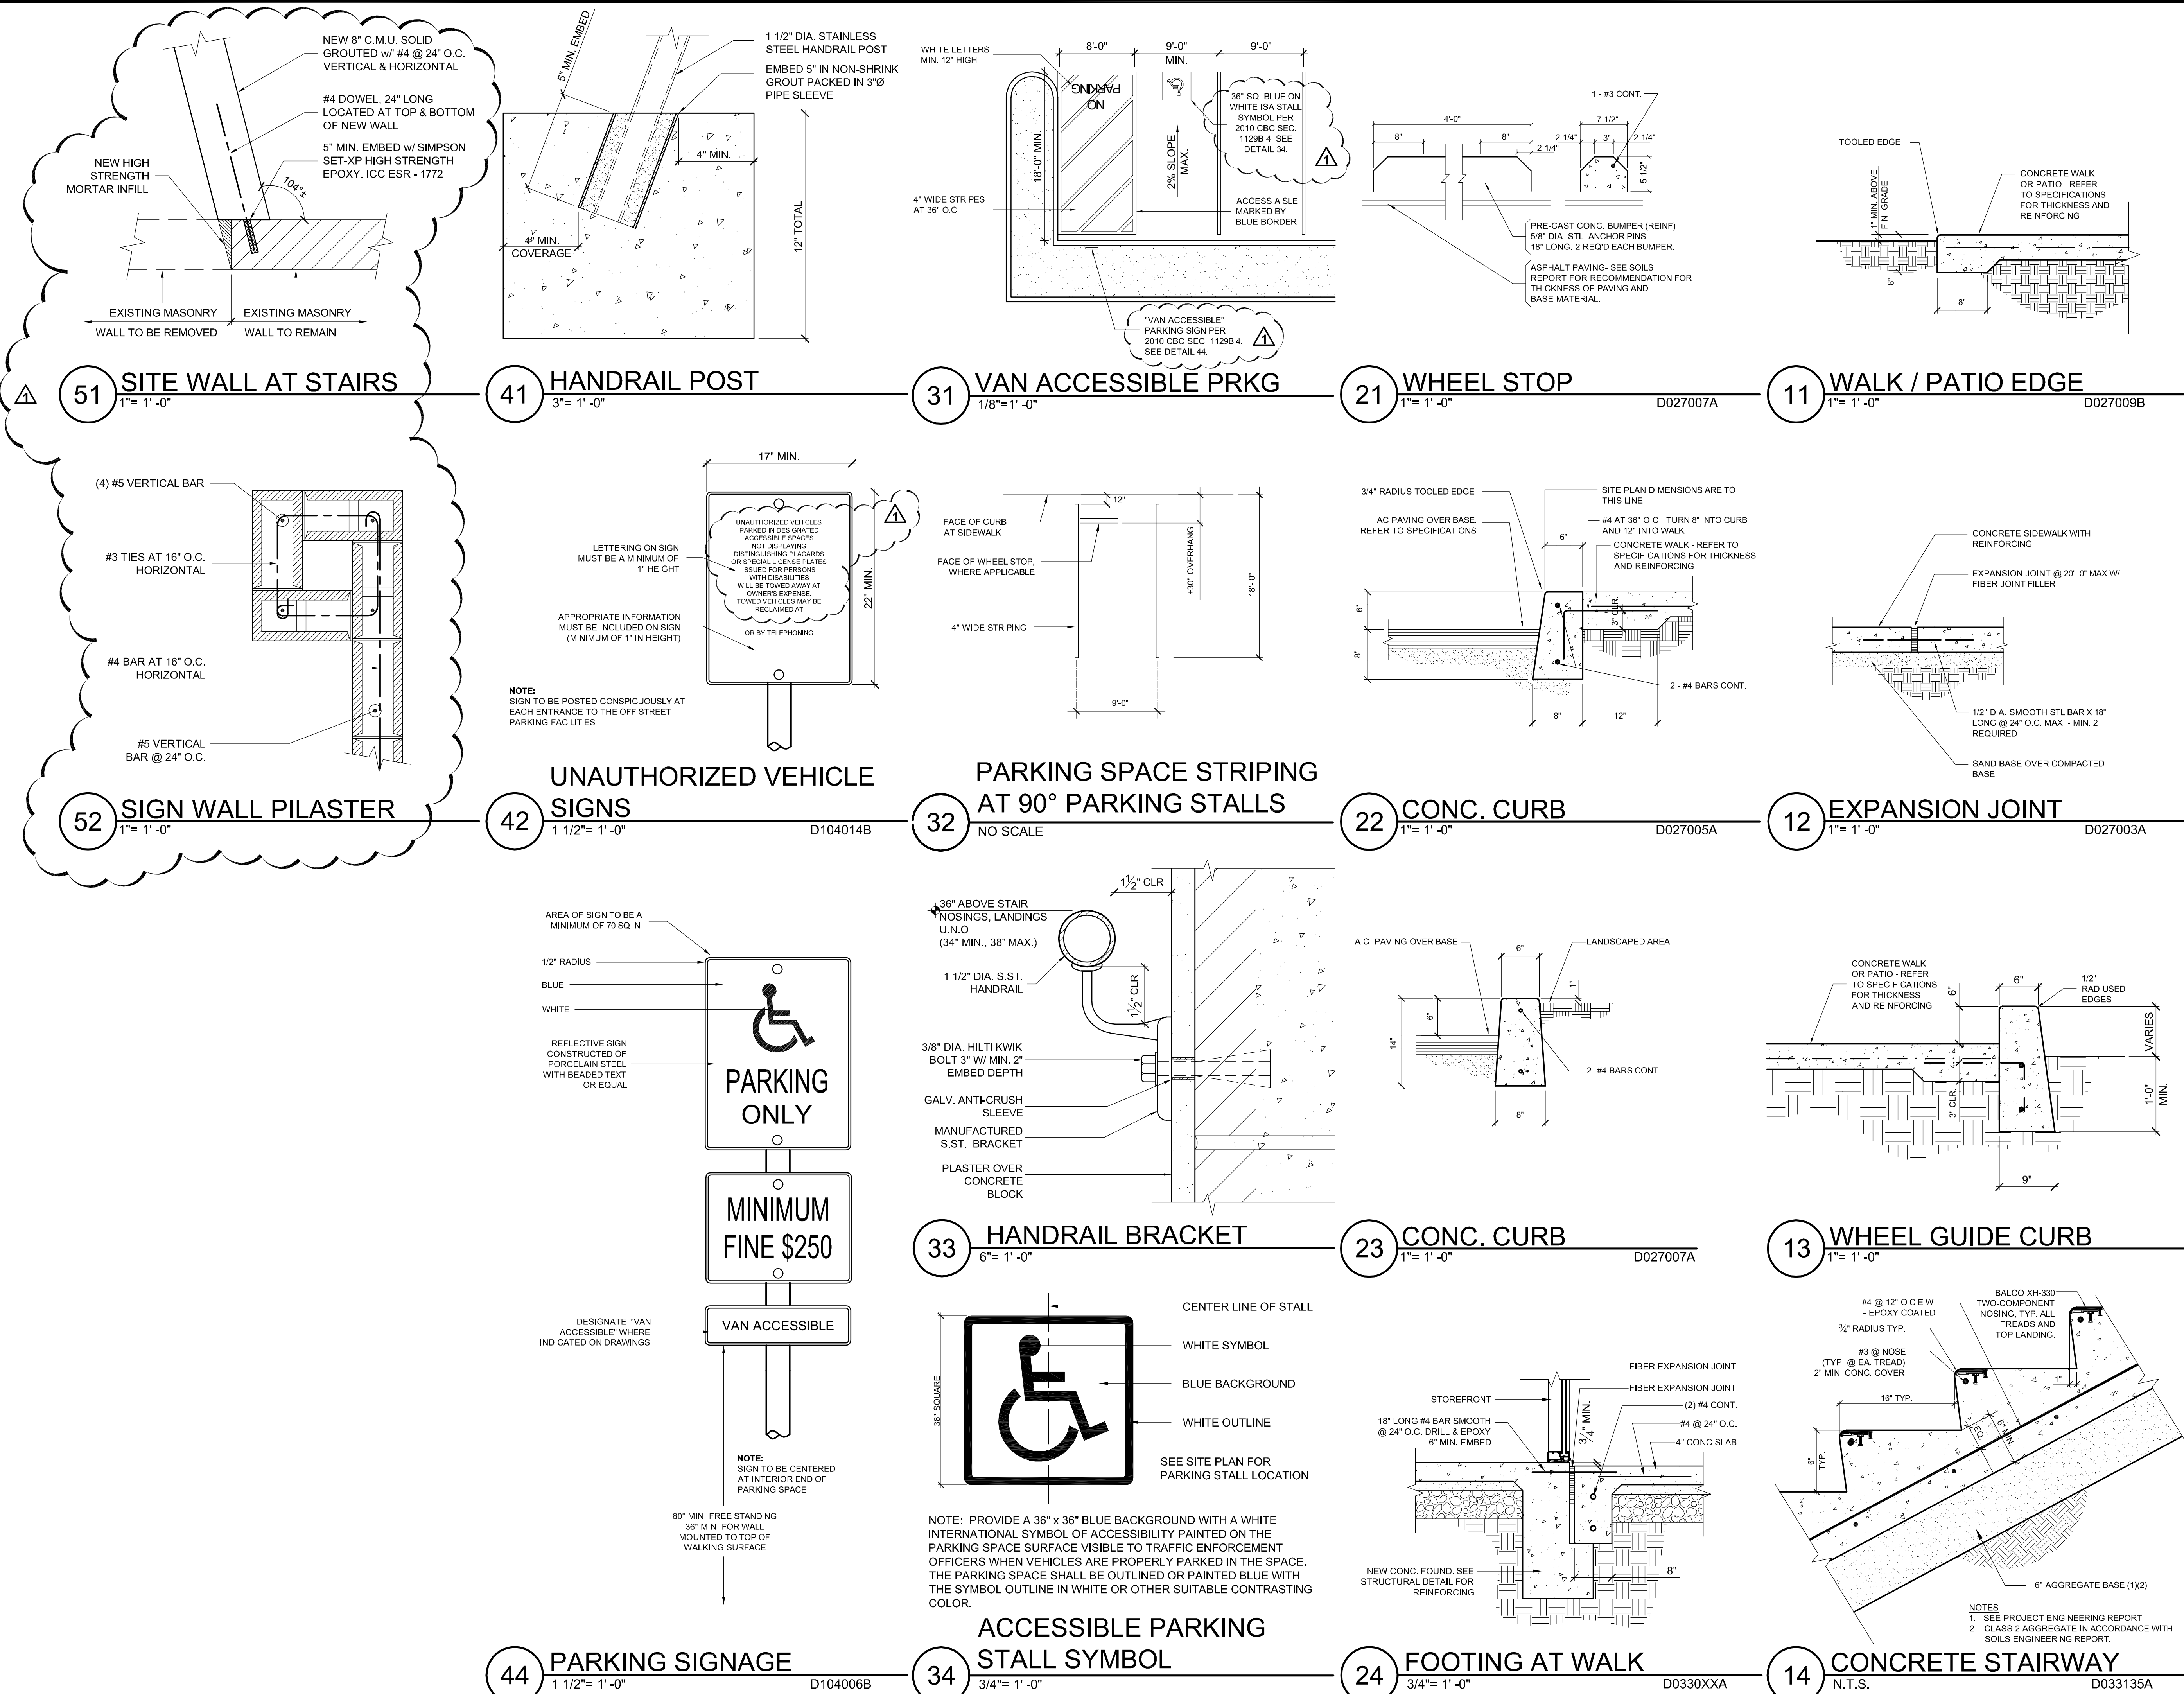

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com


PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

06/20/11

SIGNED

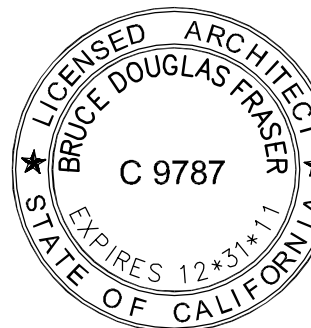

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.



SHEET TITLE

**PHASE I
SITE DETAILS**

SHEET #

A1.3

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A2.1 - Phase I Descriptive Floor Plan.dwg, 4/29/2011 3:13:43 PM, PDF595

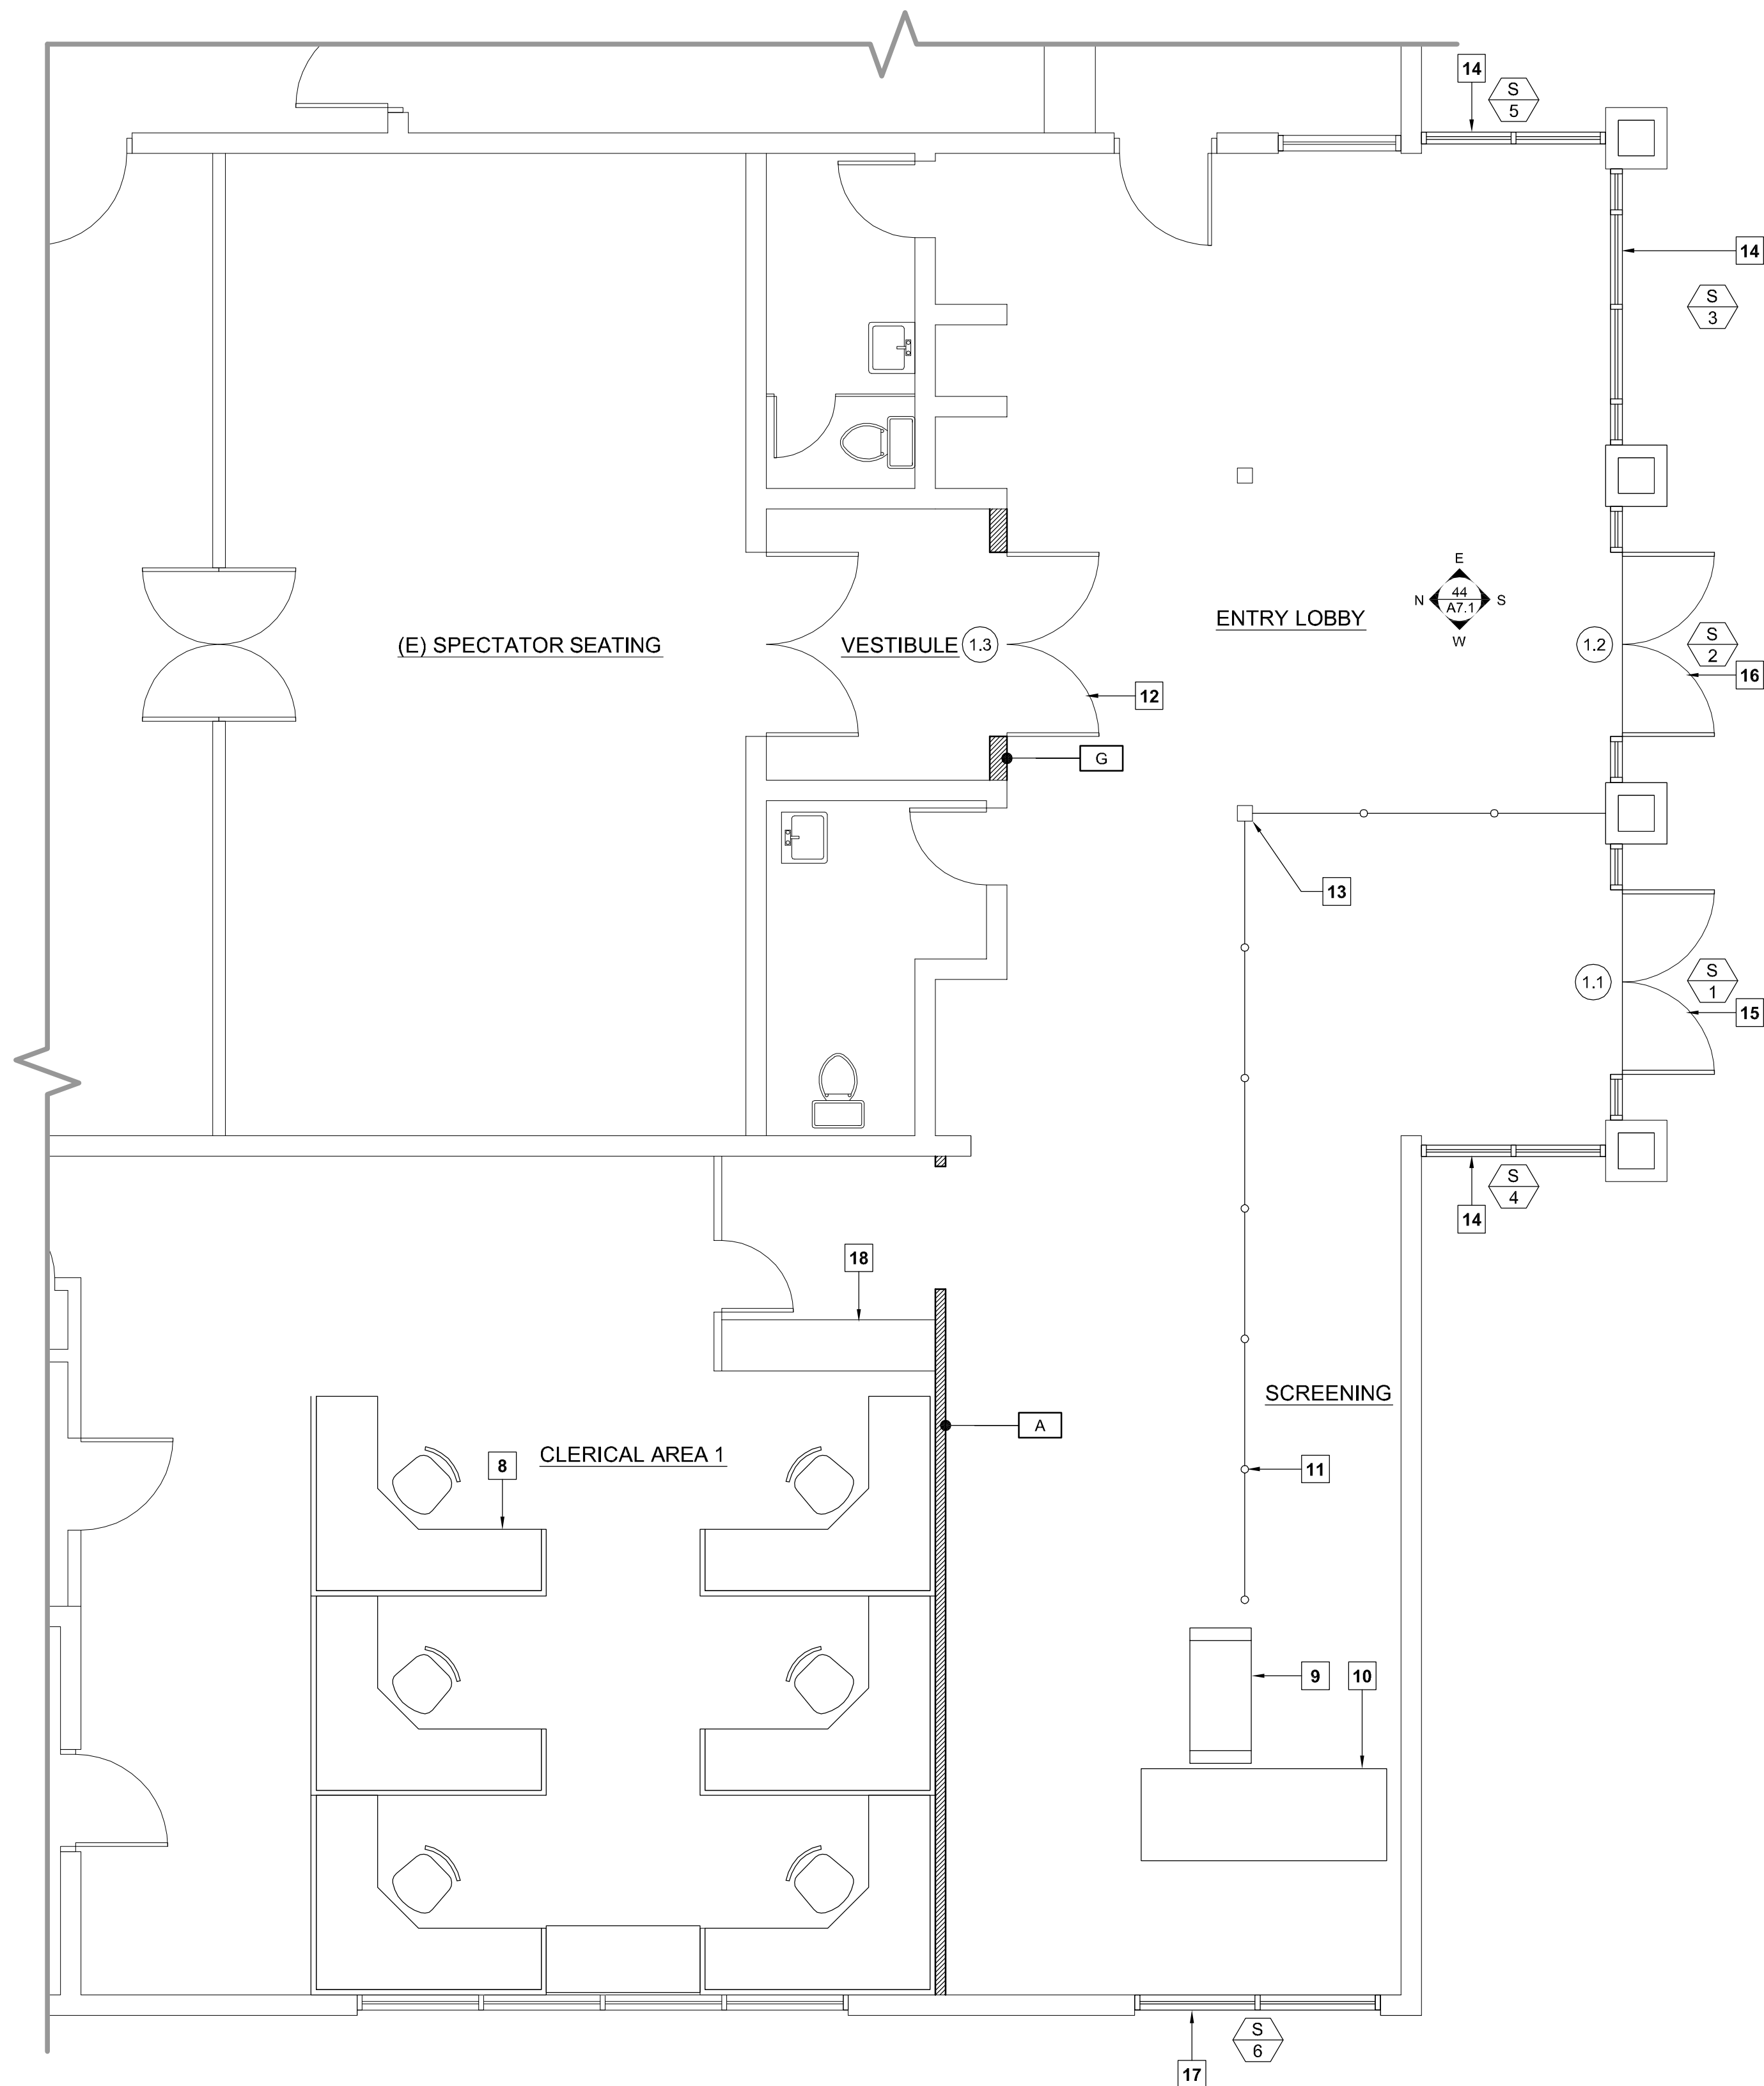

PHASE I FLOOR PLAN - LOBBY



SCALE: 1/4" = 1'-0"

LEGEND

- NEW WALL
- EXISTING WALL TO REMAIN



FLOOR PLAN KEYNOTES

- 2040 SOLID CORE WOOD DOOR.
- 3070 SOLID CORE STEEL DOOR.
- "COMBY" TOILET / SINK / BUBBLER.
- STAINLESS STEEL PRIVACY SCREEN.
- STAINLESS STEEL 12" FLOOR MOUNTED BENCH.
- 3070 SOLID CORE WOOD DOOR.
- 12-1/2"W X 16-1/2" H STAINLESS STL. MIRROR.
- NEW PREFABRICATED WORK STATIONS AND PARTITIONS.
- WALK-THROUGH METAL DETECTOR BY OTHERS.
- PACKAGE SCANNER BY OTHERS.
- NEW PORTABLE CROWD CONTROL STANCHIONS WITH 48" SOLID PANELS.
- NEW PAIR OF 3080 SOLID CORE WOOD DOORS.
- EXISTING STEEL COLUMN TO REMAIN.
- NEW GLAZED STOREFRONT INFILL.
- NEW STOREFRONT ENTRY - PUBLIC ENTRANCE.
- NEW STOREFRONT ENTRY - EXIT
- STOREFRONT REPLACED WITH TEMPORARY ENTRANCE DURING CONSTRUCTION OF NEW LOBBY.
- EXISTING SERVICE COUNTER TO REMAIN.
- OPENING TO BE TEMPORARILY BLOCKED OFF UNTIL PHASE 2 CONSTRUCTION COMMENCES.
- ROOF ACCESS LADDER.

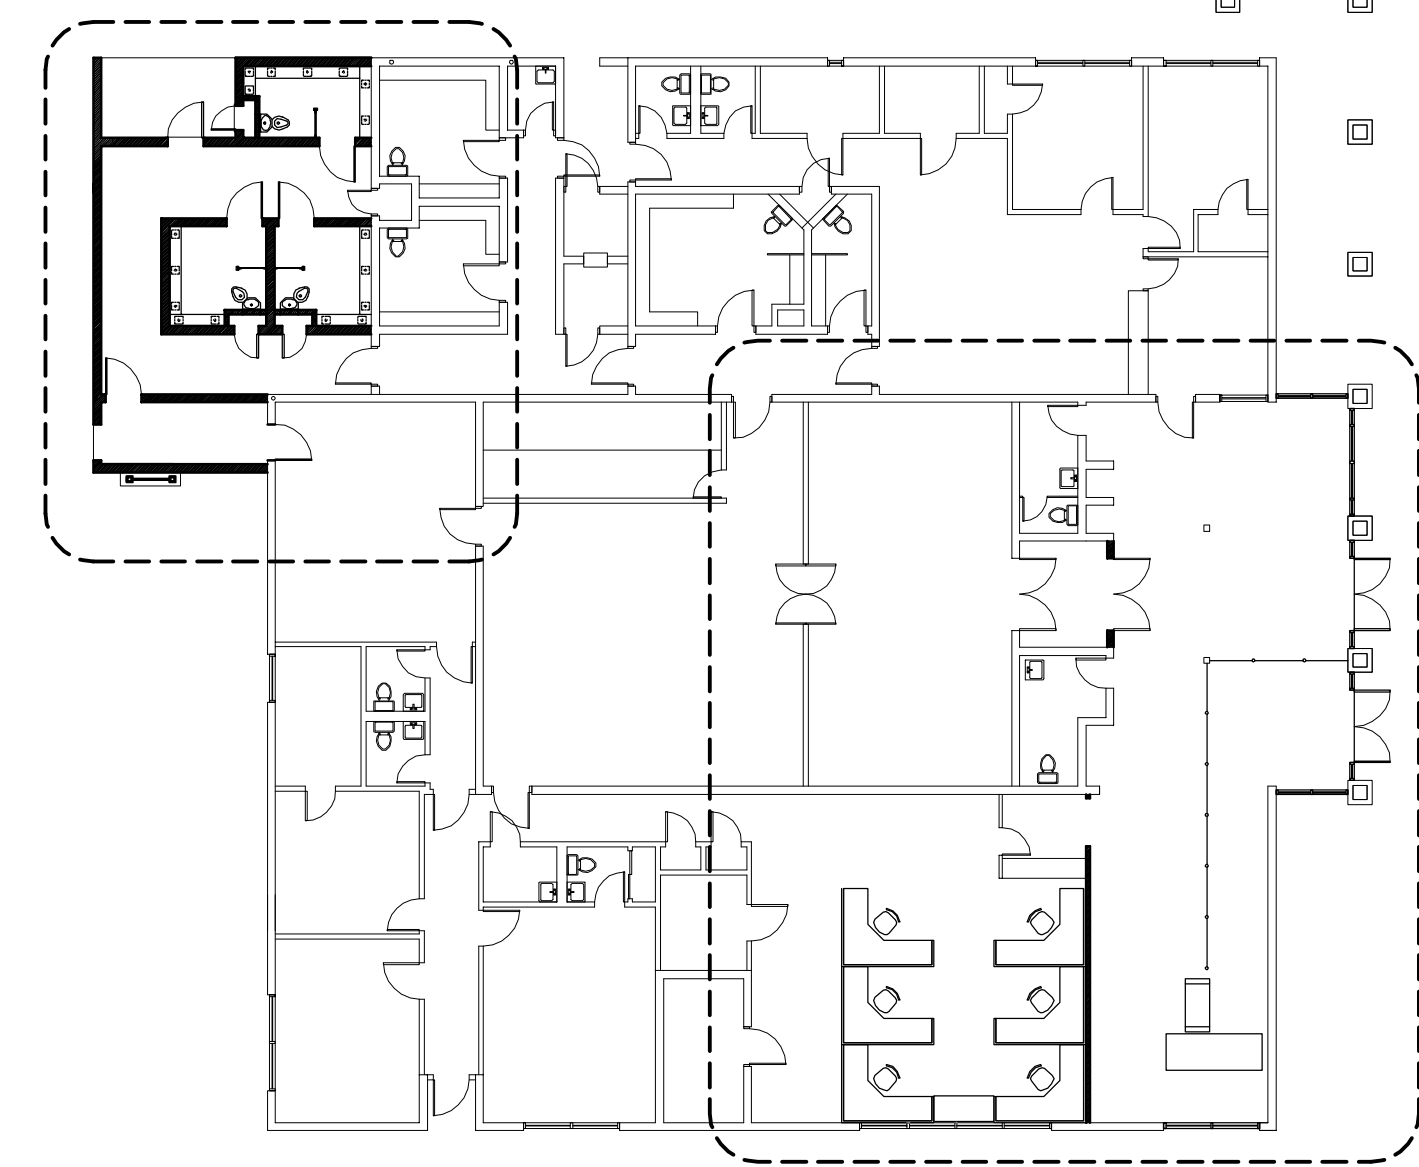

PHASE I KEY PLAN

SCALE: 1/16" = 1'-0"

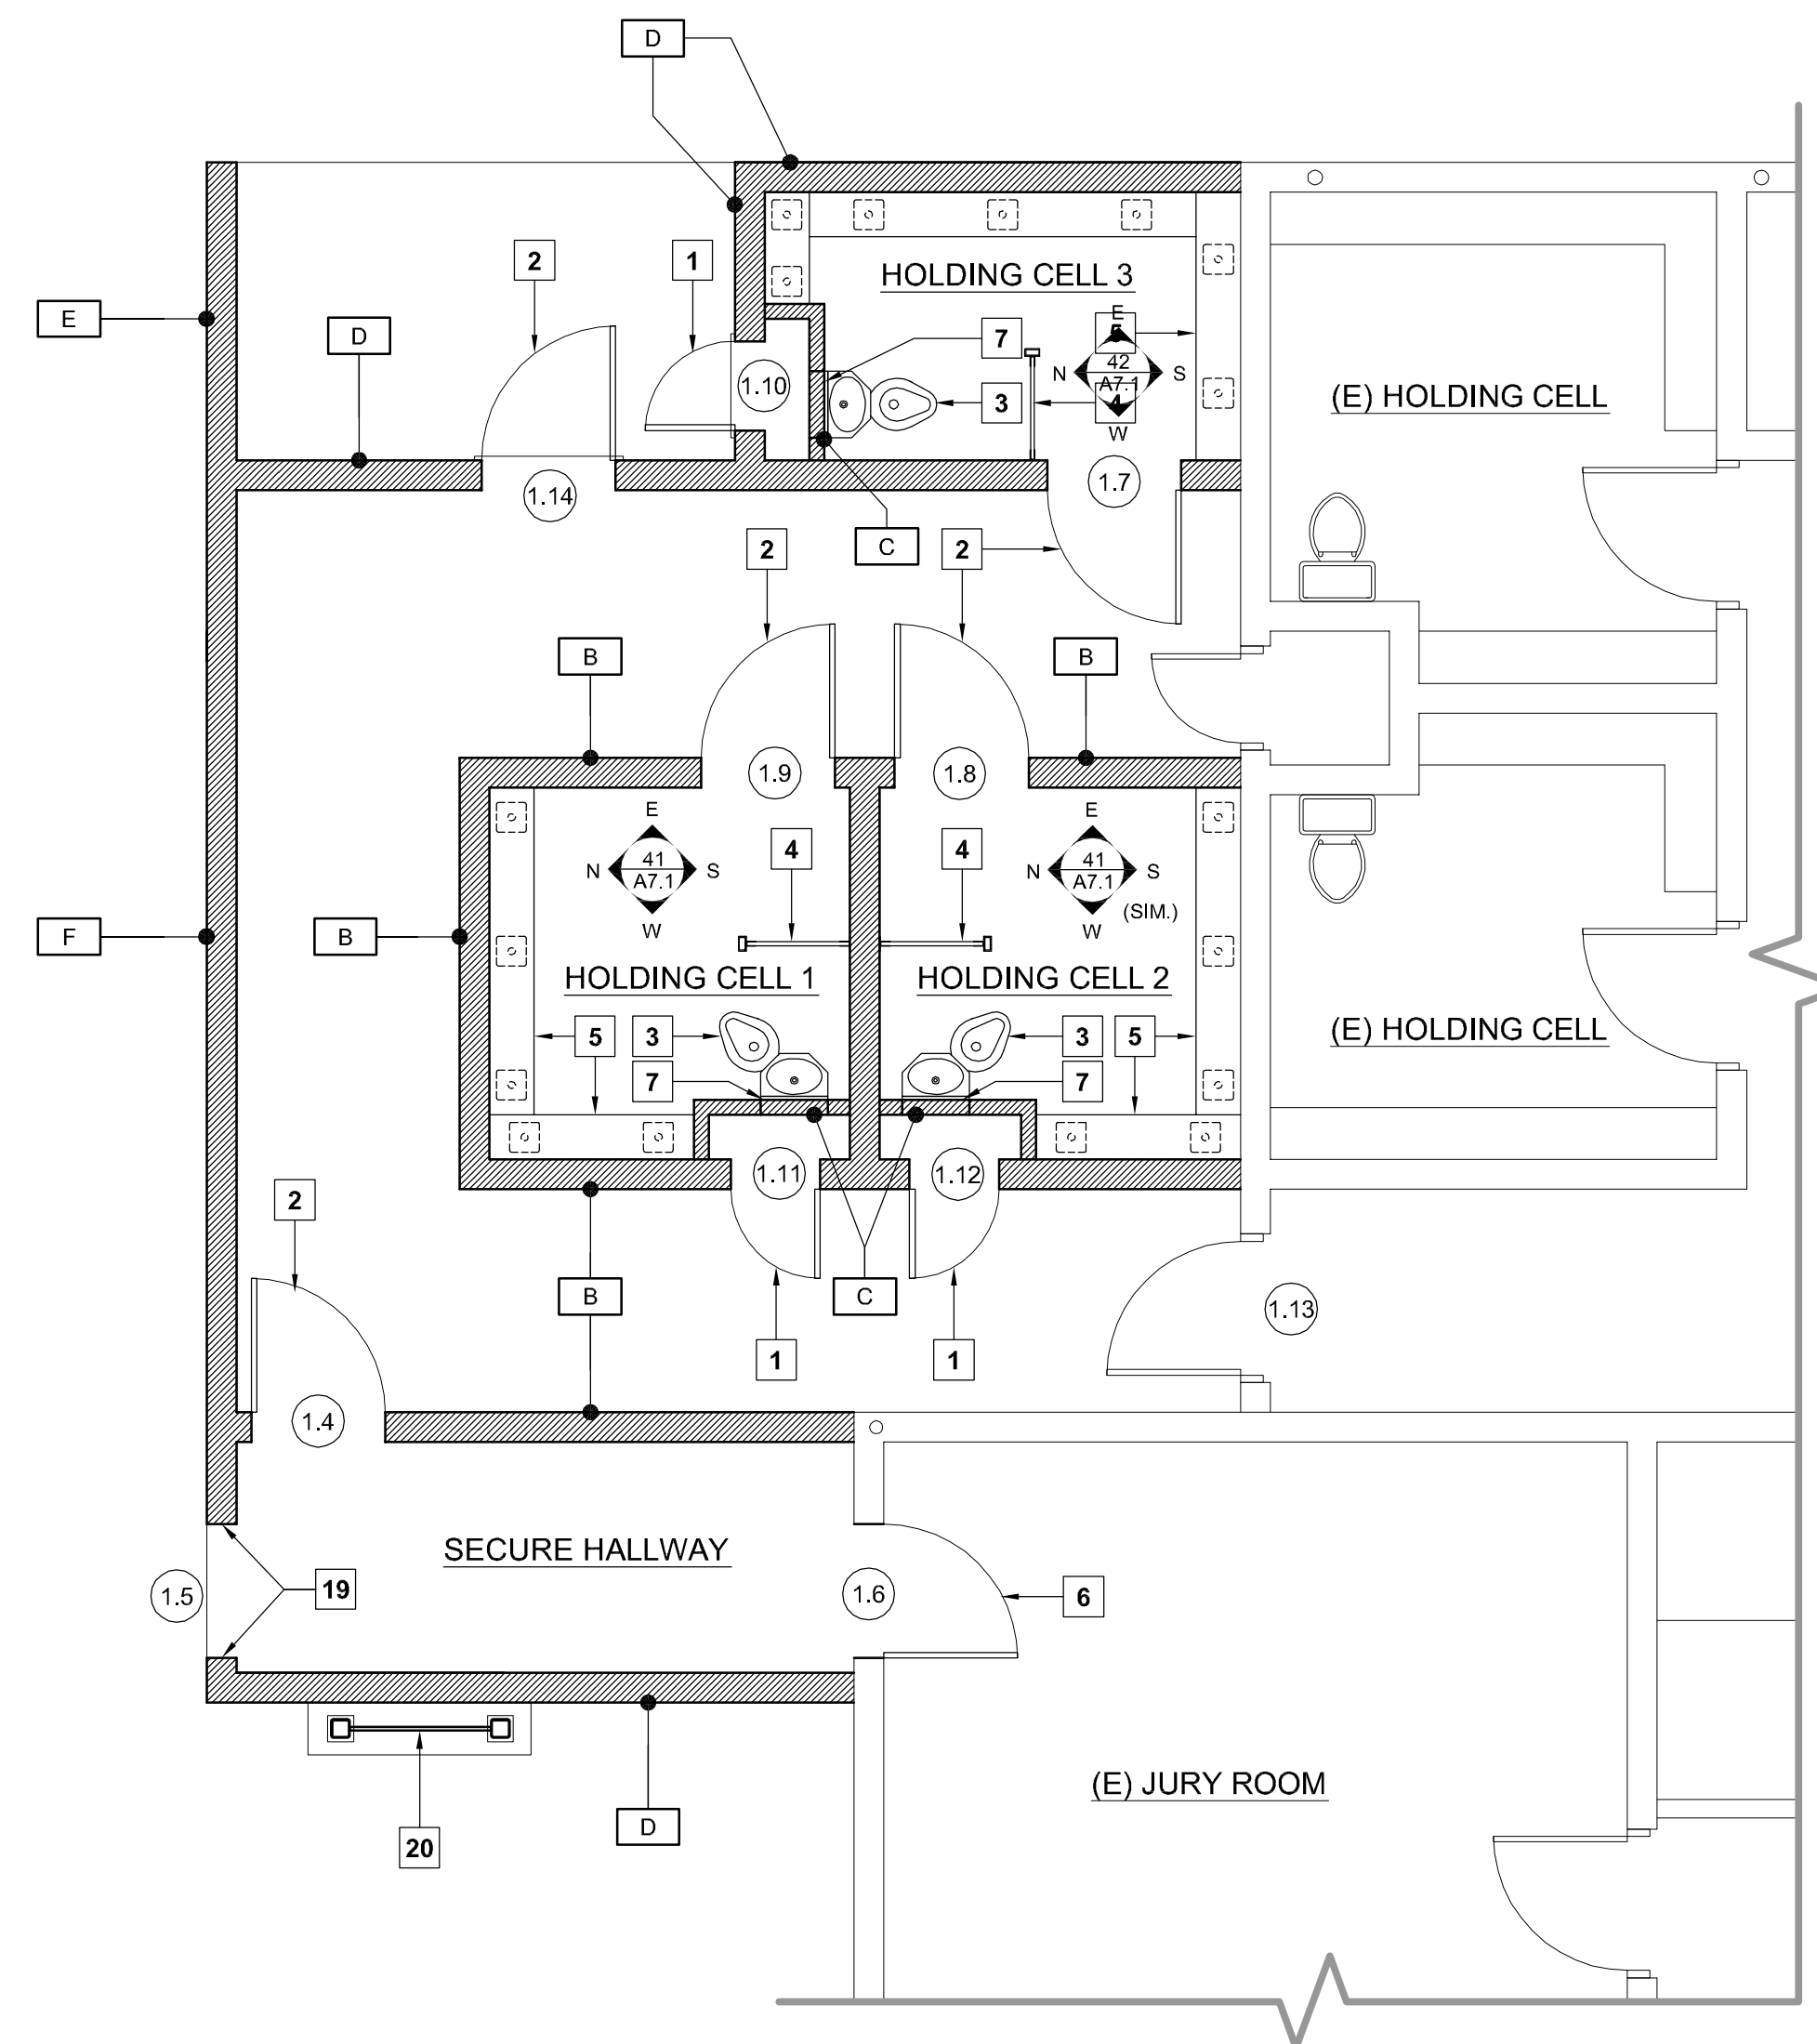

PHASE I FLOOR PLAN - HOLDING CELL ADDITION

SCALE: 1/4" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

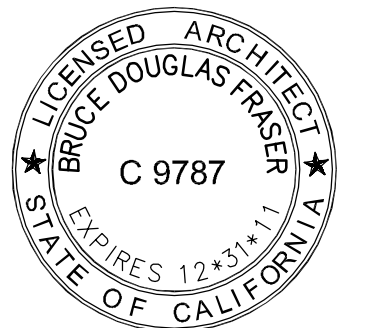

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
DESCRIPTIVE
FLOOR PLAN**

SHEET #


A2.1

\\John\\Manteca Courthouse 1007\\Drawings\\Sheets\\Phase I\\A2.1 - Phase I Descriptive Floor Plan.dwg, 4/29/2011 3:14:45 PM, PDF995

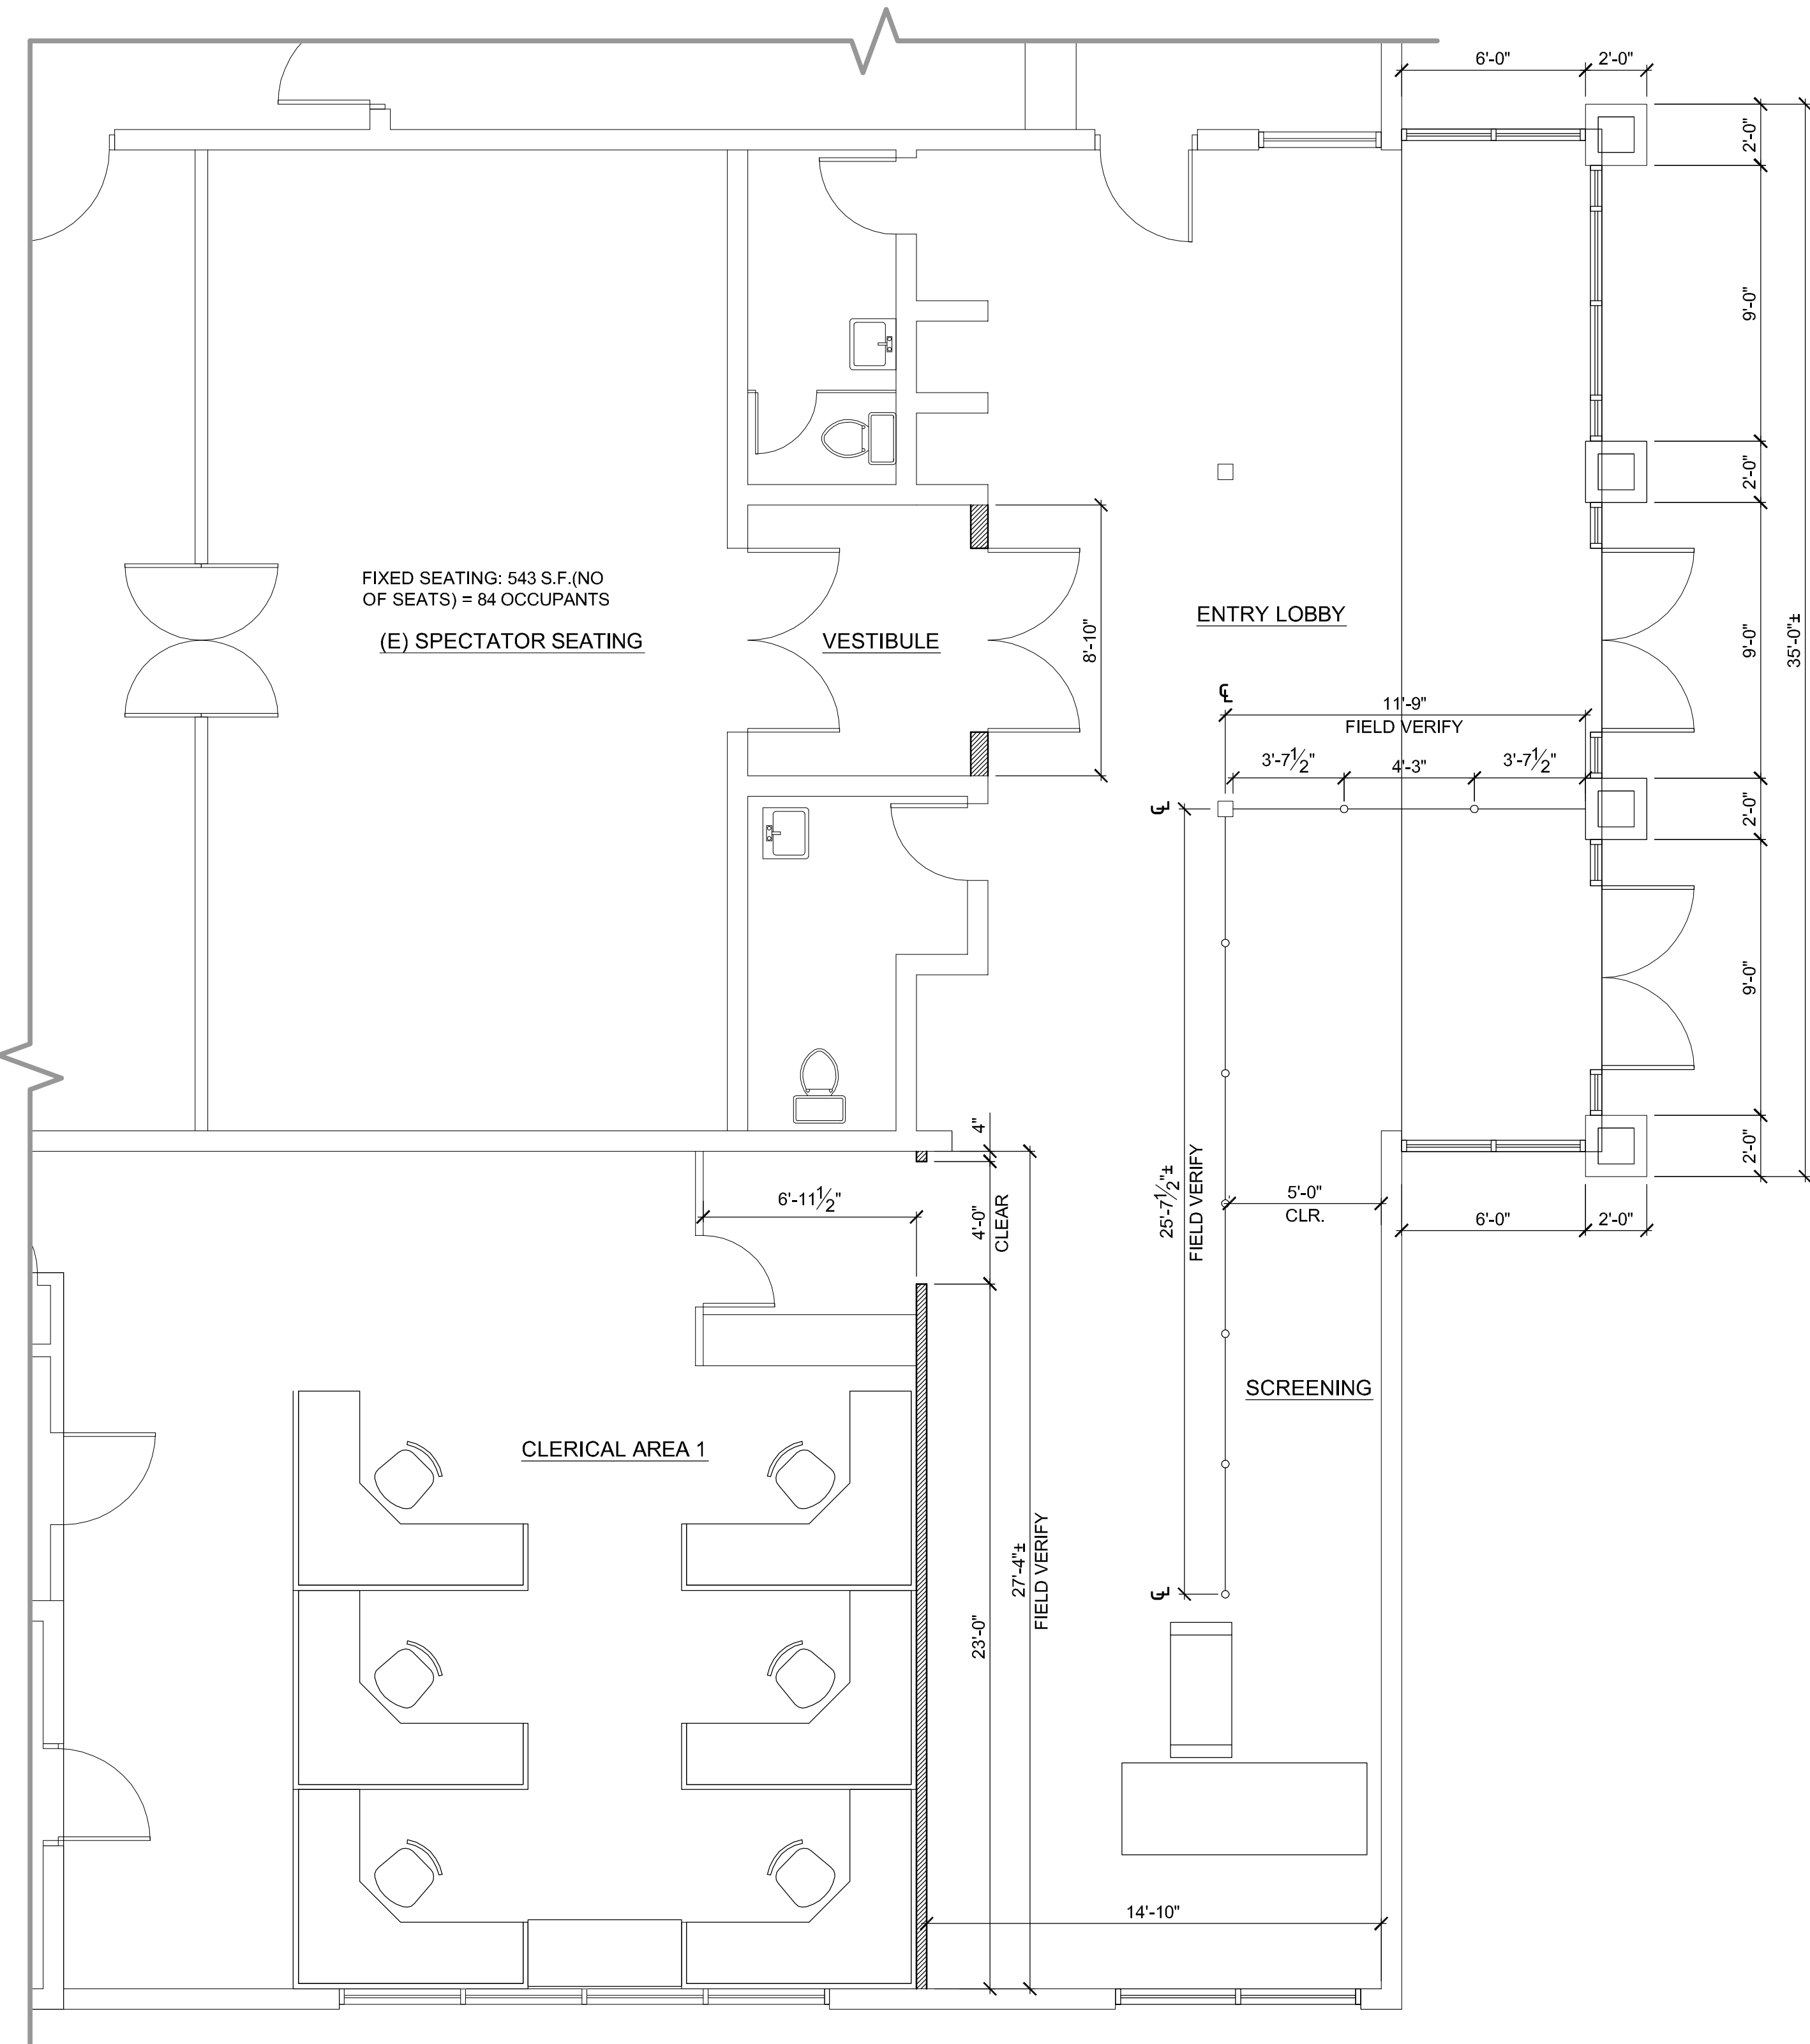


PHASE I FLOOR PLAN - LOBBY
SCALE: 1/4" = 1'-0"

NOTE
1. DIMENSIONS AT HOLDING CELL ADDITION
ARE TO FACE OF CONCRETE BLOCK.

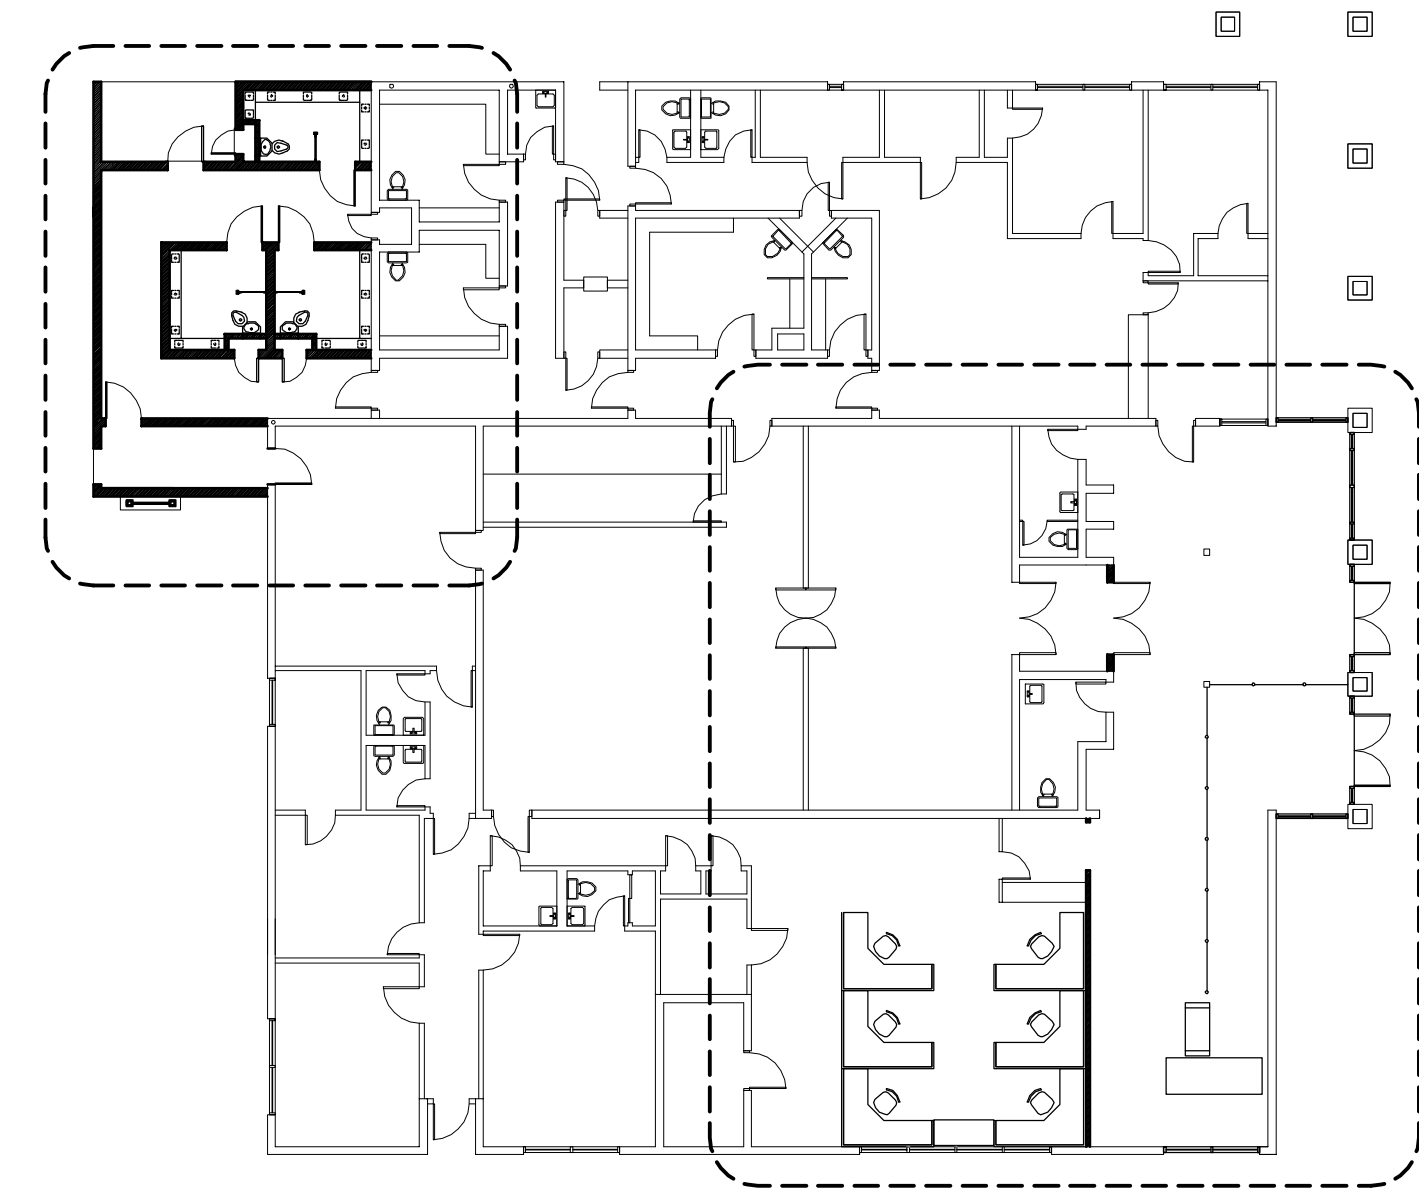

PHASE I KEY PLAN
SCALE: 1/16" = 1'-0"

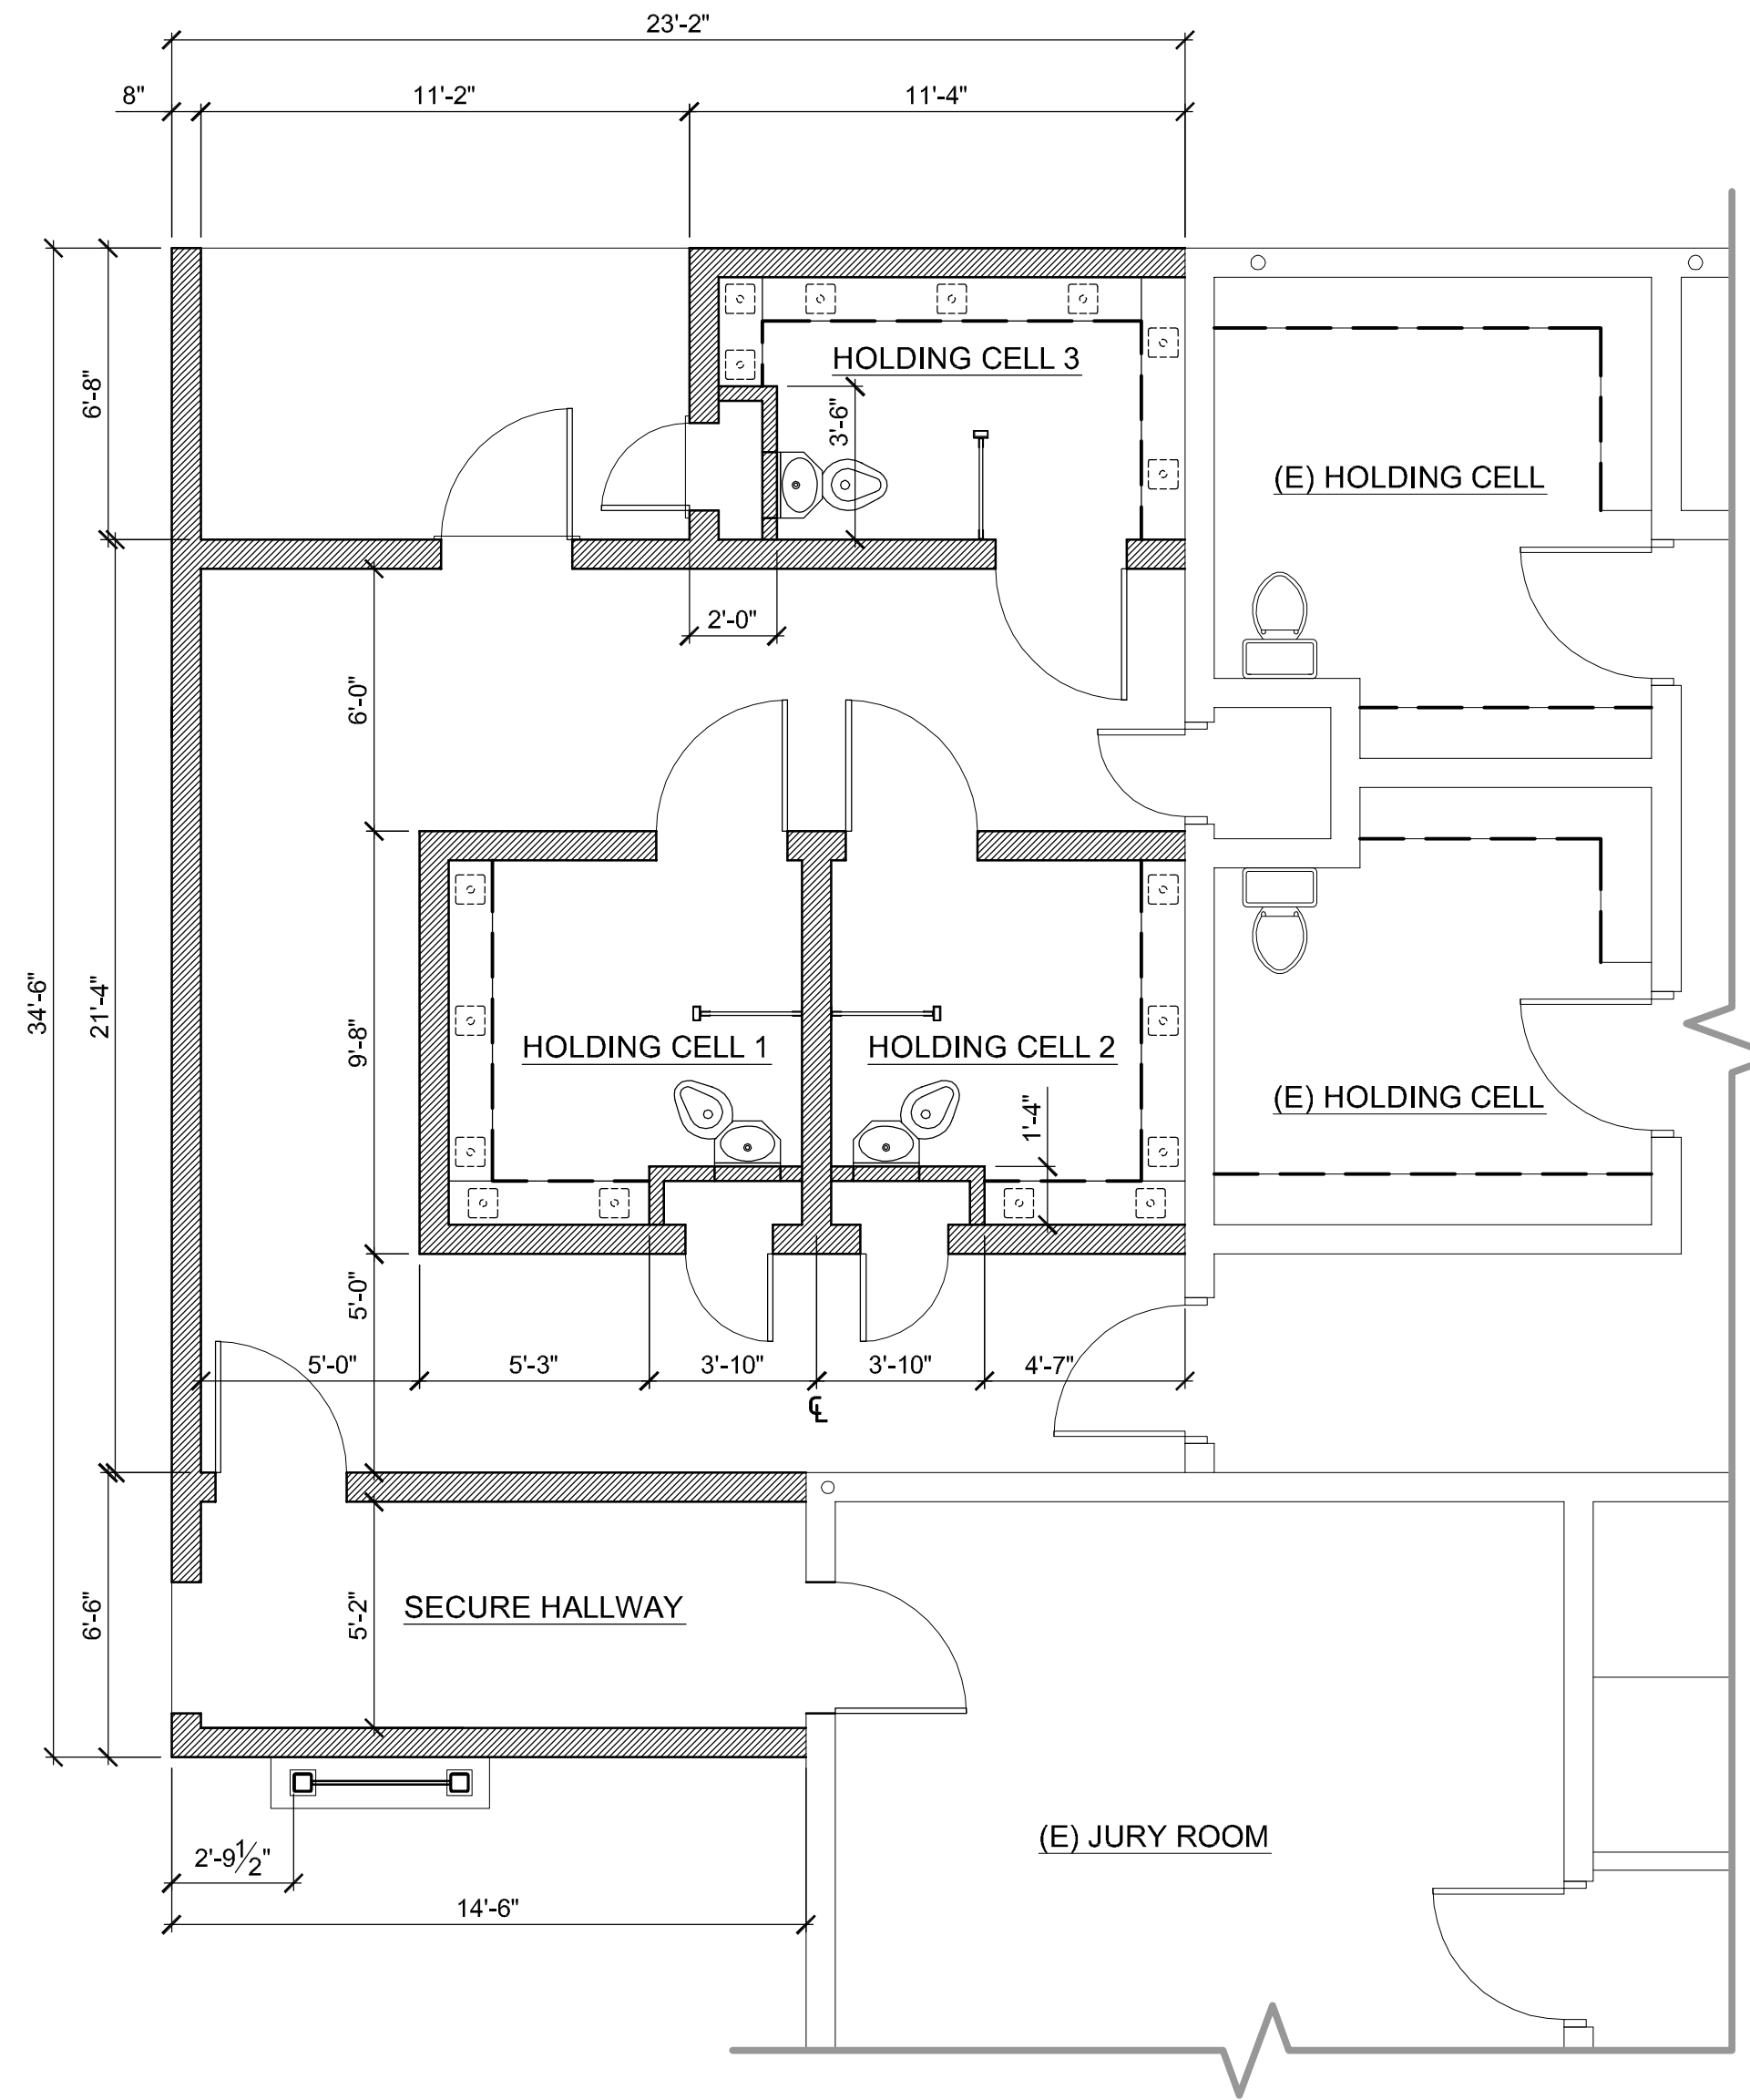

PHASE I FLOOR PLAN - HOLDING CELL ADDITION
SCALE: 1/4" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

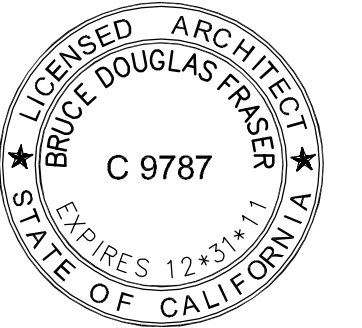

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE


**PHASE I
DIMENSIONED
FLOOR PLAN**


SHEET #

A2.2

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A2.3 - Phase I Construction and Relocation Staging Plan.dwg, 4/29/2011 3:16:15 PM, PDF995

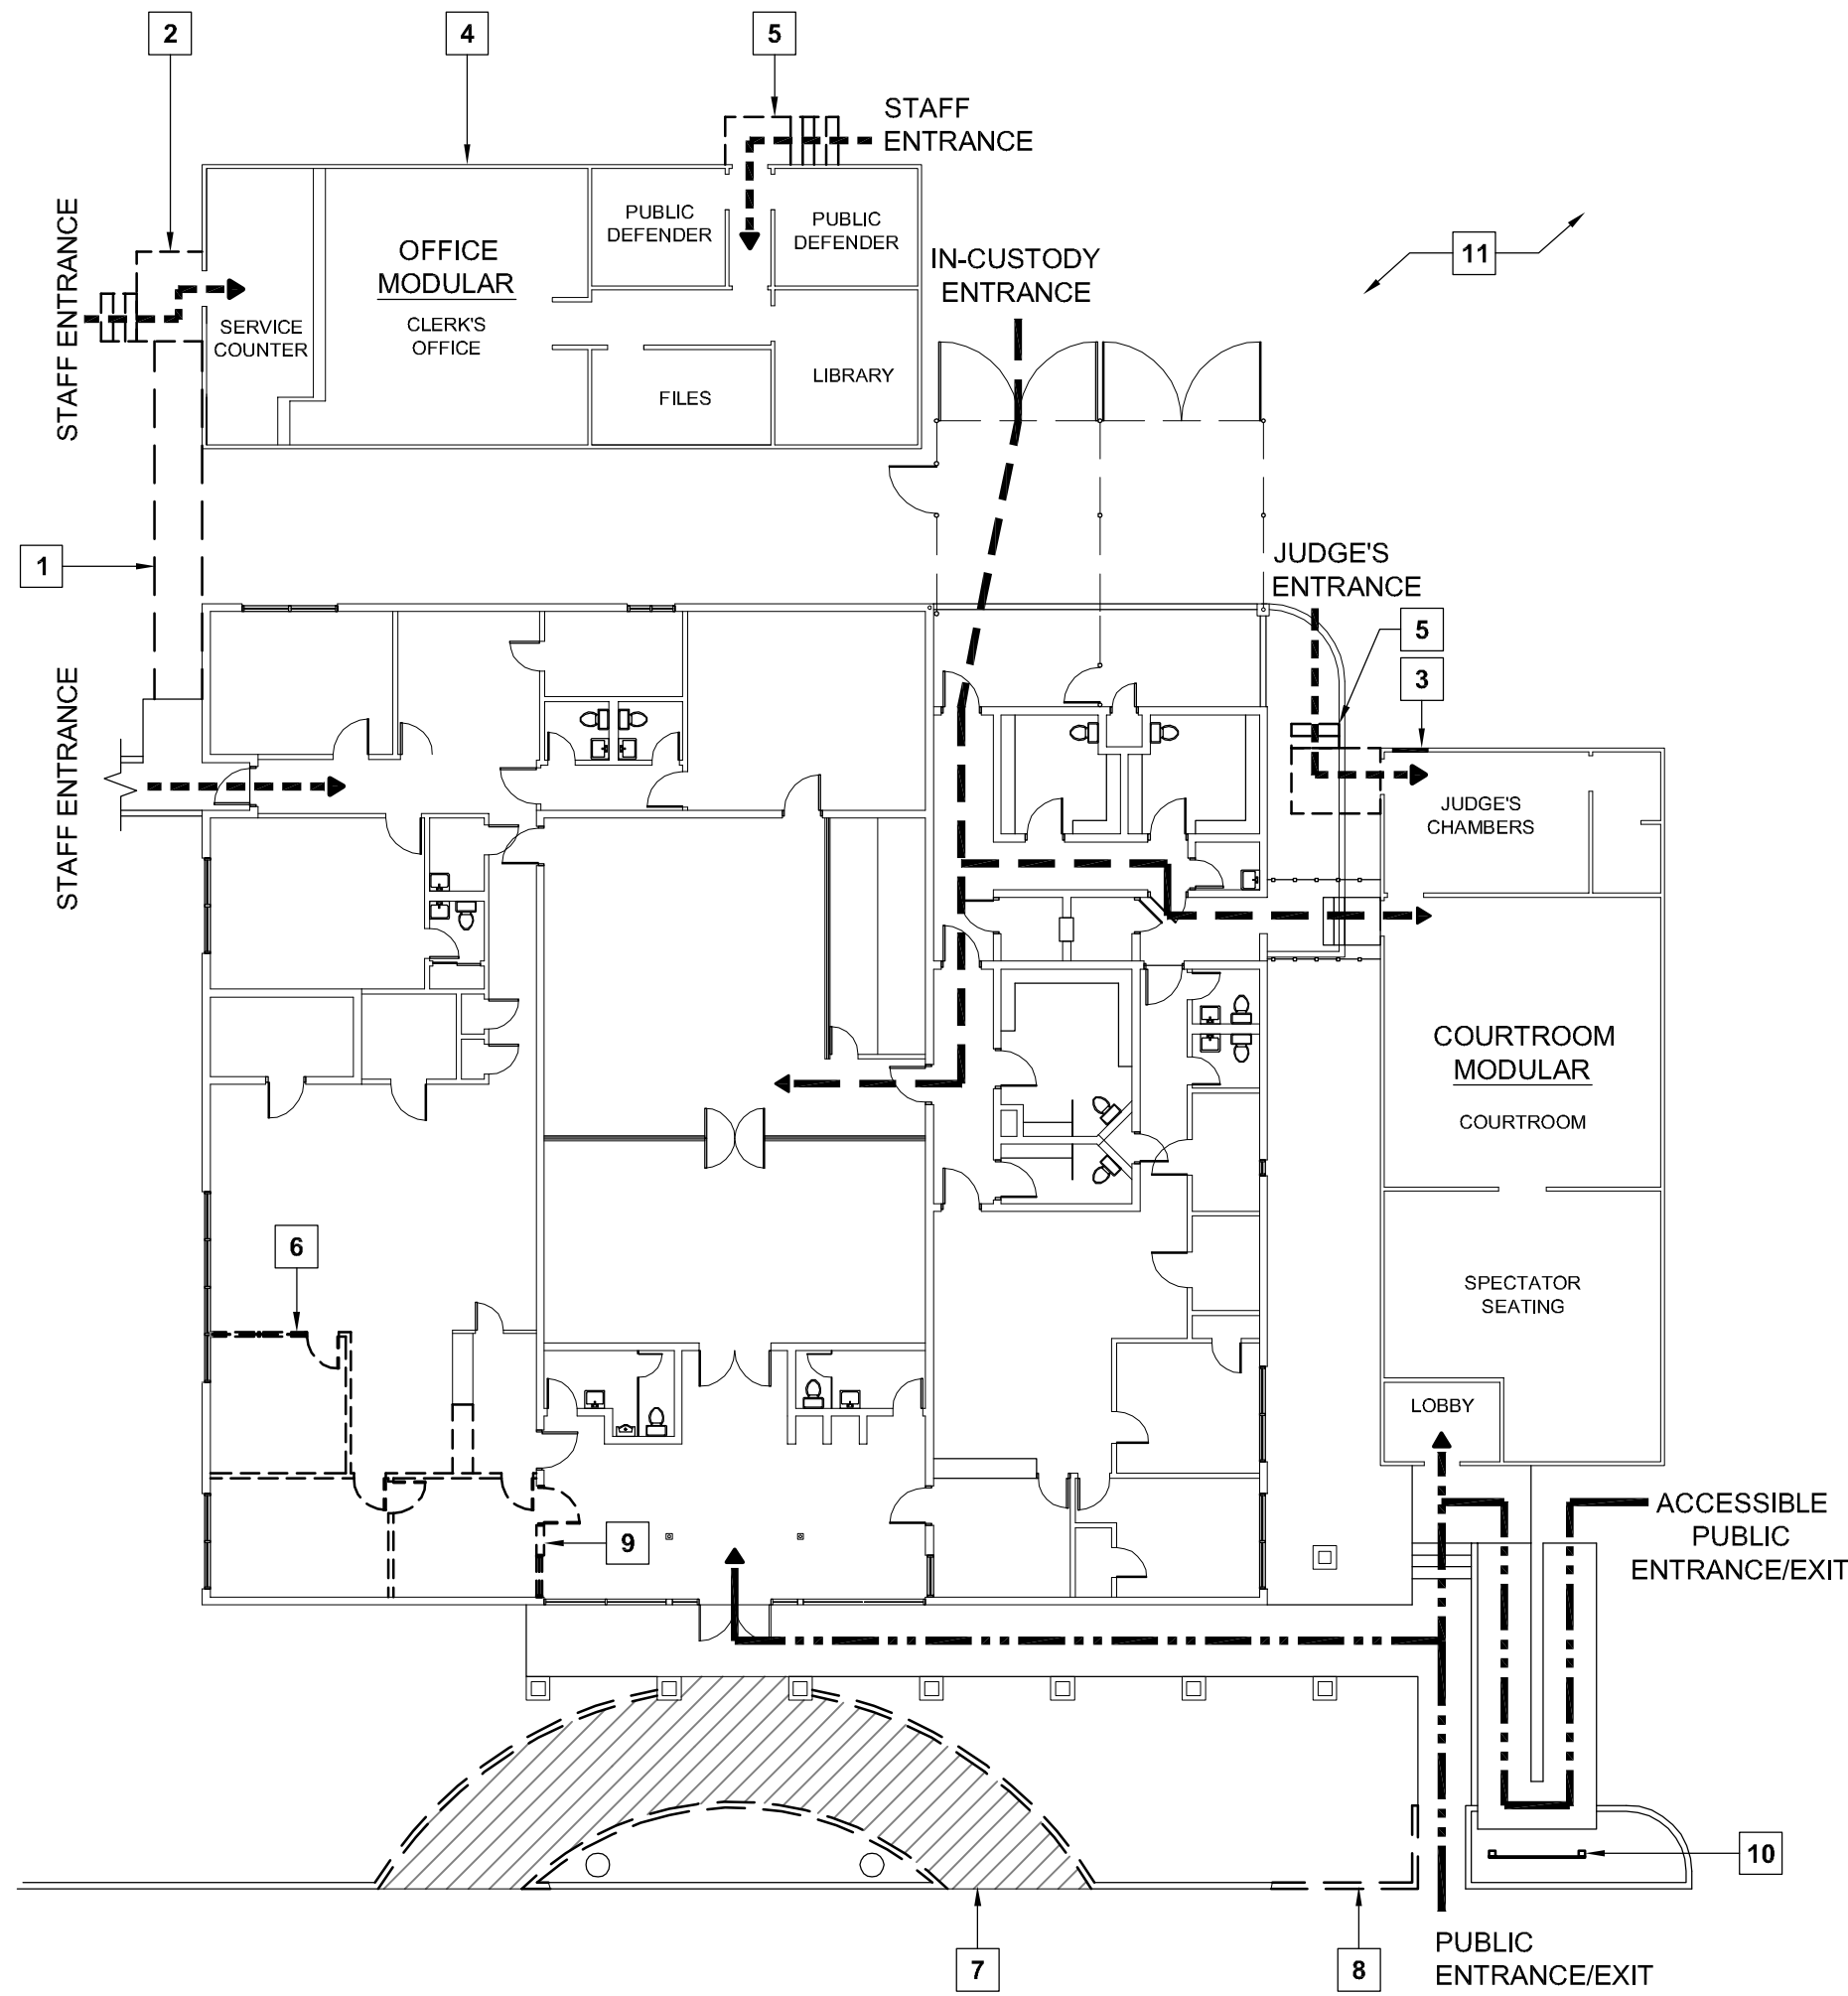

 **STAGE 1 - DEMOLITION**
SCALE: 1/16" = 1'-0"

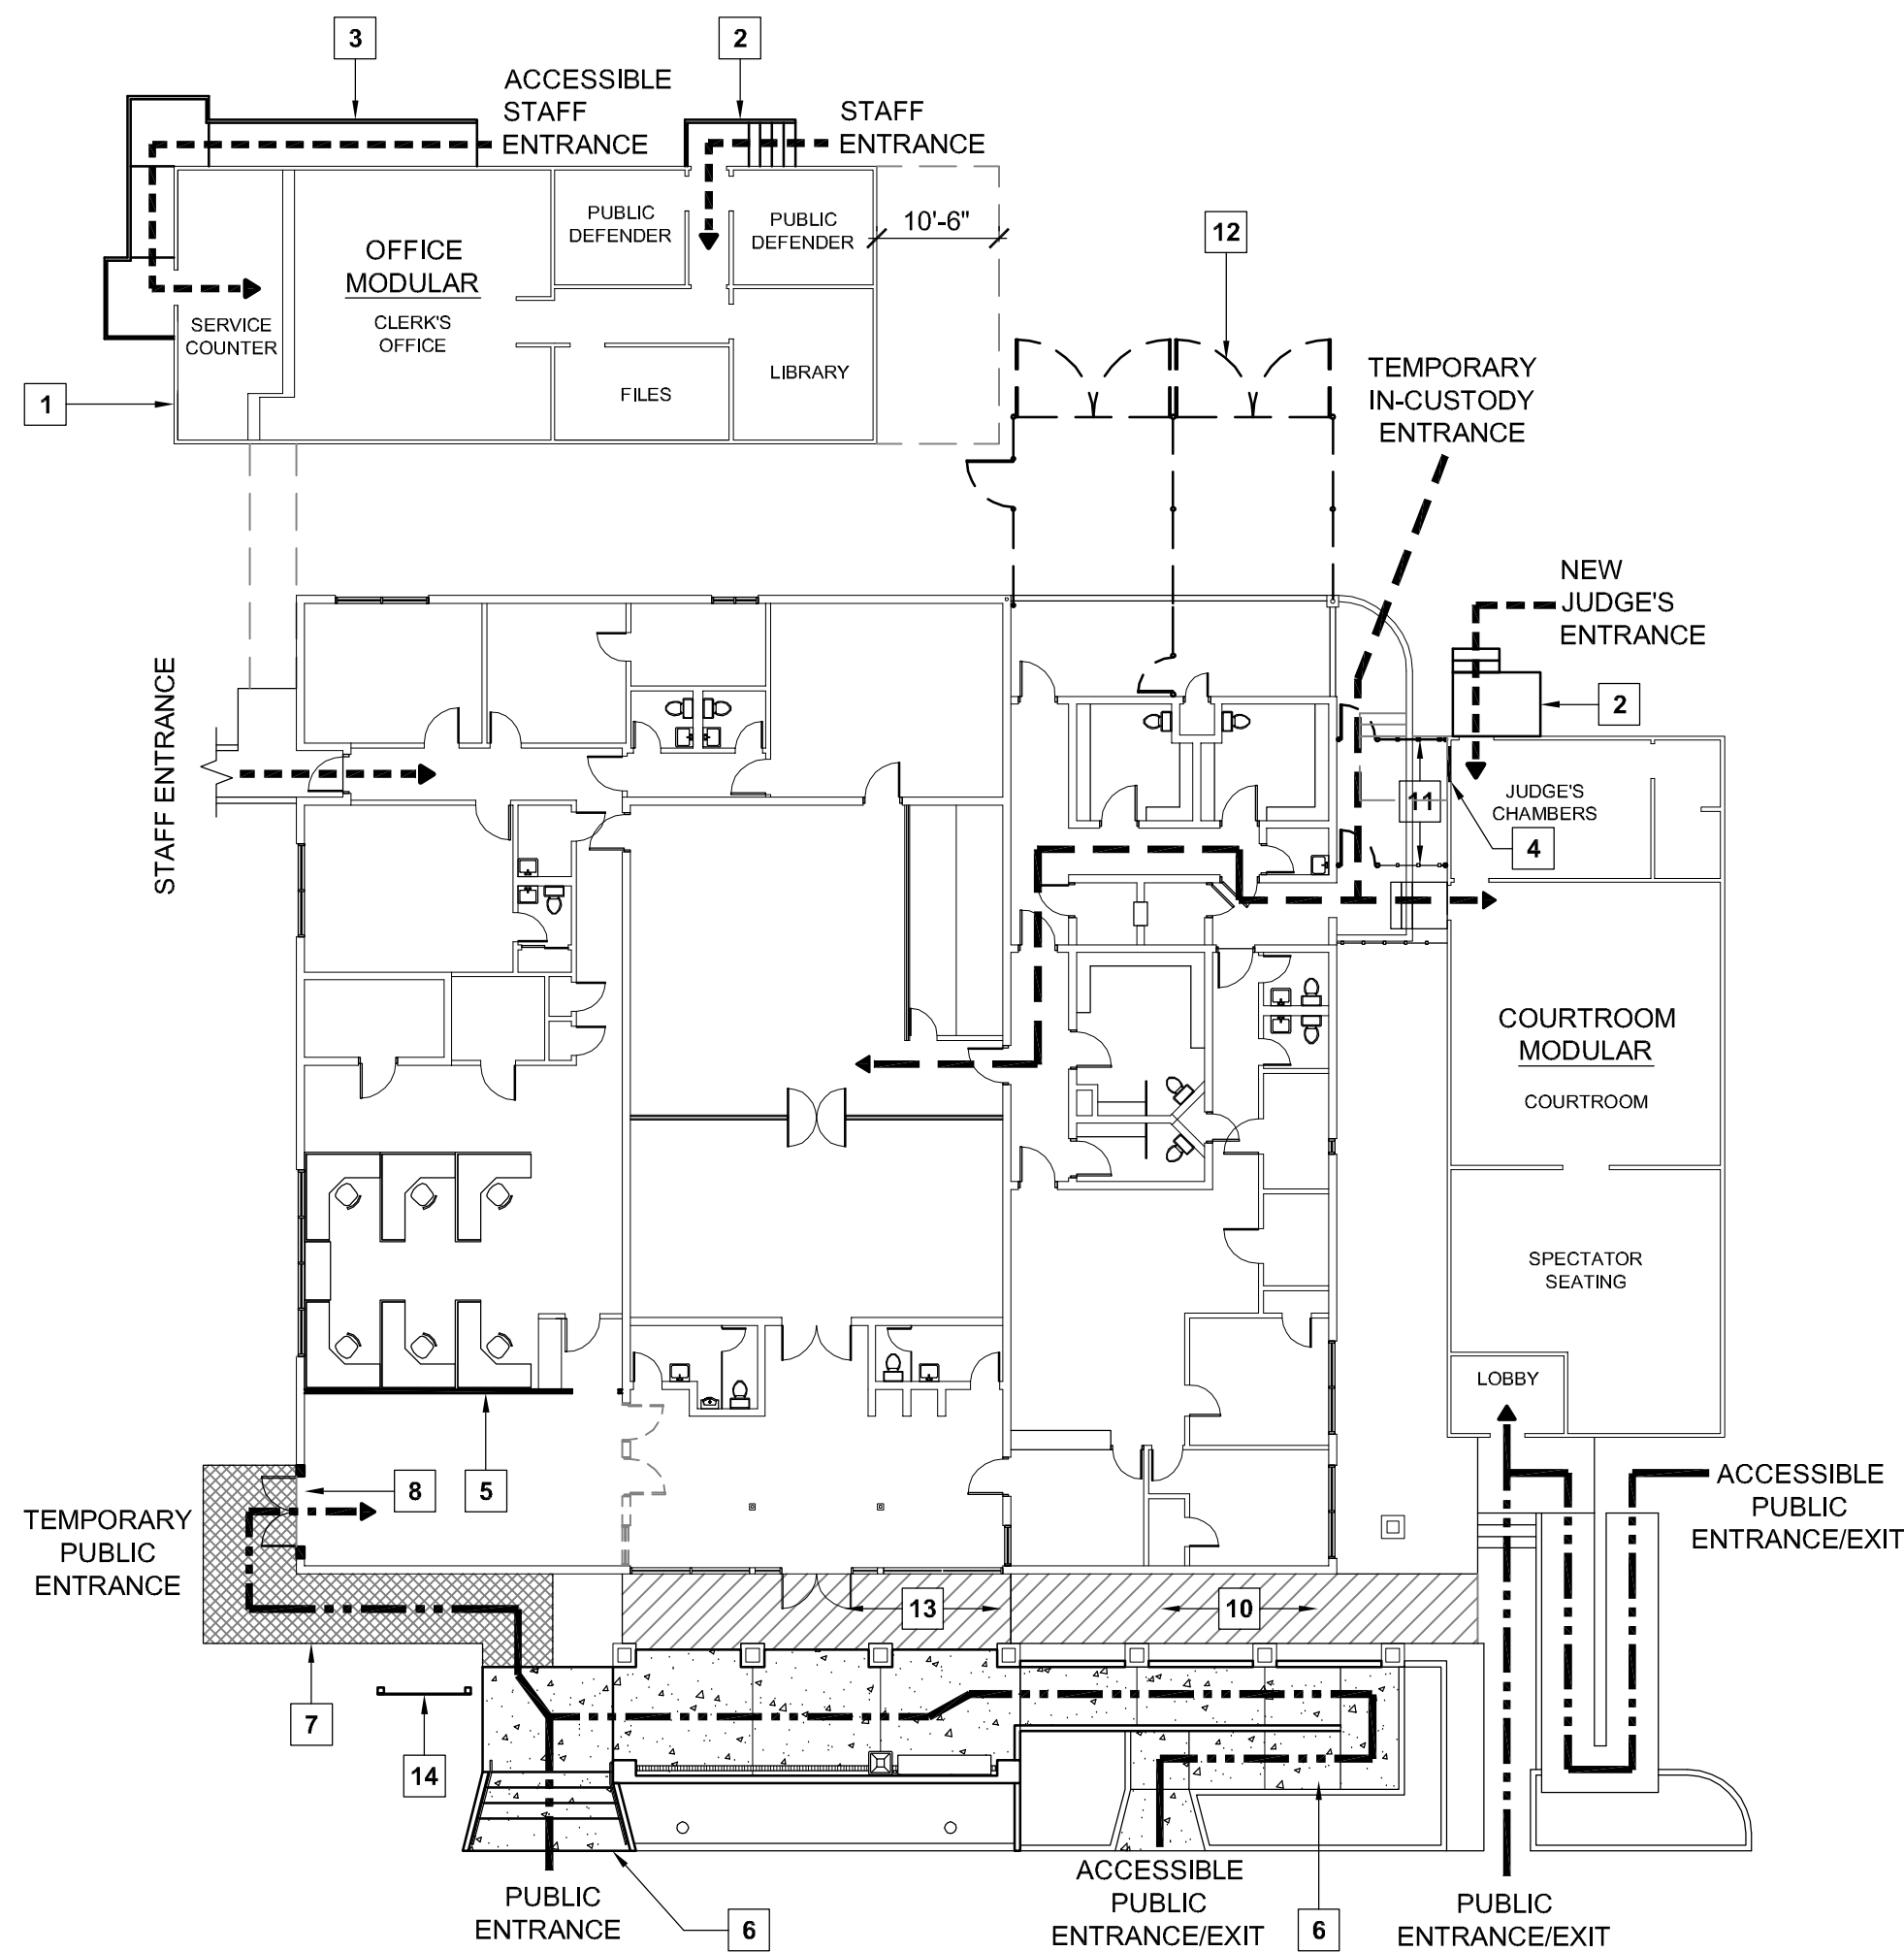

 **STAGE 2 - TEMPORARY ACCESS**
SCALE: 1/16" = 1'-0"

CIRCULATION LEGEND

- IN-CUSTODY SECURE PATH OF TRAVEL
- STAFF/SHERIFF PATH OF TRAVEL
- PUBLIC PATH OF TRAVEL


STAGING PLAN KEYNOTES


- STAGE 1 - DEMOLITION**
- DEMOLISH EXISTING RAMP.
 - DEMOLISH EXISTING STAIRWAY AND LANDING.
 - INSTALL NEW DOOR.
 - RELOCATE EXISTING MODULAR BUILDING TOWARD LINCOLN ST.
 - RELOCATE AND RECONSTRUCT WOOD STAIRWAY AND LANDING.
 - DEMOLISH INTERIOR WALLS AND COUNTER AS INDICATED.
 - RE-ROUTE PUBLIC ACCESS TO EXISTING SIDE RAMP AND DEMOLISH EXISTING ENTRY RAMP AND SITE/RETAINING WALLS.
 - DEMOLISH PORTION OF RETAINING WALL AS REQUIRED FOR NEW RAMP.
 - DEMOLISH WALL AND INSTALL TEMPORARY BARRICADE.
 - INSTALL TEMPORARY PUBLIC DIRECTORY SIGN.
 - PERFORM SITE DEMOLITION TO REMOVE IRRIGATION PIPE.


- STAGE 2 - TEMPORARY ACCESS**
- RELOCATED MODULAR OFFICE BUILDING.
 - RELOCATED STAIRWAY AND LANDING.
 - NEW RAMP AND LANDING.
 - INFILL DOOR OPENING.
 - BUILD NEW INTERIOR WALLS.
 - BUILD NEW PRIMARY PUBLIC ACCESS STAIRS AND RAMP.
 - INSTALL TEMPORARY ENTRY.
 - REMOVE EXISTING STOREFRONT AND INSTALL TEMPORARY PUBLIC ENTRANCE.
 - DEMOLISH PORTION OF EXISTING WALL.
 - DEMOLISH WALKWAY.
 - INSTALL NEW TEMPORARY CHAIN LINK SALLY PORT. INSTALL NEW GATE IN EXISTING FENCE.
 - DEMOLISH EXISTING SALLY PORT FENCING AND RE-ROUTE IN-CUSTODY ENTRANCE TO NEW TEMPORARY SALLY PORT.
 - DEMOLISH EXISTING LANDING AND POUR NEW LOBBY SLAB AND PERIMETER FOOTINGS.
 - INSTALL TEMPORARY PUBLIC DIRECTORY SIGN.


- STAGE 3 - CONSTRUCTION**
- INSTALL NEW STOREFRONT.
 - BUILD HOLDING CELL ADDITION.
 - INSTALL NEW COURTROOM VESTIBULE DOORS.

- STAGE 4 - FINAL ACCESS**
- REMOVE TEMPORARY SALLY PORT / GATE AND RE-ROUTE IN-CUSTODY ENTRANCE TO NEW SALLY PORT.
 - DEMOLISH EXISTING STOREFRONT AND RE-ROUTE PUBLIC ACCESS TO NEW ENTRY/EXIT.
 - REMOVE TEMPORARY WALKWAY.
 - INSTALL TEMPORARY INFILL WALL PENDING PHASE II CONSTRUCTION.
 - INSTALL NEW SECURITY LINE EQUIPMENT/DIVIDERS.

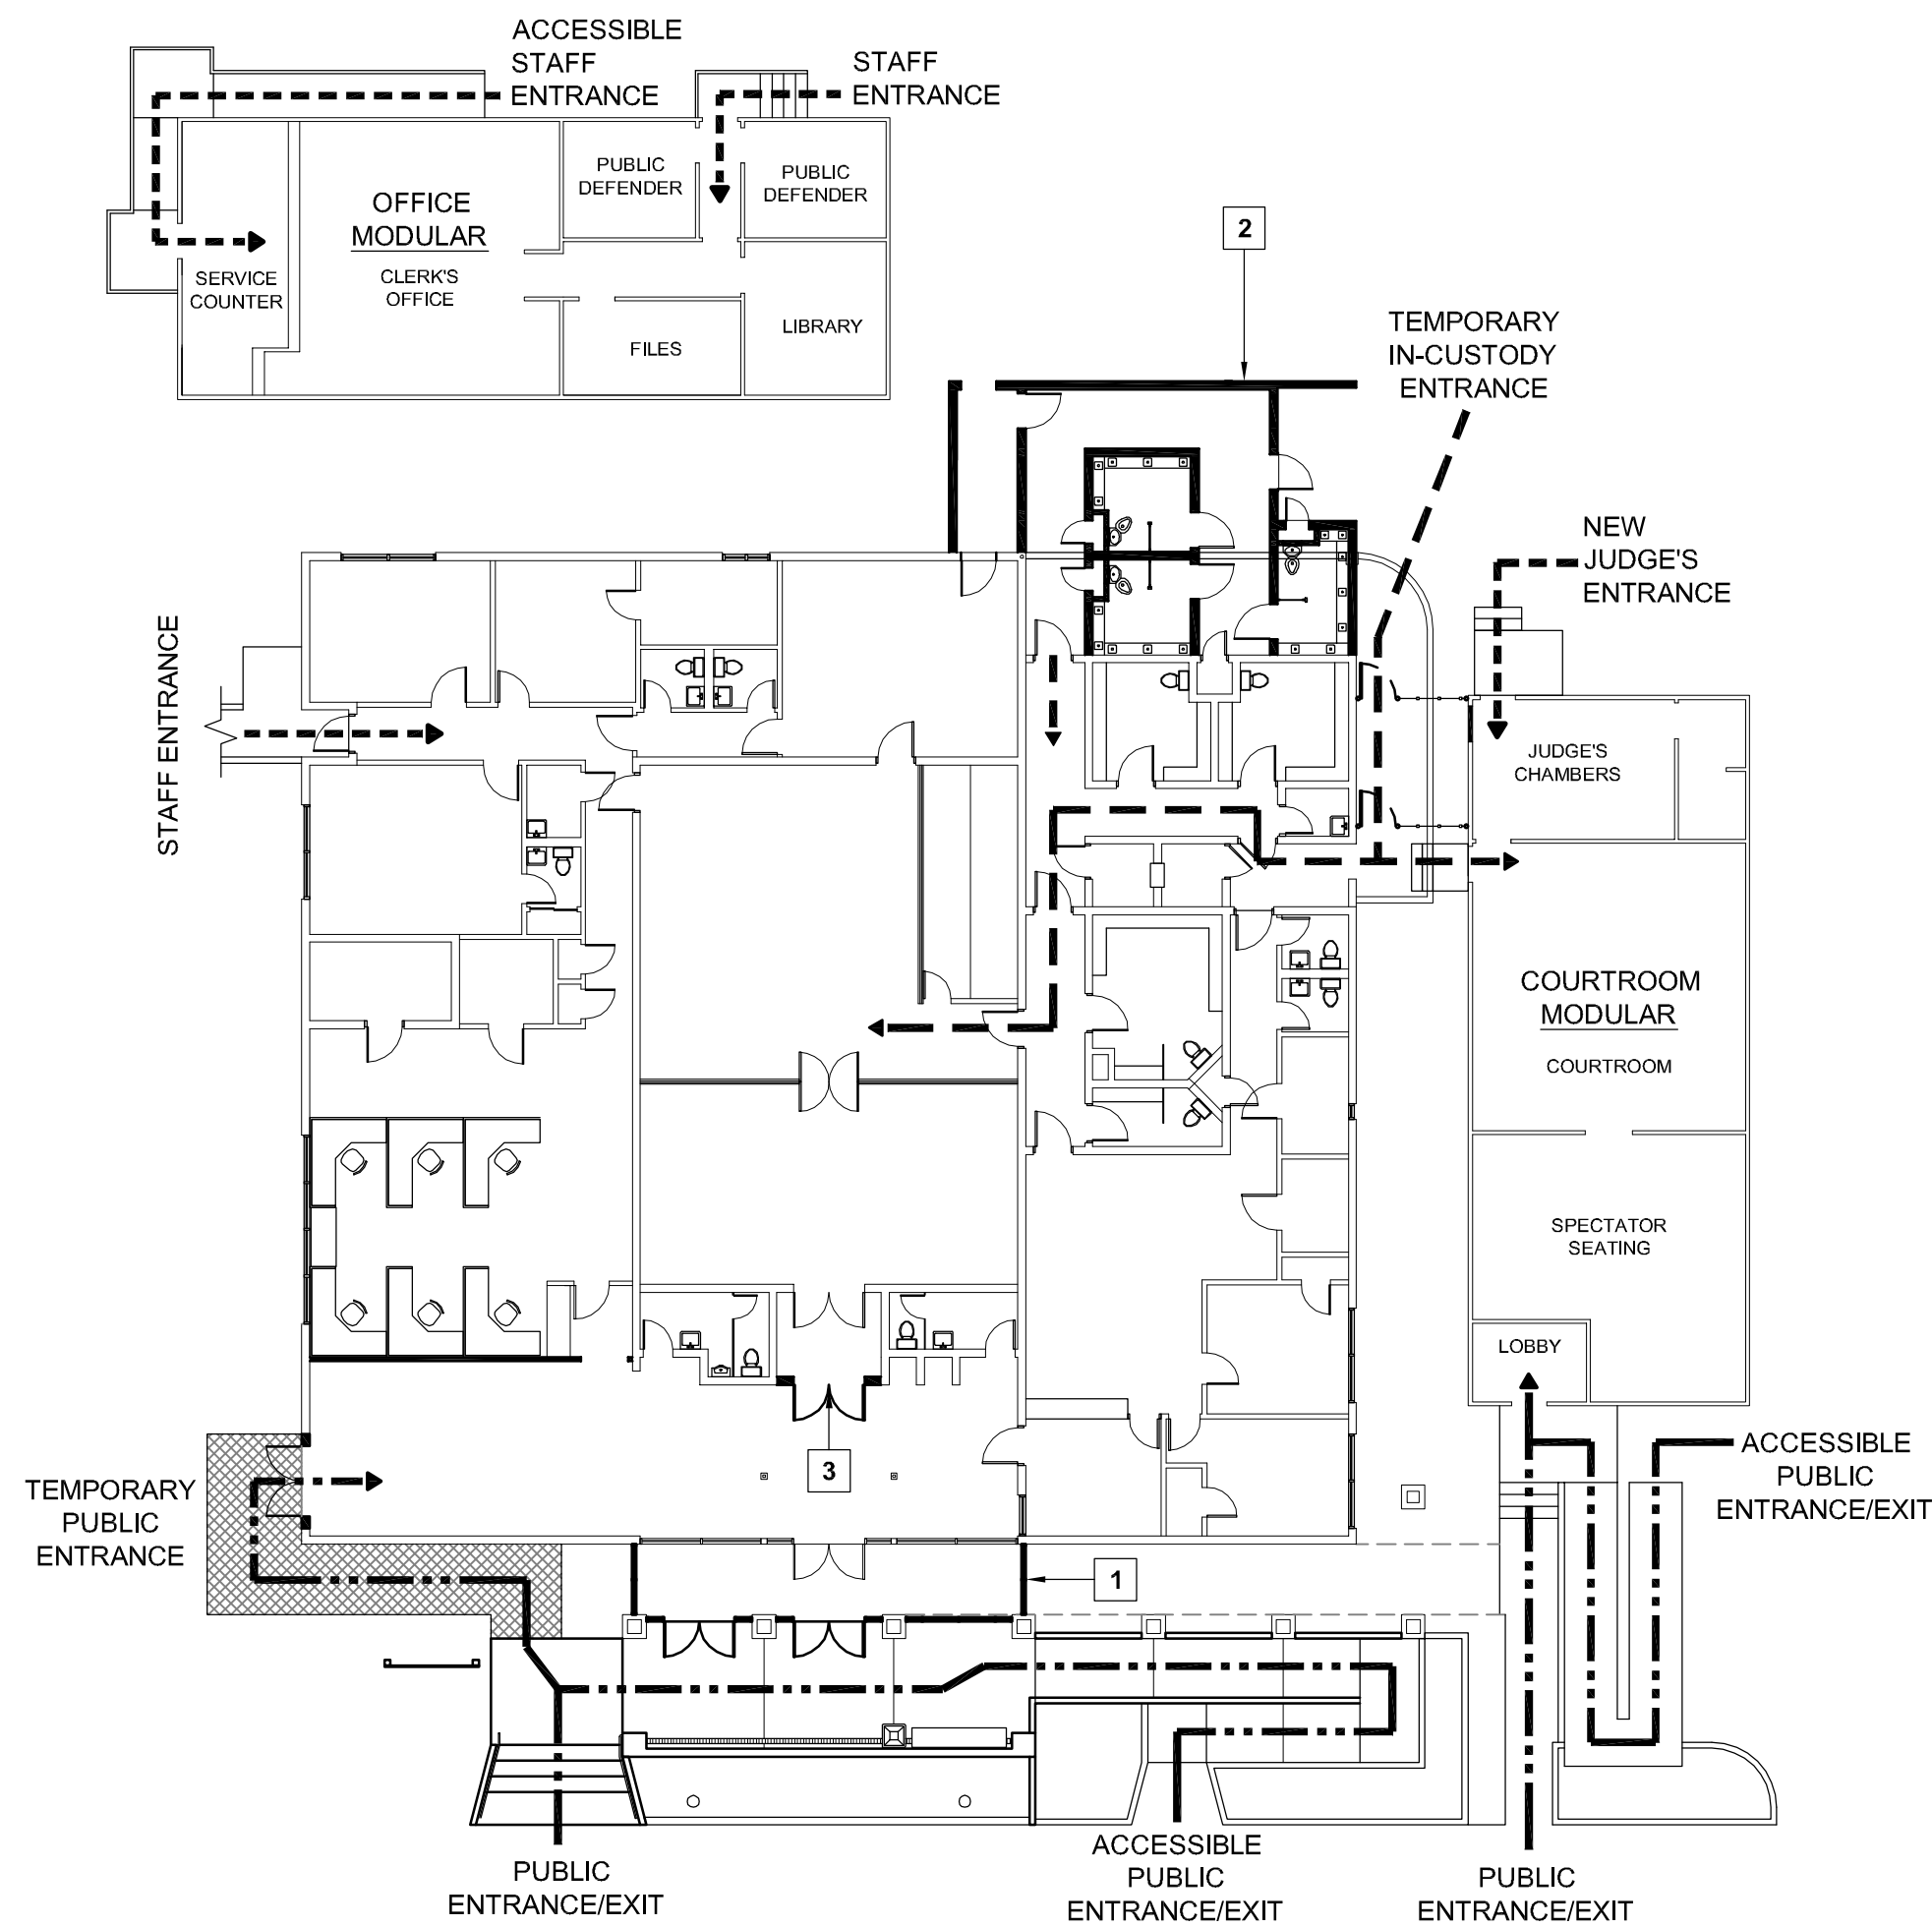

 **STAGE 3 - CONSTRUCTION**
SCALE: 1/16" = 1'-0"

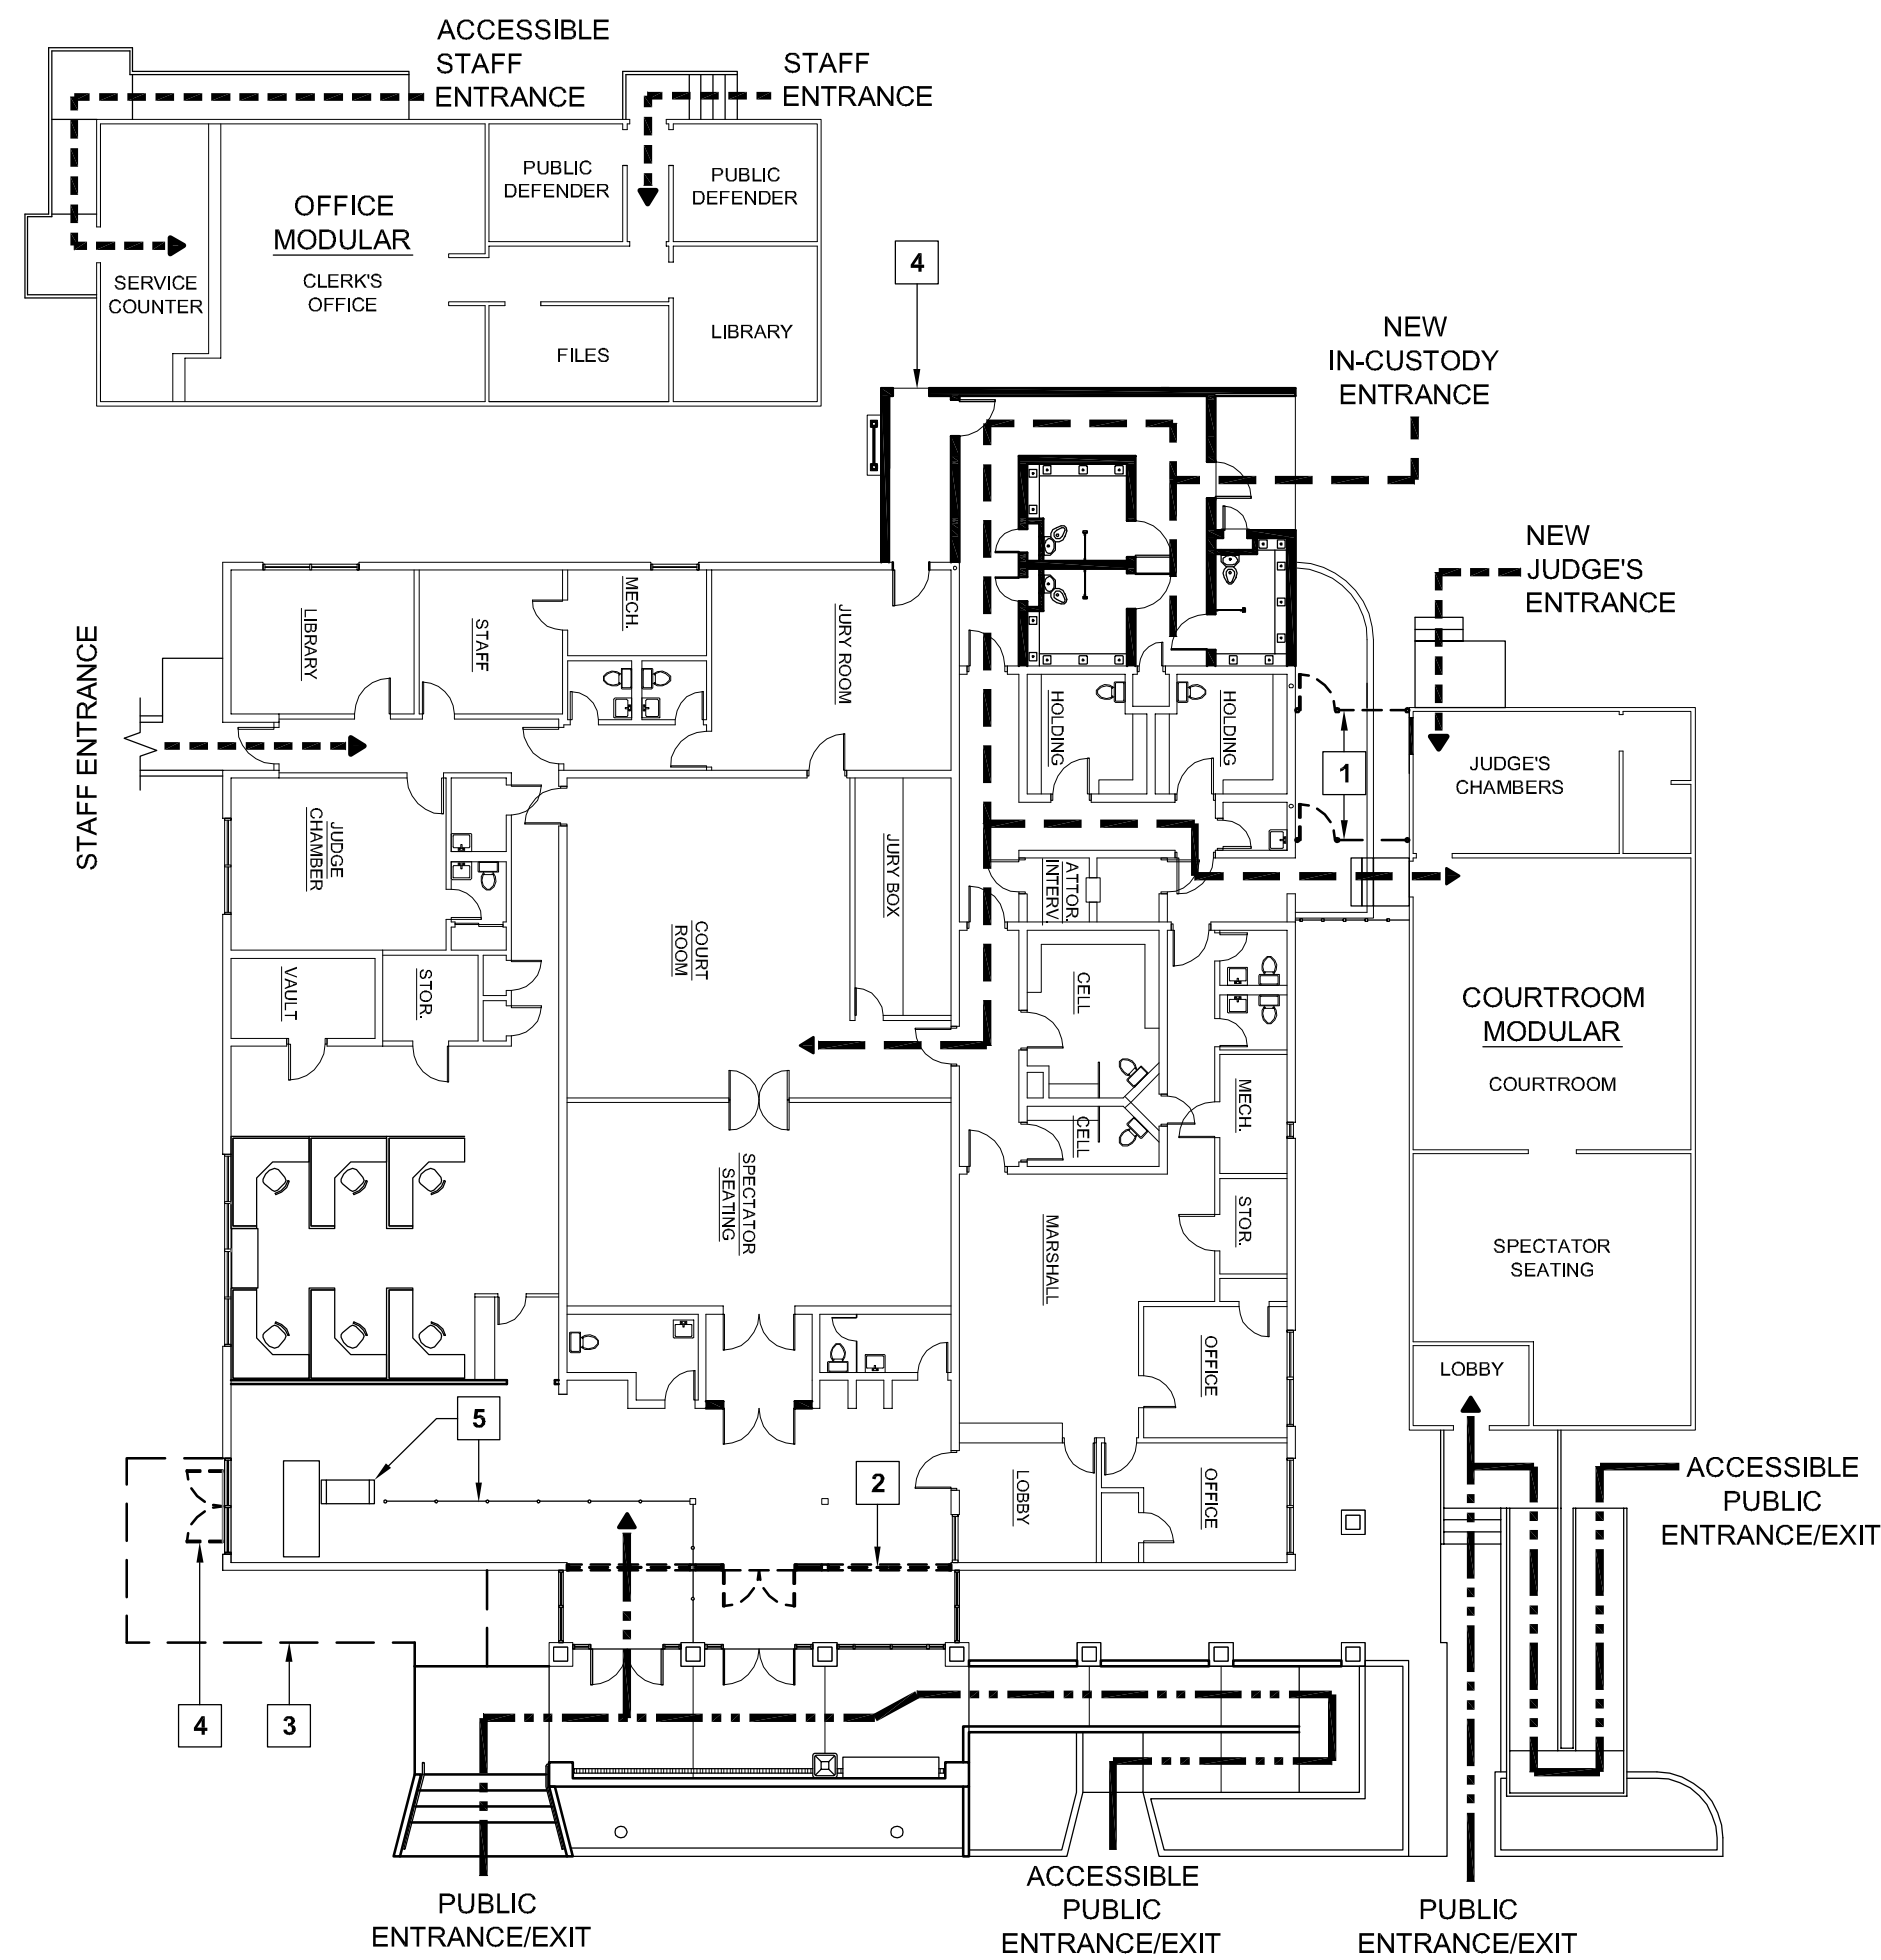

 **STAGE 4 - FINAL ACCESS**
SCALE: 1/16" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

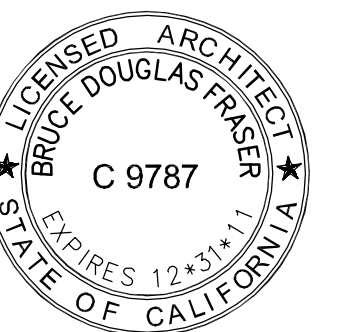

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
CONSTRUCTION
AND RELOCATION
STAGING PLAN**

SHEET #



A2.3

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\A3.1 - Phase I Roof Plan.dwg, 6/15/2011 2:02:45 PM, PDF995



PHASE I ROOF PLAN - HOLDING CELL ADDITION

SCALE: 1/4" = 1'-0"

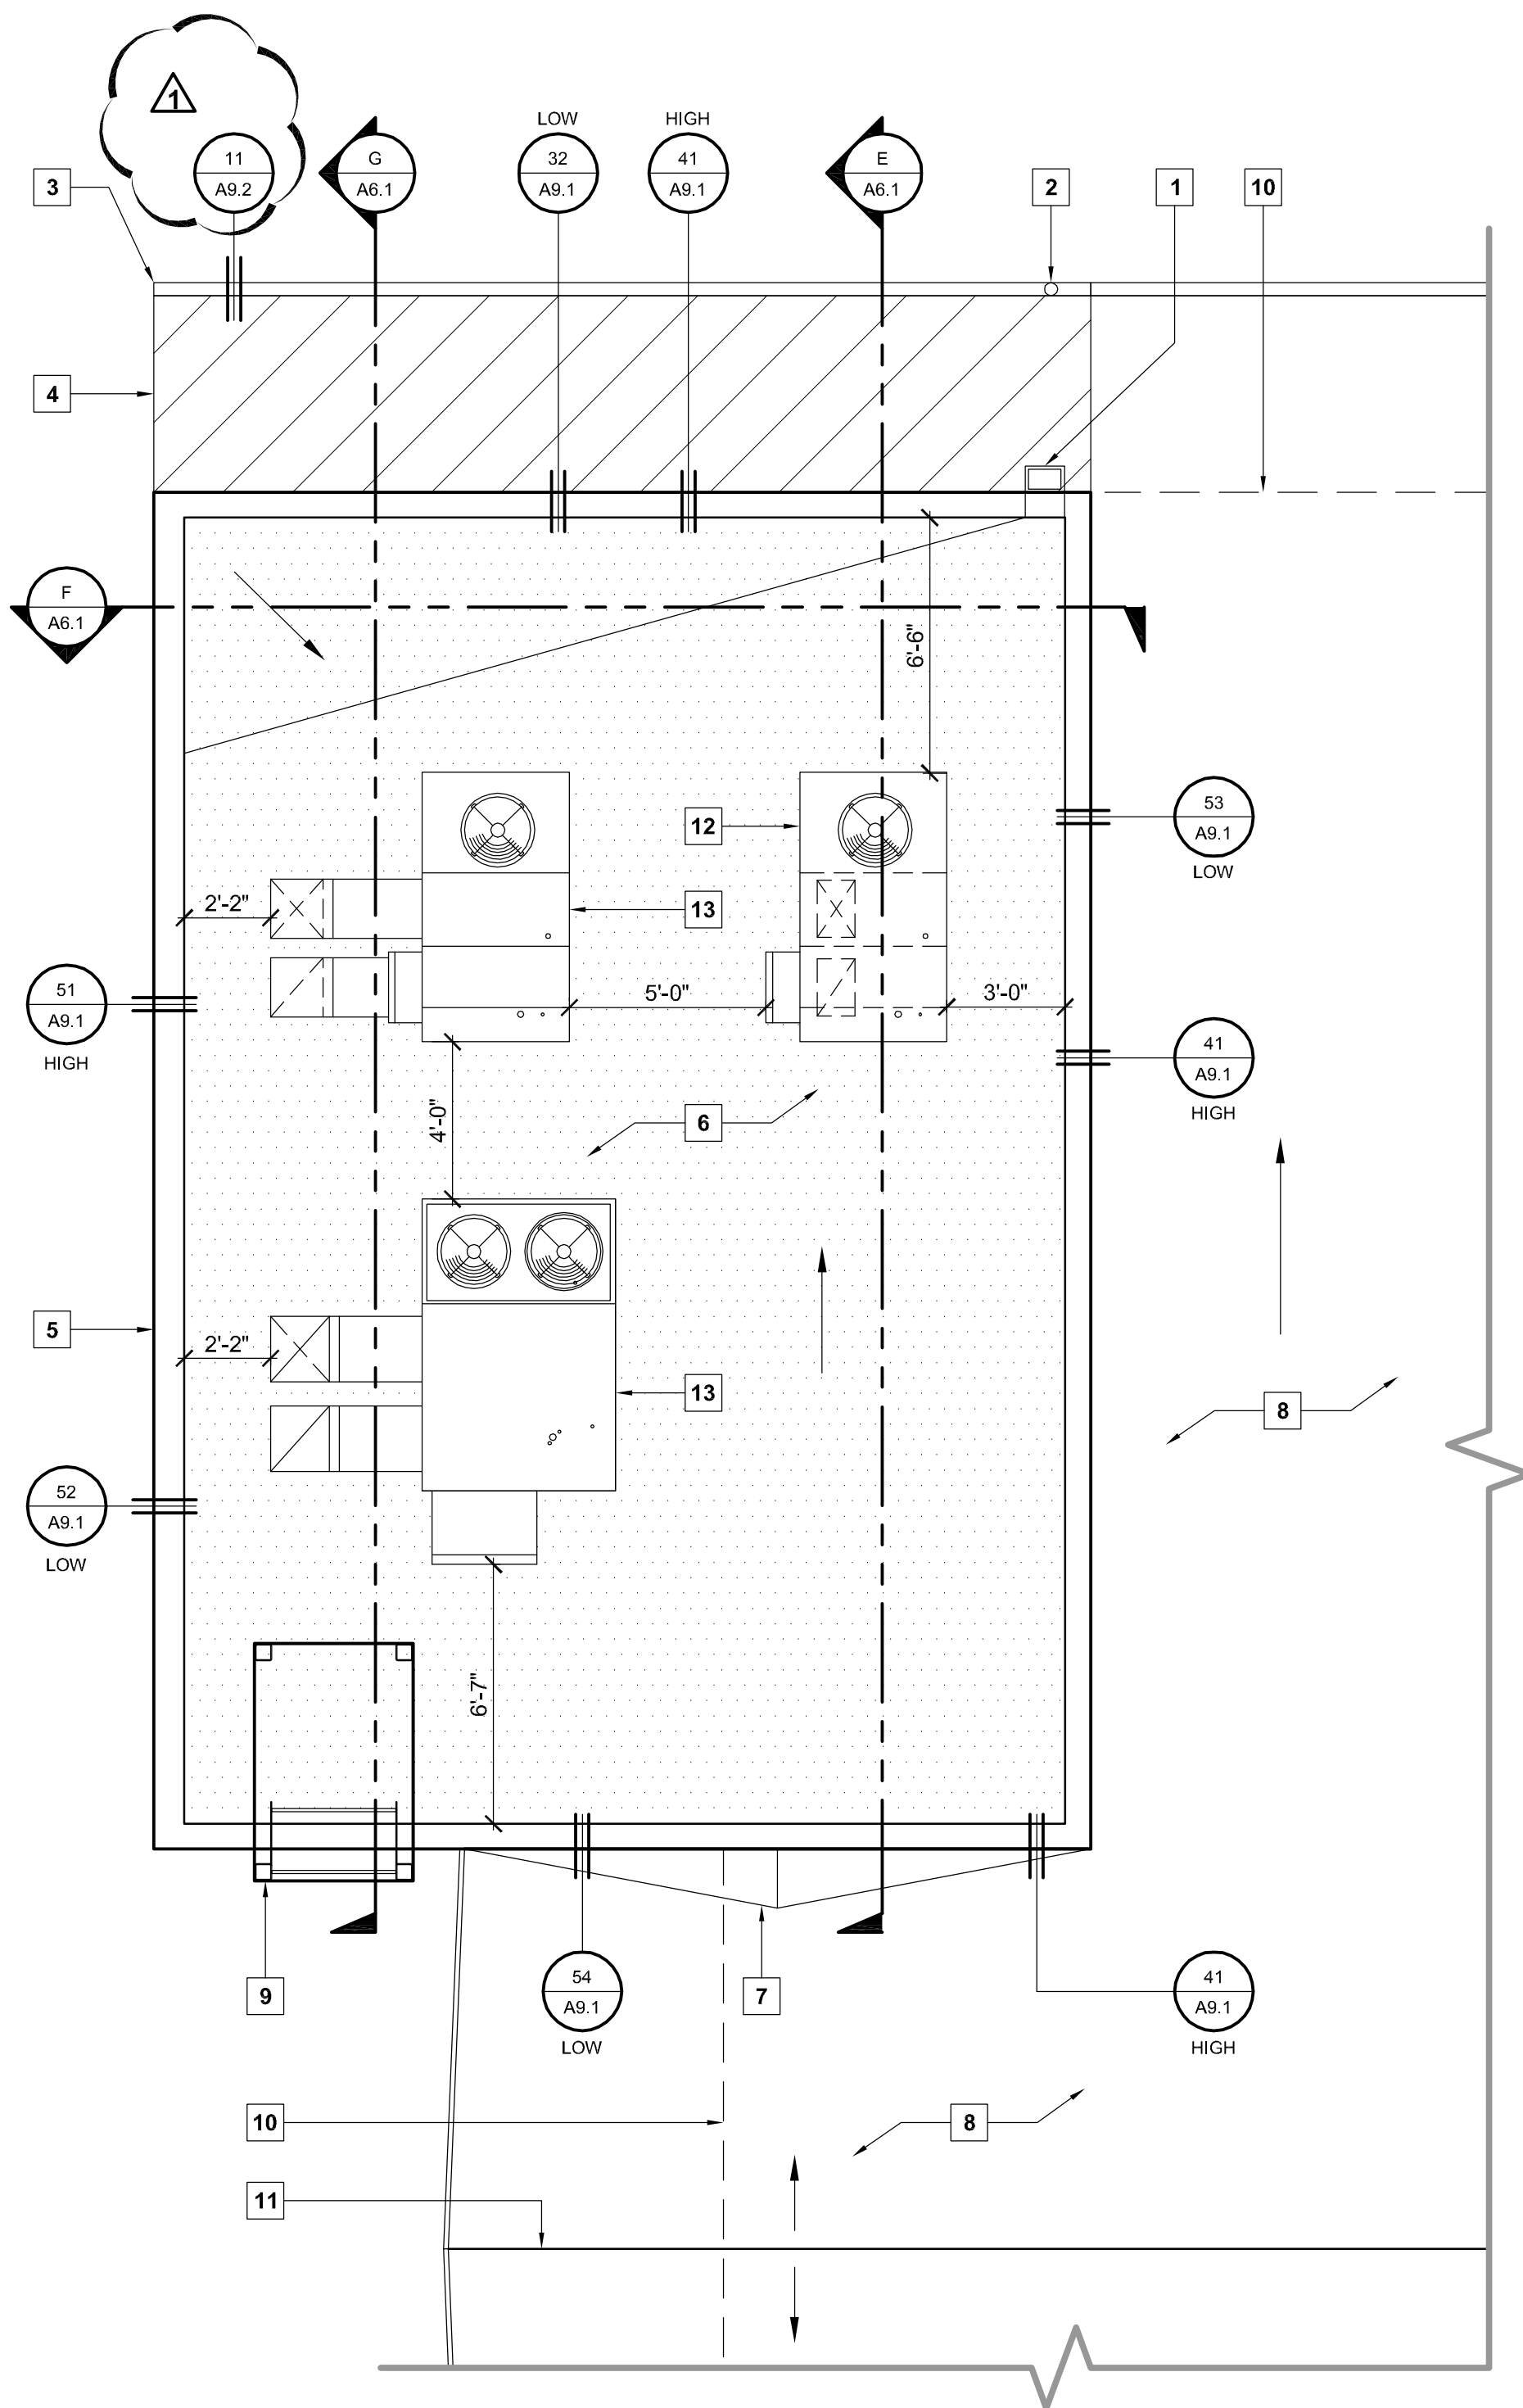


PHASE I KEY PLAN

SCALE: 1/16" = 1'-0"

KEYNOTES

1. THROUGH-WALL SCUPPER AND CONDUCTOR HEAD WITH BUILT-IN OVERFLOW. PROVIDE DOWNSPOUT TO LOWER ROOF. SEE DETAILS 31 & 44 / A9.1.
2. NEW DOWNSPOUT TO MATCH EXISTING.
3. NEW GUTTER TO MATCH EXISTING.
4. AREA OF NEW ROOF. ALIGN WITH EXISTING ADJACENT ROOF TO ACHIEVE CONTINUOUS, EVEN ROOF SURFACE AND FASCIA.
5. NEW PARAPET WALL WITH PAINTED METAL COPING.
6. NEW SINGLE PLY ROOF MEMBRANE OVER GLASS-MAT ROOF BOARD OVER SLOPED PLYWOOD ROOF DECK. SLOPE ROOF 1/2" PER FOOT.
7. NEW CRICKET.
8. EXISTING SINGLE PLY ROOF TO REMAIN.
9. ROOF ACCESS LADDER / EQUIPMENT TOWER.
10. WALL BELOW.
11. EXISTING RIDGE.
12. PHASE I CURB MOUNTED HVAC UNIT.
13. PHASE II CURB MOUNTED HVAC UNITS. UNIT CURBS TO BE INSTALLED DURING PHASE I.

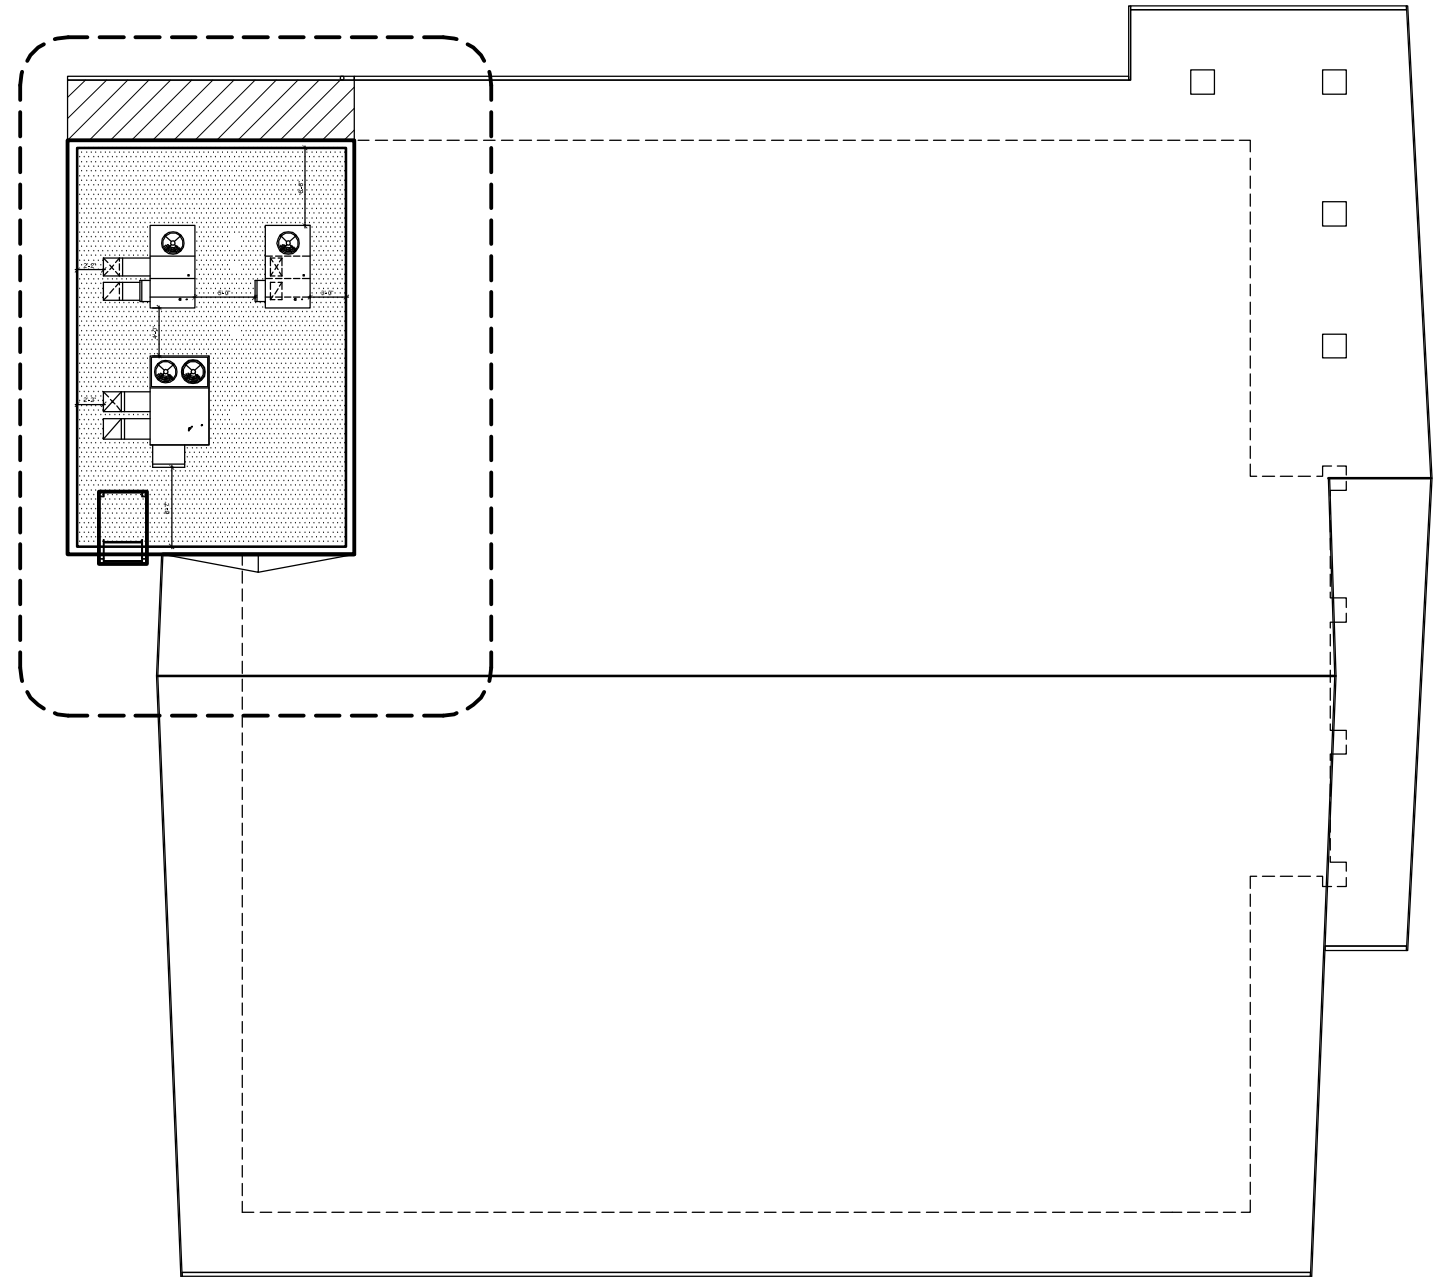

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

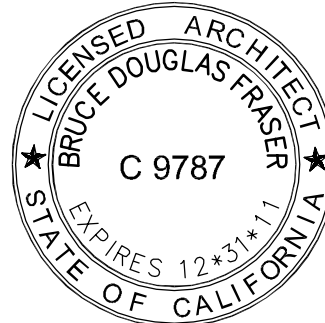

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
ROOF PLAN**

SHEET #


A3.1

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A4.1 - Phase I Reflected Ceiling Plan.dwg, 6/15/2011 2:39:10 PM, R05995




PHASE I REFLECTED CEILING PLAN - LOBBY

SCALE: 1/4" = 1'-0"

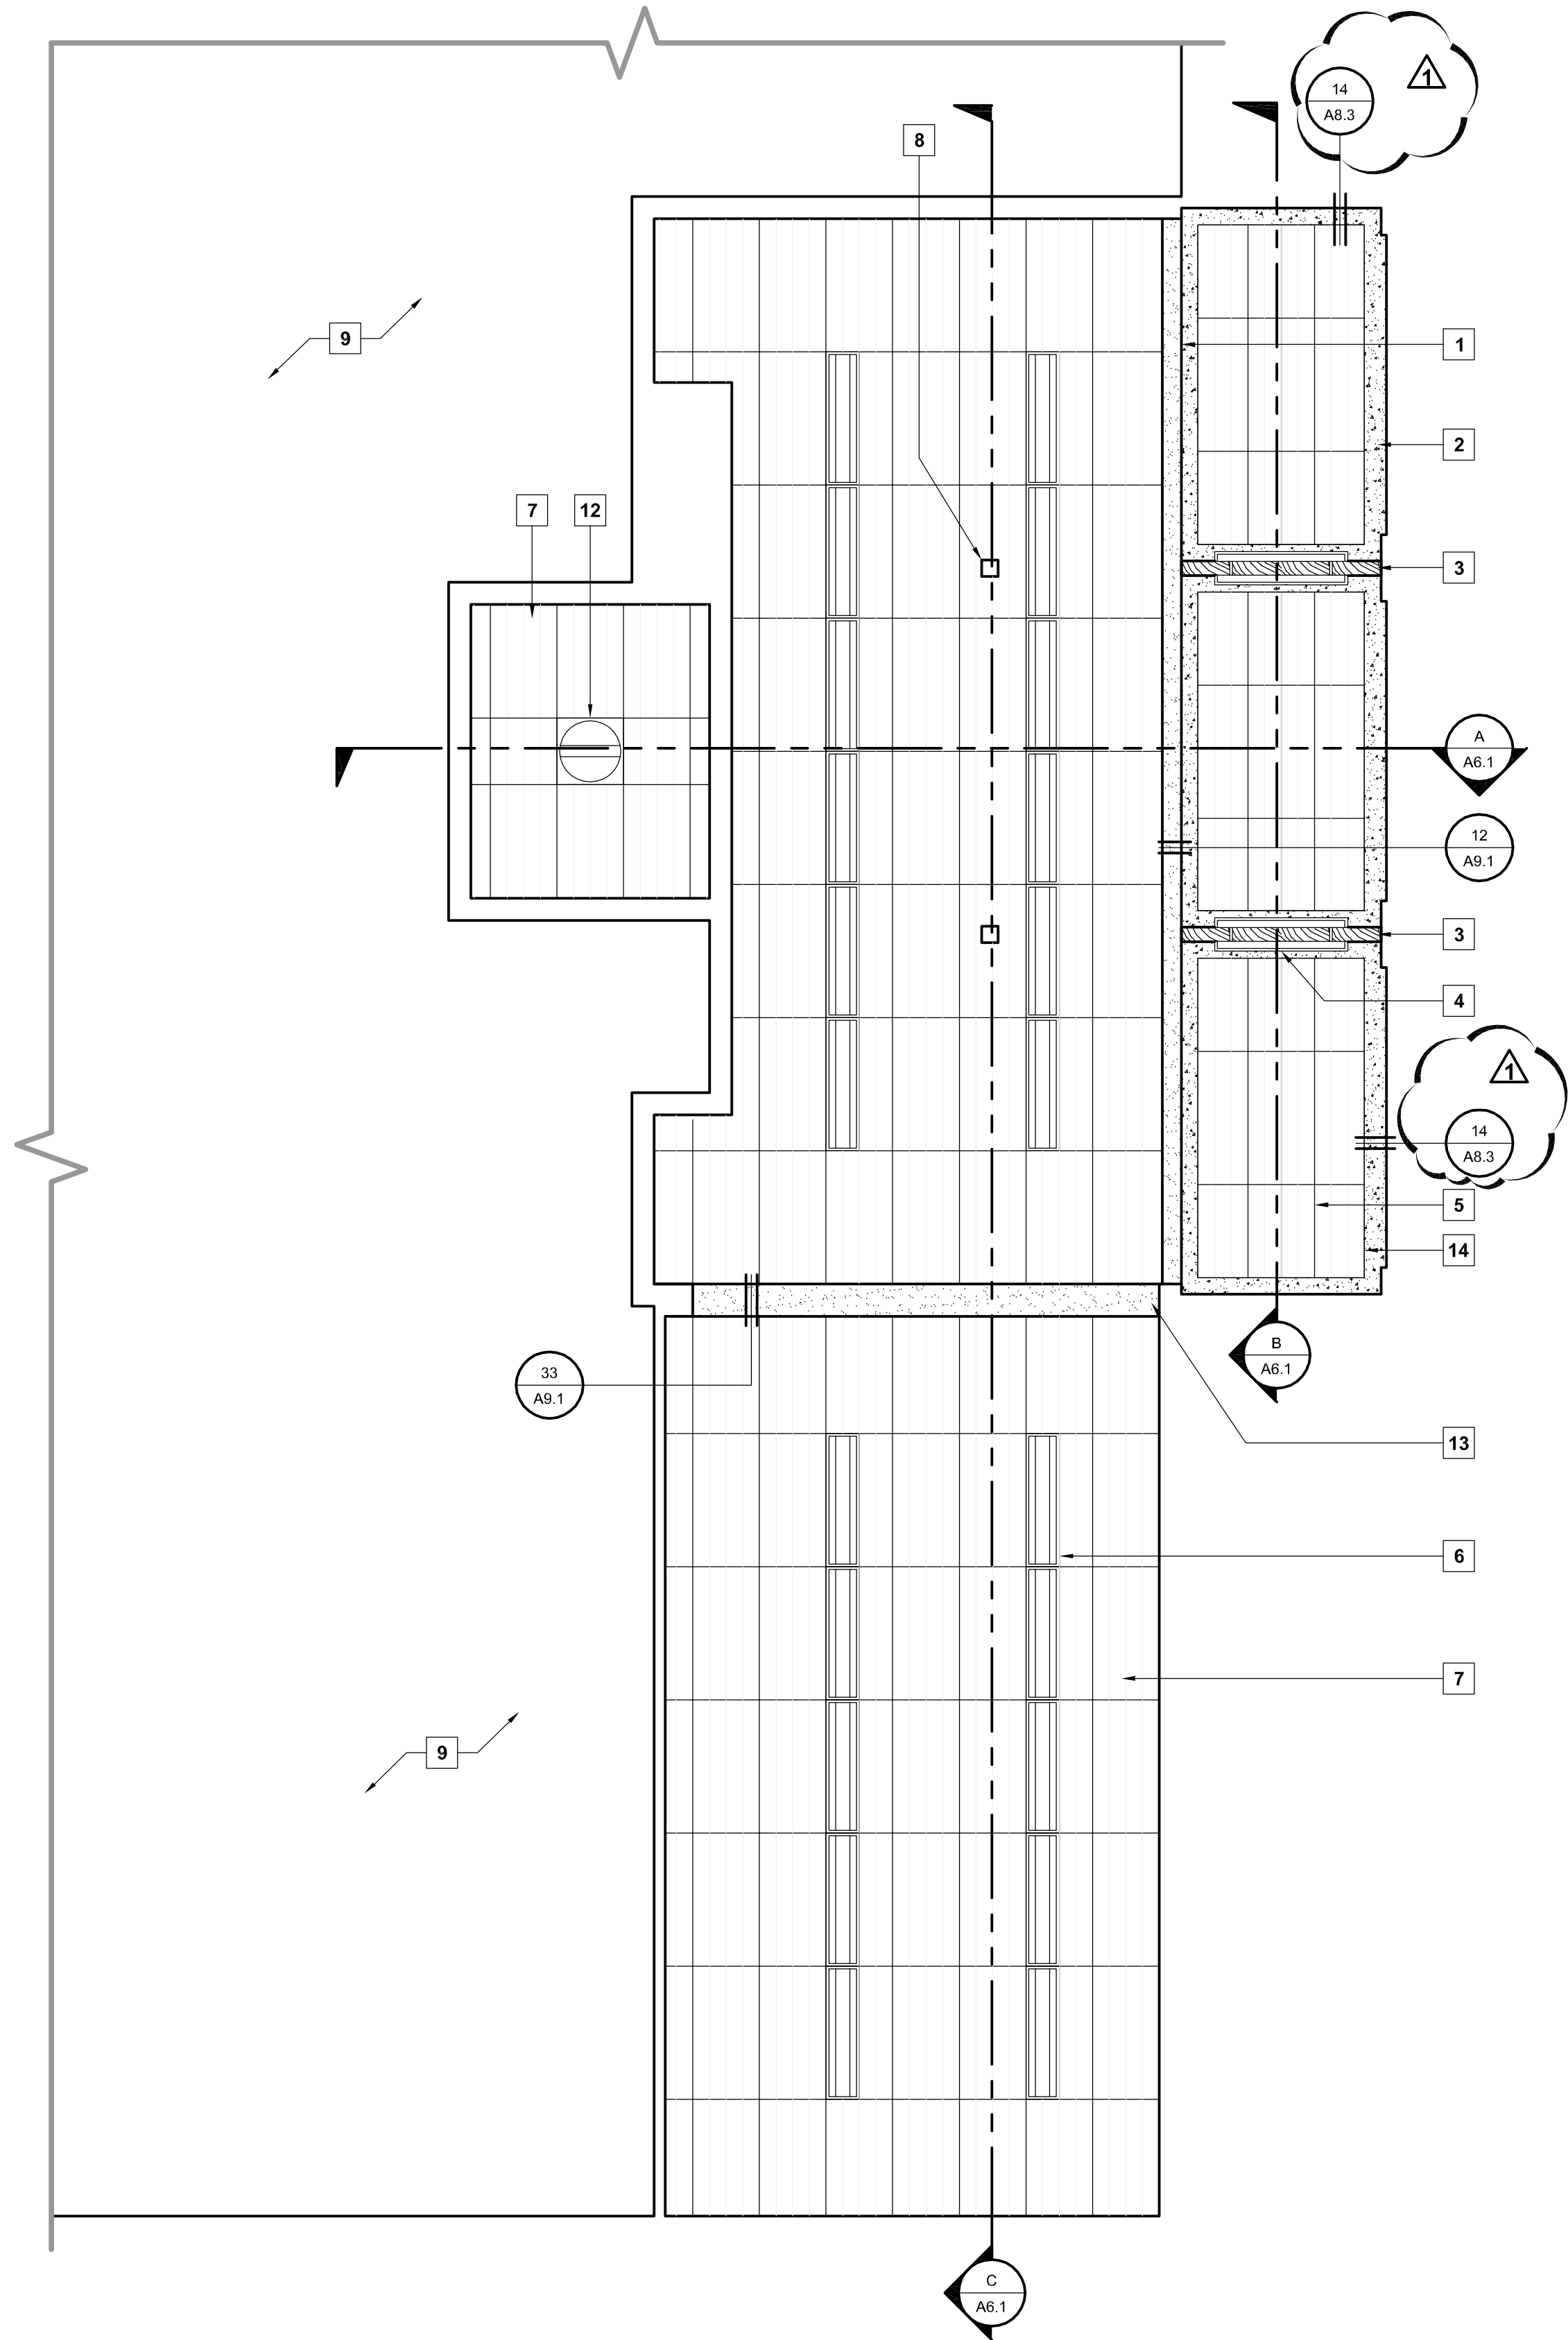



KEYNOTES

1. NEW PAINTED DRYWALL SOFFIT AT 10'-0".
2. EXISTING PLASTER SOFFIT.
3. EXISTING EXPOSED WOOD BEAMS.
4. NEW SUSPENDED INDIRECT FLUORESCENT LIGHT FIXTURE AT +8'-6".
5. NEW SUSPENDED ACOUSTIC TILE CEILING, MATCH SLOPE OF PLASTER SOFFIT.
6. 1' x 4' RECESSED INDIRECT FLUORESCENT LIGHT FIXTURES.
7. NEW SUSPENDED ACOUSTIC TILE CEILING AT +10'-0", TYP.
8. EXISTING STEEL COLUMNS AND ALUMINUM COVERS.
9. NO CEILING WORK IN THIS AREA.
10. PAINTED CONCRETE CEILING AT 8'-8".
11. NEW PLASTER SOFFIT AT 8'-7" A.F.F.
12. RECESSED INDIRECT FLUORESCENT LIGHT FIXTURE.
13. NEW PAINTED DRYWALL SOFFIT AT 8'-10".
14. SUSPENDED CEILING EDGE TRIM.
15. SURFACE MOUNTED LIGHT FIXTURE.
16. CCTV CAMERA LOCATION.
17. HARDENED SUPPLY AIR REGISTER.
18. HARDENED RETURN AIR GRILLE.
19. SUPPLY AIR REGISTER.
20. RETURN AIR GRILLE.
21. SURFACE MOUNTED SPEAKER.
22. SURFACE MOUNTED SMOKE DETECTOR.
23. 24"x36" FLUSH ATTIC ACCESS DOOR, 3 HOUR FIRE RATED. SEE DETAIL 34 / A9.2.




PHASE I KEY PLAN

SCALE: 1/16" = 1'-0"

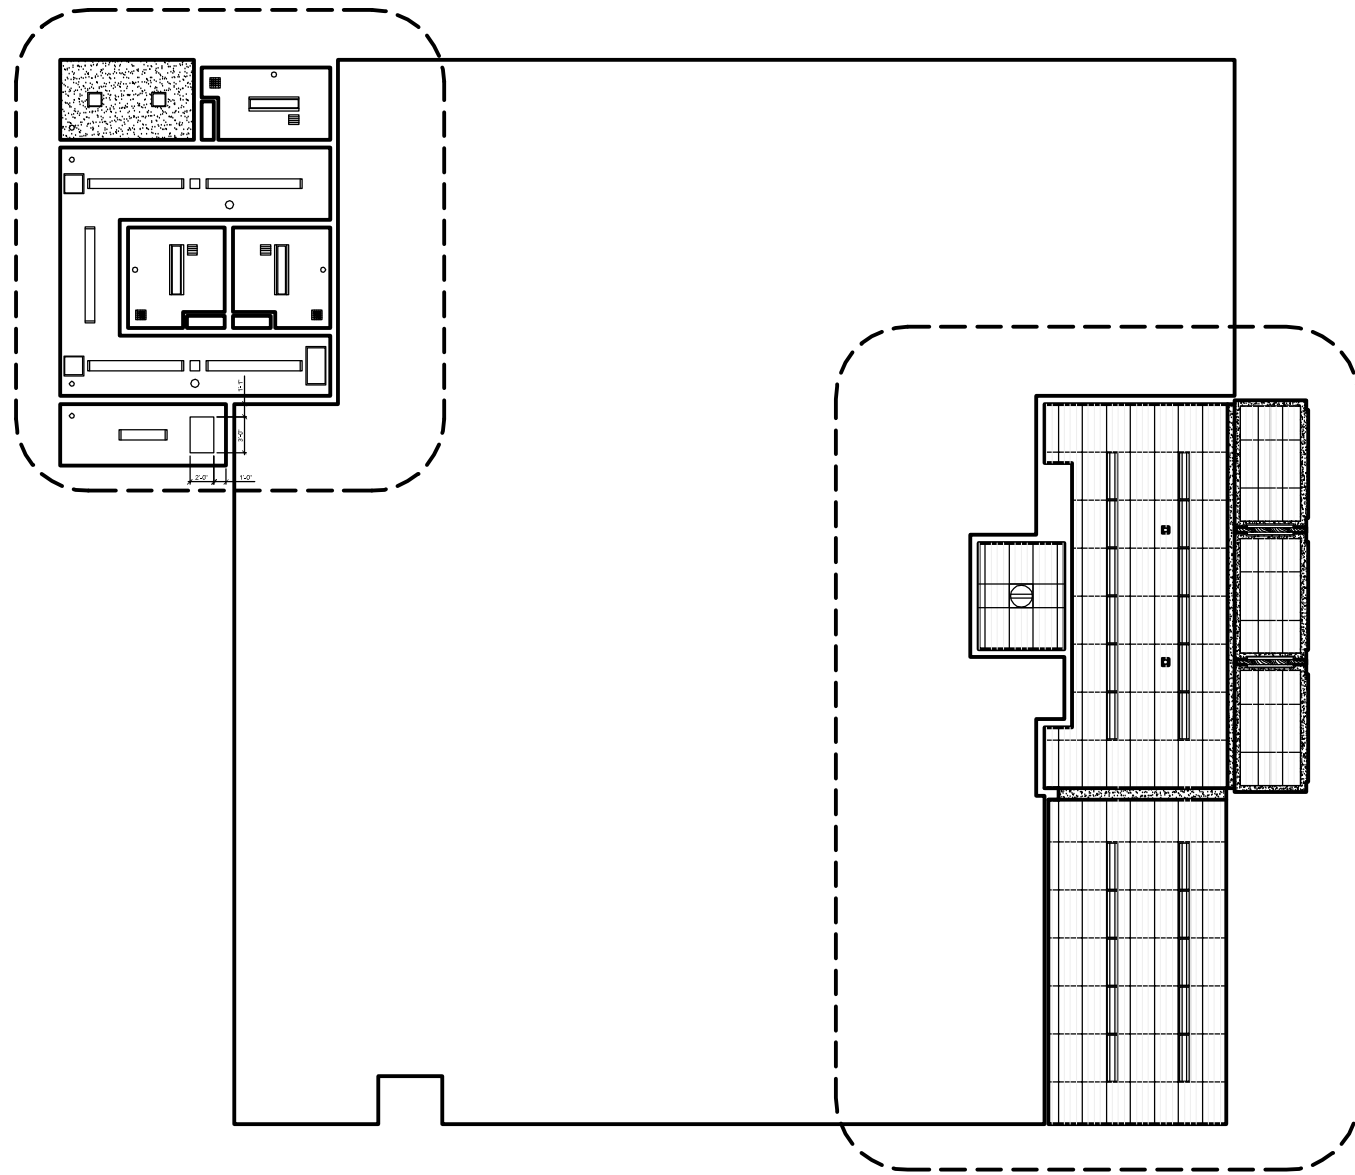

PHASE I REFLECTED CEILING PLAN - HOLDING CELL ADDITION

SCALE: 1/4" = 1'-0"

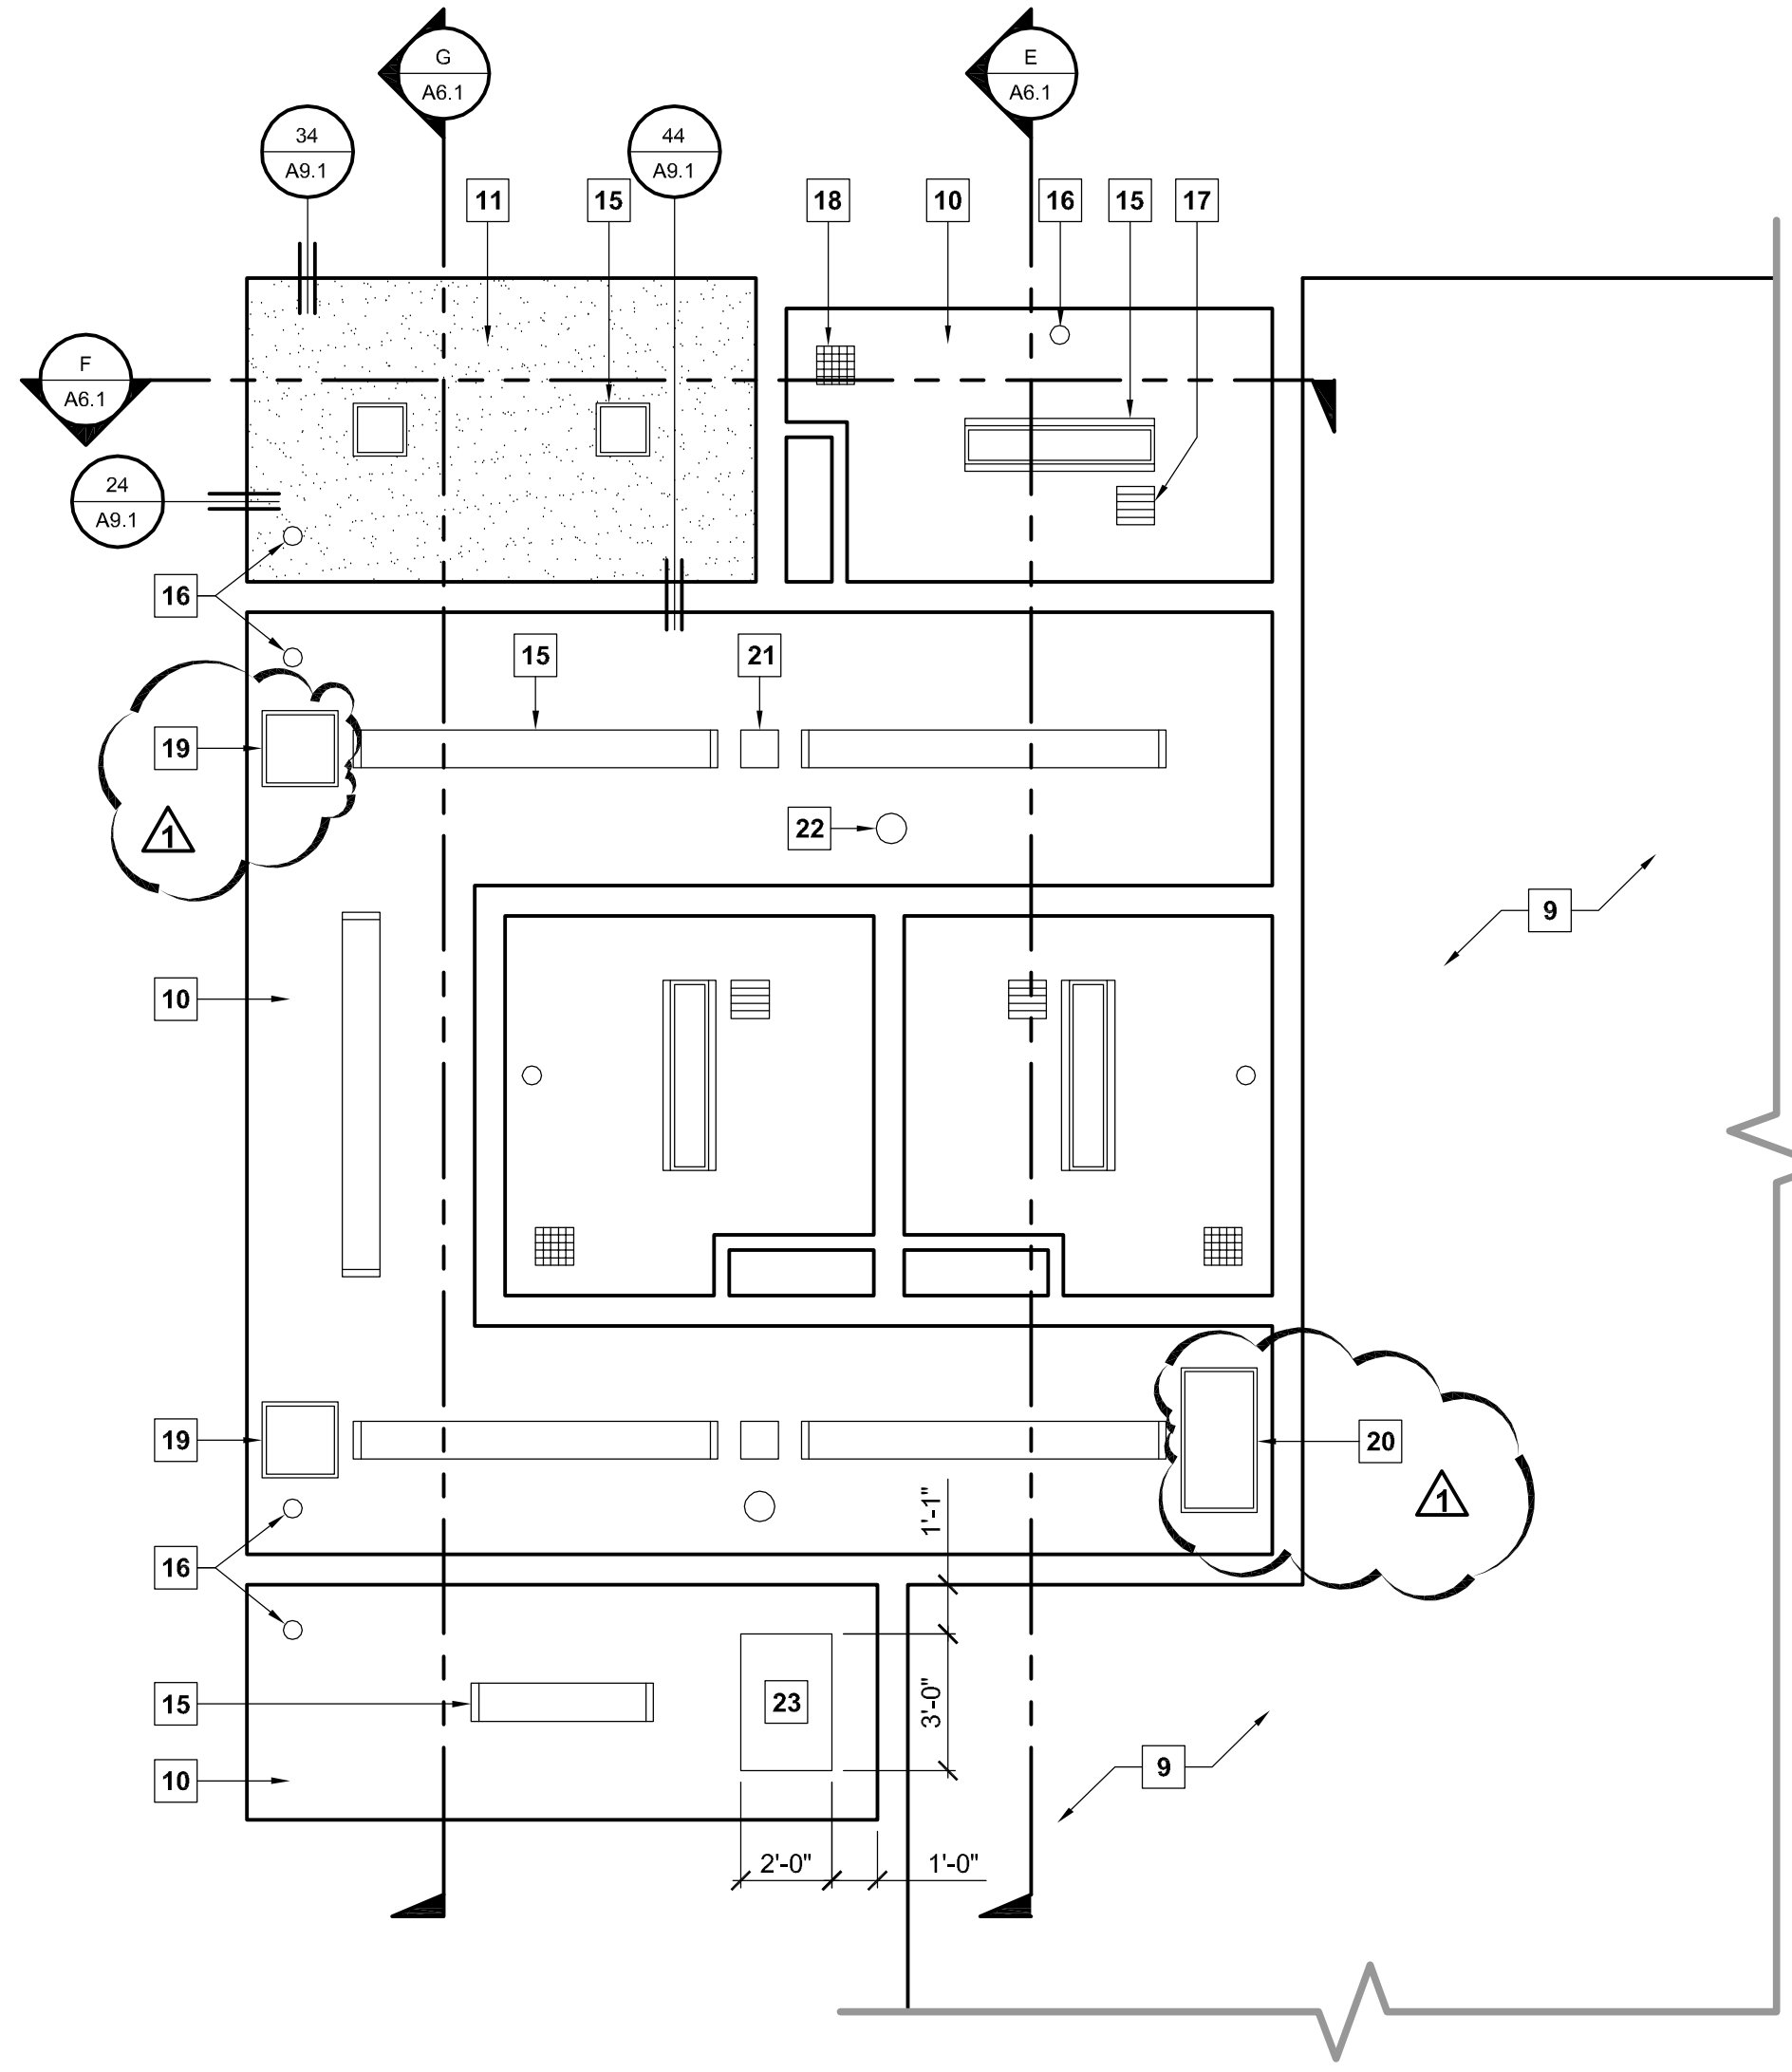

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

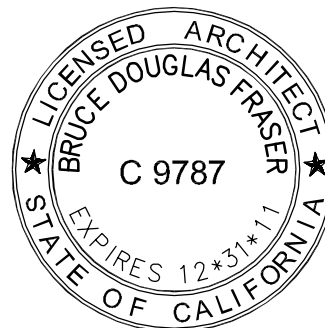

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
REFLECTED
CEILING PLAN**

SHEET #


A4.1

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\A5.1 - Phase I Exterior Elevations.dwg, 6/15/2011 2:42:13 PM, PDF995

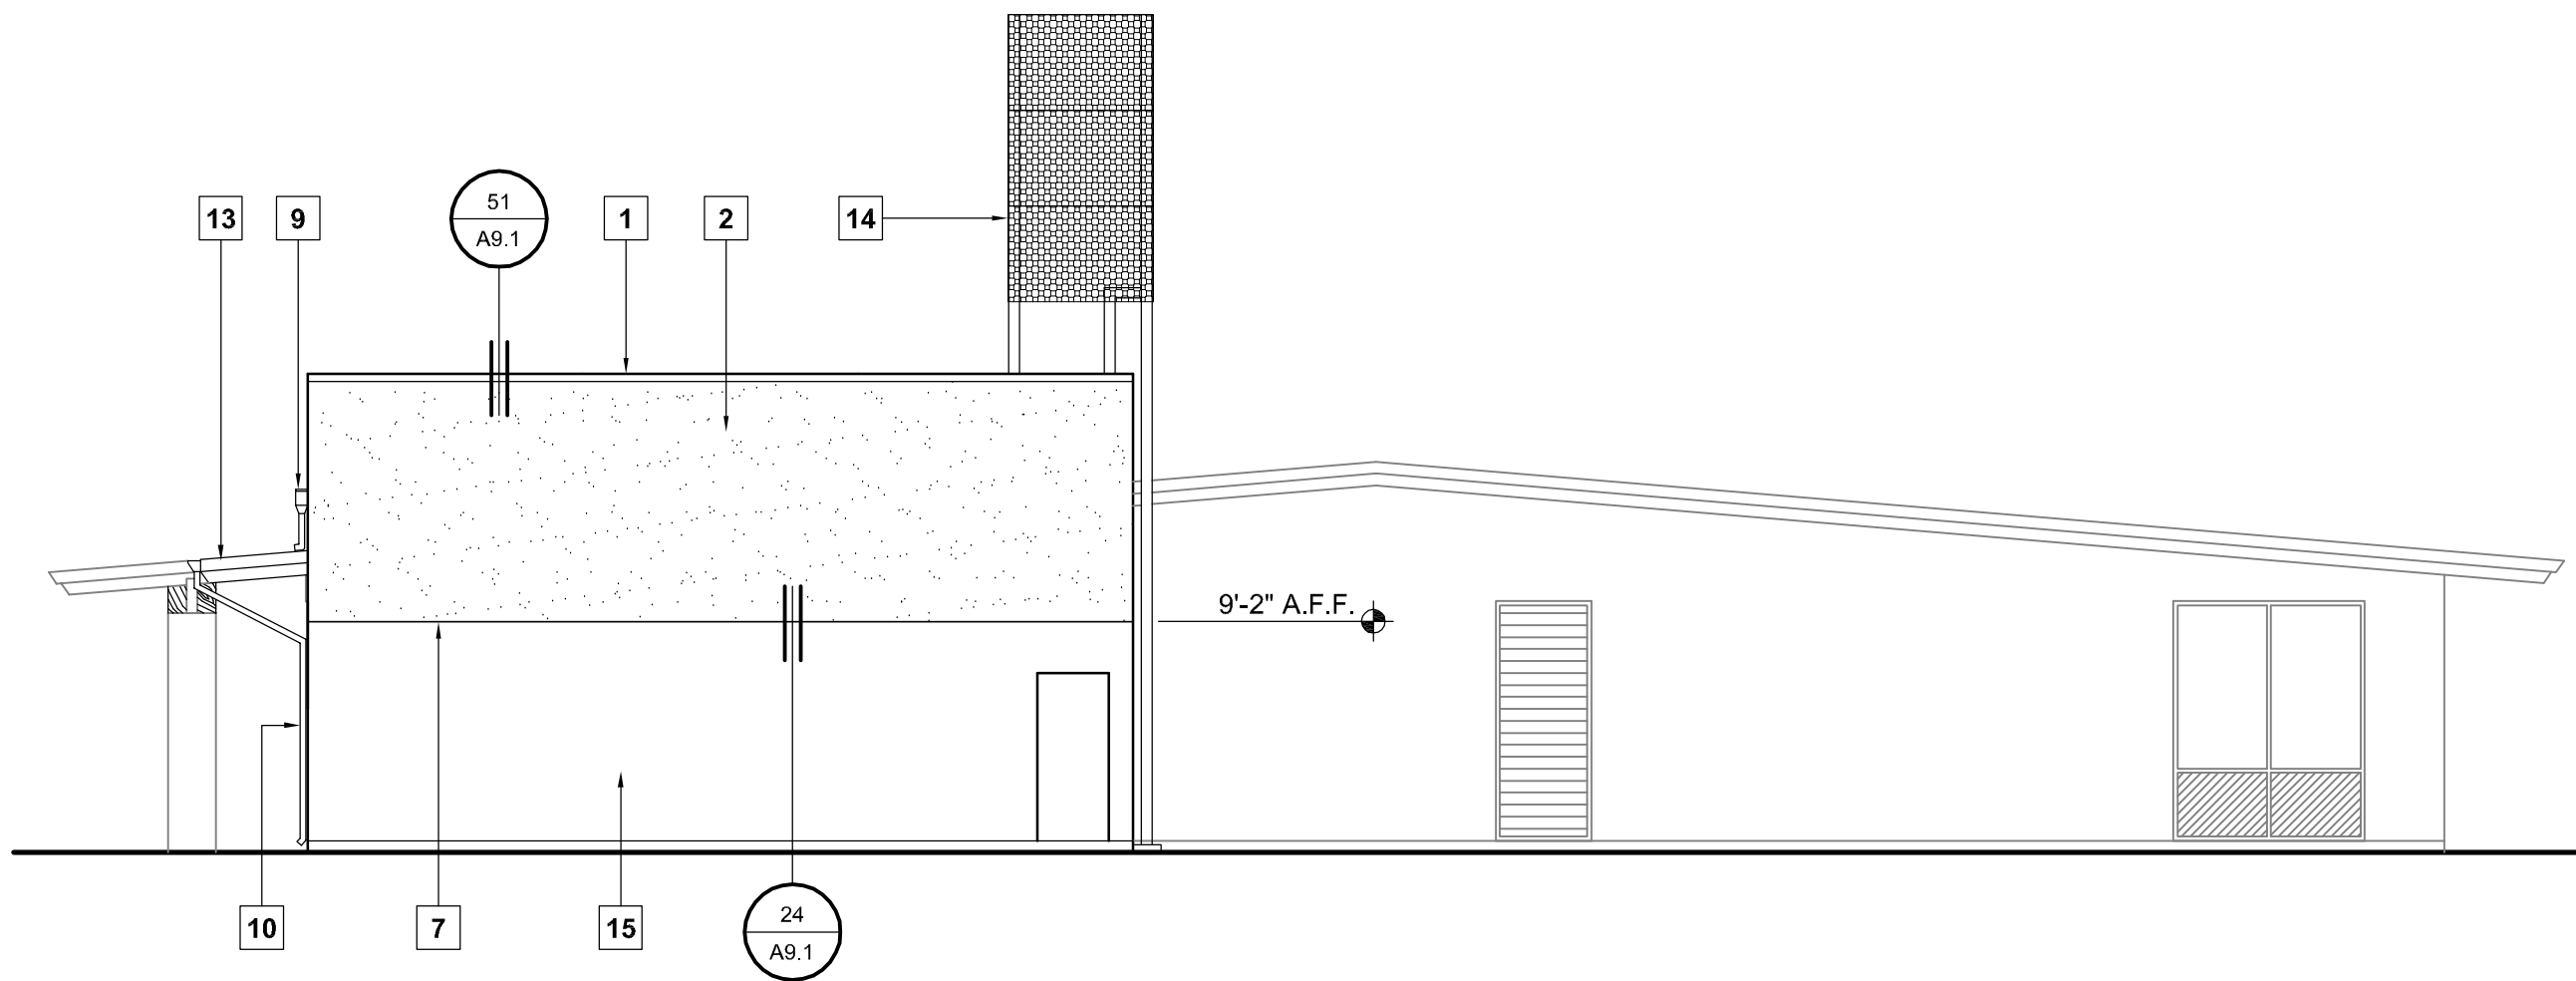


NORTH

SCALE: 1/8" = 1'-0"

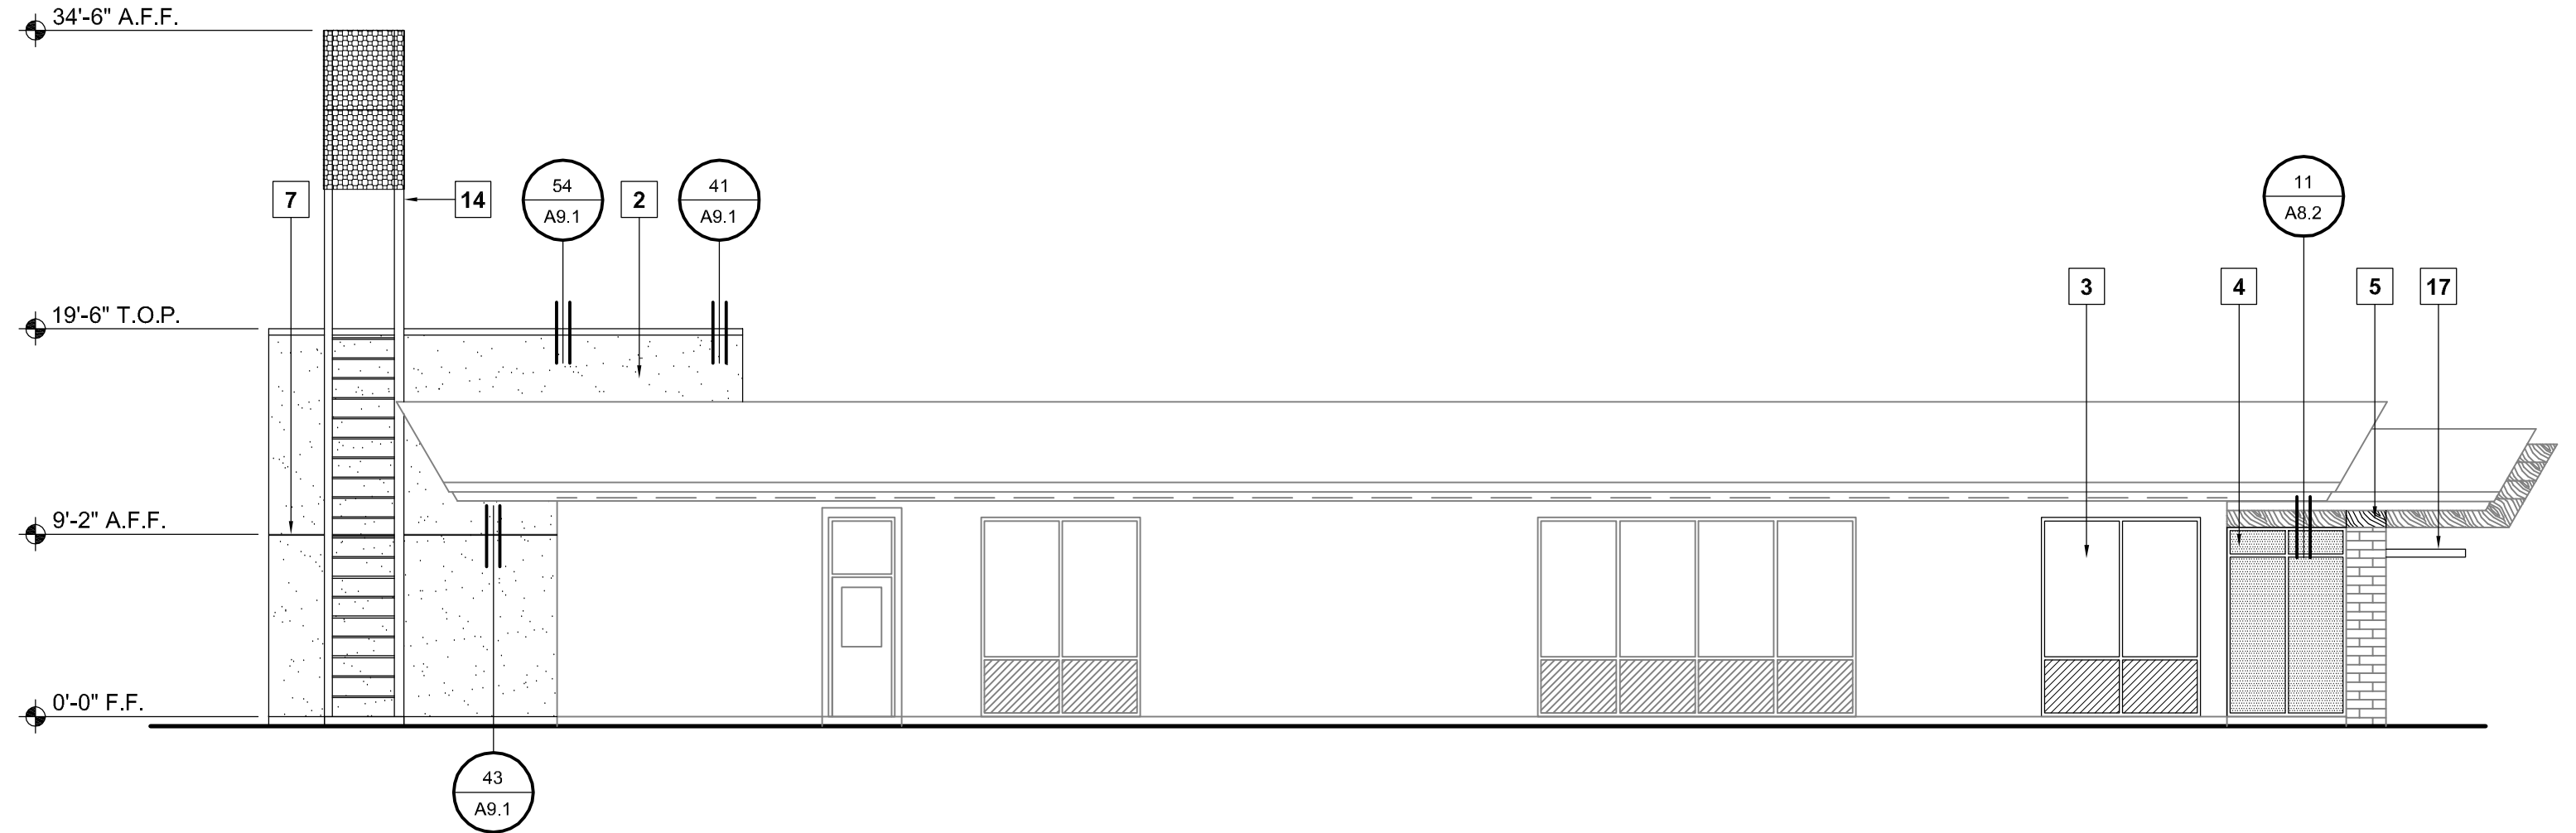


WEST

SCALE: 1/8" = 1'-0"

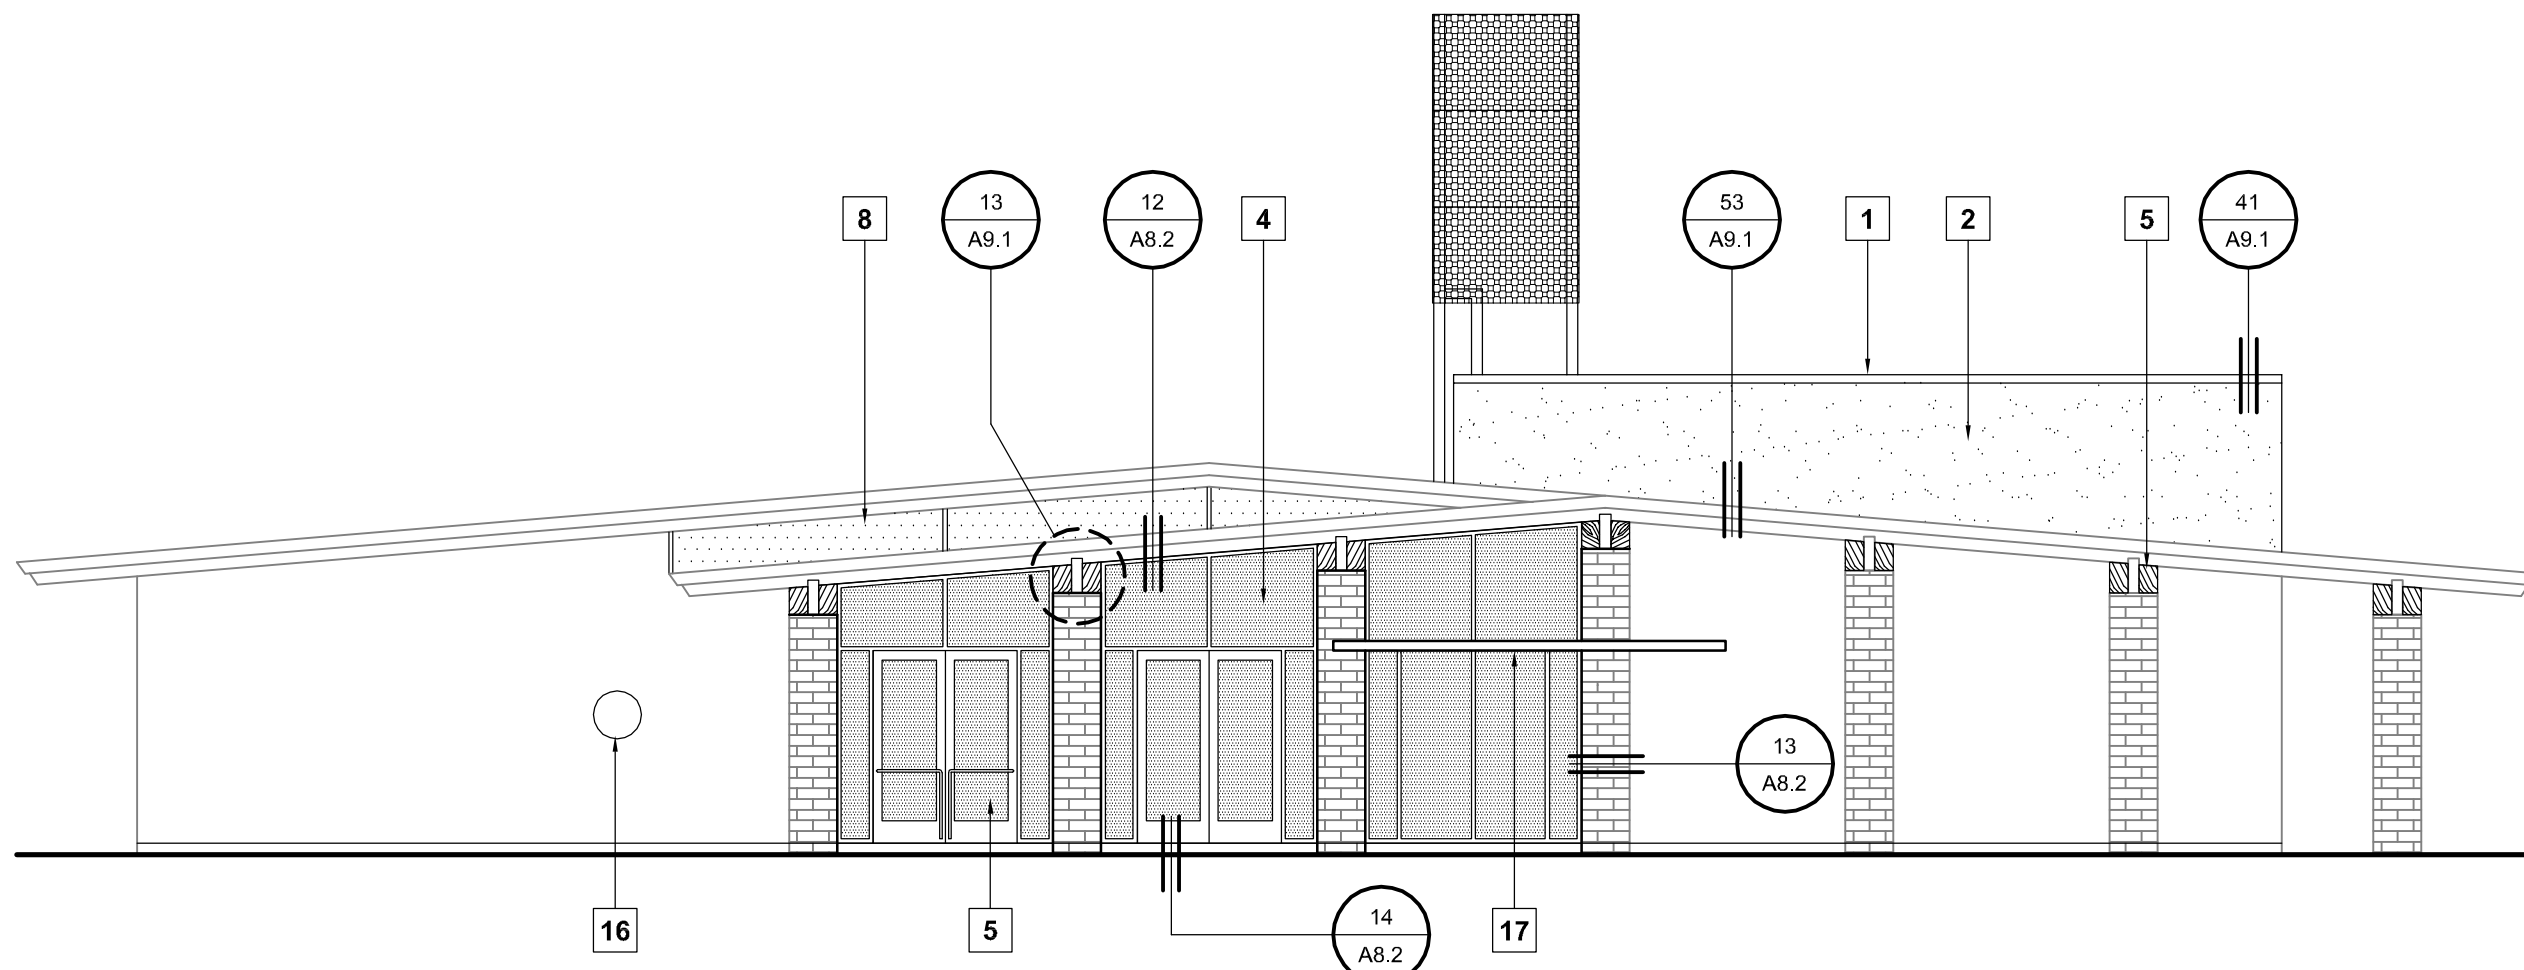

SOUTH

SCALE: 1/8" = 1'-0"

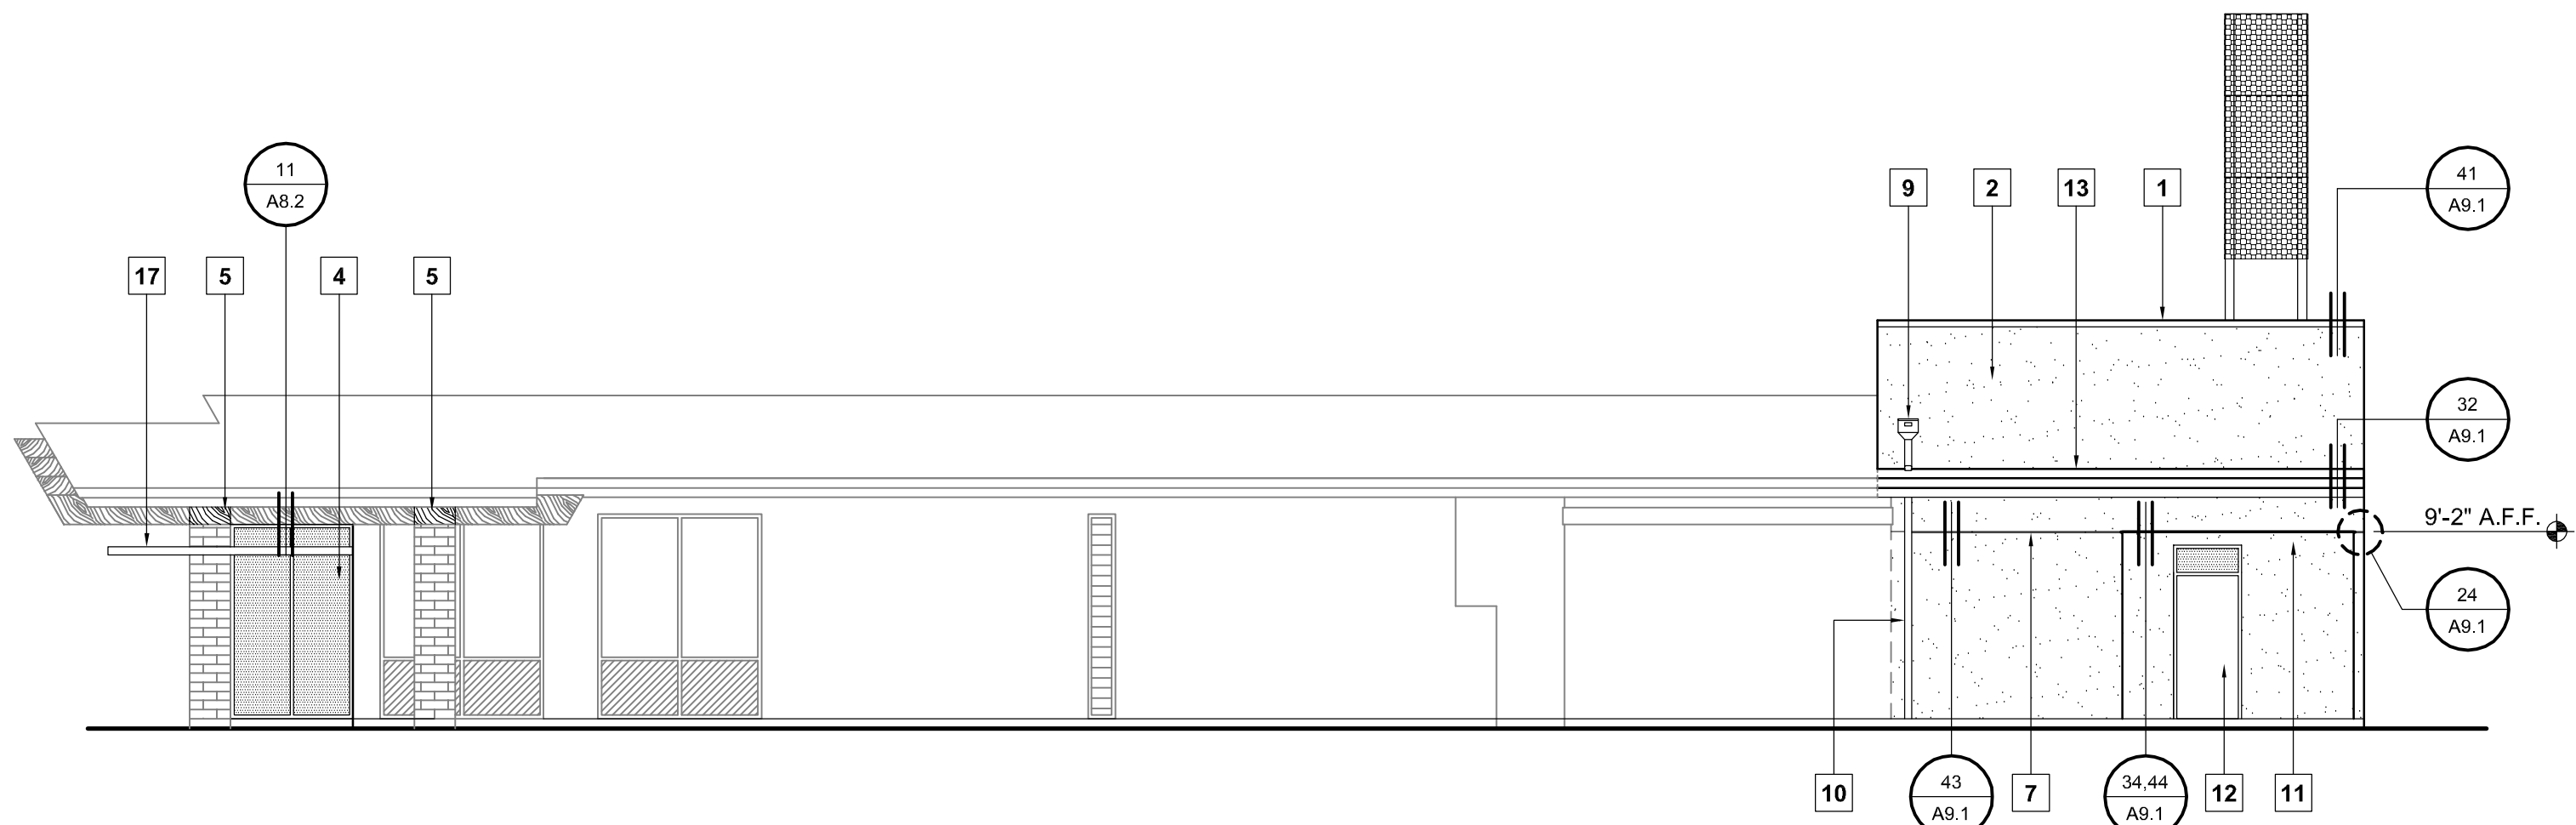

EAST

SCALE: 1/8" = 1'-0"

KEYNOTES:

1. MECHANICAL ROOF WELL PARAPET WALL WITH PAINTED METAL COPING.
2. 3-COAT STUCCO OVER PAPER BACKED METAL LATH.
3. EXISTING STOREFRONT REPLACED AFTER TEMPORARY ENTRANCE IS REMOVED.
4. NEW STOREFRONT.
5. REPLACE EXISTING METAL CAPS WITH INFILL BLOCKING. SEE DETAIL 13 / A9.1. REPAIR ALL GLU-LAM BEAM ENDS. SEE DETAIL 14 / A9.1.
6. NEW STOREFRONT ENTRY DOORS.
7. 2-PIECE EXPANSION SLIP JOINT WITH 5/8" REVEAL.
8. SMOOTH HARDIE BOARD AND BATTENS PAINTED TO MATCH EXISTING ADJACENT WALL.
9. CONDUCTOR HEAD WITH BUILT IN OVERFLOW. DRAIN THROUGH DOWNSPOUT TO ROOF BELOW. SEE DETAILS 21 & 31 / A9.1.
10. NEW DOWNSPOUT TO GRADE.
11. PLASTER SOFFIT.
12. NEW DOOR.
13. NEW ROOF TO MATCH ADJACENT.
14. ROOF ACCESS LADDER / EQUIPMENT TOWER WITH PERFORATED METAL PANELS.
15. CONCRETE BLOCK WALL WITH ACRYLIC BLOCK FILL PRIMER AND ELASTOMERIC PAINT. PLASTER SHALL BE ADDED TO EXPOSED AREA OF WALL DURING THE CONSTRUCTION OF PHASE 2.
16. EXISTING SEAL TO REMAIN. EXISTING ADDRESS NUMBERS ABOVE TO BE REMOVED.
17. NEW CANTILEVERED SUN CONTROL DEVICE. SEE DETAIL 33 / A9.2.



PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com


PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

06/20/11

SIGNED

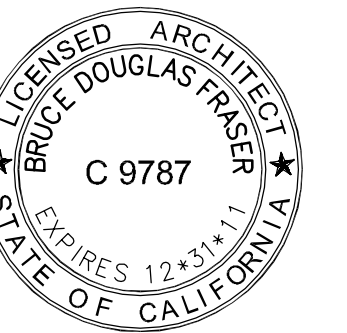

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

PHASE I EXTERIOR ELEVATIONS


SHEET #

A5.1

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A6.1 - Phase I Sections.dwg, 6/15/2011 2:47:25 PM, PDF995

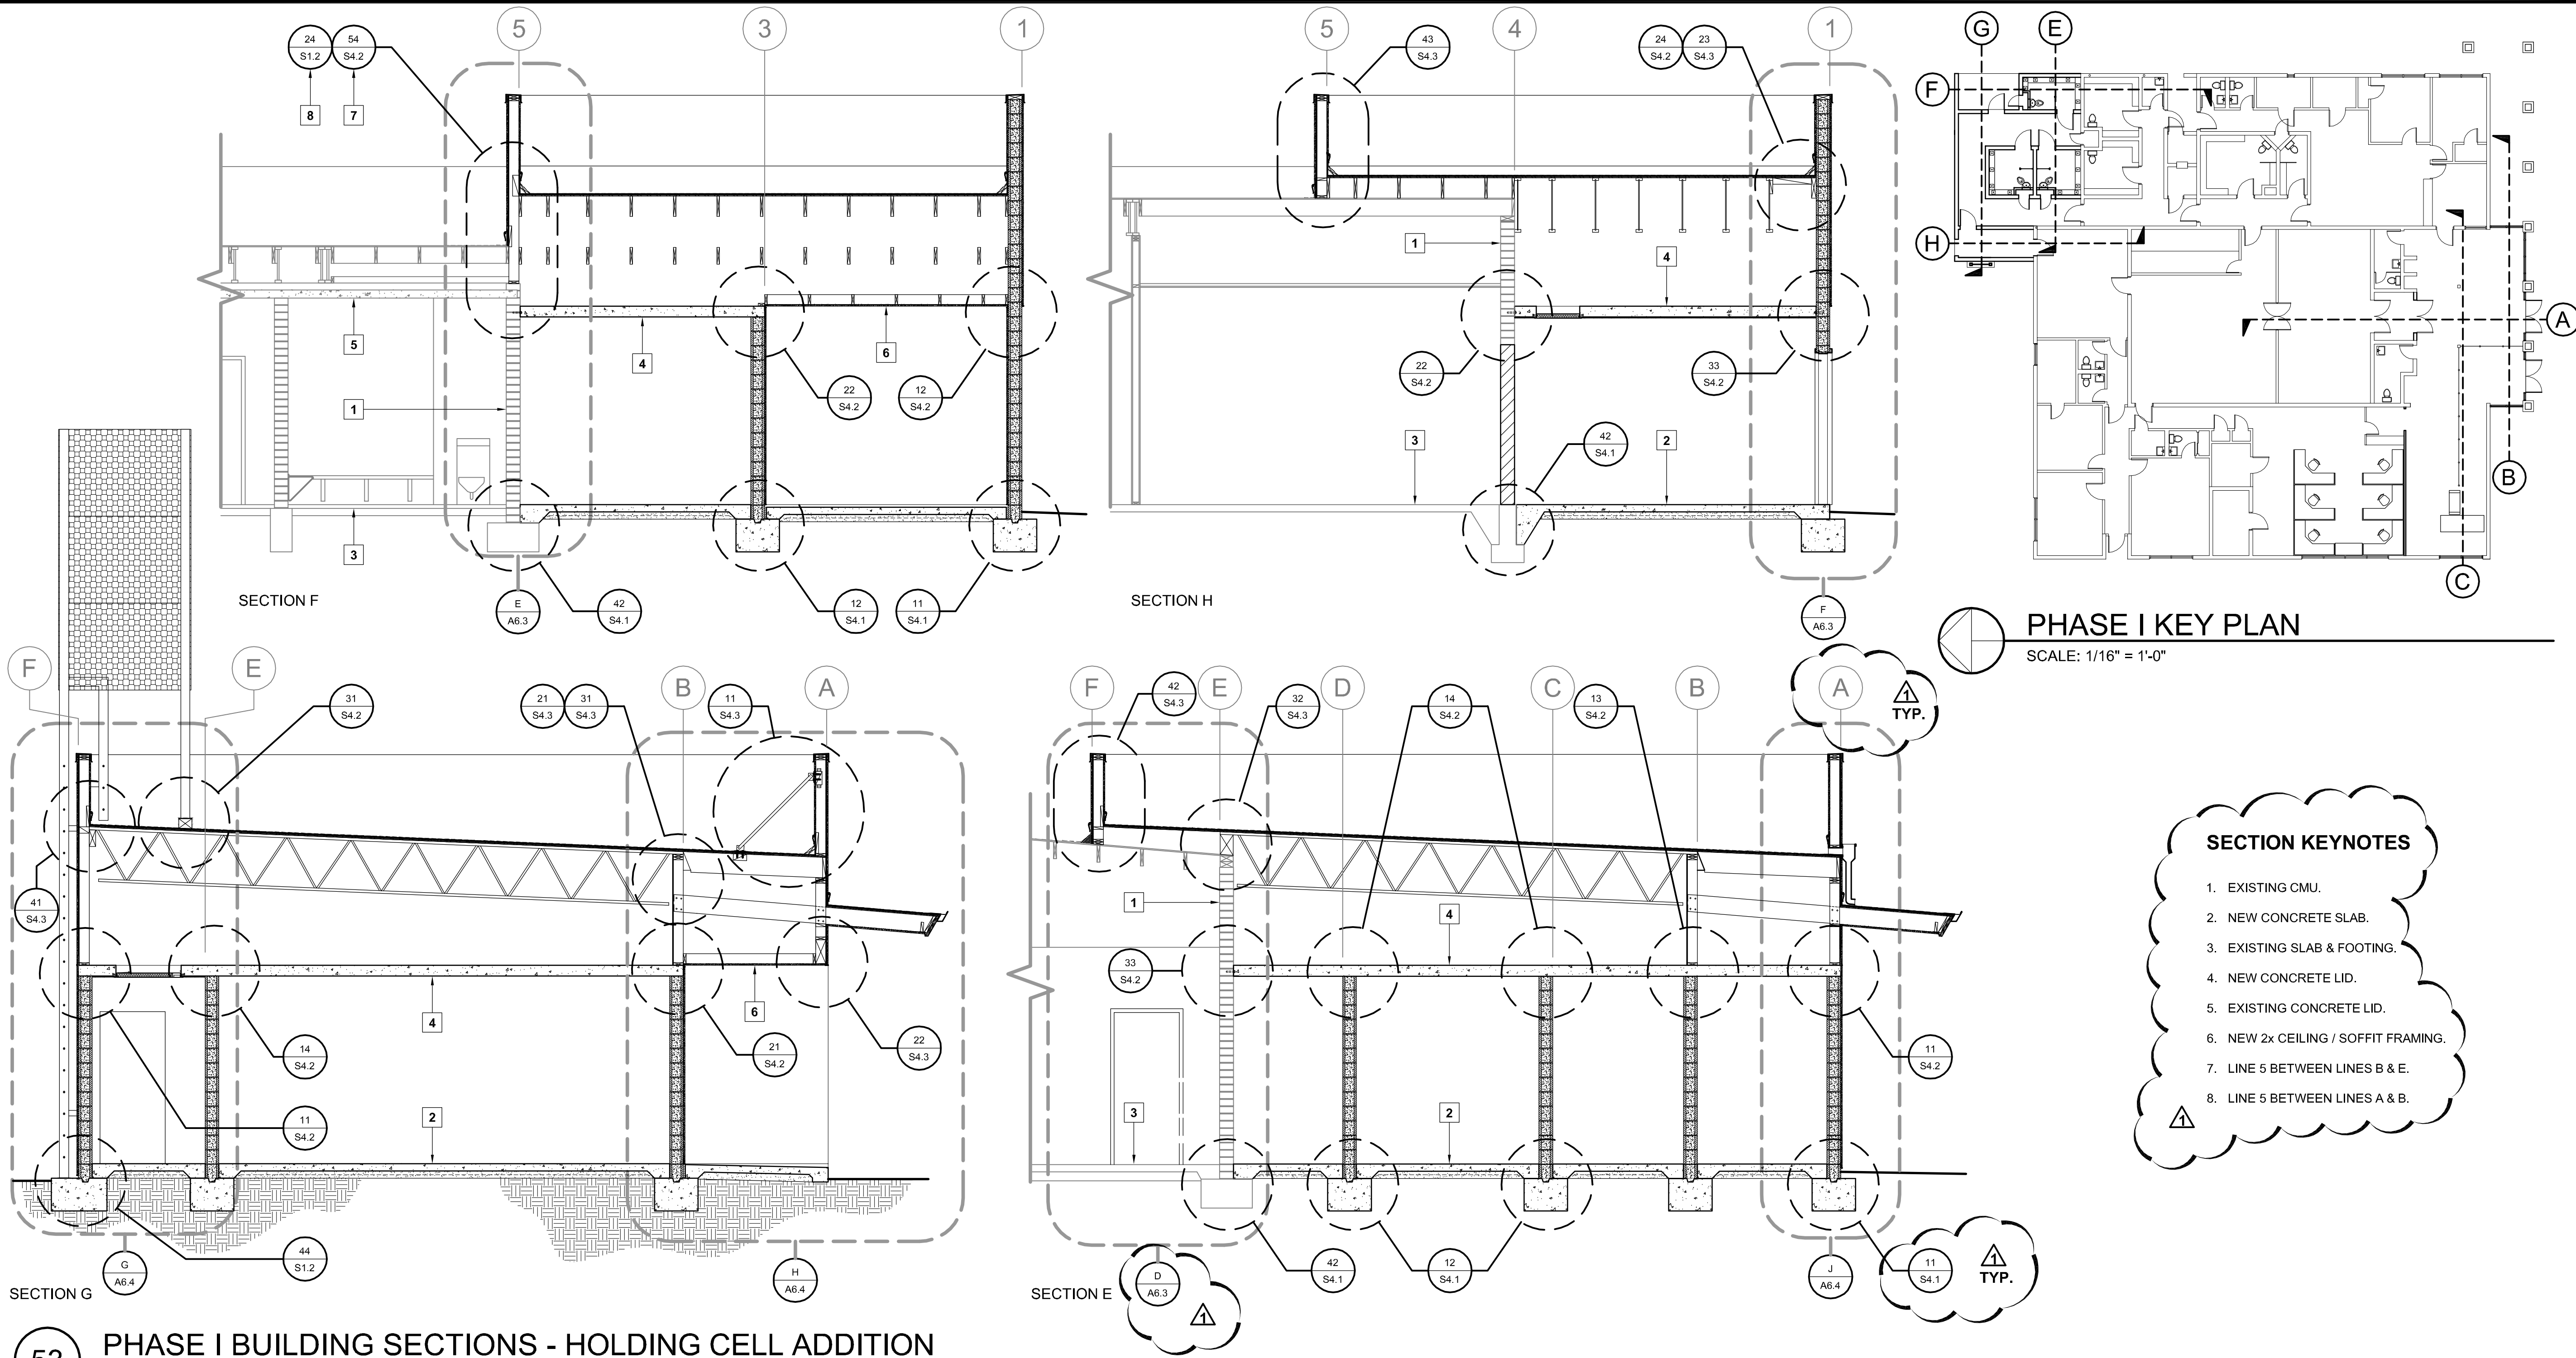

53 PHASE I BUILDING SECTIONS - HOLDING CELL ADDITION
SCALE: 1/4" = 1'-0"

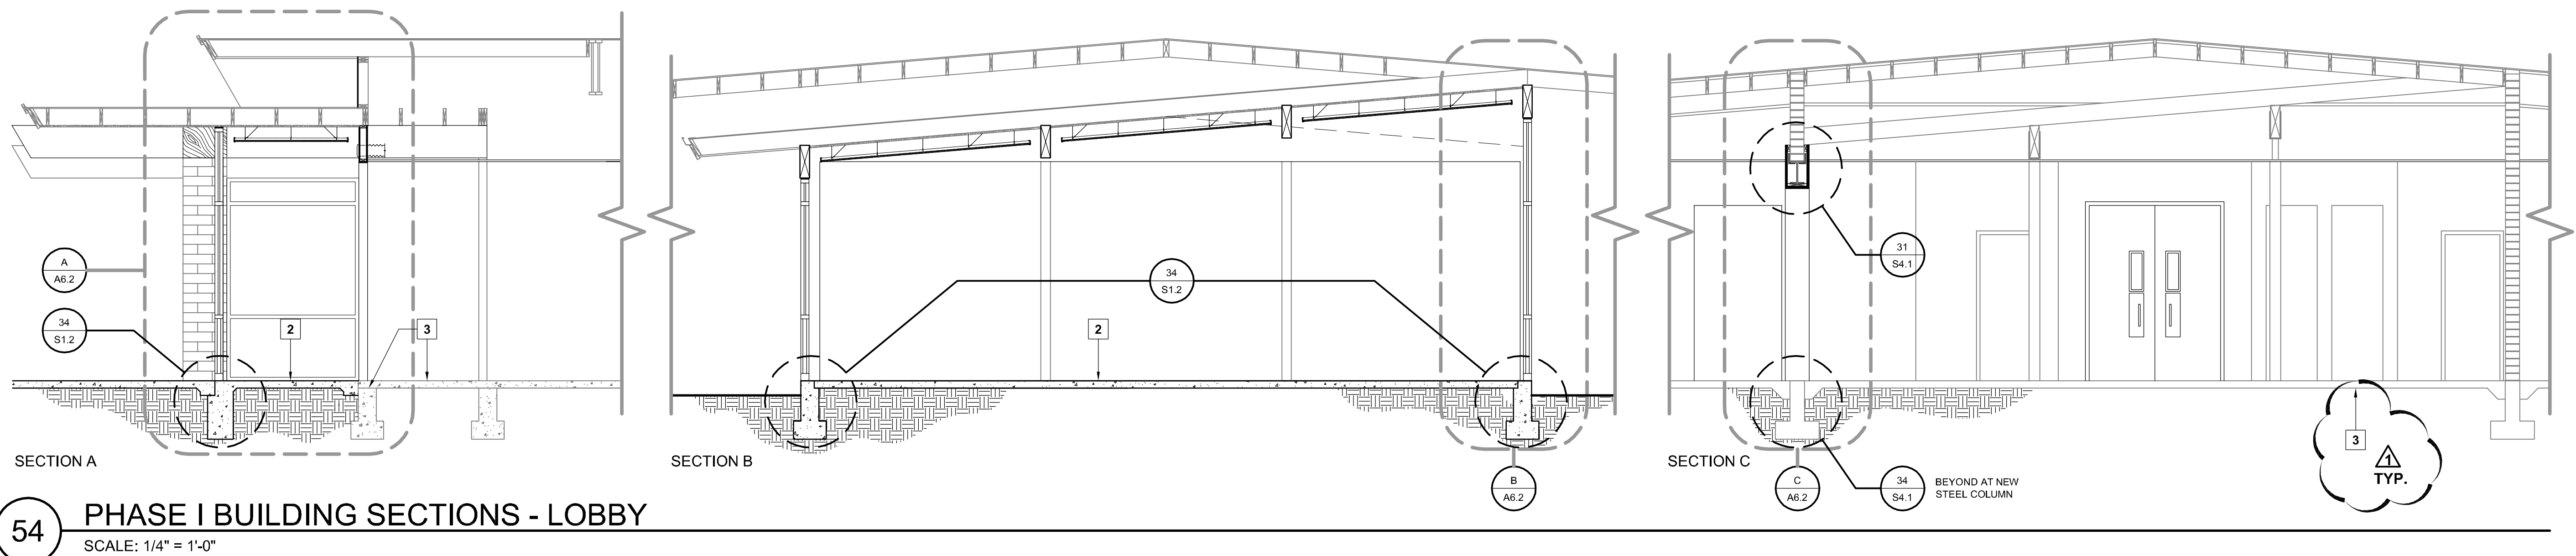

54 PHASE I BUILDING SECTIONS - LOBBY
SCALE: 1/4" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

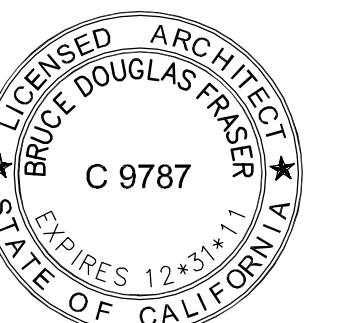

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
BUILDING
SECTIONS**


SHEET #

A6.1


\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A6.1 - Phase I Sections.dwg, 4/29/2011 3:27:09 PM, PDF995

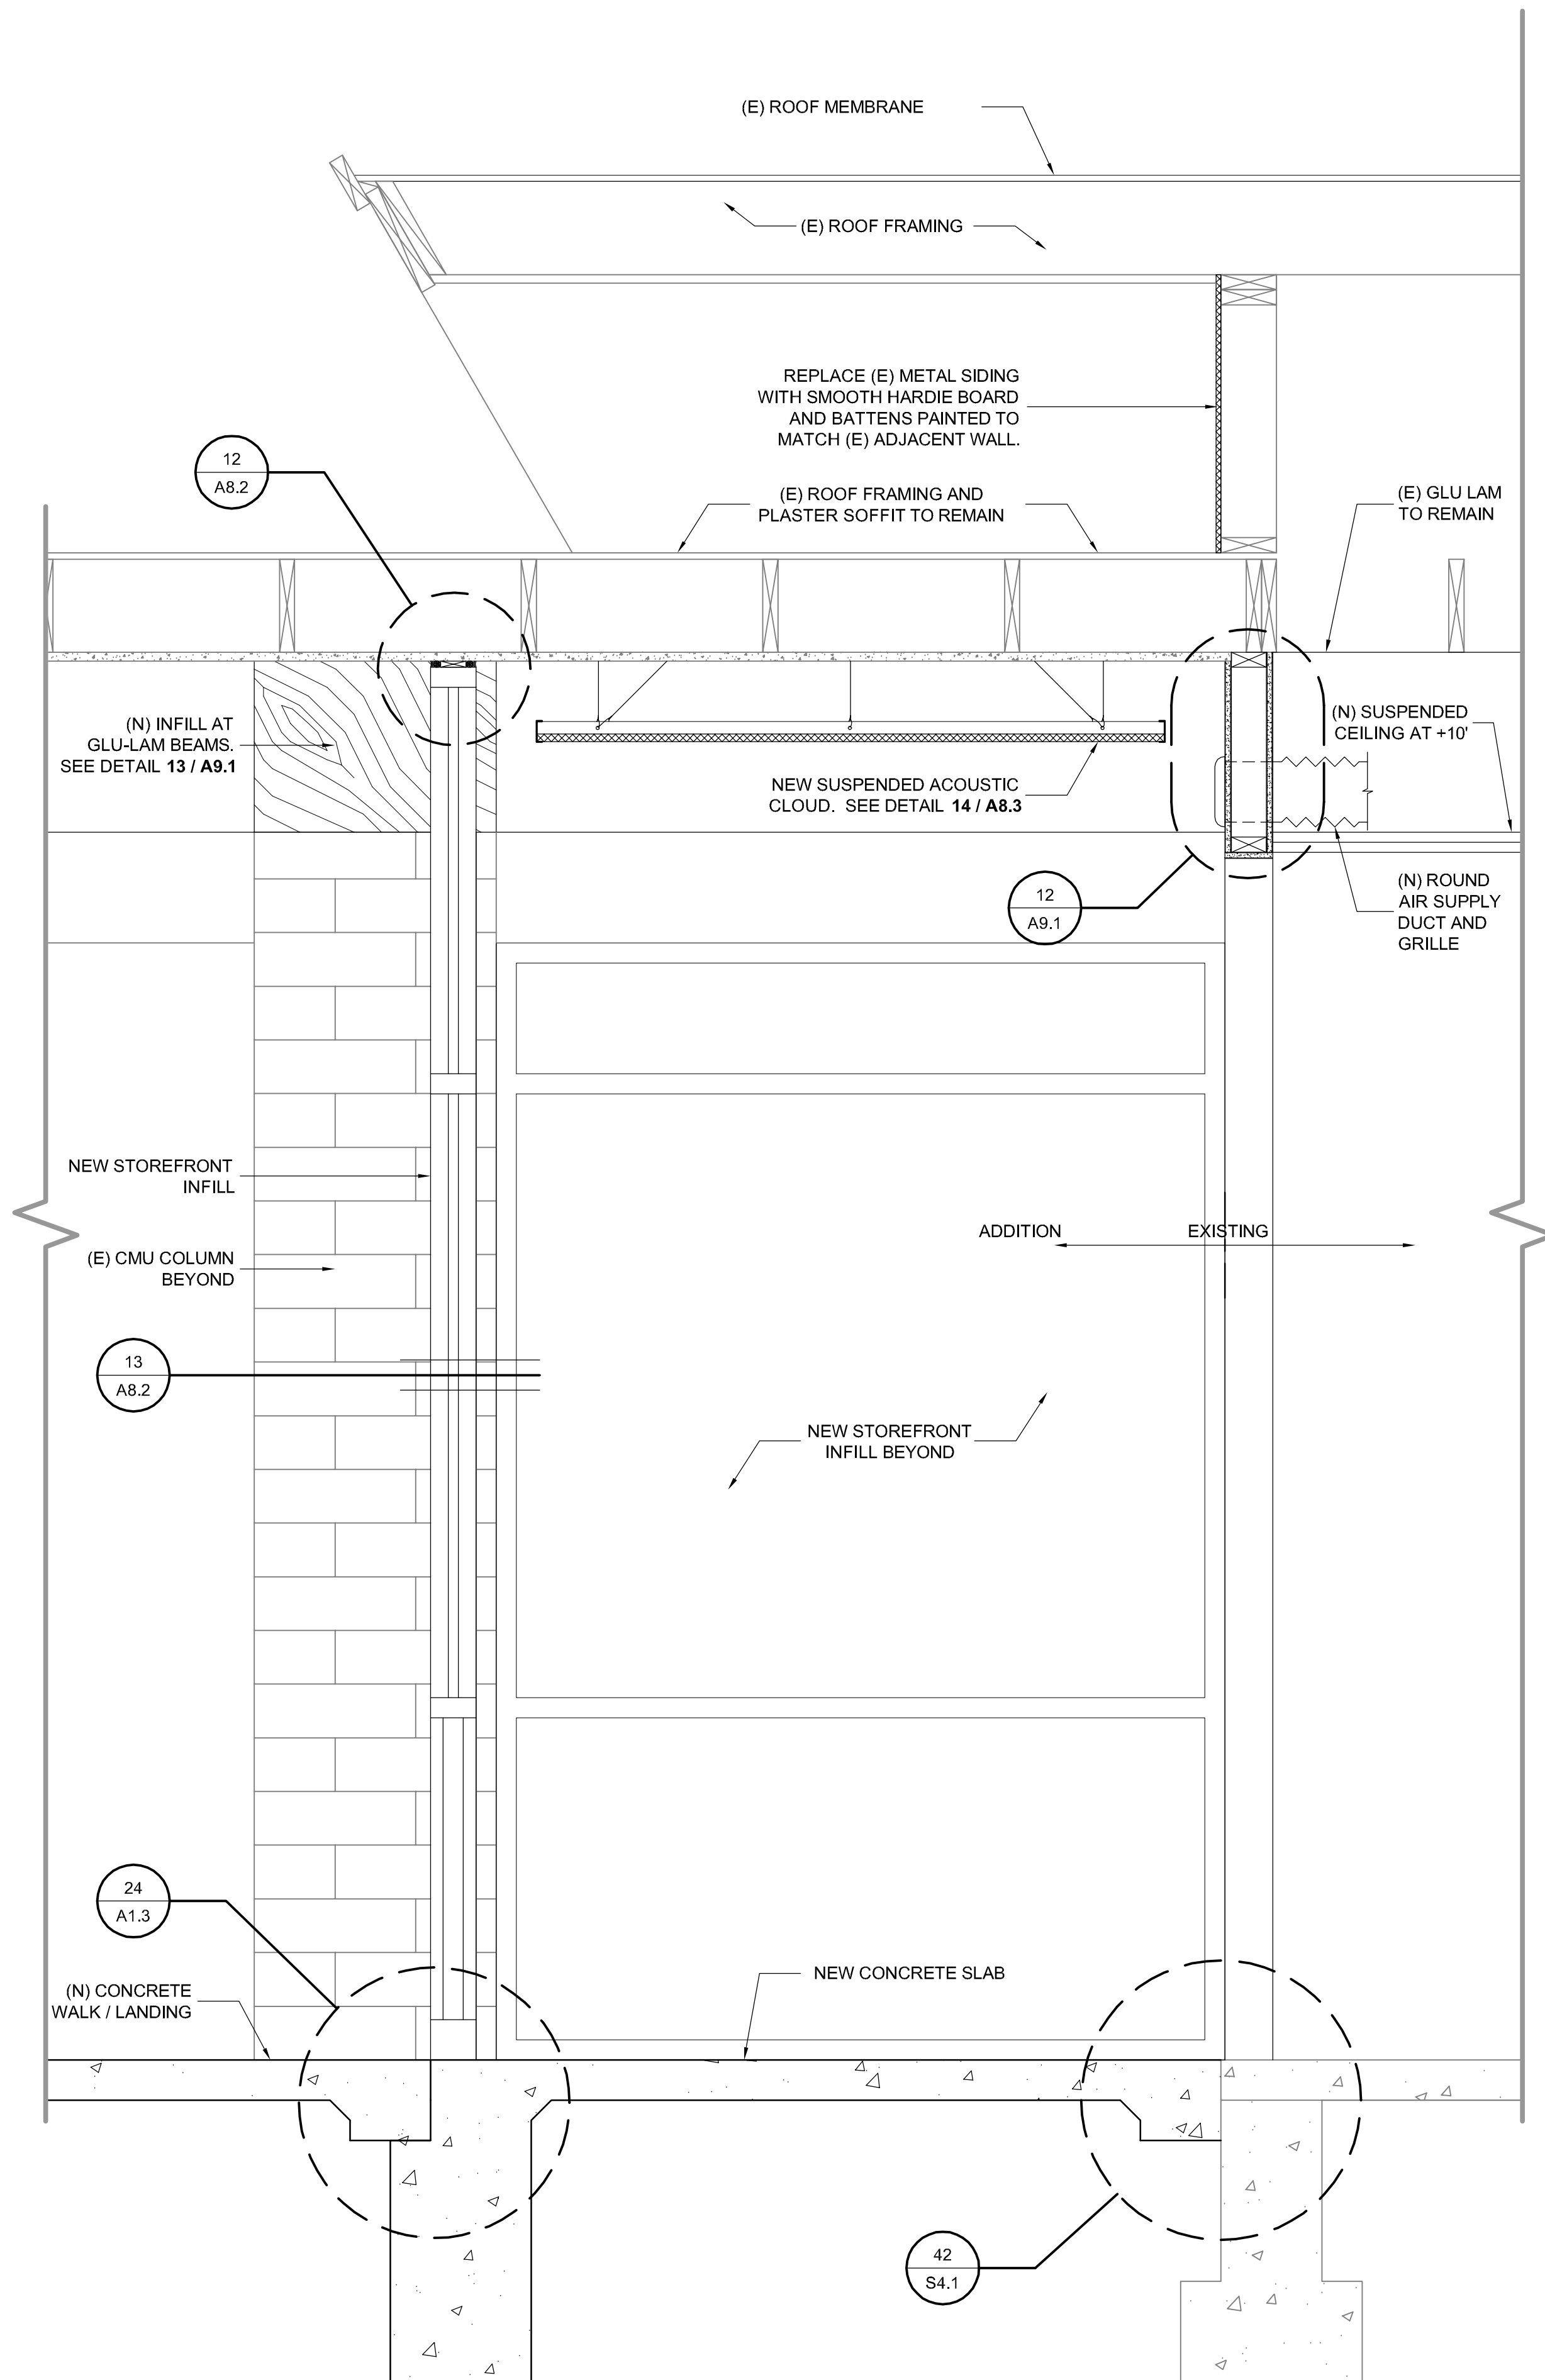

54 SECTION A
SCALE: 1" = 1'-0"

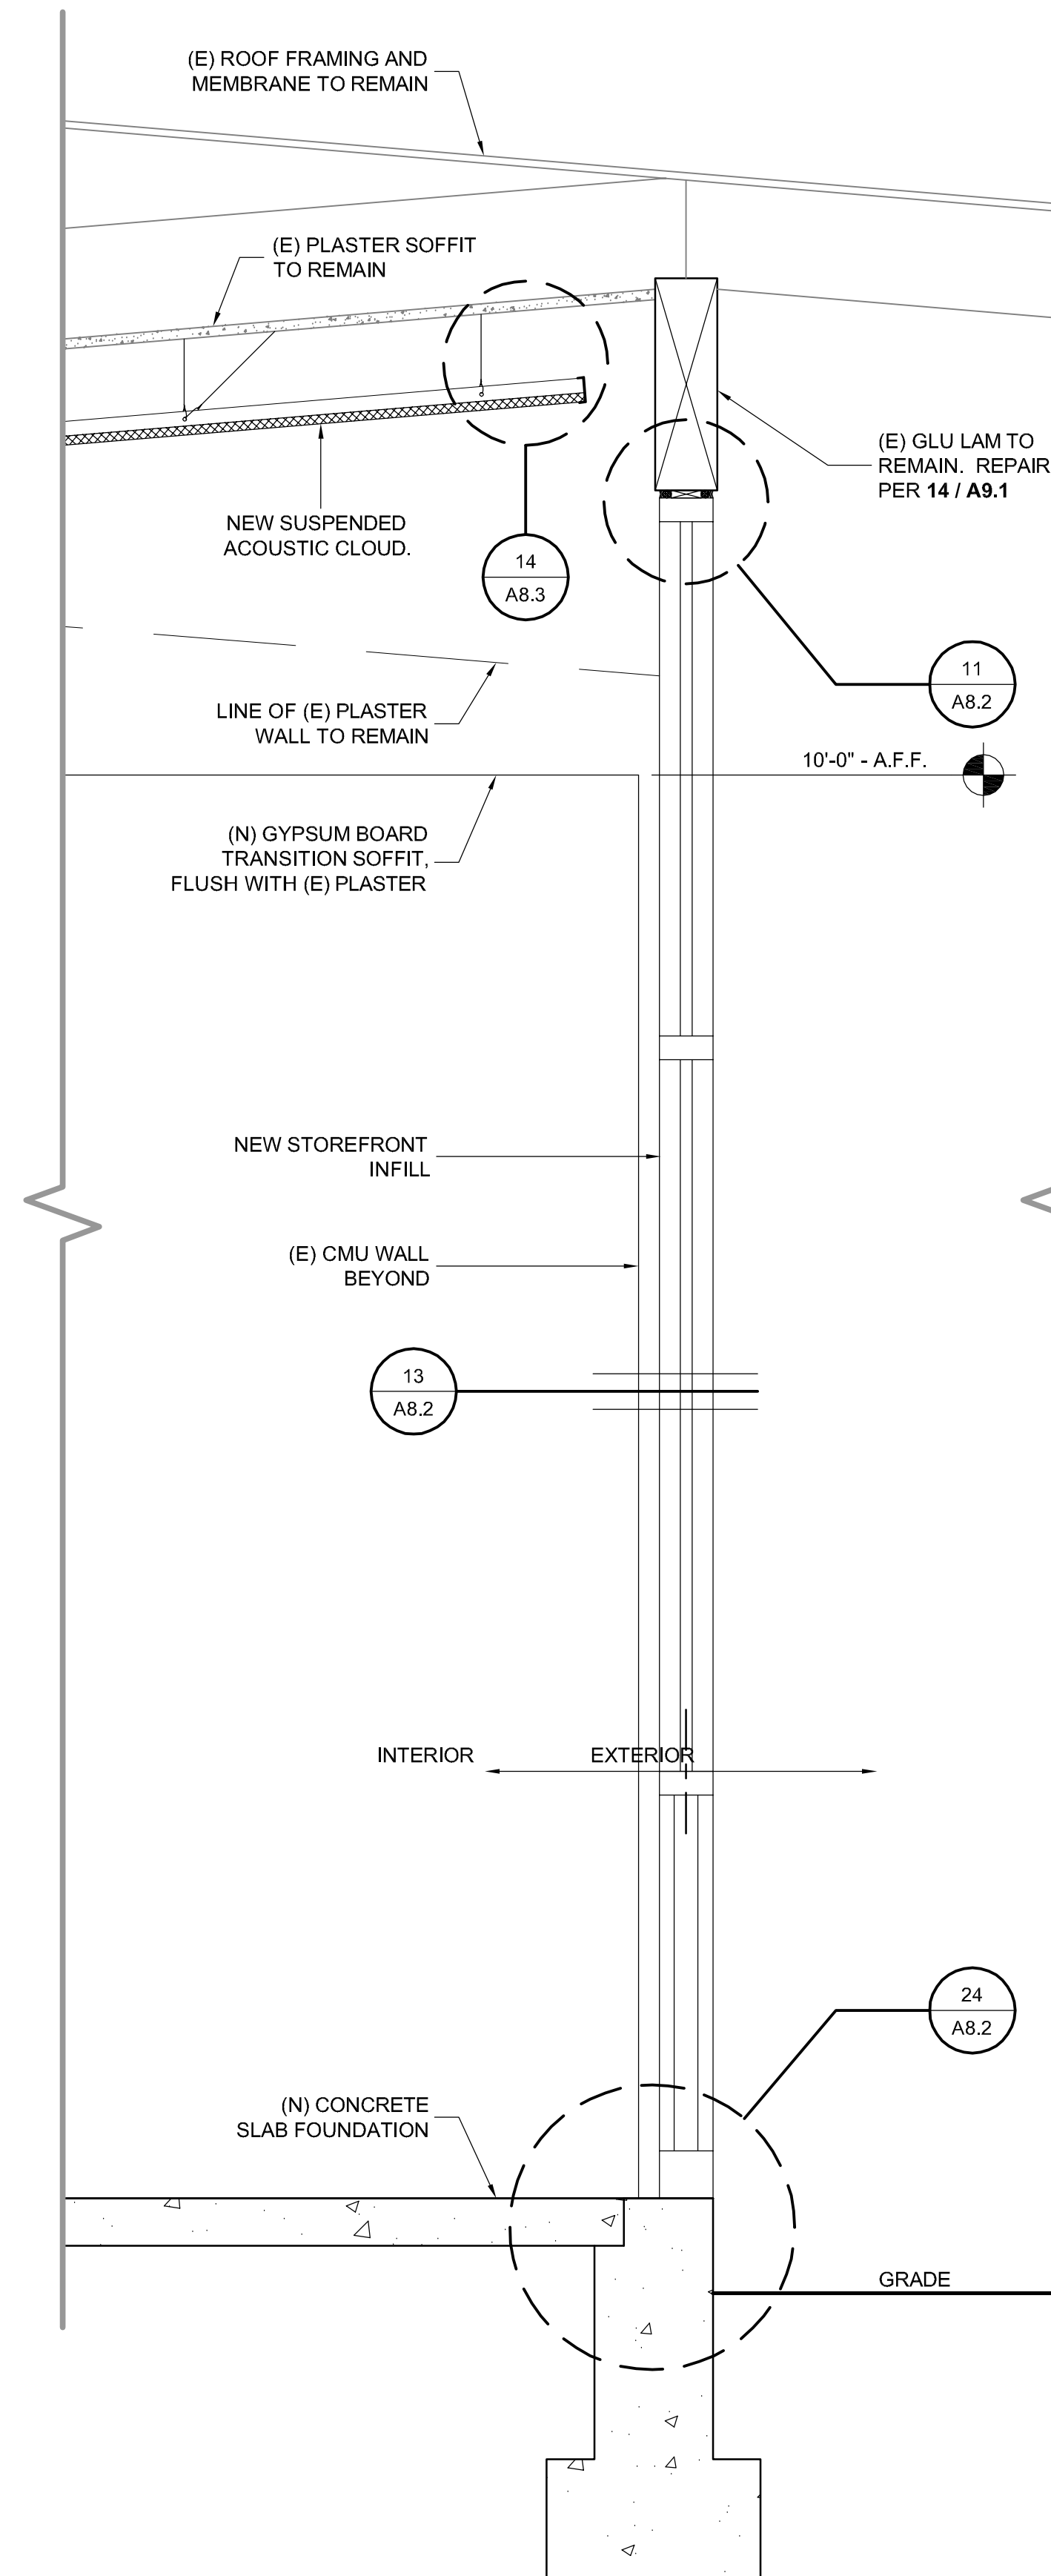

34 SECTION B
SCALE: 1" = 1'-0"

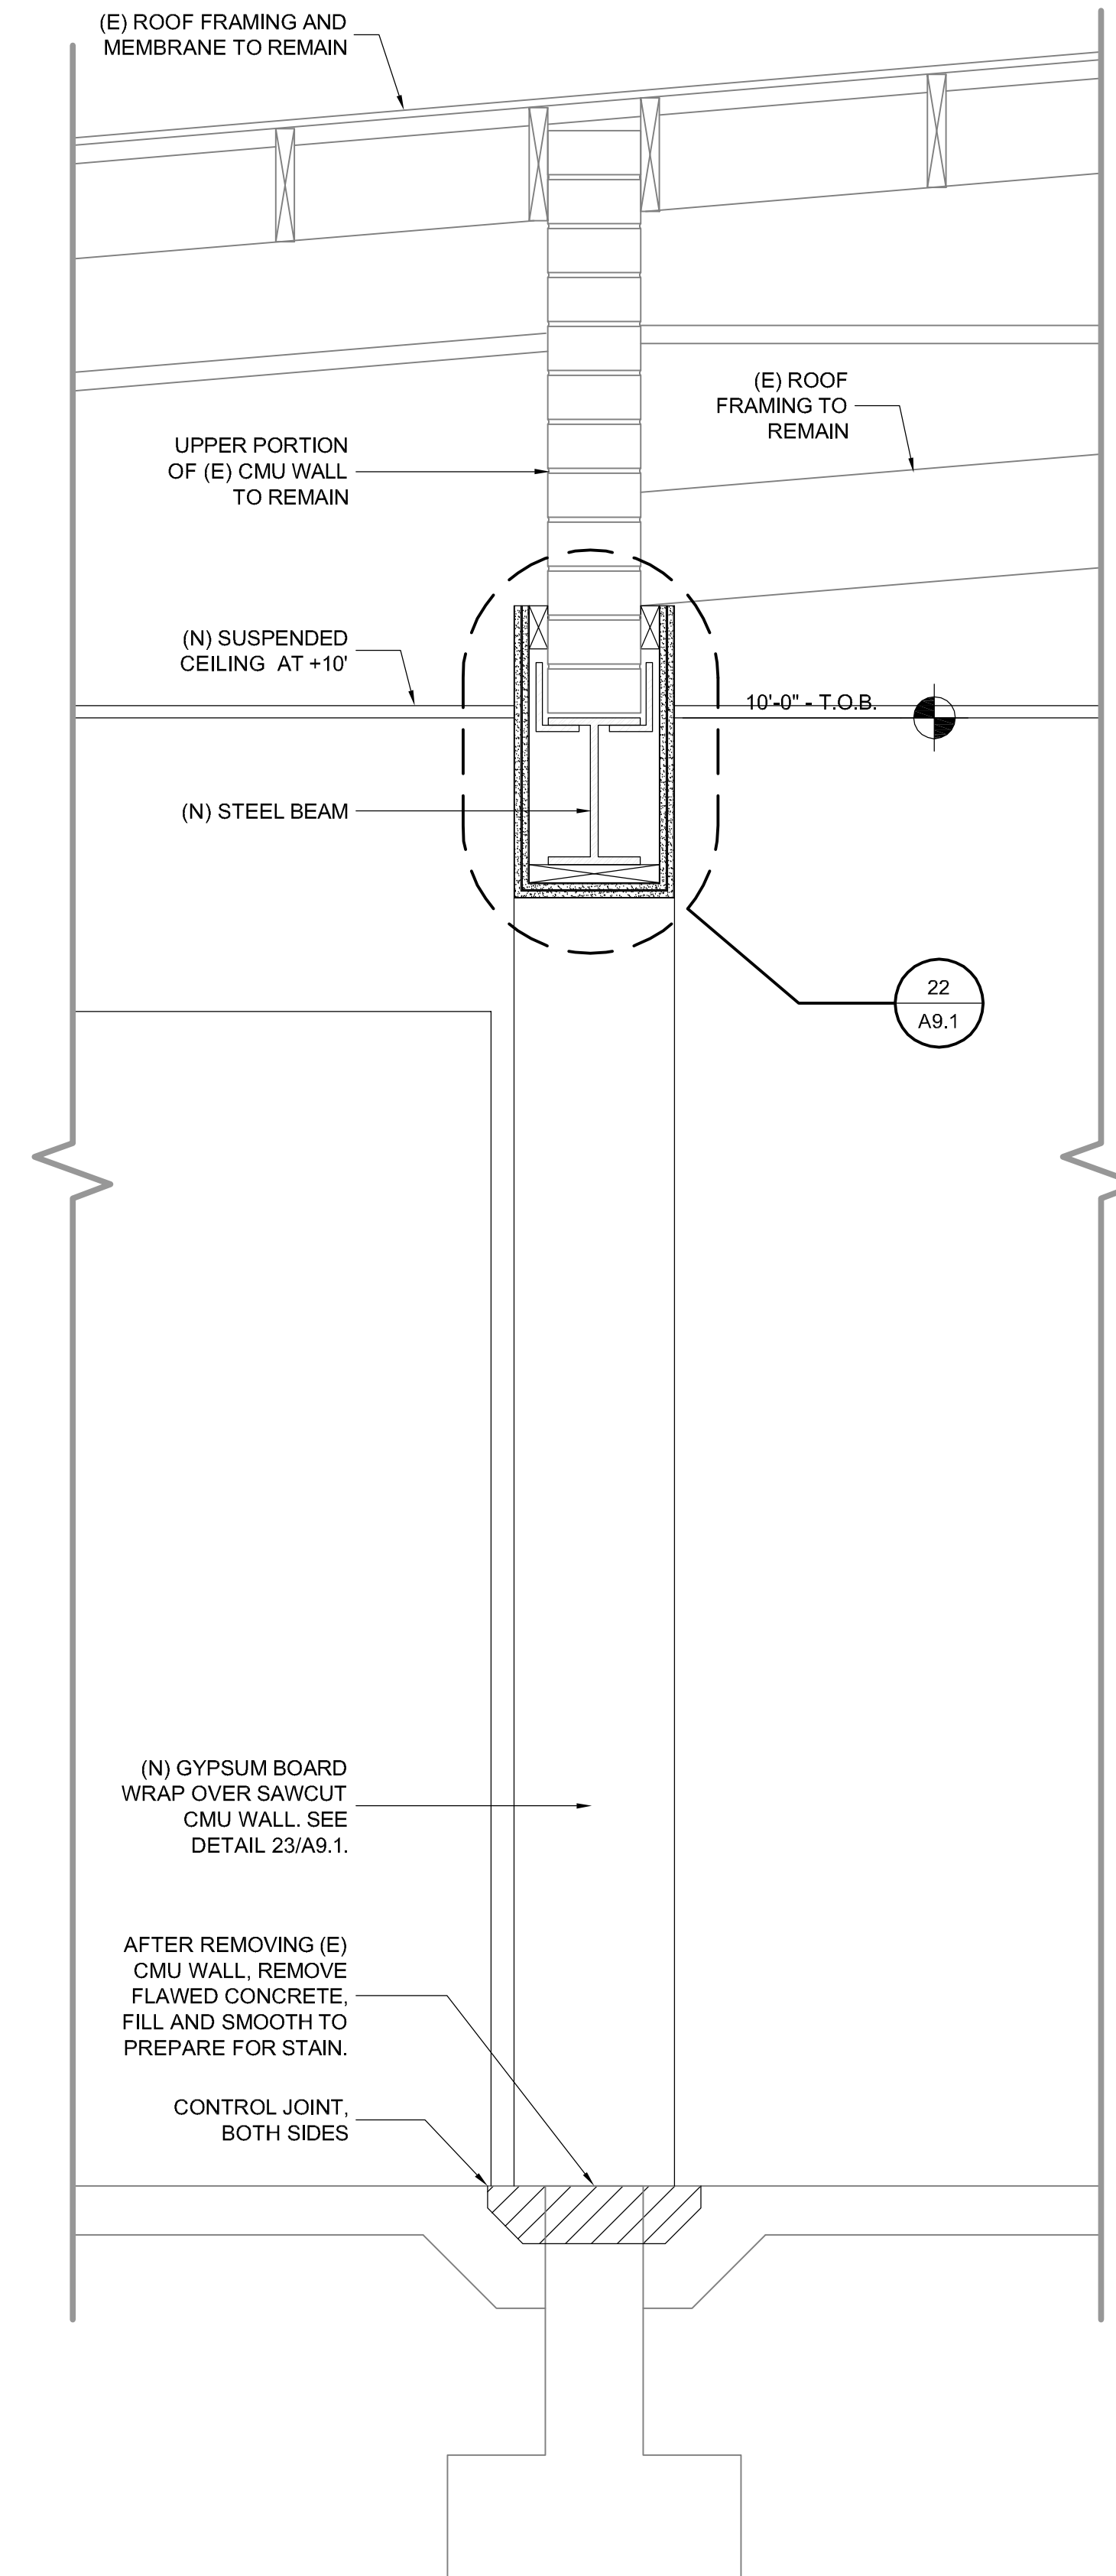

14 SECTION C
SCALE: 1" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

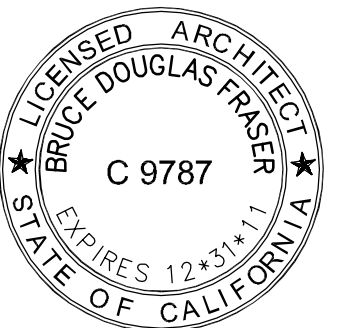

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
WALL SECTIONS**

SHEET #


A6.2

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A6.1 - Phase I Sections.dwg, 4/29/2011 3:34:33 PM, PDF995

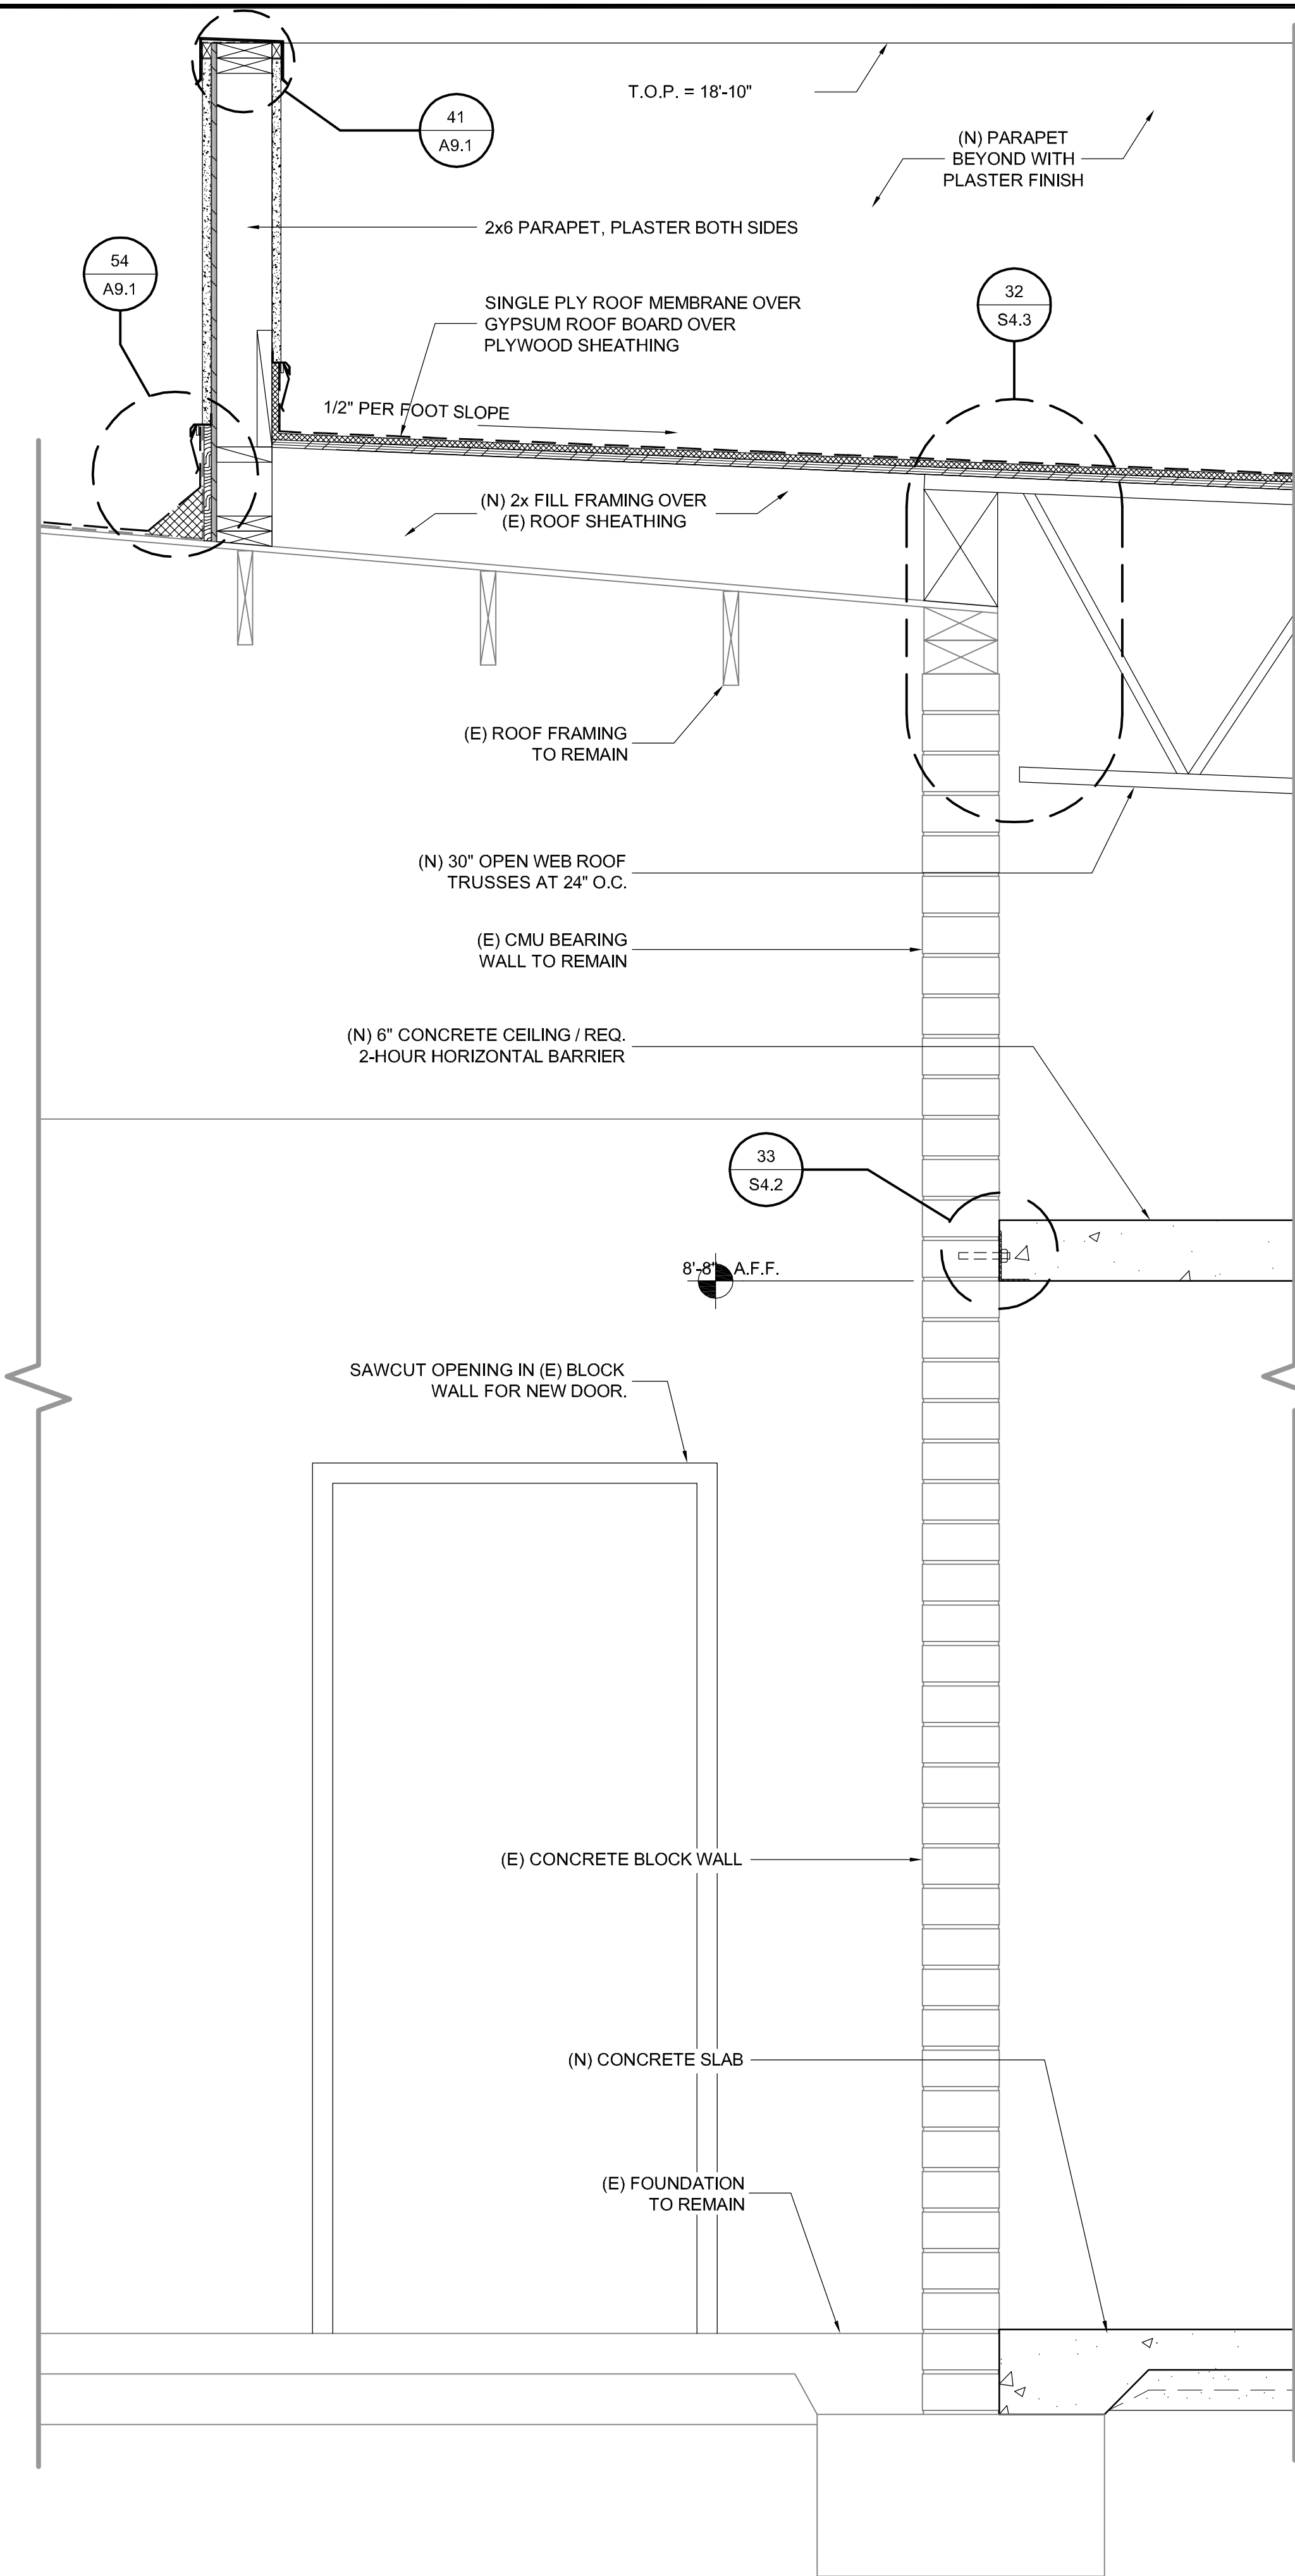


54

SECTION D
SCALE: 1" = 1'-0"

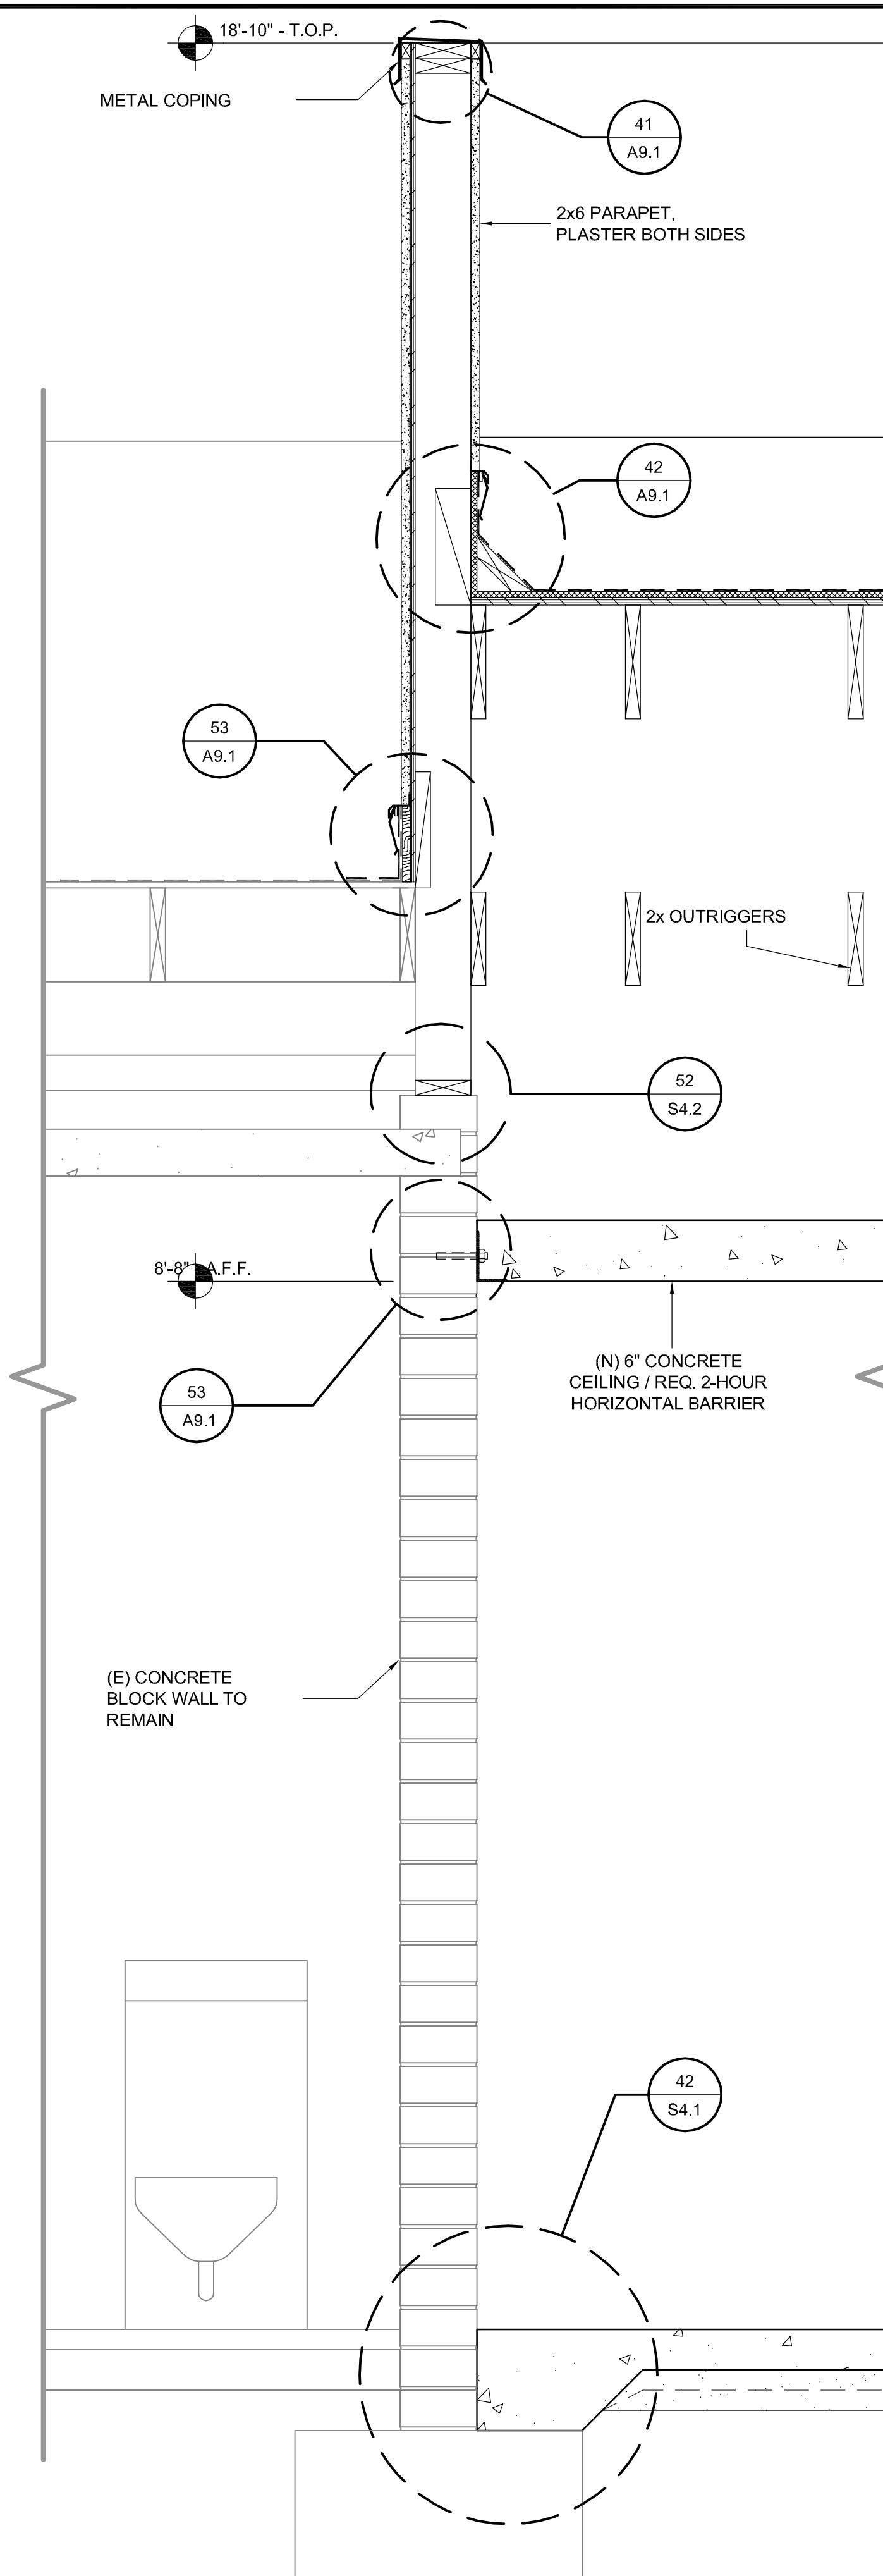

34

SECTION E
SCALE: 1" = 1'-0"

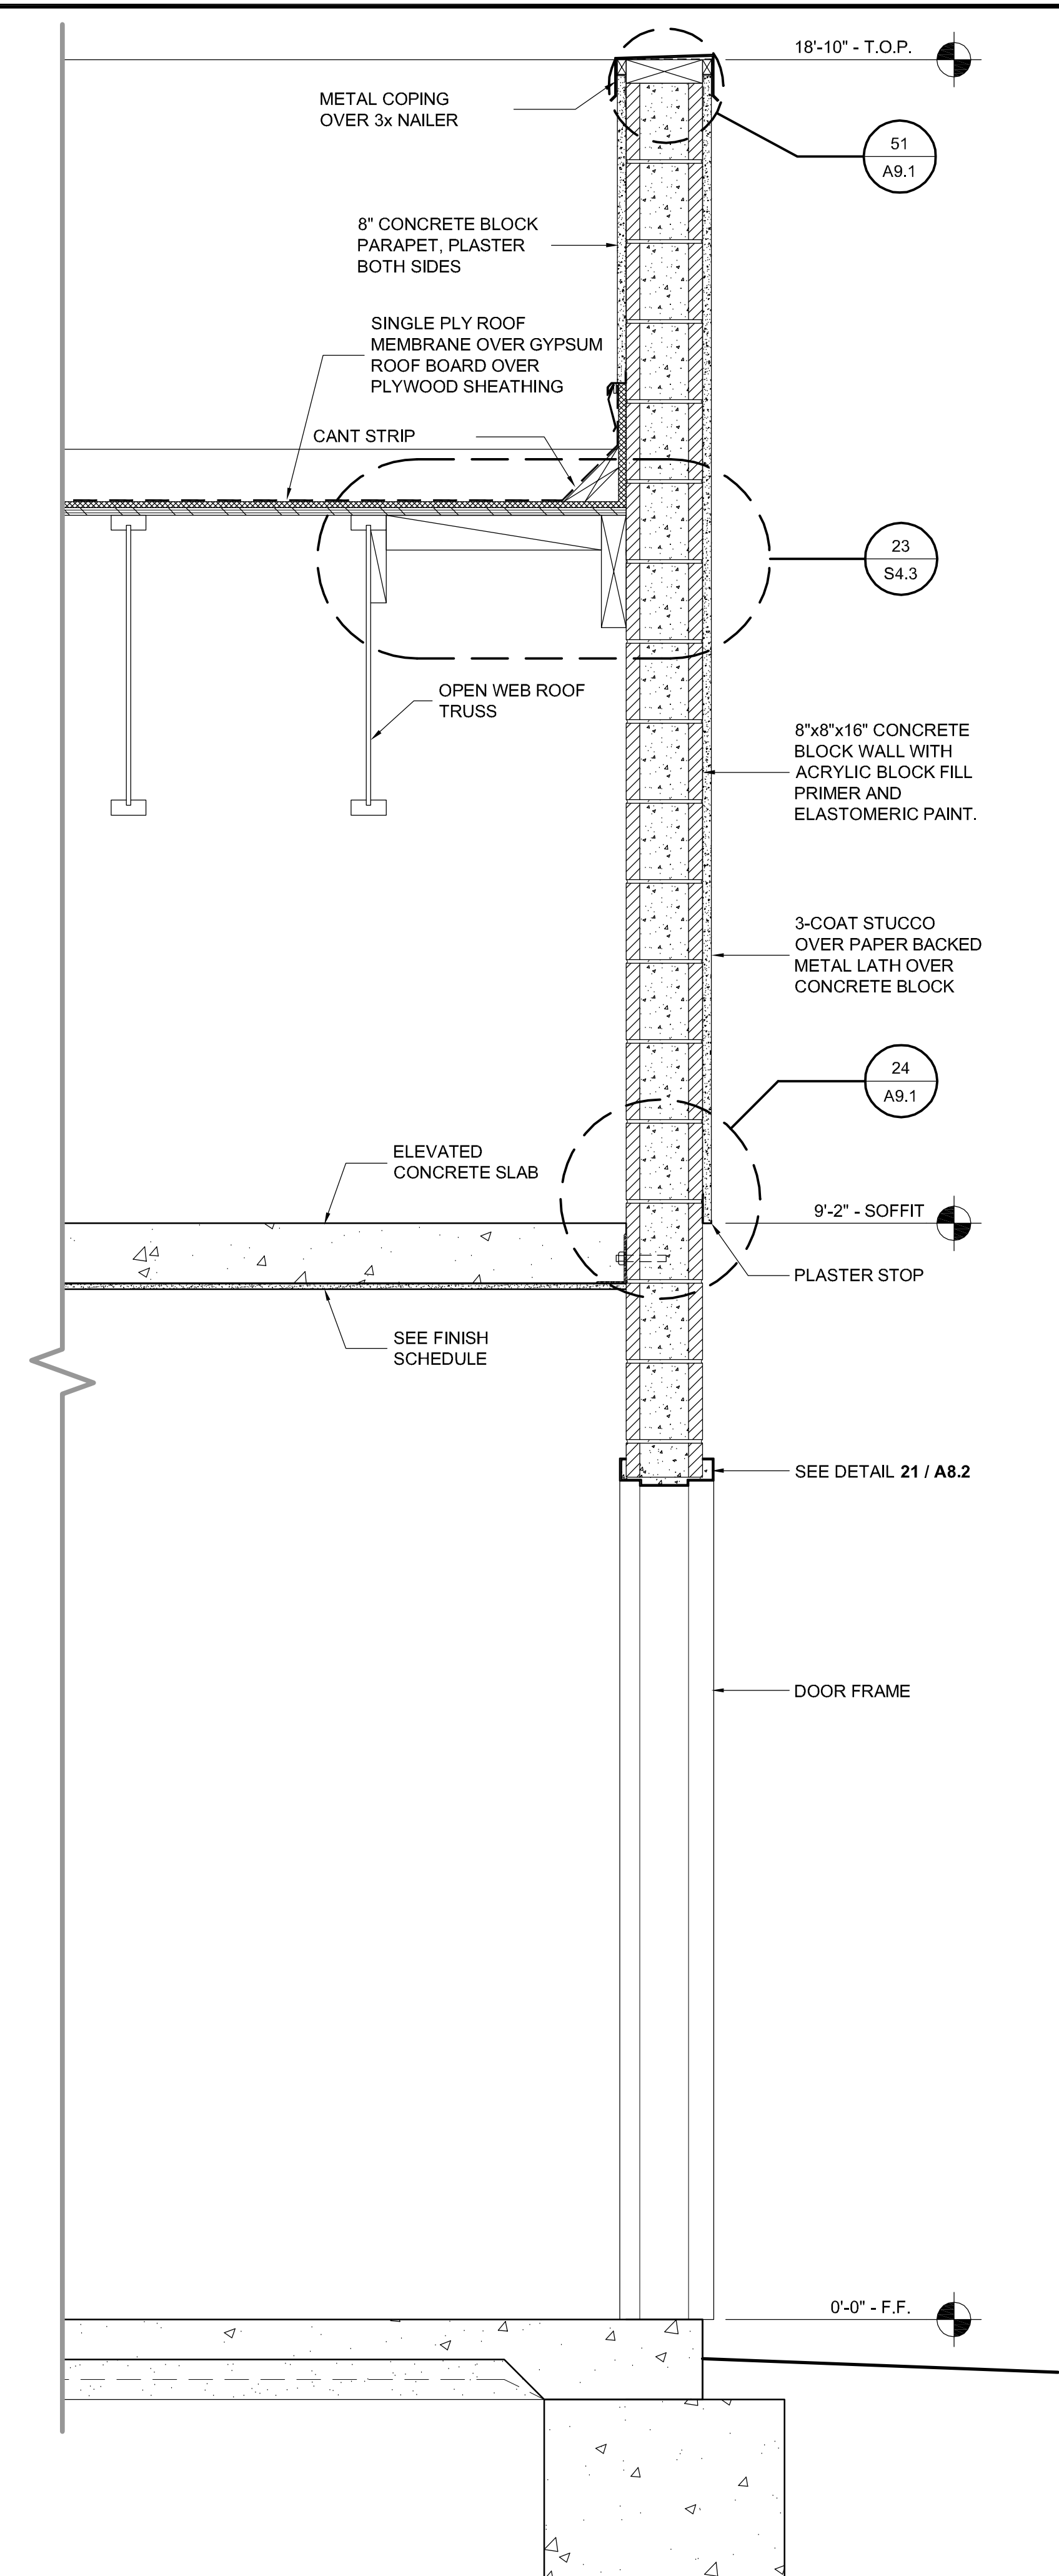

14

SECTION F
SCALE: 1" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

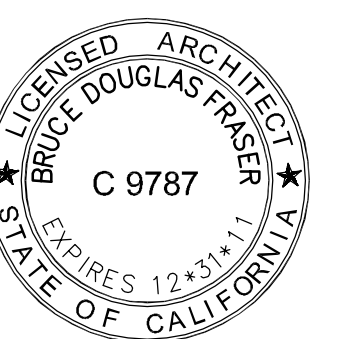

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
WALL SECTIONS**

SHEET #


A6.3

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A6.1 - Phase I Sections.dwg, 4/29/2011 3:36:34 PM, PDF995

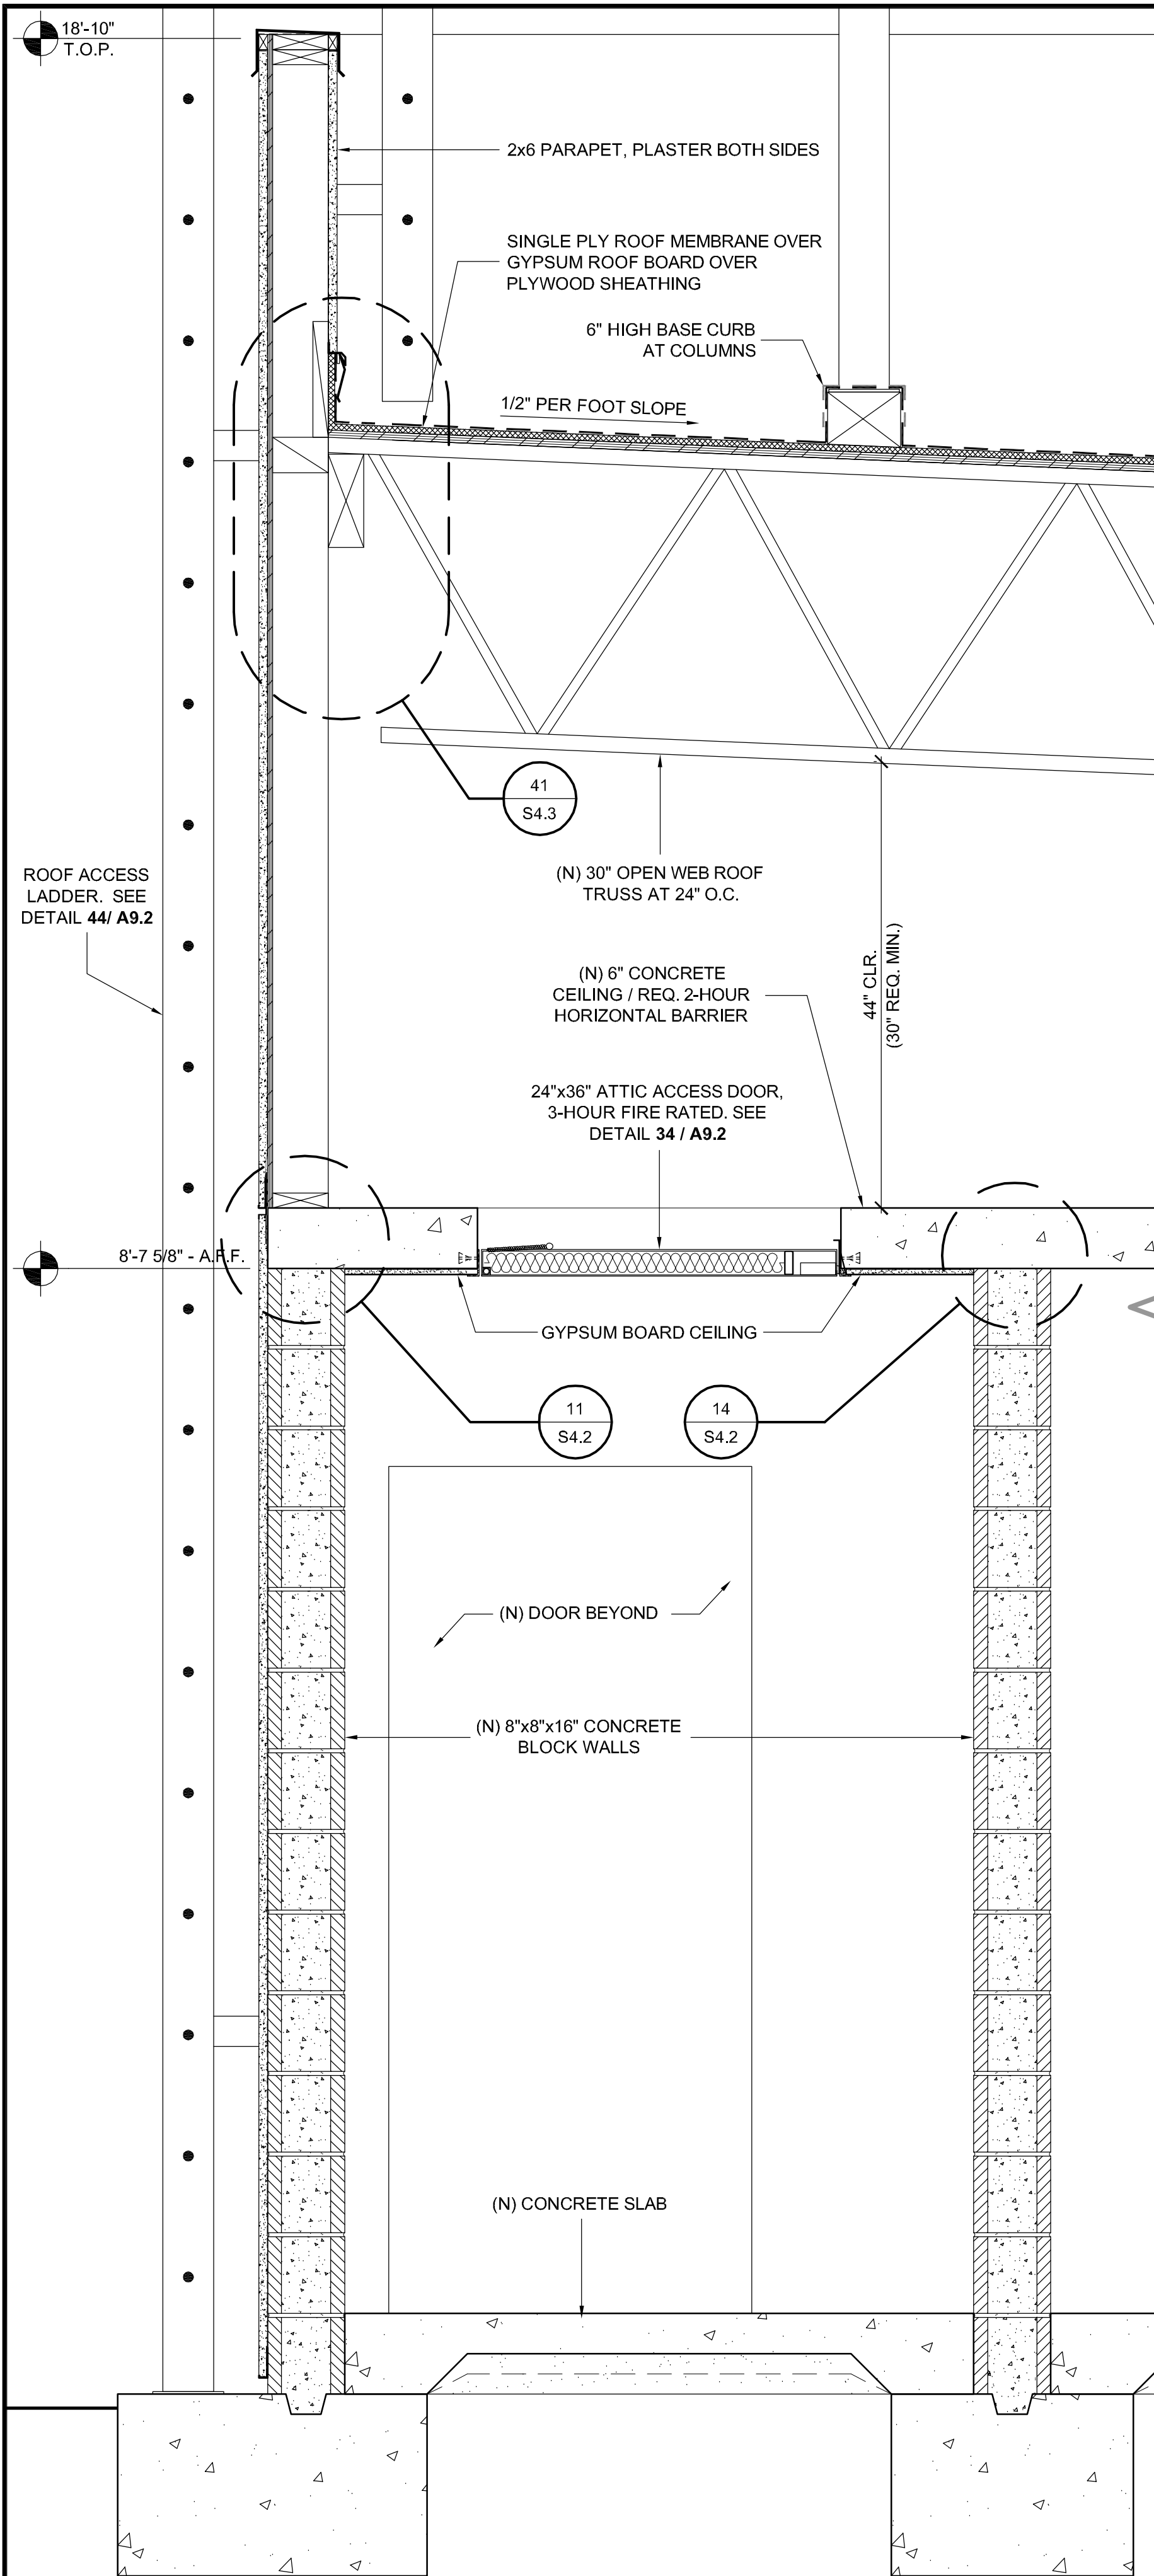


54

SECTION G
SCALE: 1" = 1'-0"

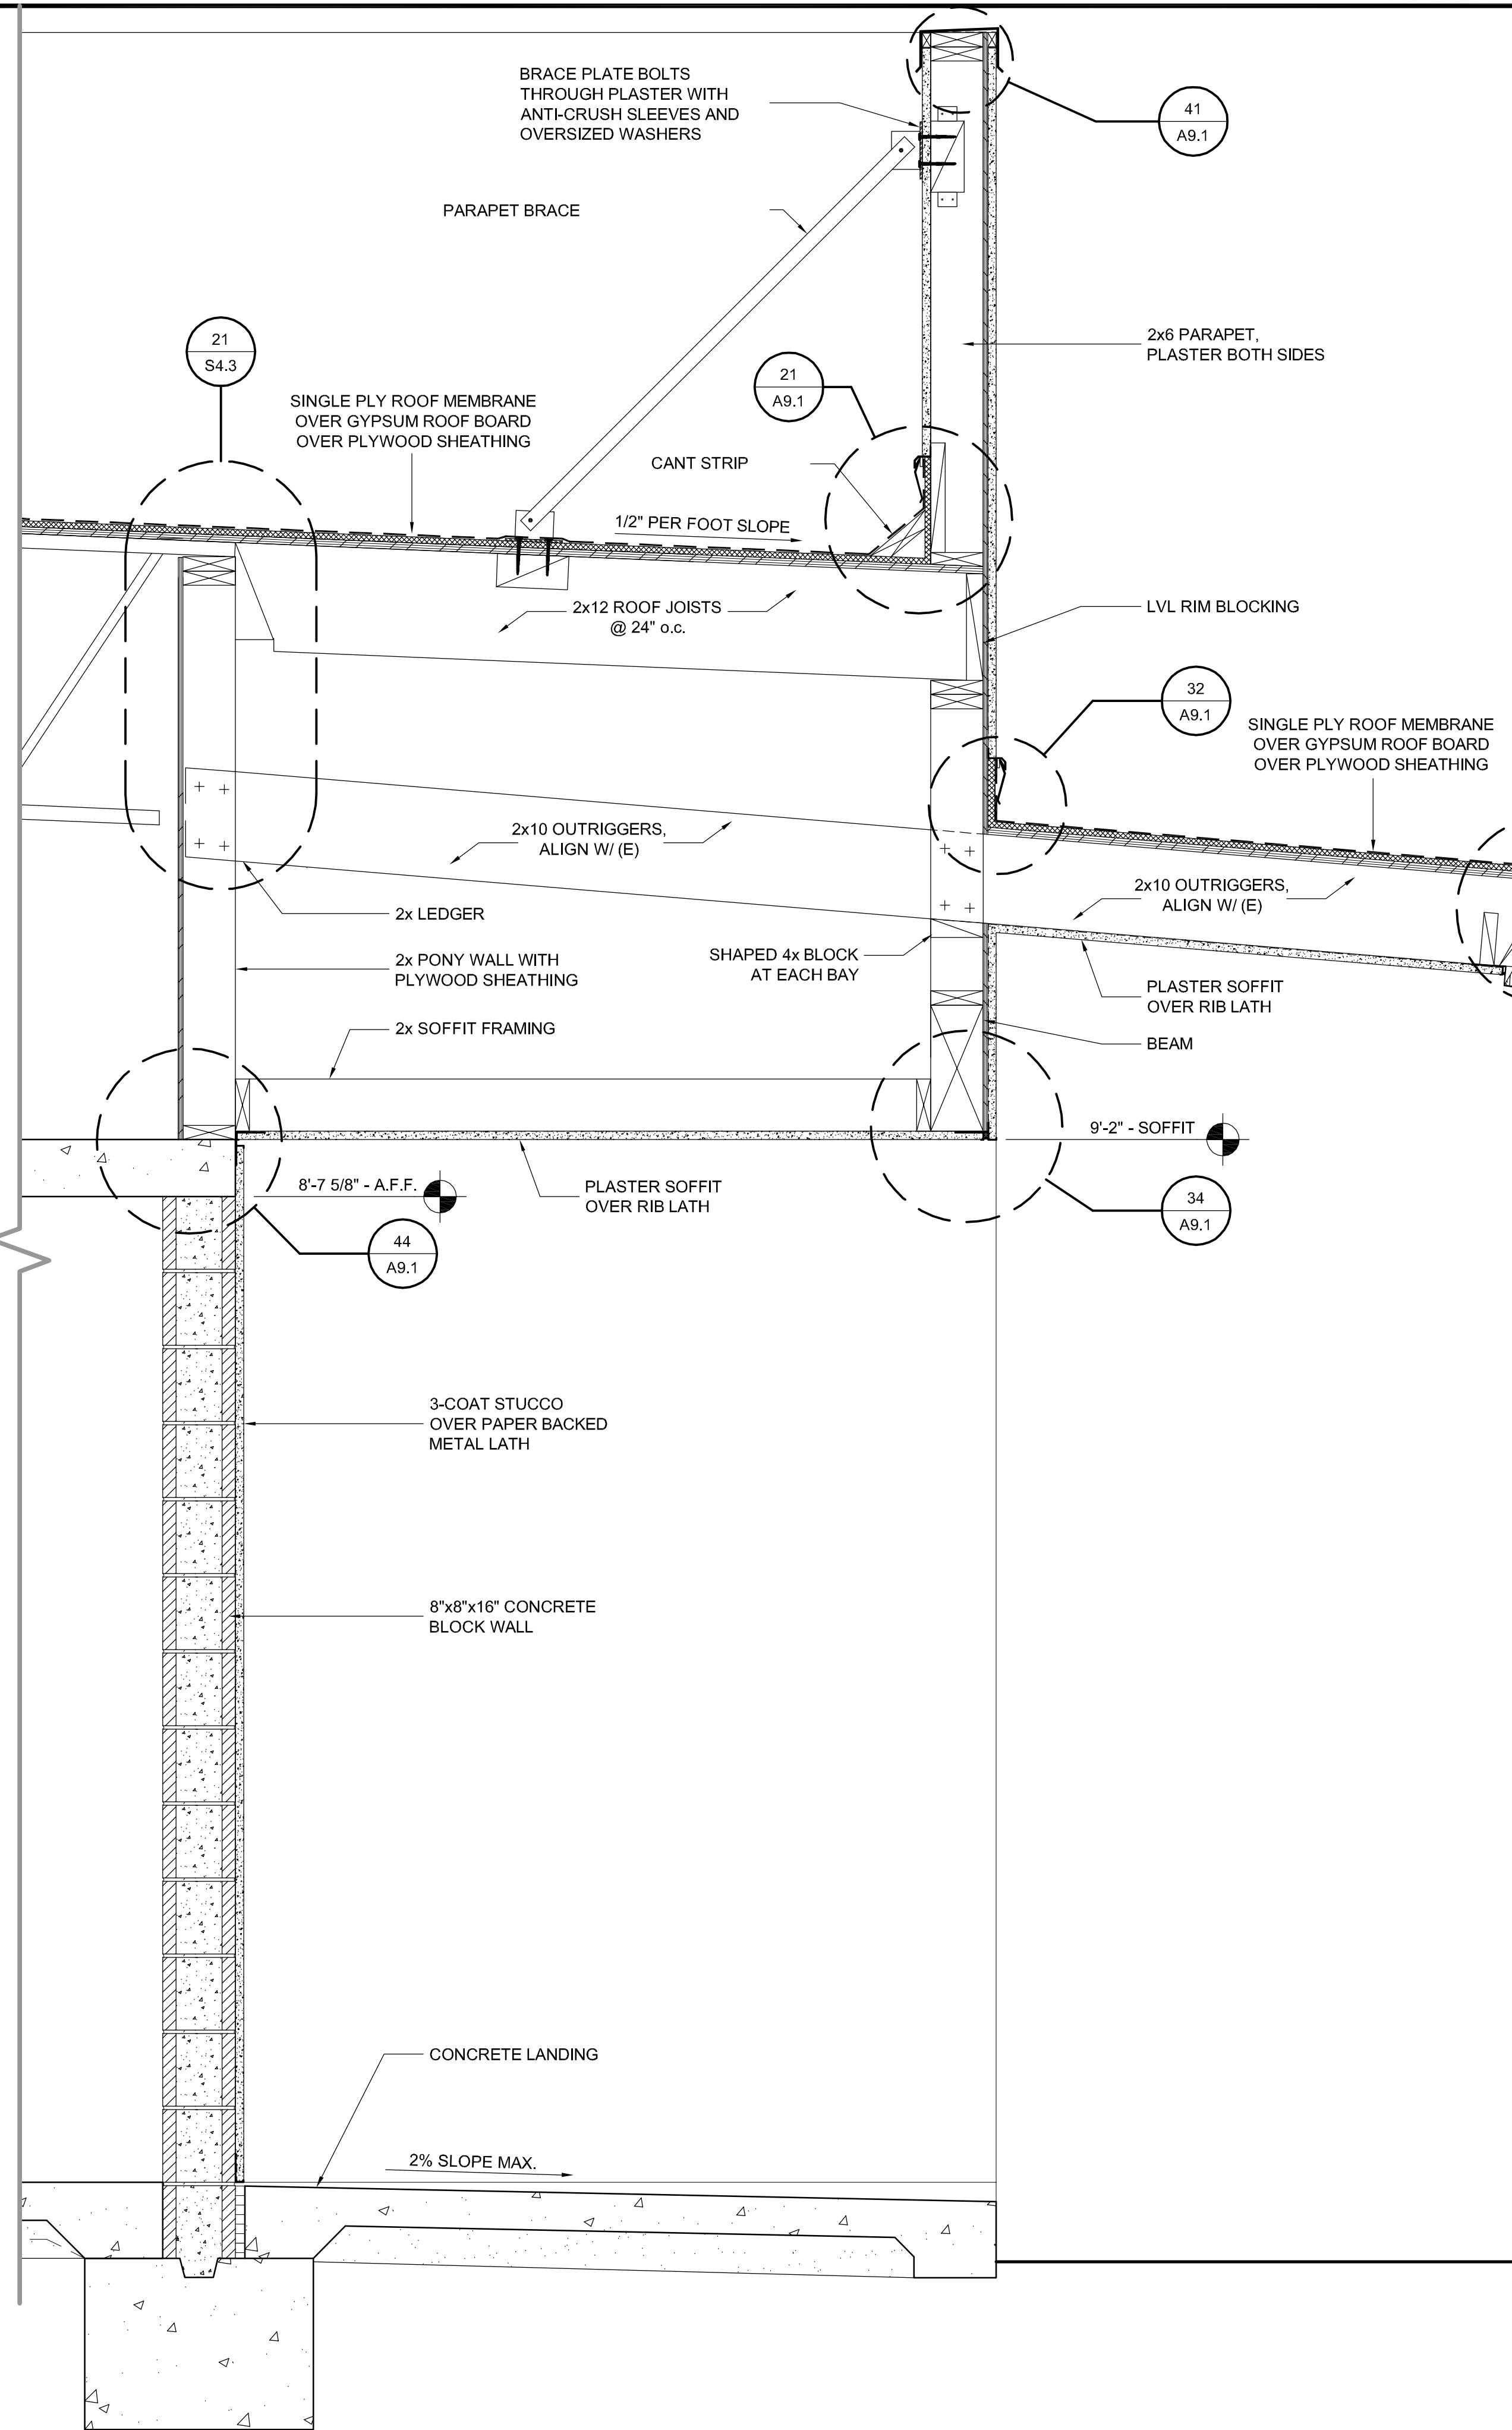

44

SECTION H
SCALE: 1" = 1'-0"

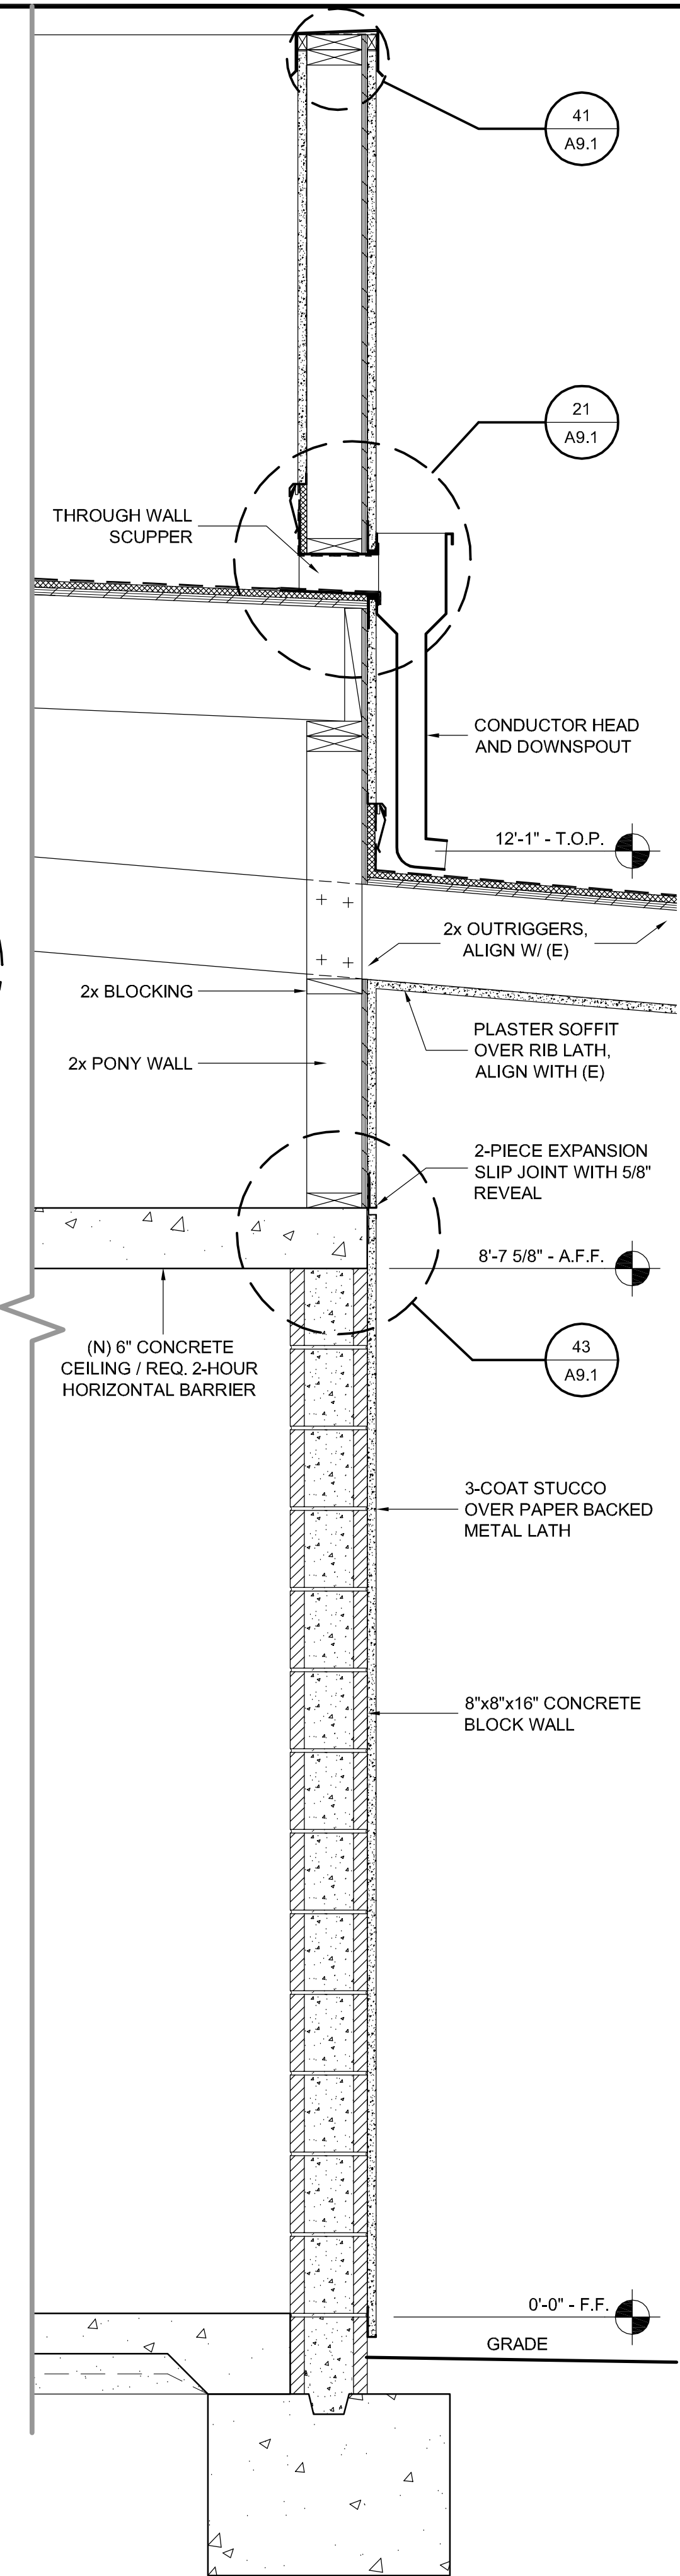

14

SECTION J
SCALE: 1" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

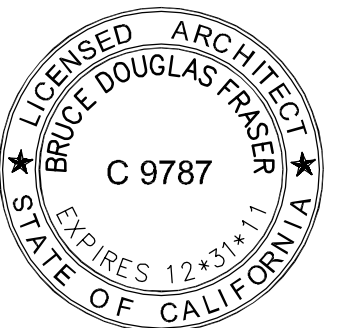

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
WALL SECTIONS**


SHEET #

A6.4



\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A7.1 - Phase Interior Elevations.dwg, 4/29/2011 3:38:08 PM, R05995

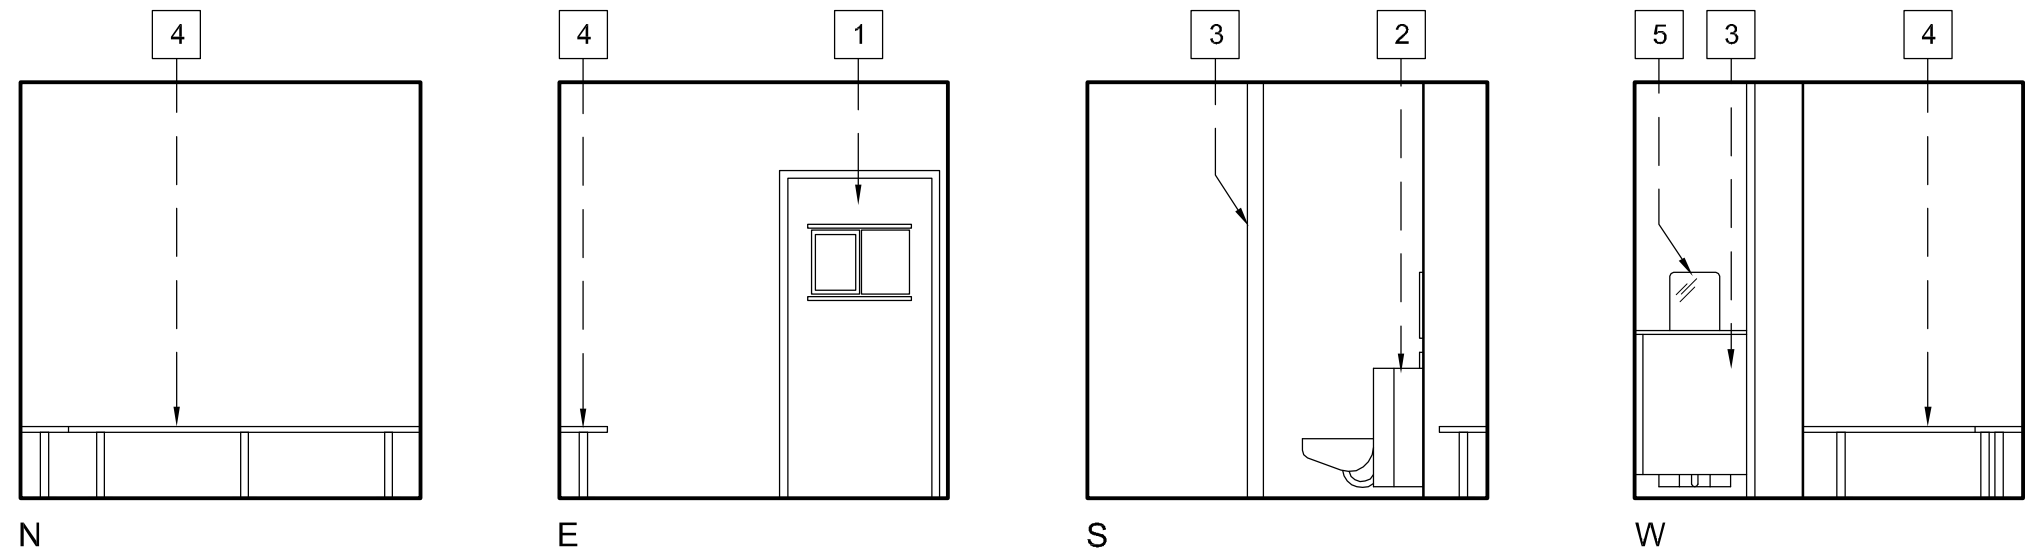

41 HOLDING CELL 1, CELL 2 (SIM.)
SCALE: 1/4" = 1'-0"

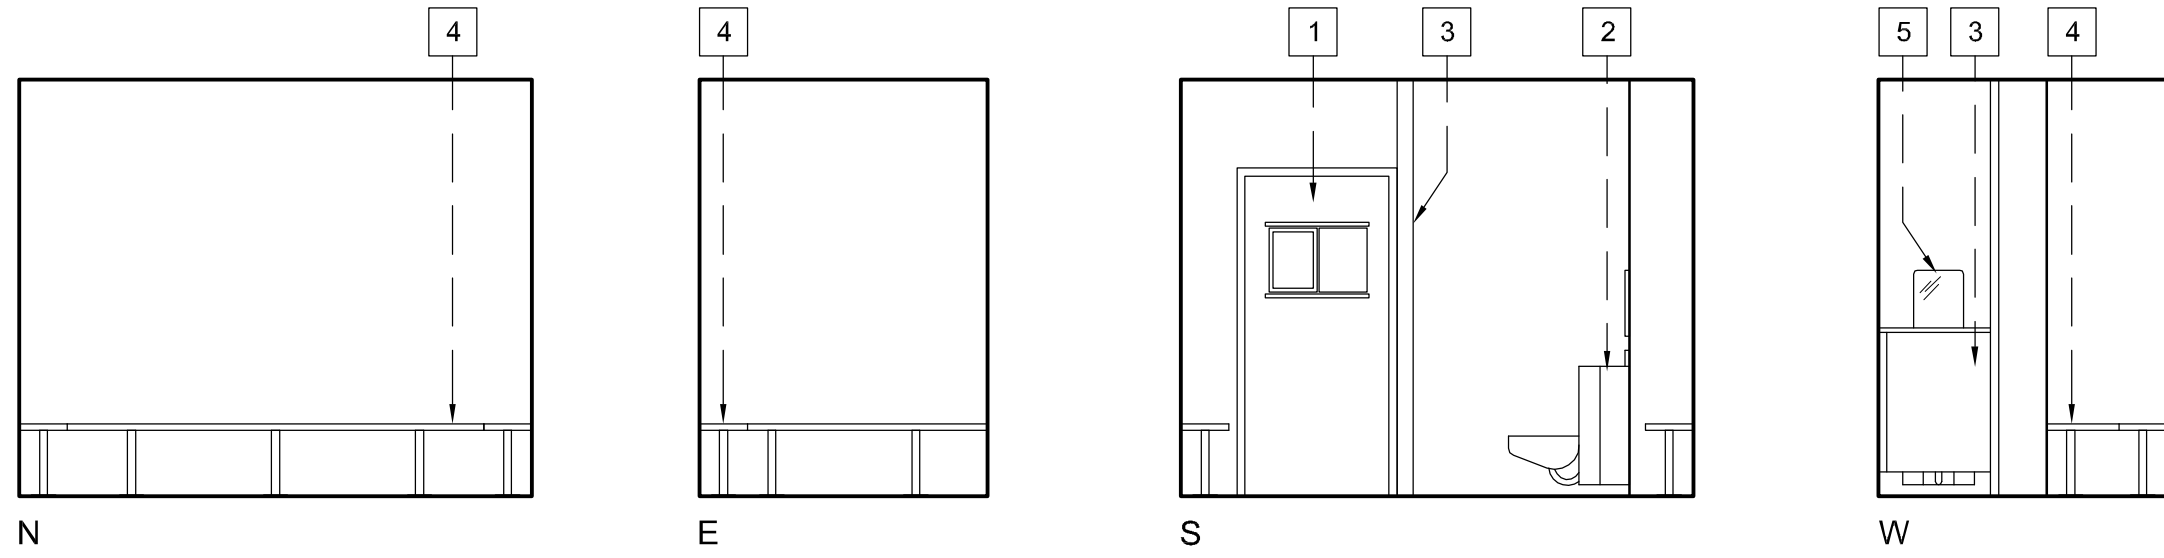



42 HOLDING CELL 3
SCALE: 1/4" = 1'-0"

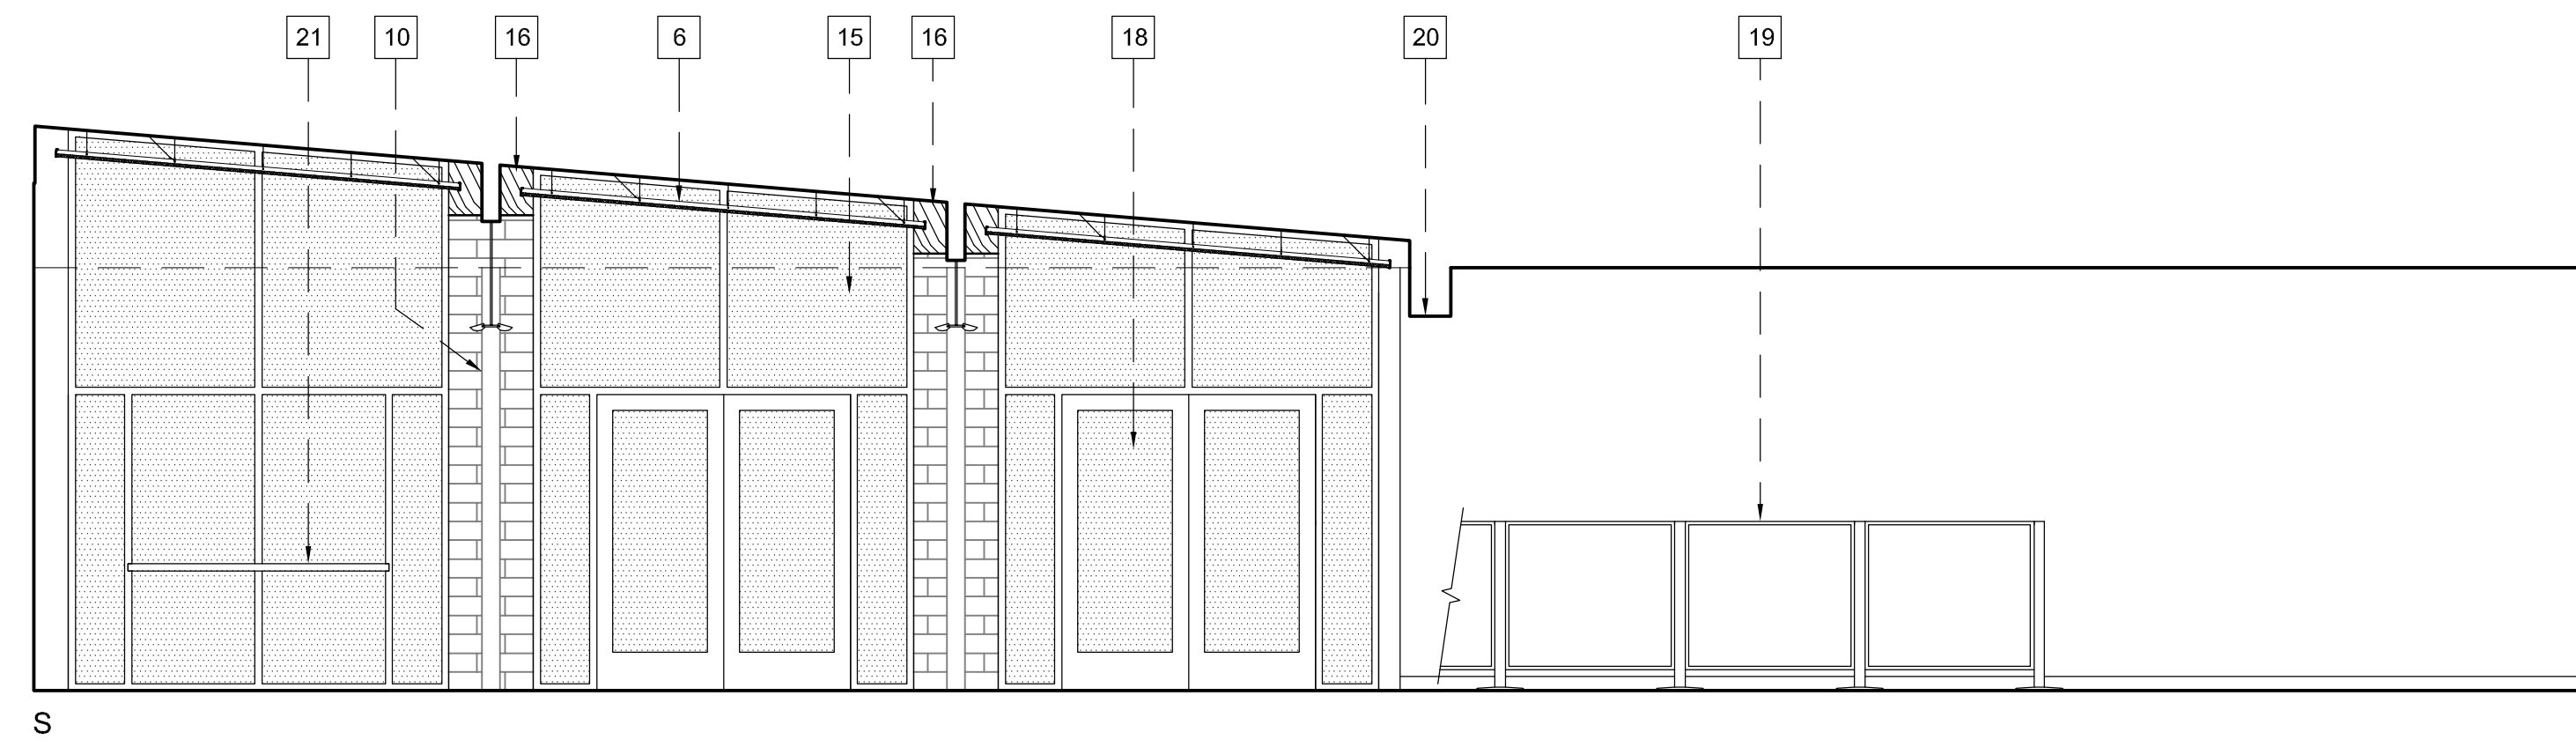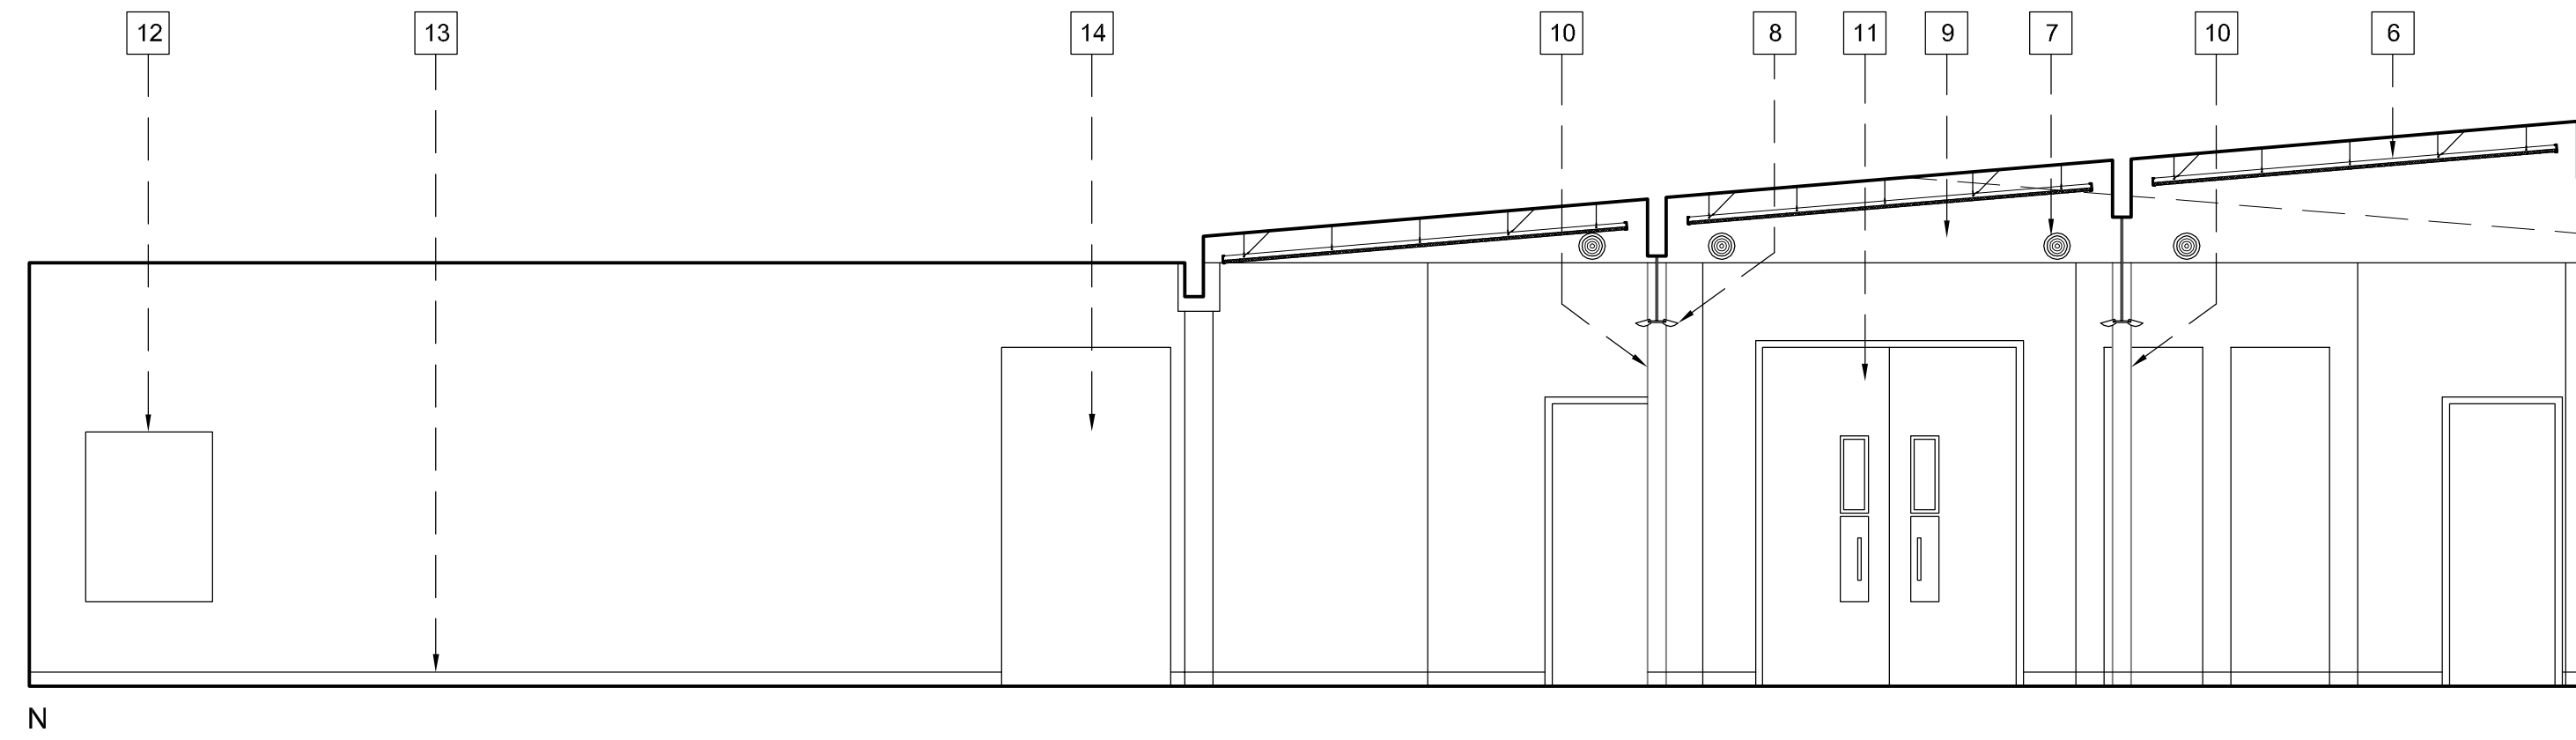

44 LOBBY
SCALE: 1/4" = 1'-0"

INTERIOR ELEVATION KEYNOTES

- 3070 SOLID CORE STEEL DOOR
- "COMBY" TOILET / SINK / BUBBLER
- STAINLESS STEEL PRIVACY SCREEN
- STAINLESS STEEL 12" FLOOR MTD. BENCH
- 12-1/2"W X 16-1/2" H STAINLESS STL. MIRROR
- SUSPENDED ACOUSTIC CEILING TILES.
- ROUND SUPPLY AIR GRILLE.
- SUSPENDE INDIRECT LIGHT FIXTURE CENTERED ON BEAM.
- NEW SOFFIT WALL.
- EXISTING STEEL COLUMN TO REMAIN.
- NEW DOORS TO COURTROOM VESTIBULE.
- DIRECTORY SIGN LOCATION.
- 4" BASE, TYP.
- 4' WIDE x 8' HIGH OPENING.
- NEW STOREFRONT.
- NEW INFILL BLOCKING AT EXISTING GLU-LAM BEAMS. SEE DETAIL 13/A9.1.
- STOREFRONT REPLACED AFTER REMOVAL OF TEMPORARY DOORS.
- NEW STOREFRONT DOORS.
- BARRICADE WITH 48" POSTS AND 48" W x 42" H PANELS.
- NEW PAINTED GYPSUM BOARD SOFFIT.
- GLAZING PROTECTION BAR MOUNTED TO STOREFRONT AT 36" A.F.F.

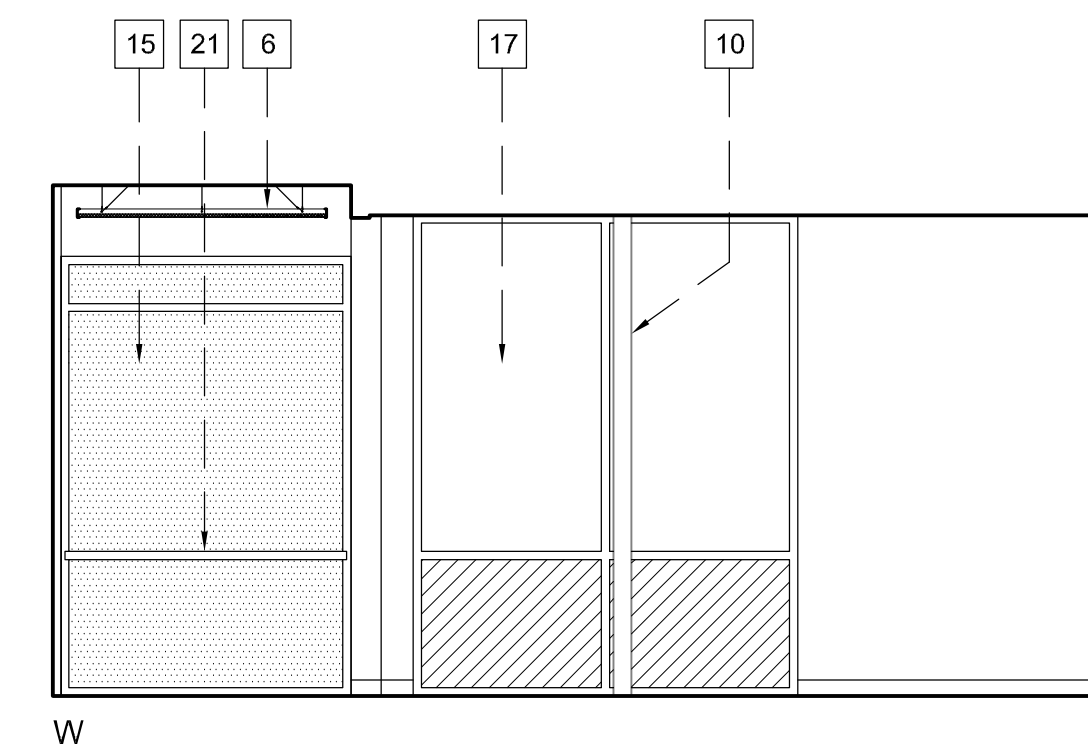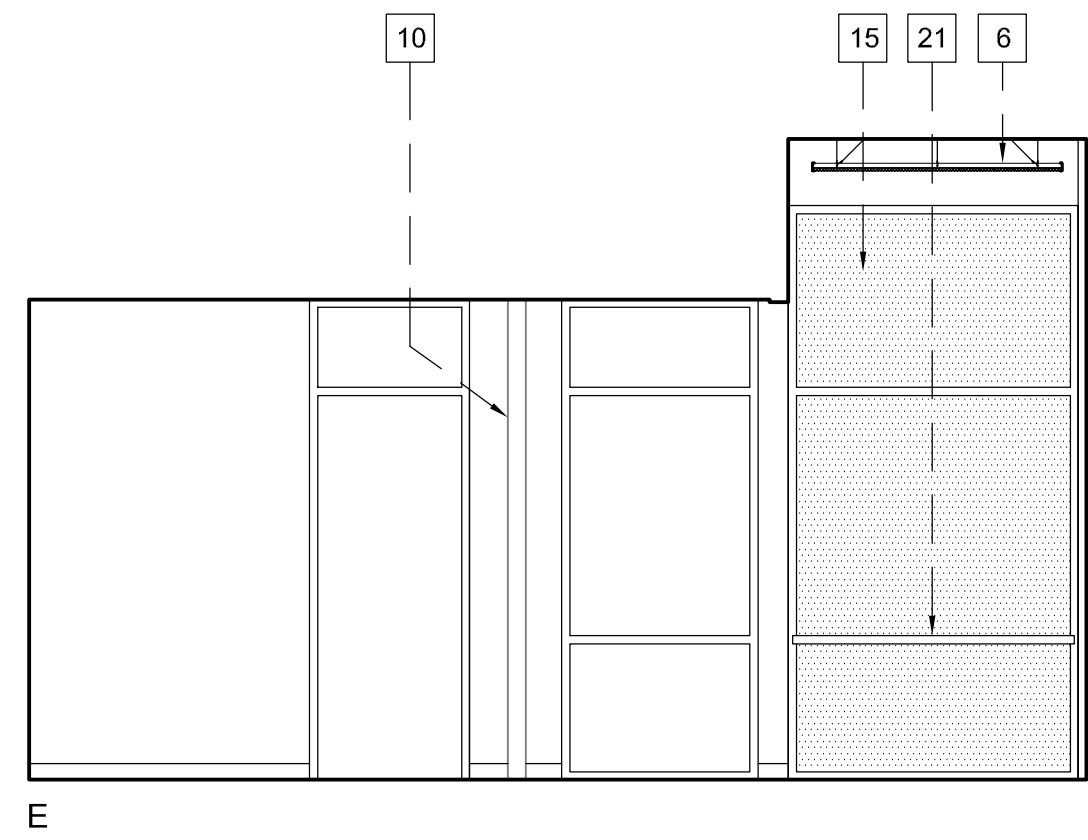

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401


805-544-6161

www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL
DATES 05/05/11

SIGNED

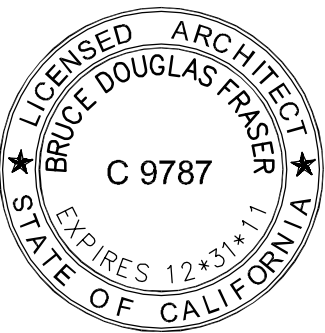

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I
INTERIOR
ELEVATIONS**

SHEET #

A7.1

DOOR SCHEDULE




NO.	TYPE	FRAME	WIDTH	HT.	THICK.	HDWRE.	REMARKS
1.1	AL.1	S.1	6'-0"	8'-0"	-	1	STOREFRONT ENTRY PAIR, SAFETY G.2 GLAZING
1.2	AL.1	S.2	6'-0"	8'-0"	-	2	STOREFRONT ENTRY PAIR, SAFETY G.2 GLAZING
1.3	WD.1	HM.1	3'-0"	8'-0"	1-3/4"	3	PASSAGE PAIR, SAFETY G.4 GLAZING
1.4	SD.1	HM.3	3'-0"	7'-0"	1-3/4"	4	PASSAGE, SAFETY G.4 GLAZING
1.5	-	HM.3	3'-0"	7'-0"	1-3/4"	5	FRAME ONLY, 90 MIN. RATED, DOOR TO BE INSTALLED IN PHASE II
1.6	WD.2	HM.3	3'-0"	7'-0"	1-3/4"	6	PASSAGE, 90 MIN. RATED
1.7	SD.2	HM.3	3'-0"	7'-0"	1-3/4"	7	DETENTION CELL DOOR, SAFETY G.3 GLAZING
1.8	SD.2	HM.3	3'-0"	7'-0"	1-3/4"	7	DETENTION CELL DOOR, SAFETY G.3 GLAZING
1.9	SD.2	HM.3	3'-0"	7'-0"	1-3/4"	7	DETENTION CELL DOOR, SAFETY G.3 GLAZING
1.10	WD.3	HM.4	2'-0"	4'-0"	1-3/4"	8	CHASE ACCESS DOOR
1.11	WD.3	HM.4	2'-0"	4'-0"	1-3/4"	9	CHASE ACCESS DOOR
1.12	WD.3	HM.4	2'-0"	4'-0"	1-3/4"	9	CHASE ACCESS DOOR
1.13							EXISTING DOOR, FRAME TO REMAIN
1.14	SD.3	HM.2	3'-0"	7'-0"	1-3/4"	10	ENTRY / EXIT WITH SAFETY G.3 GLAZING TRANSOM ABOVE

GENERAL DOOR NOTES

- THE UNLATCHING OF ANY EXIT DOOR SHALL NOT REQUIRE MORE THAN ONE OPERATION.
- ALL EXIT DOORS SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE.
- HC ACCESSIBLE DOOR HARDWARE SHALL BE CENTERED BETWEEN 30 AND 44 INCHES ABOVE FINISH FLOOR OR LANDING, AND SHALL BE OPERATED WITH SINGLE PUSH-PULL ACTIVATING BARS OR OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE WITHOUT REQUIRING THE ABILITY TO GRASP THE OPENING HARDWARE.
- INTERIOR AND EXTERIOR THRESHOLDS SHALL BE NO HIGHER THAN 1/2 INCH ABOVE ADJACENT FLOOR LEVELS. HC ACCESSIBLE THRESHOLDS SHALL BE REQUIRED TO BE SLOPED A MINIMUM OF 2 HORIZONTAL TO 1 VERTICAL SO THAT NO VERTICAL CHANGE OF ELEVATION EXCEEDS 1/4 INCH.
- ON DOORS THAT HAVE CLOSERS, THE DOOR CLOSER PRESSURE SHALL NOT EXCEED 5 POUNDS FOR INTERIOR DOORS AND 8.5 POUNDS FOR EXTERIOR DOORS.
- THE BOTTOM 10 INCHES OF ALL HC ACCESSIBLE DOORS SHALL HAVE A SMOOTH UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST.
- ALL GLAZING IN DOORS SHALL BE TEMPERED.


LEGEND

- AL ALUMINUM, STOREFRONT OR DOOR FRAME
HM HOLLOW STEEL FRAME
WD STAIN GRADE SOLID WOOD DOOR
SD STEEL DOOR

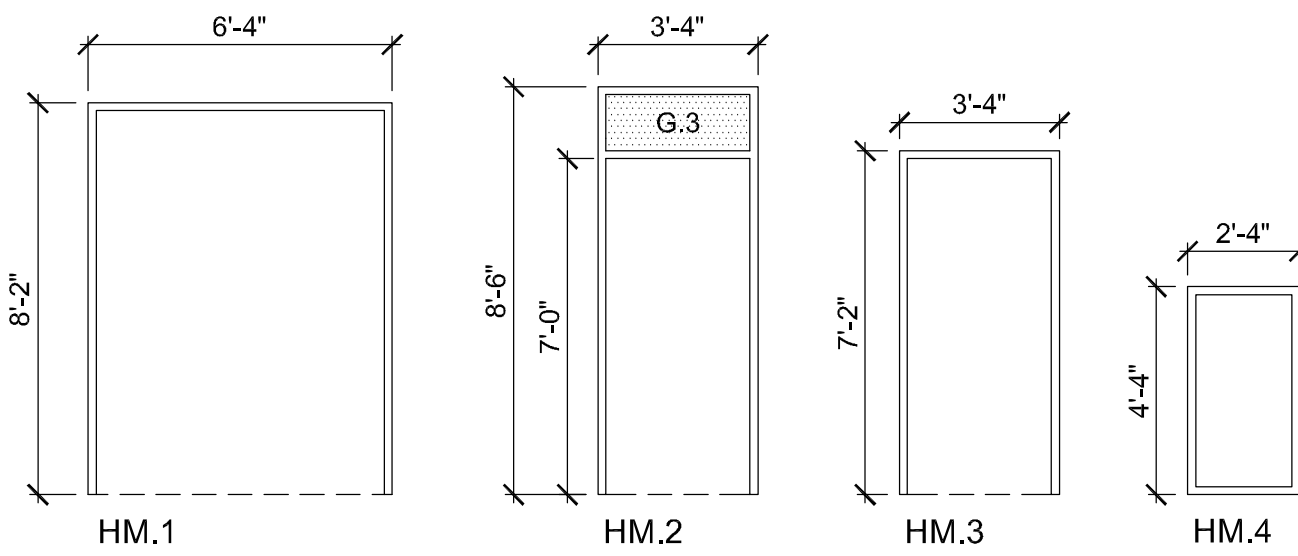

PHASE I FRAME TYPES

1/4"= 1' -0"

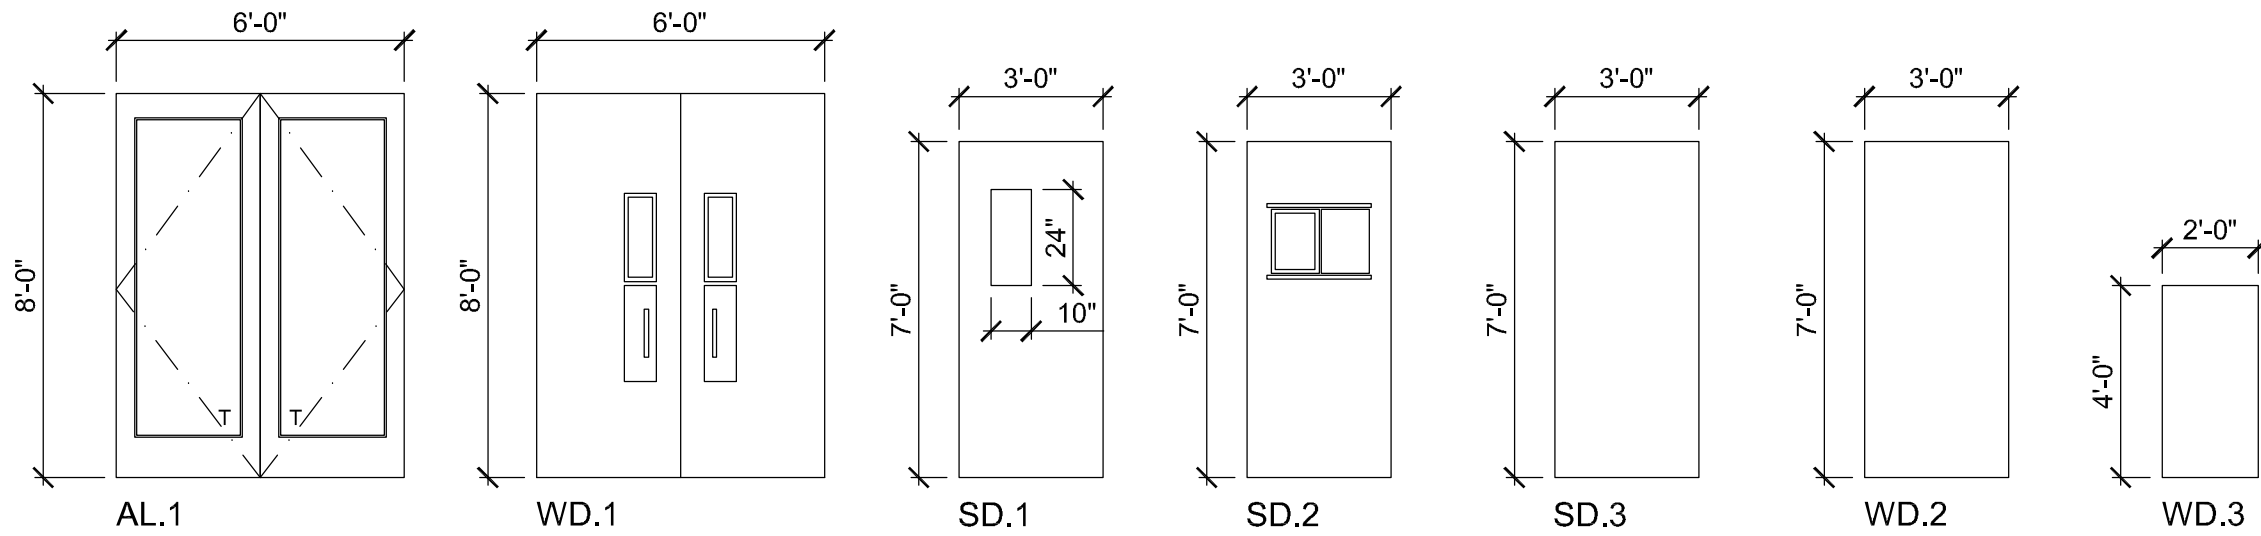

PHASE I DOOR TYPES

1/4"= 1' -0"

FINISH SCHEDULE

ROOM NAME	FLOOR	BASE	WALLS	CEILING
LOBBY / SCREENING	CONC.1	RB.1	GB.1	AT.1
COURTROOM VESTIBULE	CONC.1	RB.1	GB.1	AT.1
NEW HOLDING CELL 1	CONC.2	-	CB.1	CONC.4
NEW HOLDING CELL 2	CONC.2	-	CB.1	CONC.4
NEW HOLDING CELL 3	CONC.2	-	CB.1	CONC.4
HOLDING CELL HALLWAY	CONC.2	-	CB.2	CONC.4
SECURE HALLWAY	RF.1	RB.1	CB.2	GB.3

FINISH LEGEND

TYPE	FLOOR
CONC.1	STAINED CONCRETE
CONC.2	EPOXY FINISHED CONCRETE
RF.1	12"x12" VINYL COMPOSITION TILE (1 FIELD COLOR; 2 ACCENT COLORS)

	BASE
RB.1	4" COVED RESILIENT WALL BASE

	WALLS
CB.1	EPOXY FINISHED CONCRETE BLOCK
CB.2	PAINTED CONCRETE BLOCK
GB.1	GYPSUM BOARD, LOW TEXTURE, SATIN PAINT

	CEILING
AT.1	SUSPENDED ACOUSTIC TILE
CONC.4	SEALED CONCRETE, EPOXY FINISH
GB.3	GYPSUM BOARD, LOW TEXTURE, SATIN PAINT

STOREFRONT SCHEDULE

SYM.	FRAME	WIDTH	HT.	GLAZING	REMARKS
S.1	AL	9'-0"	10'-9" / 11'-6"	G.1 / G.2	FIXED GLAZING W/ PR 3'-0" x 8'-0" DOOR OPENING
S.2	AL	9'-0"	11'-8" / 12'-5"	G.1 / G.2	FIXED GLAZING W/ PR 3'-0" x 8'-0" DOOR OPENING
S.3	AL	9'-0"	12'-7" / 13'-4"	G.1 / G.2	FIXED GLAZING, GLAZING PROTECTION BAR @ 36"
S.4	AL	6'-0"	12'-0"	G.1 / G.2	FIXED GLAZING, GLAZING PROTECTION BAR @ 36"
S.5	AL	6'-0"	9'-3"	G.1 / G.2	FIXED GLAZING, GLAZING PROTECTION BAR @ 36"
S.6	AL	8'-0"	10'-0"	G.2	FIXED GLAZING



GENERAL NOTES

GLAZING LEGEND:

- G.1 DUAL PANE HIGH PERFORMANCE GLASS, REGULAR STRENGTH
G.2 DUAL PANE HIGH PERFORMANCE GLASS, TEMPERED
G.3 GLASS CLAD POLYCARBONATE GLAZING
G.4 SINGLE PANE GLASS, TEMPERED

SAFETY GLAZING REQUIREMENTS:

- GLAZING IN WINDOWS ADJACENT TO DOORS WHERE THE GLAZING IS WITHIN 24 INCHES OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION SHALL BE SAFETY GLAZING (TEMPERED GLASS).

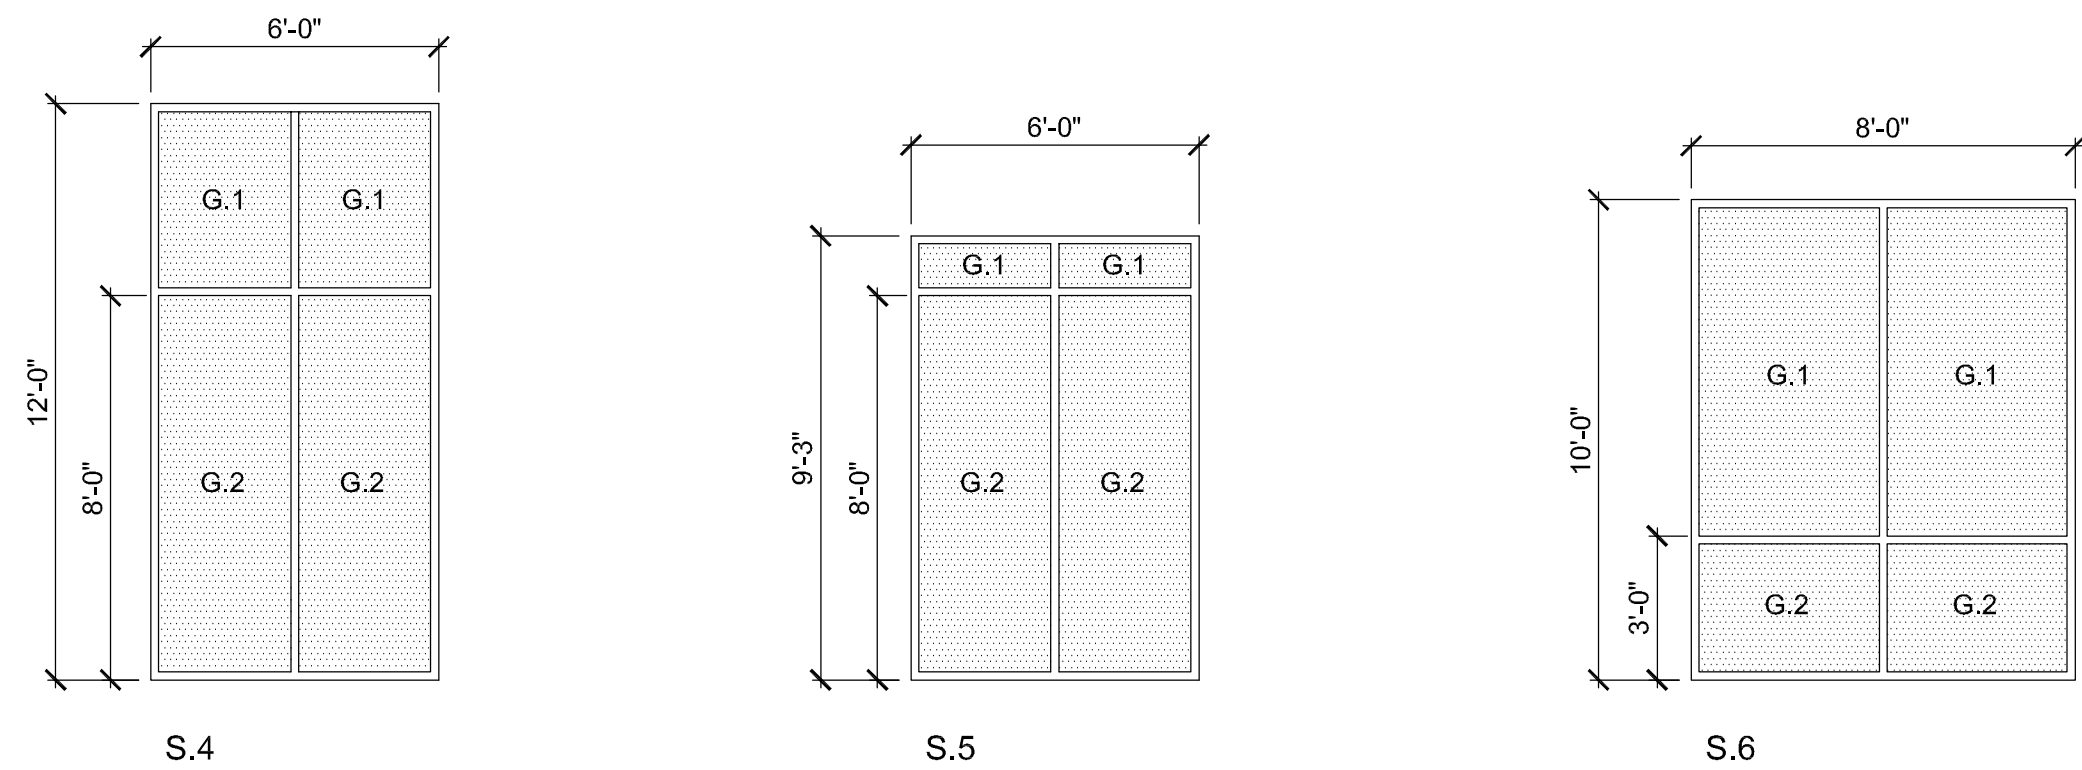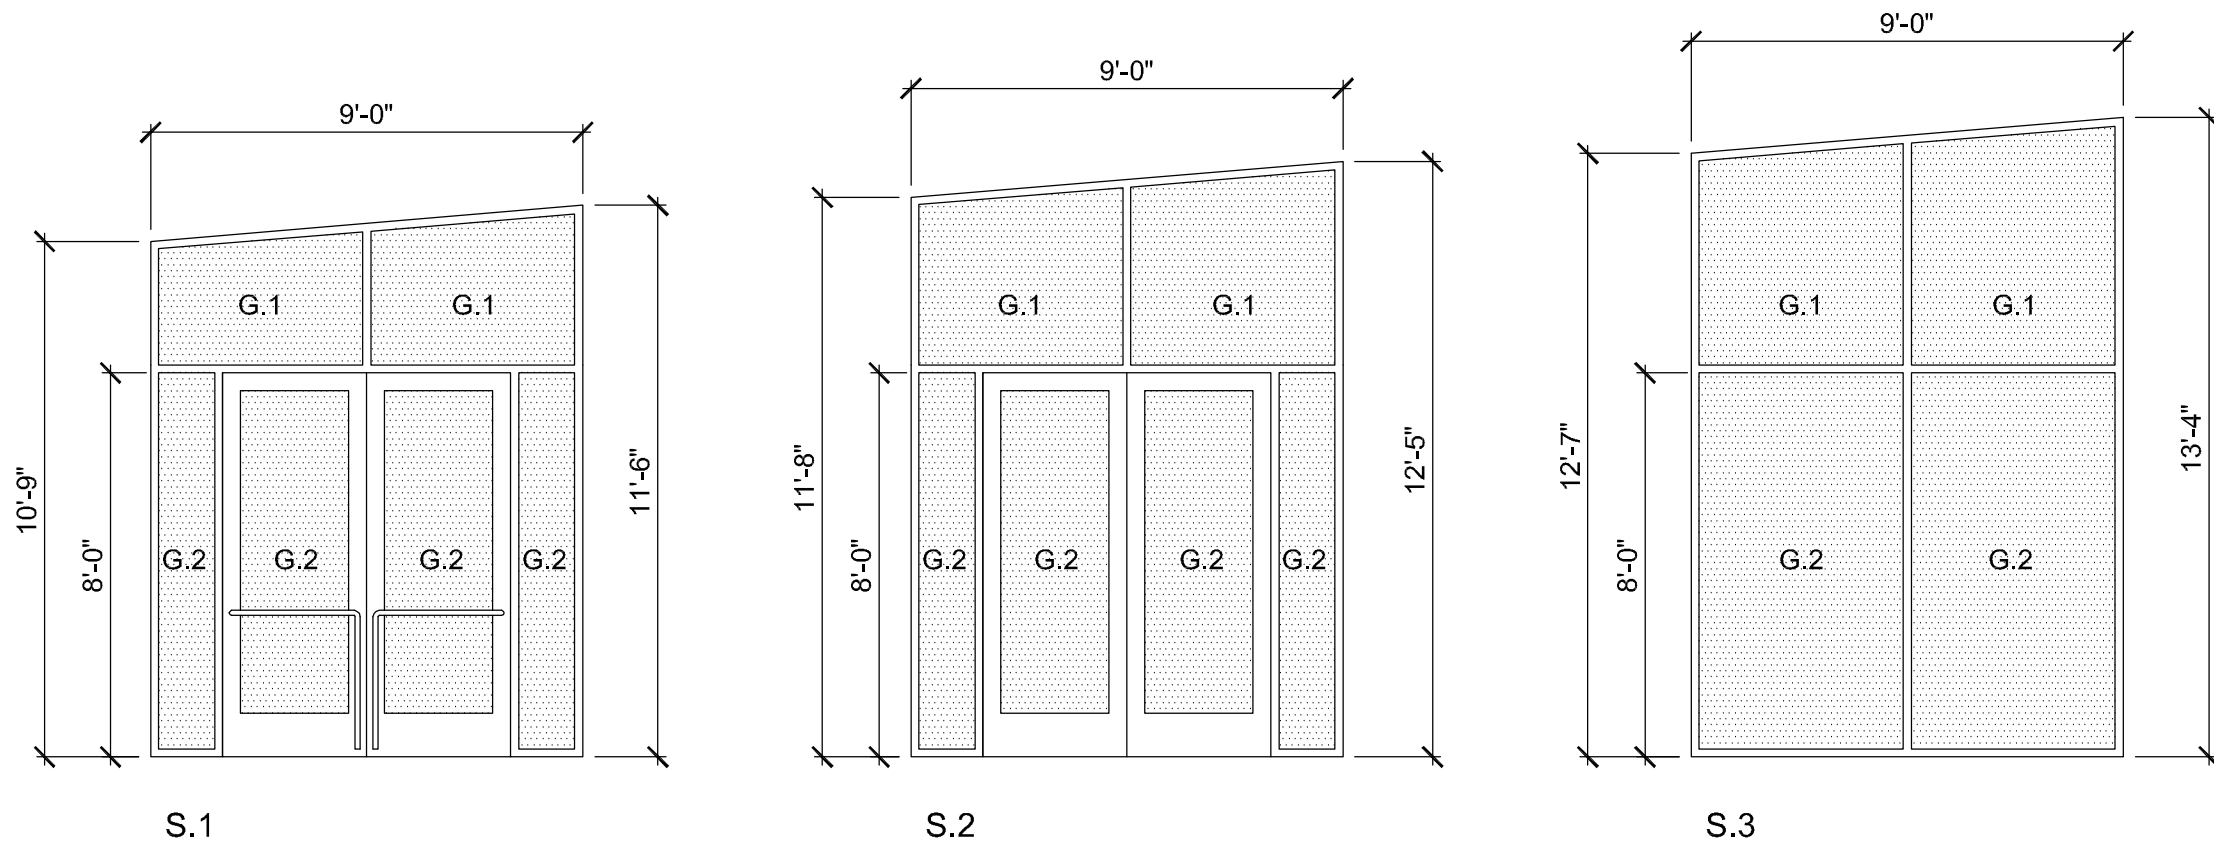

PHASE I STOREFRONTS

1/4"= 1' -0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007



971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

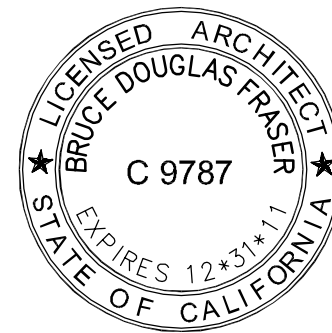

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
SCHEDULES**


SHEET #

A8.1


\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\A8.1 - Phase I Schedule.dwg, 5/5/2011 11:48:22 AM, PDF995

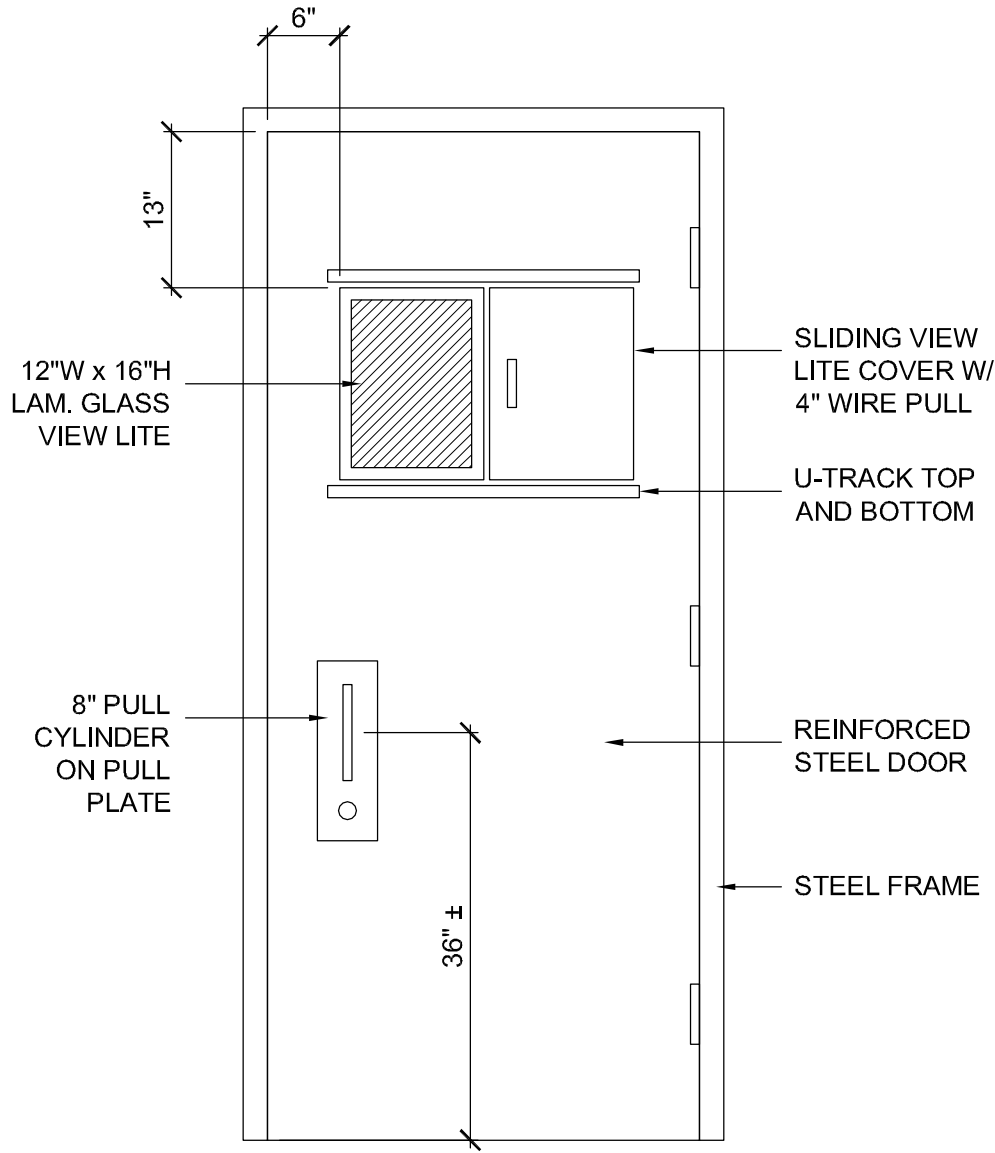


32 CELL DOOR ELEVATION
SCALE : 1/2" = 1'-0"

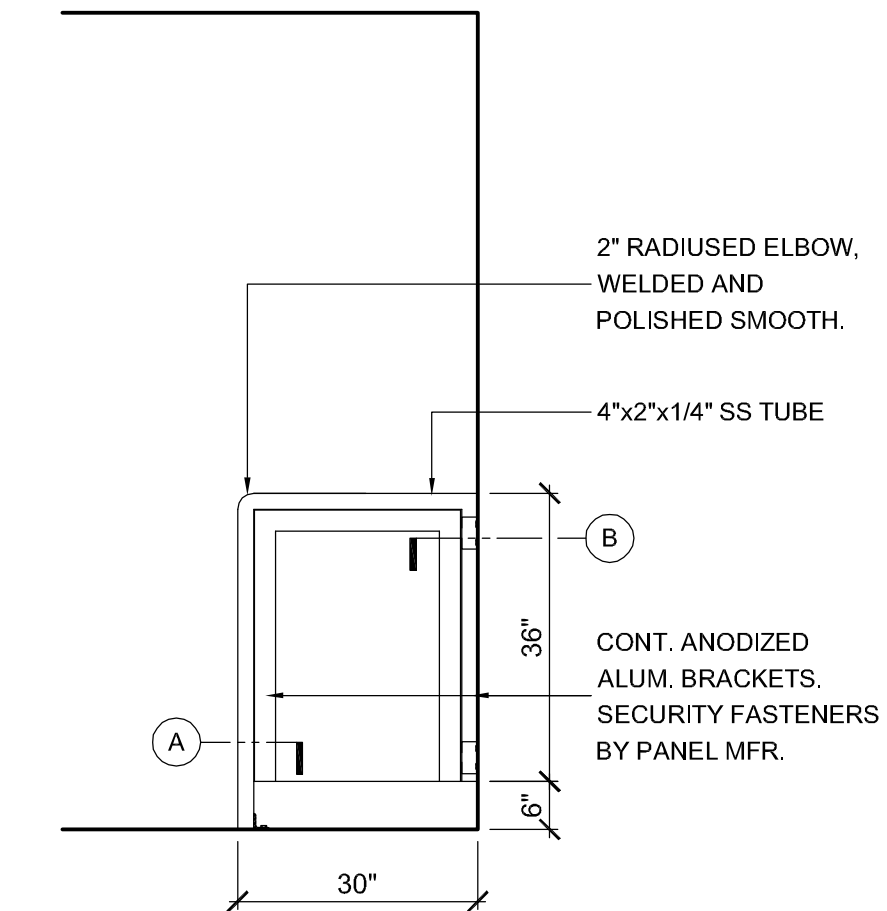


ELEVATION
1/2" = 1'-0"

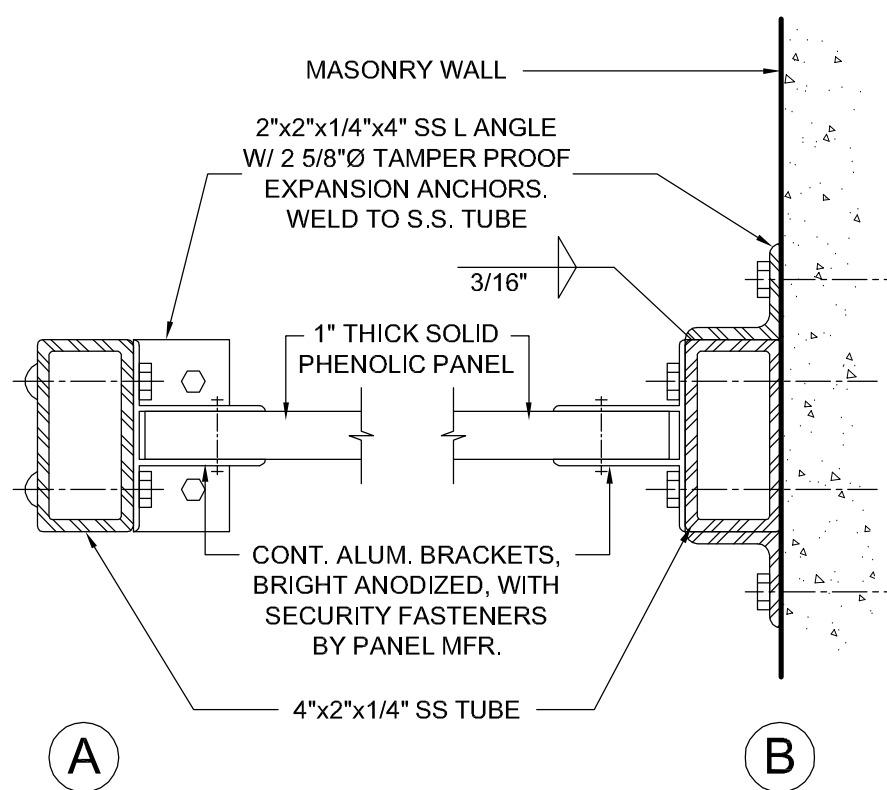


34 PRIVACY SCREEN
SCALE : AS NOTED

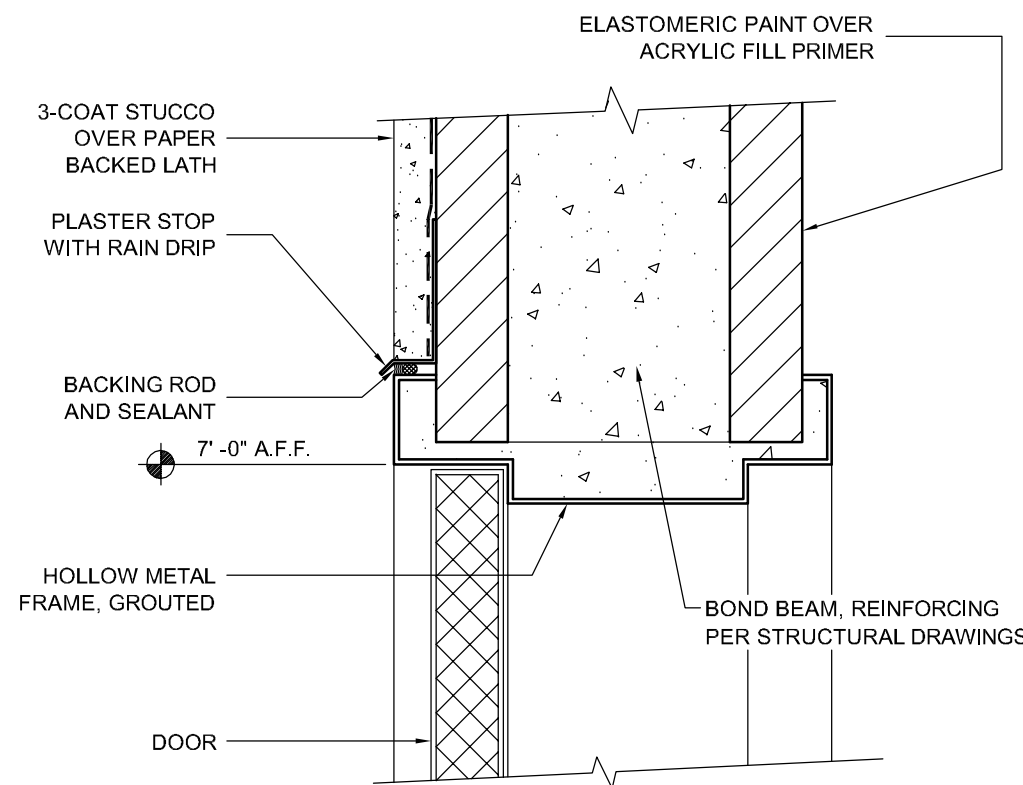


DOOR HEAD
3"= 1'- 0"

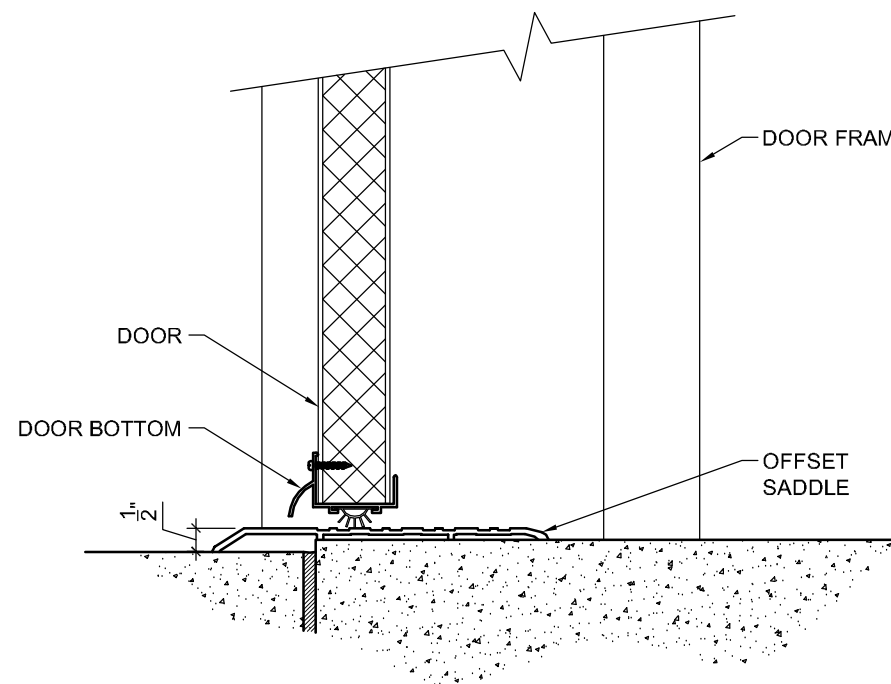


22 DOOR THRESHOLD
3"= 1'- 0"

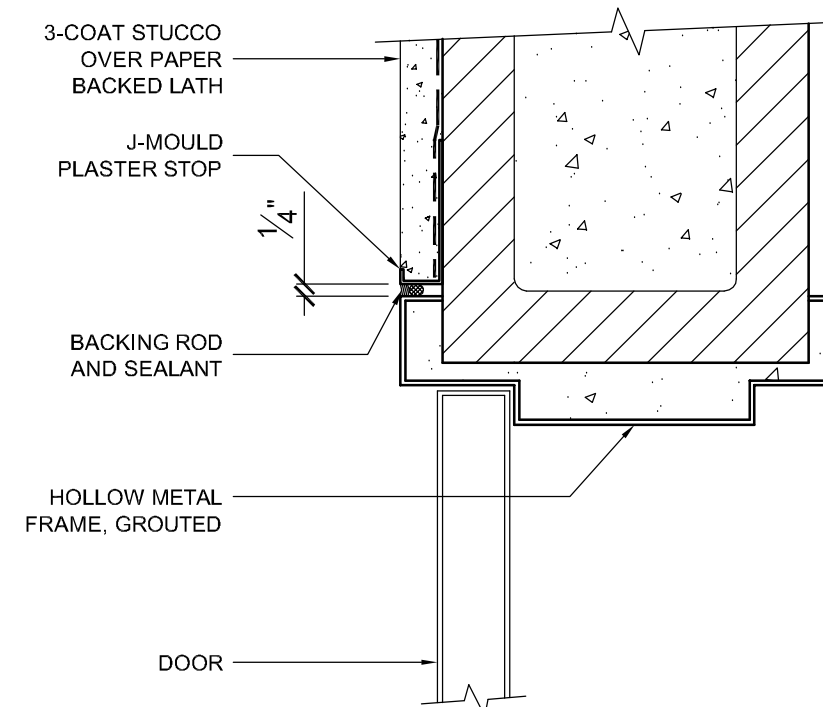


23 DOOR JAMB
3"= 1'- 0"

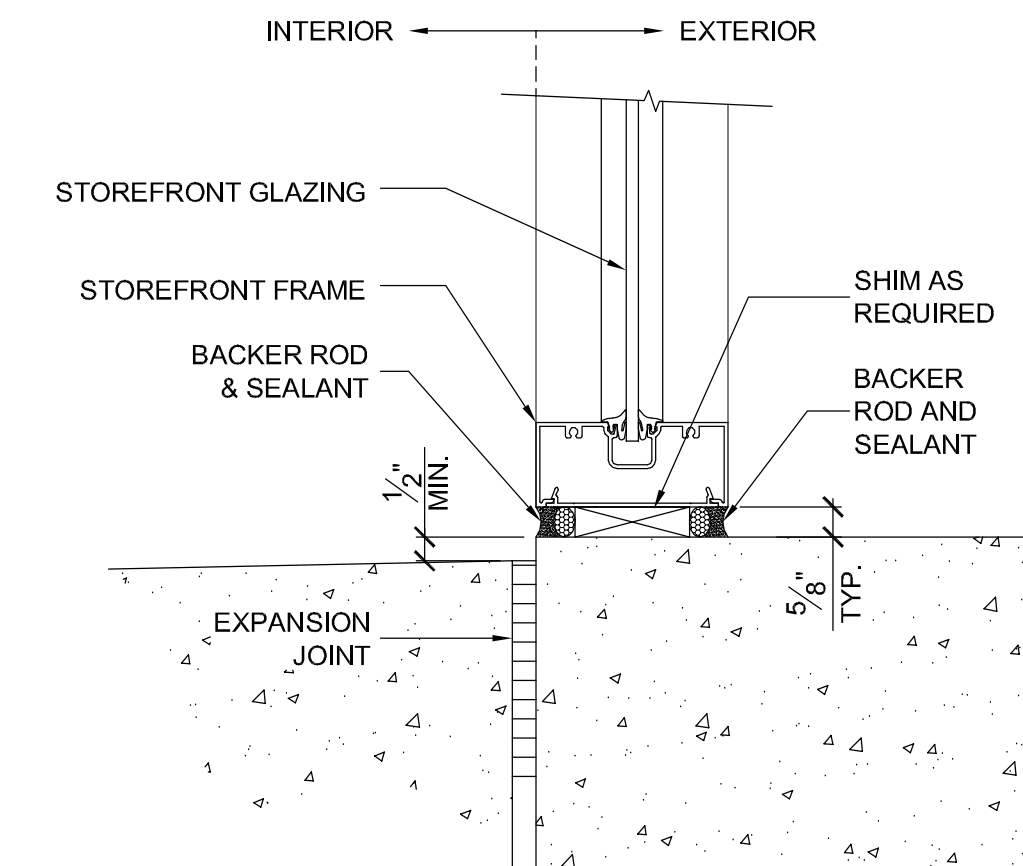


24 STOREFRONT SILL
3"= 1'- 0"

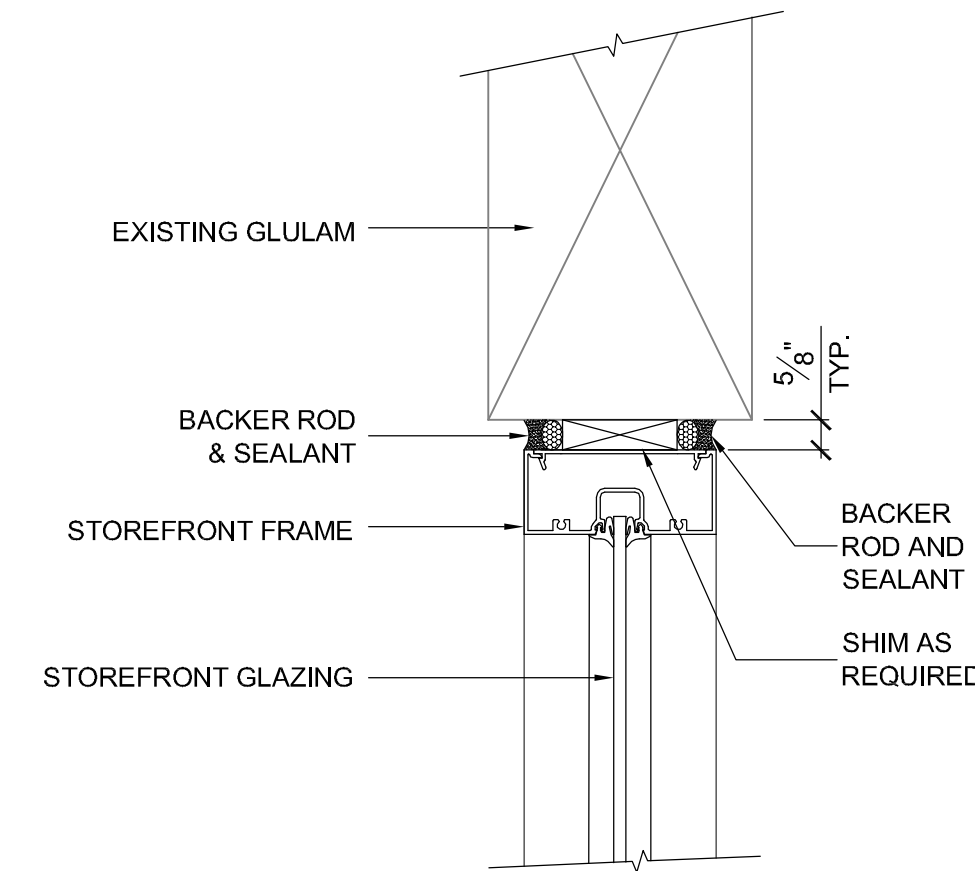


11 STOREFRONT HEAD
3"= 1'- 0"

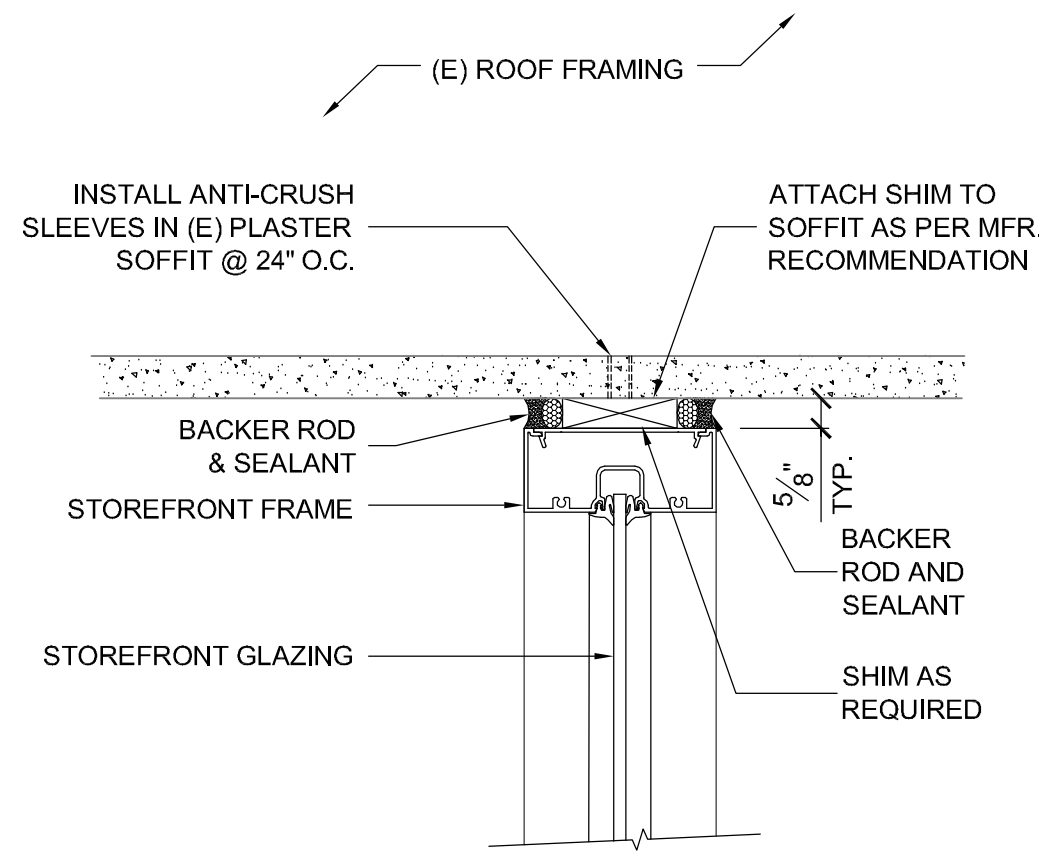

12 STOREFRONT HEAD
3"= 1'- 0"

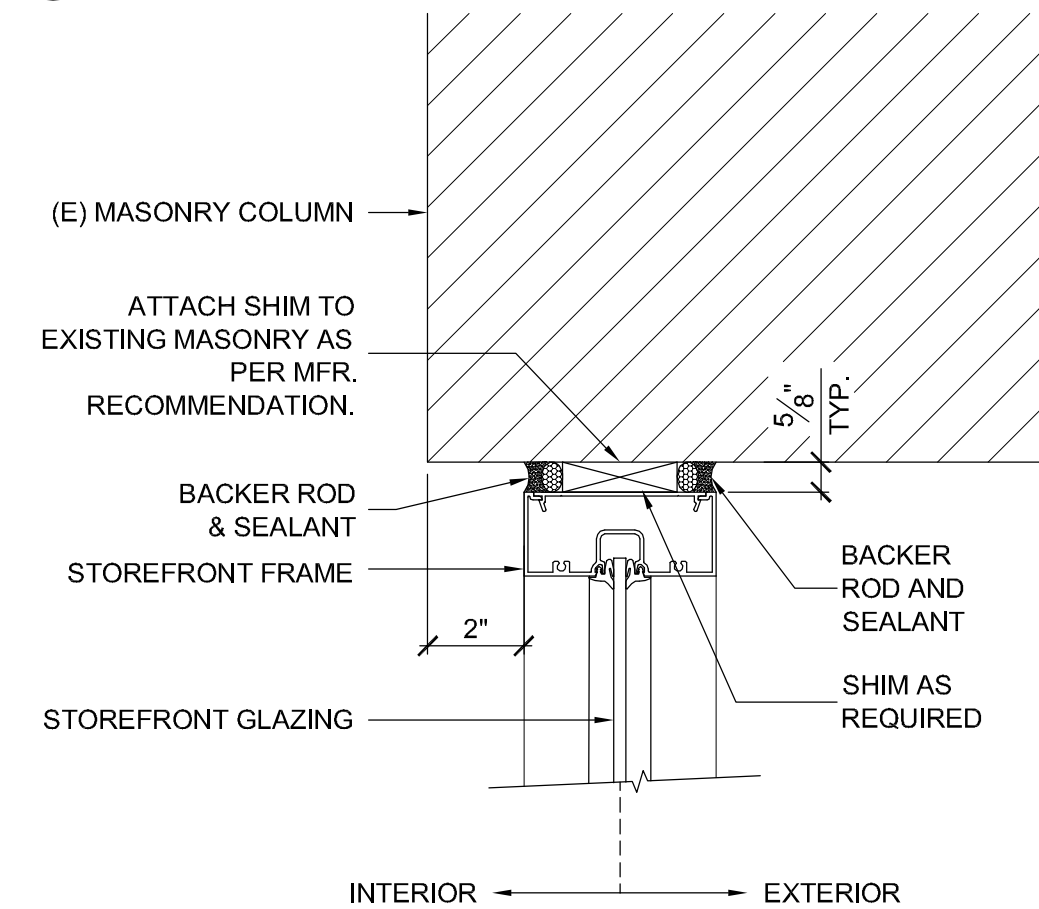

13 STOREFRONT JAMB
3"= 1'- 0"

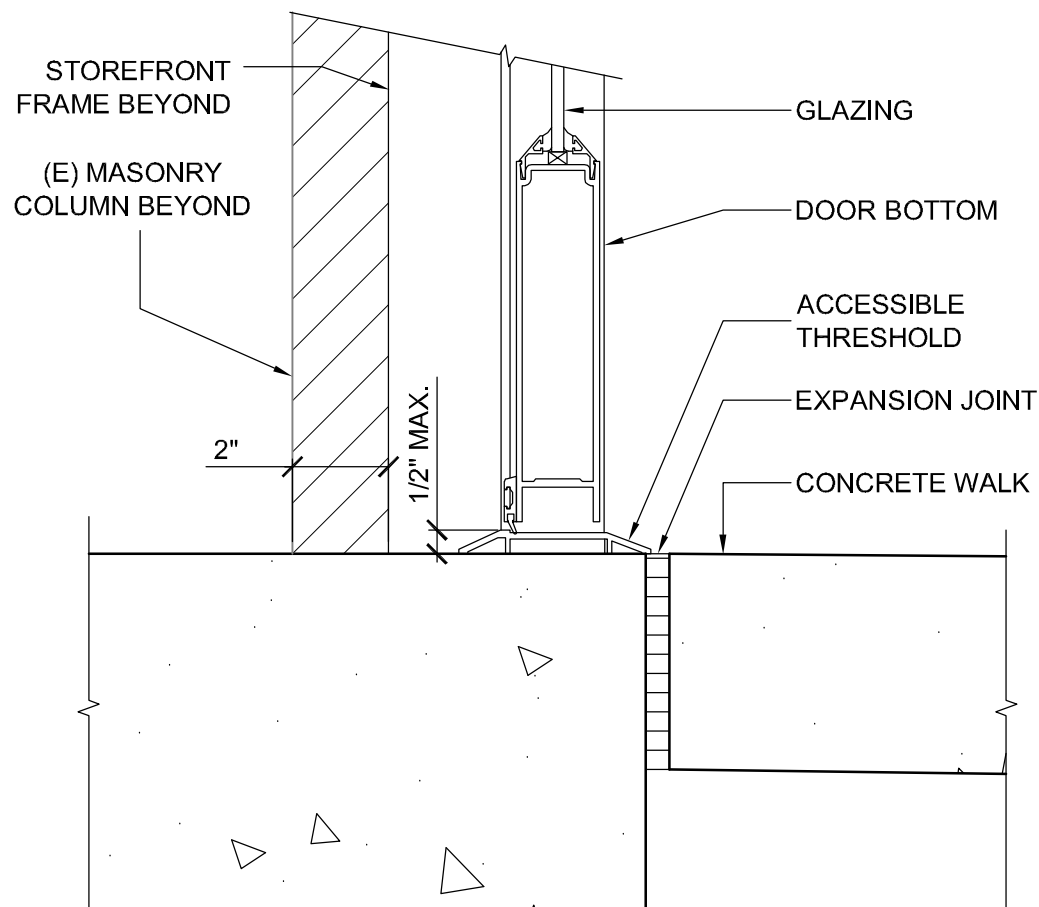

14 STOREFRONT THRESHOLD
3"= 1'- 0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

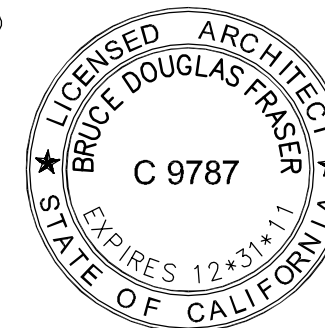

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
STOREFRONT,
DOOR & WINDOW
DETAILS**


SHEET #

A8.2


\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A8.3 - Phase 1 Suspended Ceiling Details.dwg, 4/29/2011 3:54:51 PM, PDF995

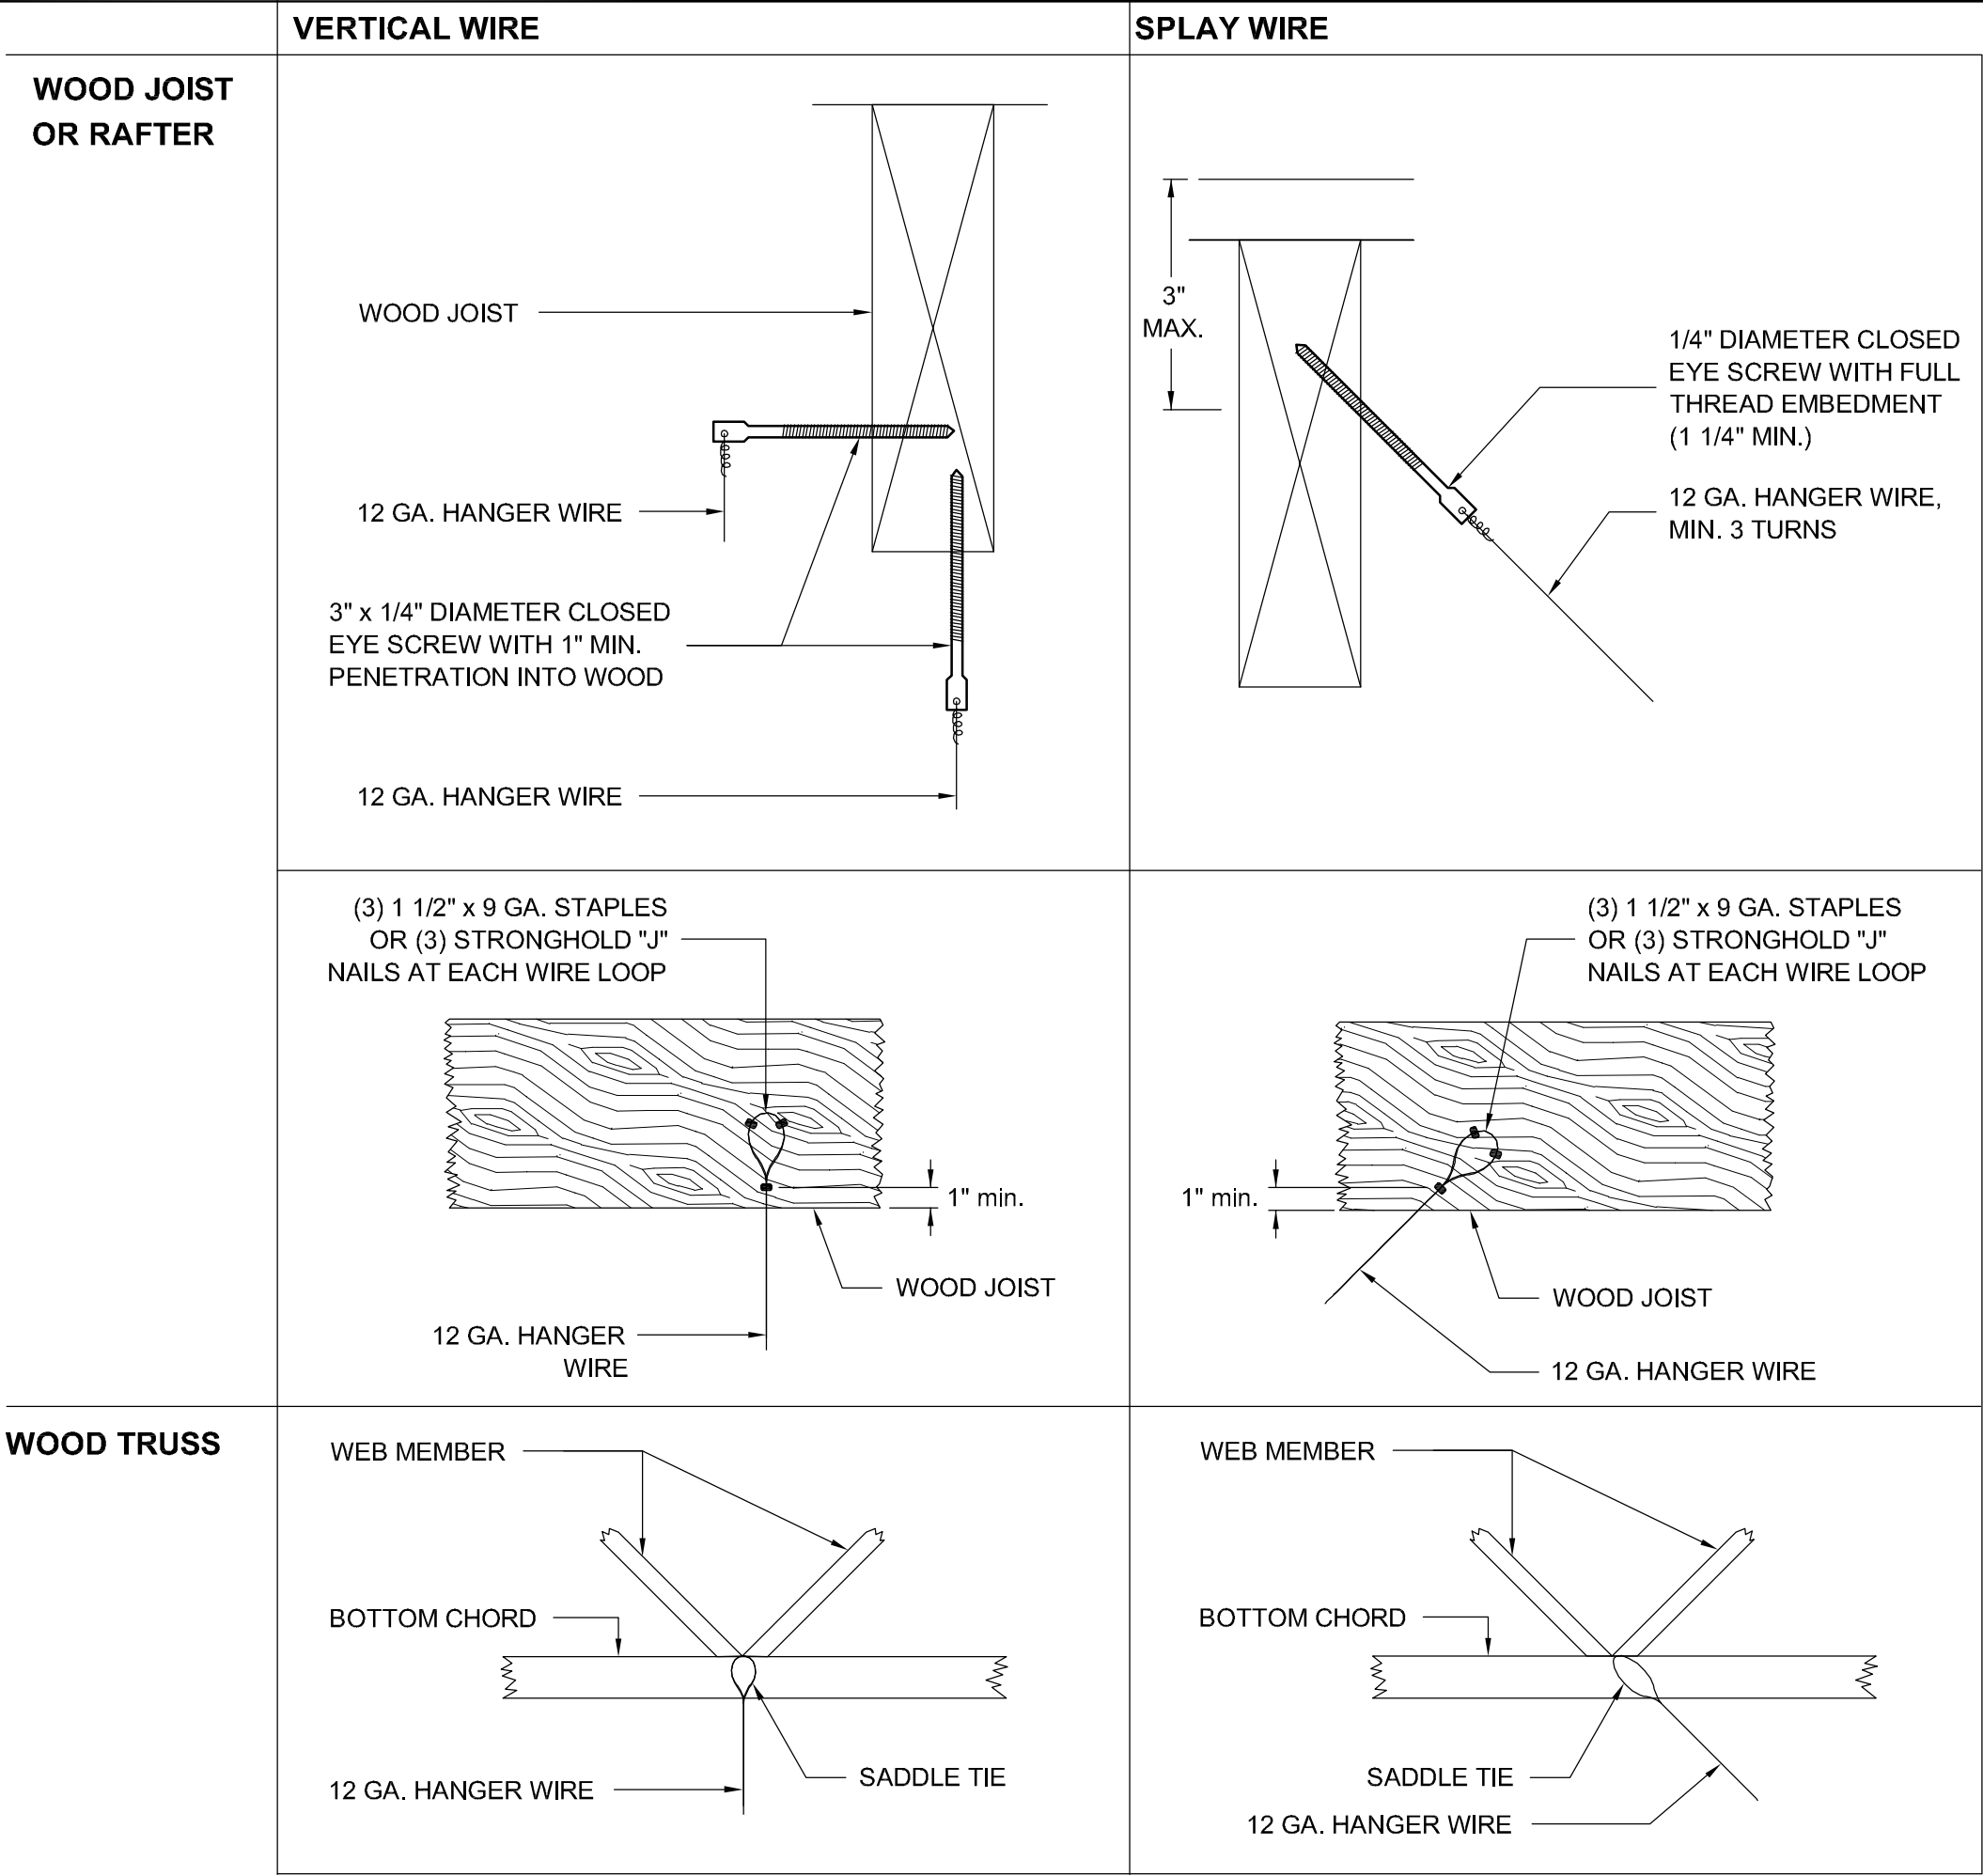


42 HANGER WIRE TO WOOD TRUSS / RAFTER
N.T.S.

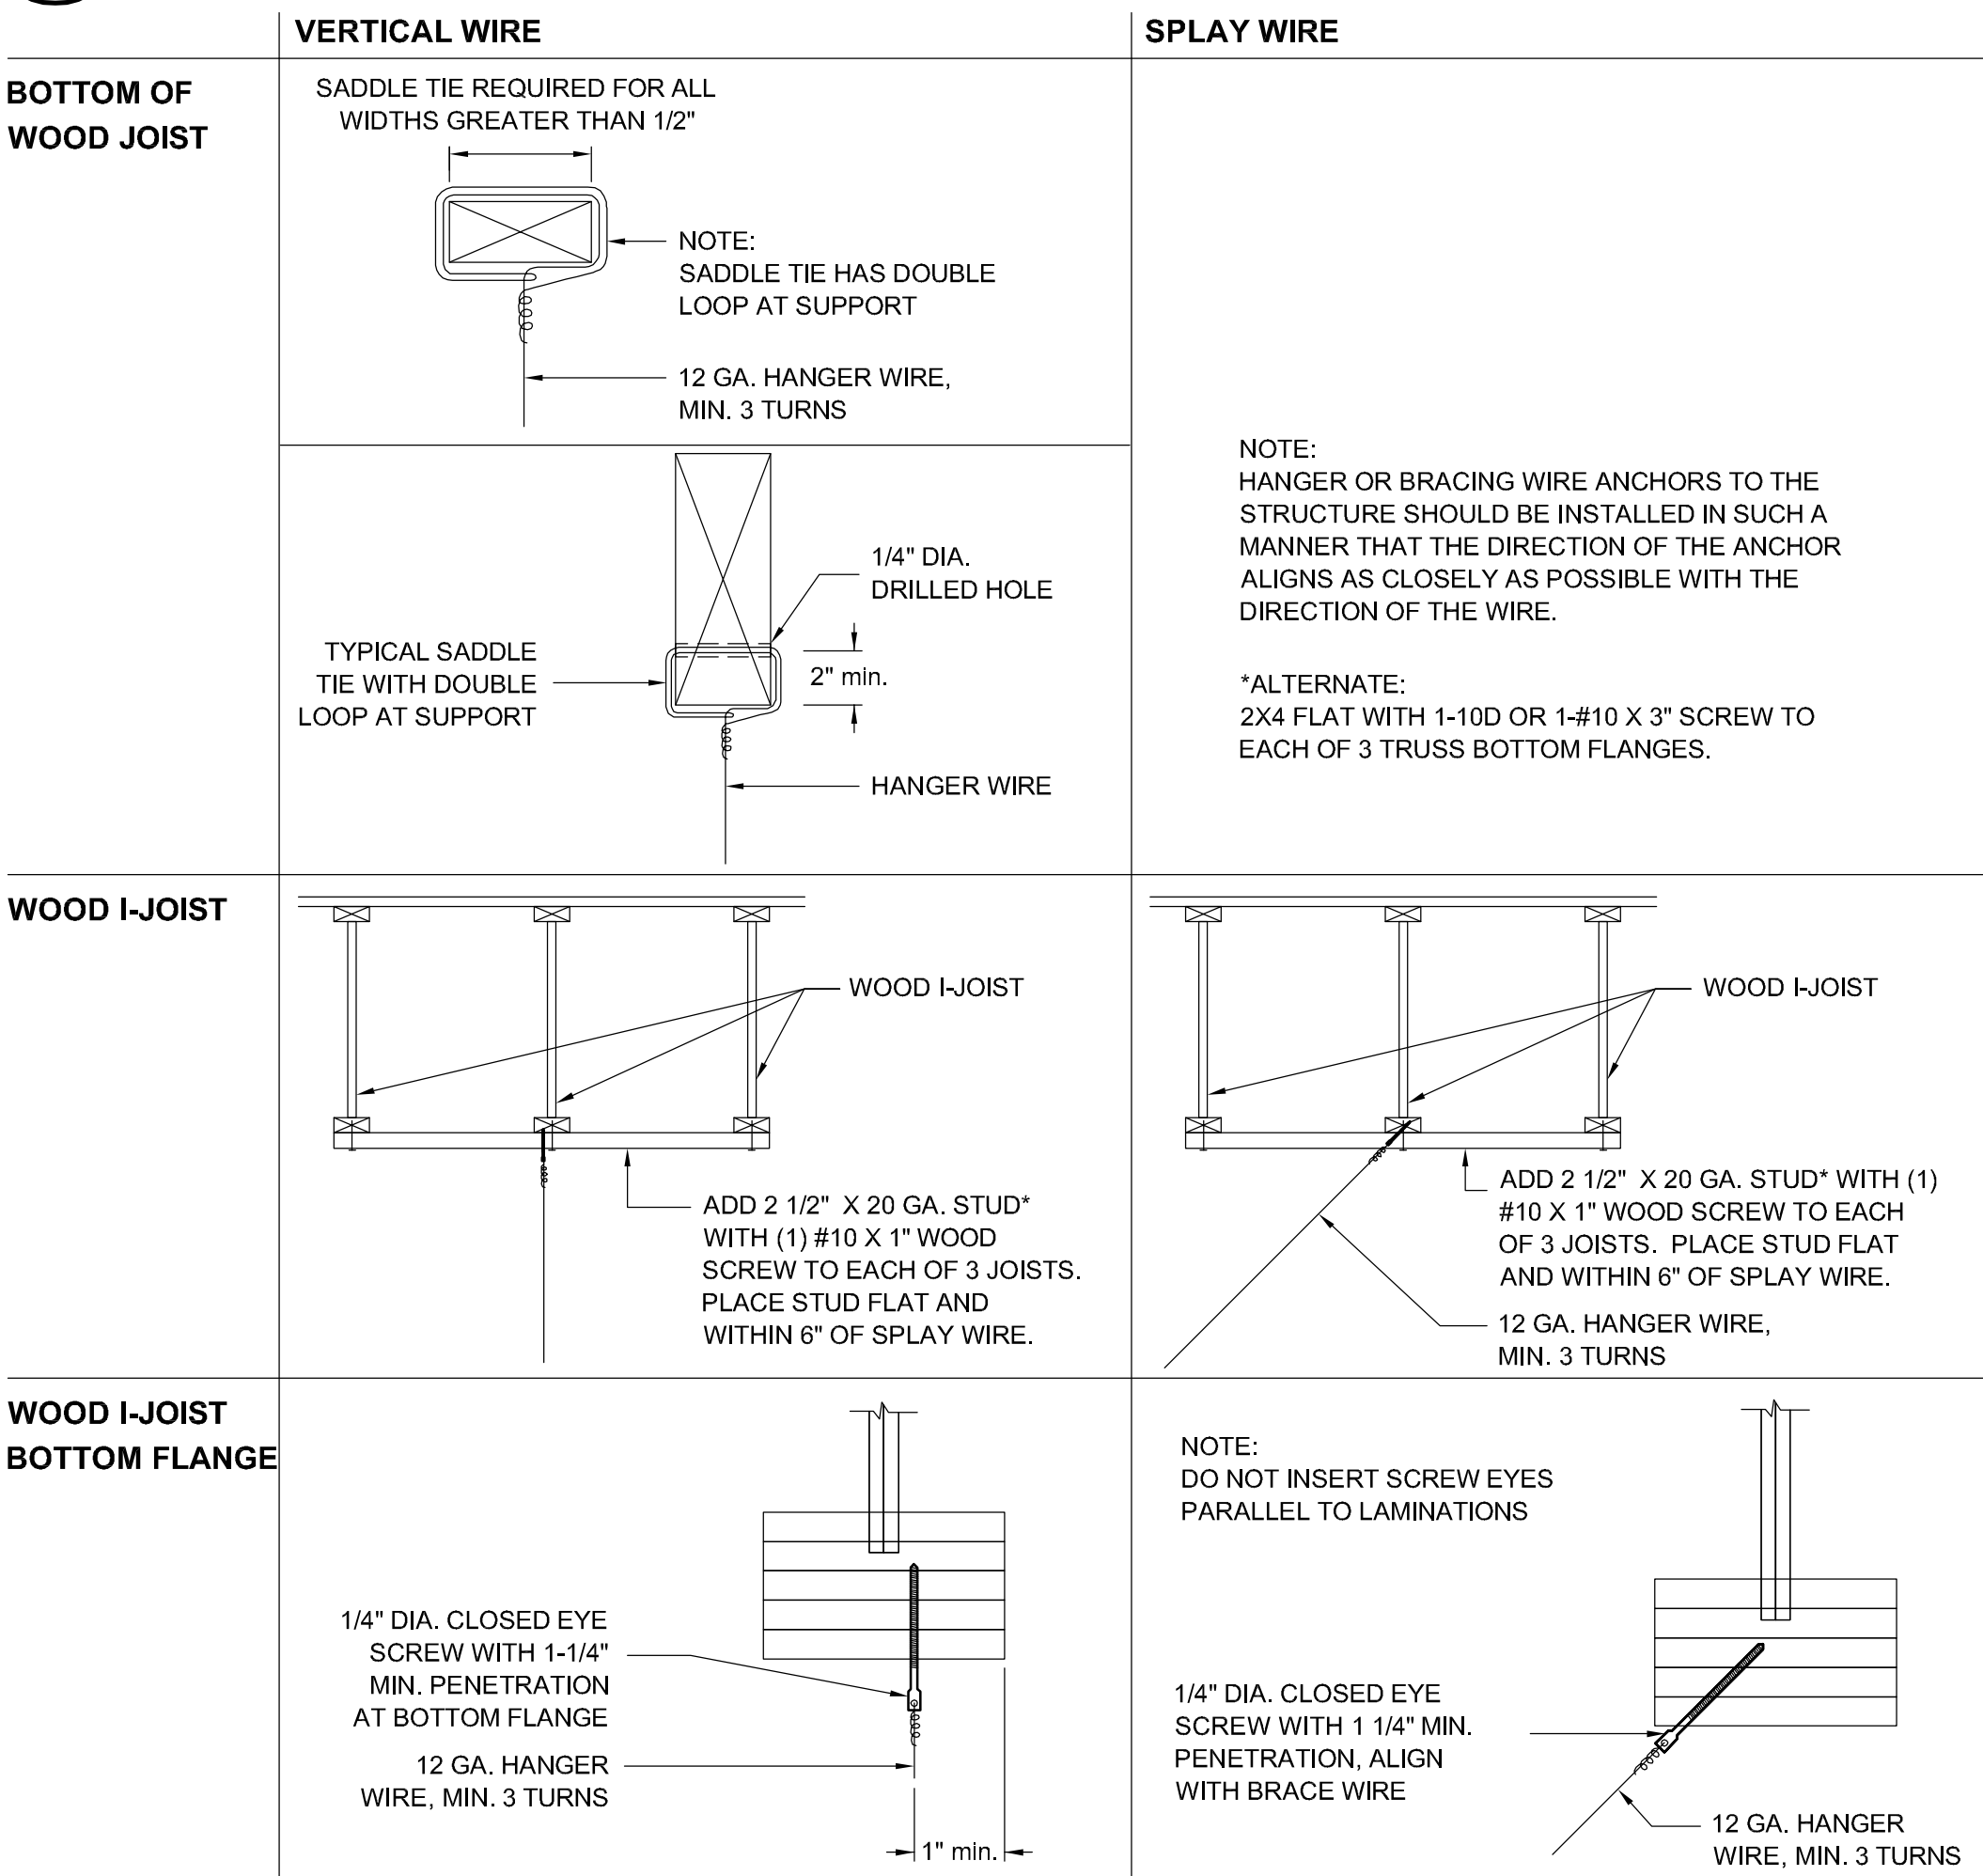


44 HANGER WIRE TO WOOD I-JOIST
N.T.S.

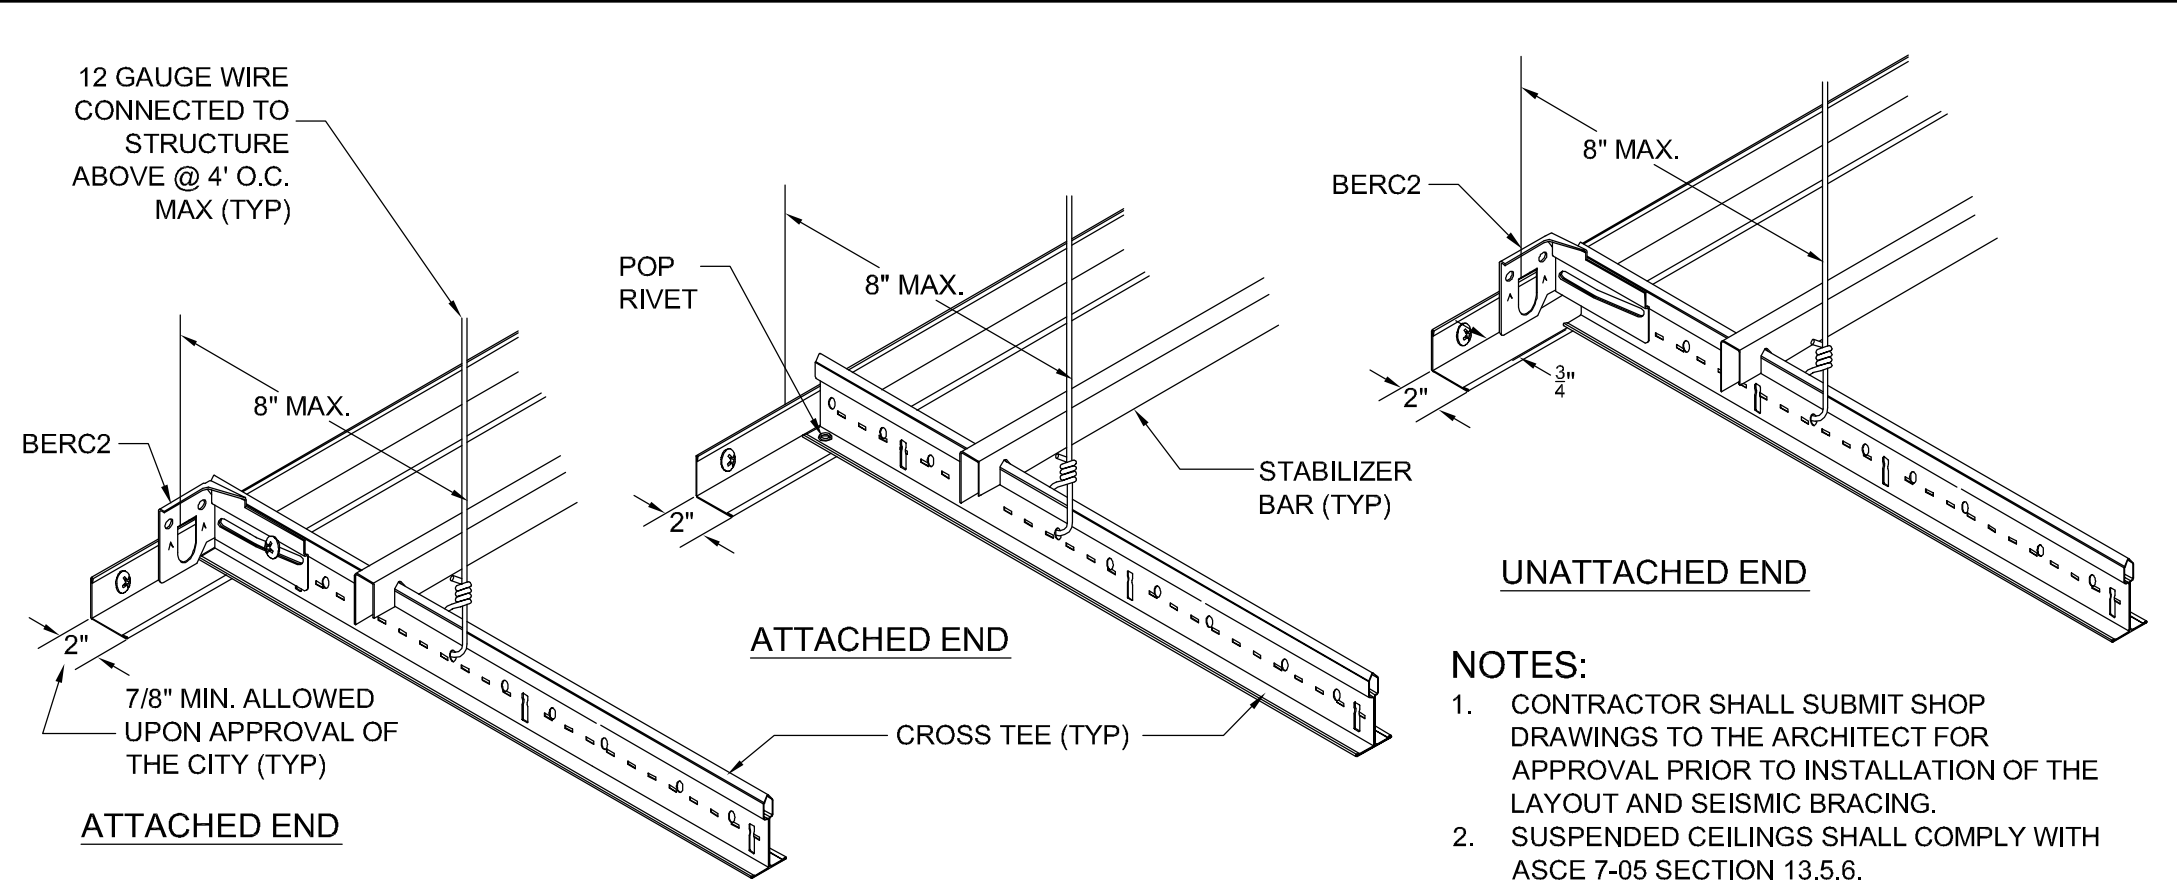


21 SEISMIC END RESTRAINTS: SEISMIC ZONES D, E & F
N.T.S.

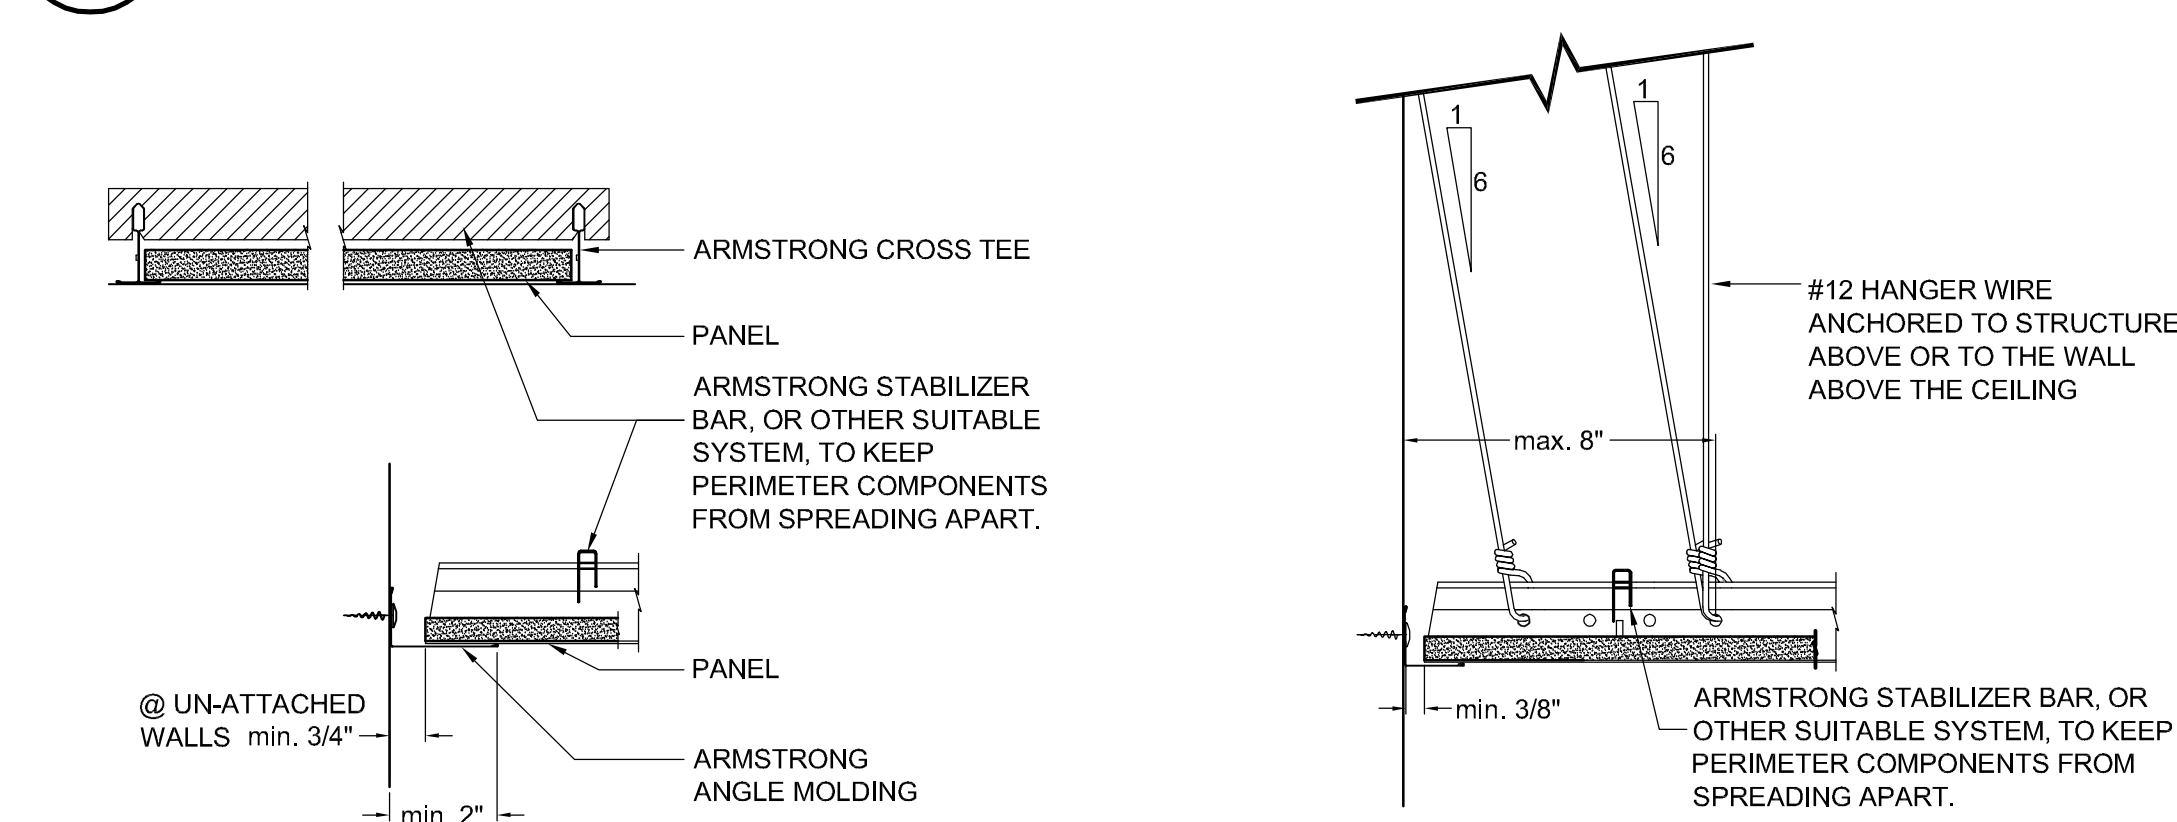

22 STABILIZER BAR: SEISMIC ZONES D, E & F
3\"= 1\"-0\"

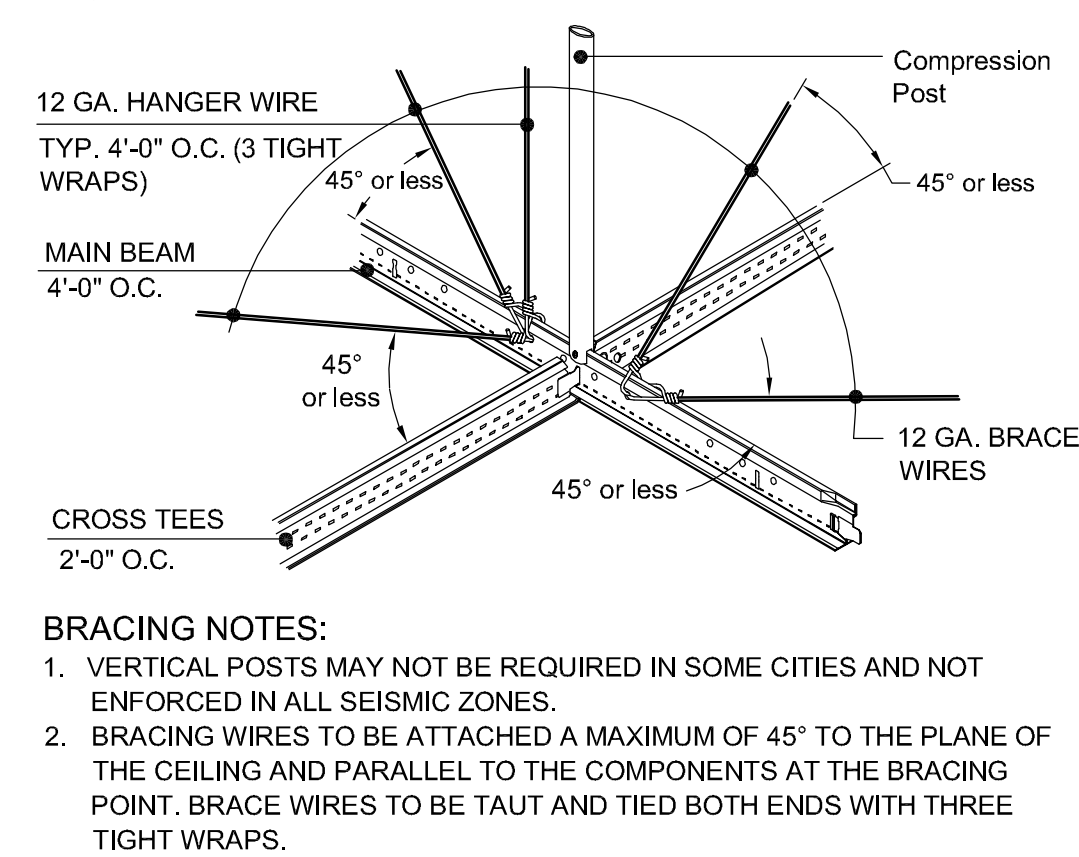


LATERAL BRACING: WITH COMPRESSION POST
N.T.S.

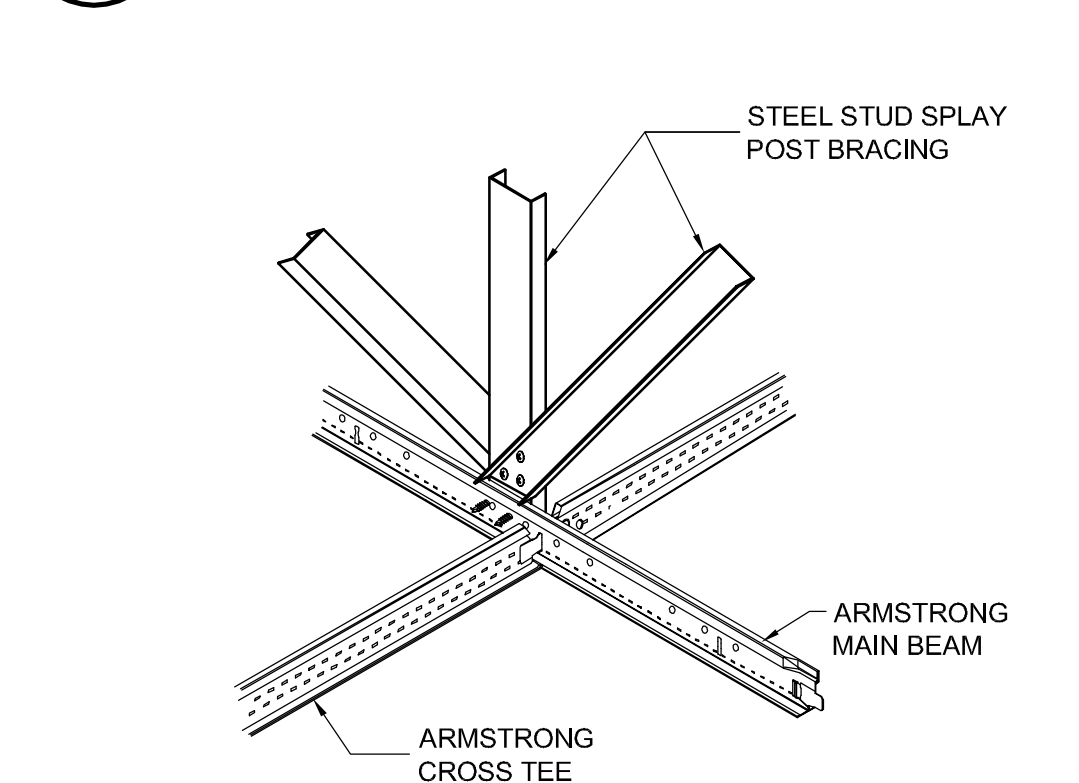


LATERAL BRACING: STEEL STUD SPLAY POST BRACING
N.T.S.

12 SEISMIC END RESTRAINT: FIXED END - SEISMIC ZONE C
3\"= 1\"-0\"

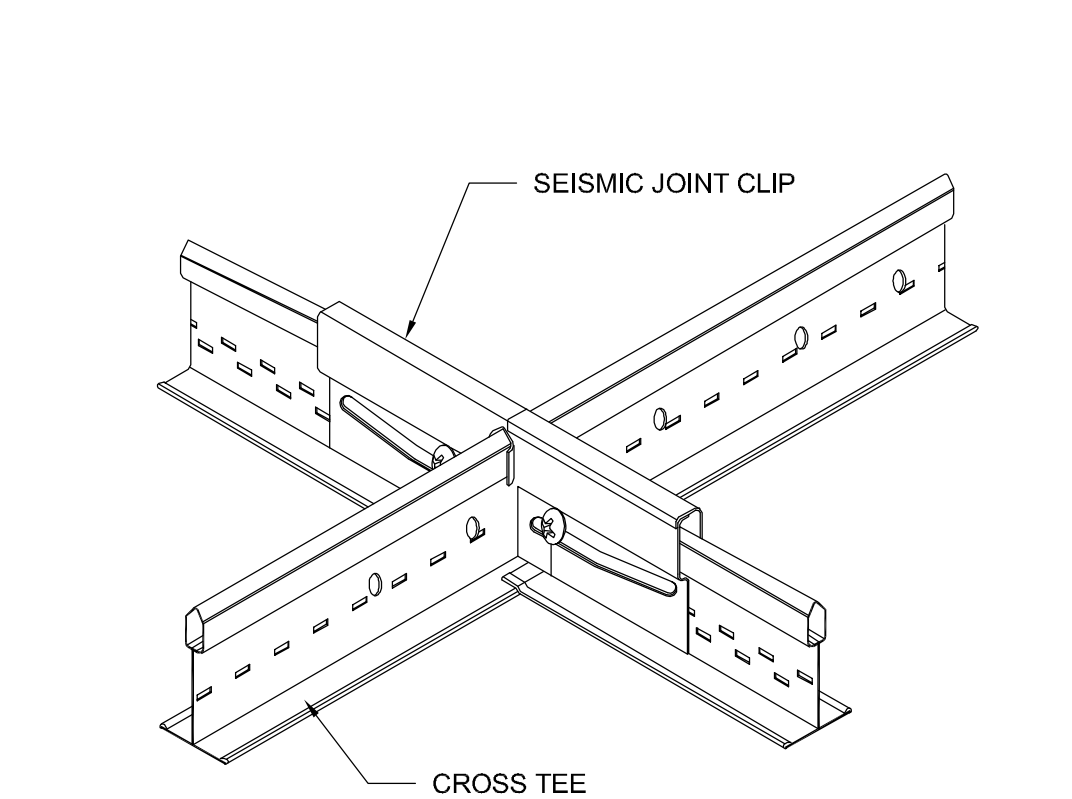

13 SEISMIC JOINT CLIP
N.T.S.

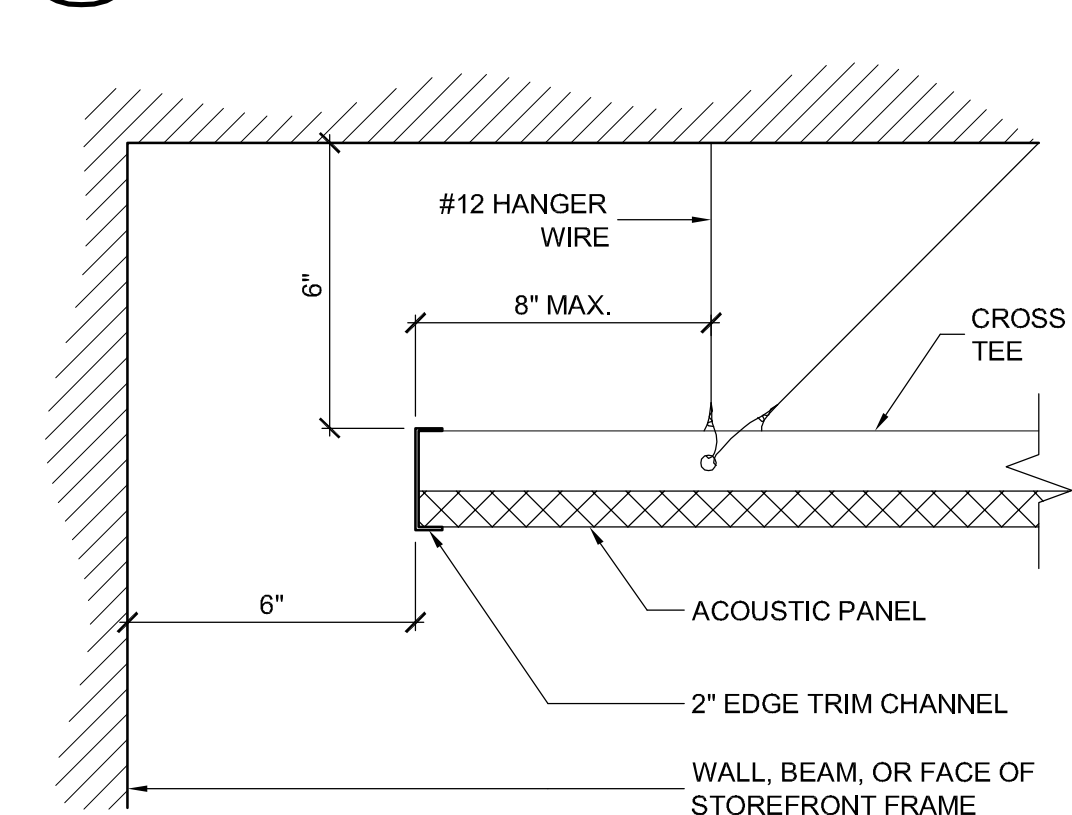

14 LOBBY - ACOUSTIC CLOUD
3\"= 1\"-0\"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

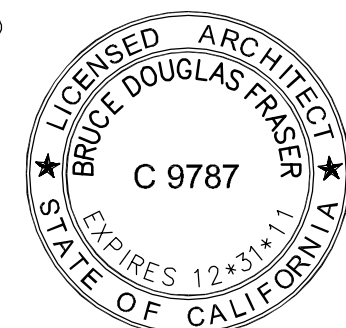

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE


**PHASE I
SUSPENDED
CEILING DETAILS**

SHEET #

A8.3

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A8.4 - Phase I Wall Types.dwg, 4/29/2011 4:48:39 PM, PDF995

System No. C-AJ-8041
F RATING = 3-HR, T RATING = 0 and 1 HR. L Rating At Ambient - 10 CFM/sq ft L Rating At 400 F - Less Than 6 CFM/sq ft

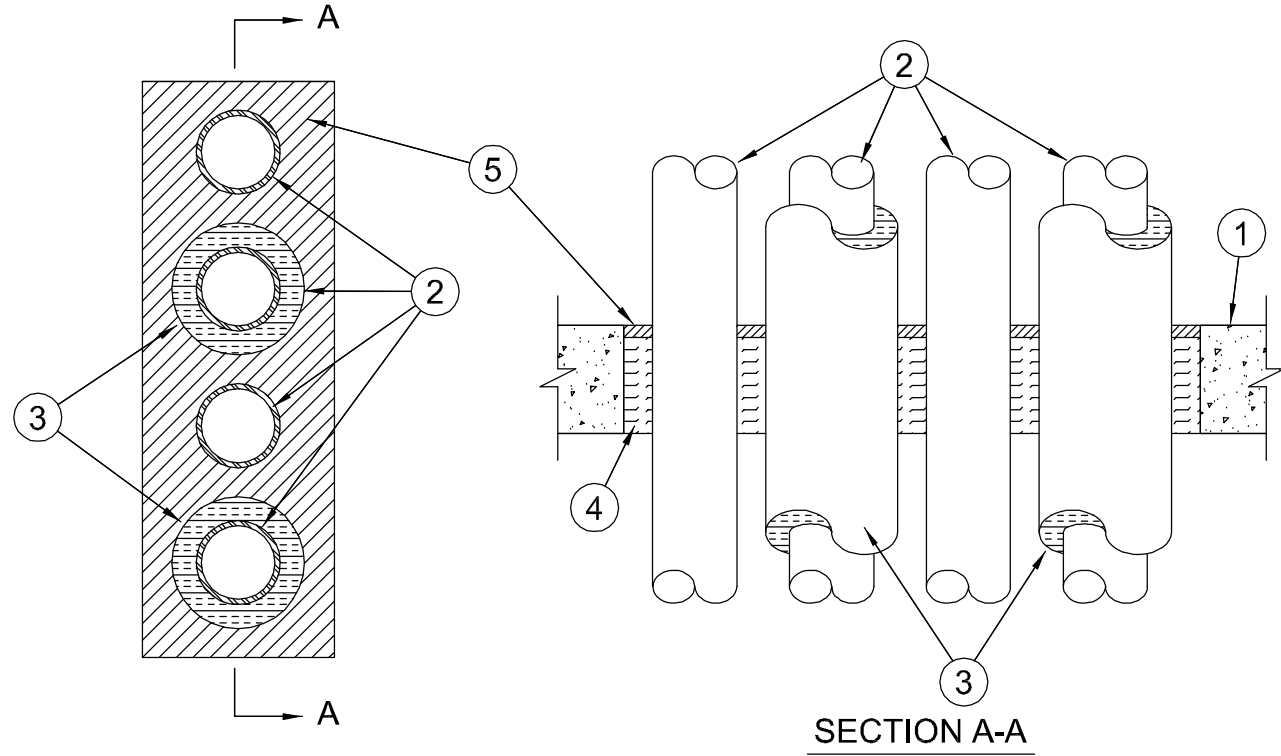


- Floor or Wall Assembly - Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete floor or min 5 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete wall. Wall may also be constructed of any UL Classified Concrete Blocks*. Max area of opening is 192 sq in. with max dimension of 24 in.
See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.
 - Through Penetrants - A max of 4 pipes, conduits or tubing to be installed within the opening. The space between pipes, conduits or tubing shall be 1-1/2 in. The space between pipes, conduits or tubing and periphery of opening shall be min 1-5/8 in. to max 2-1/2 in. Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
 - Steel Pipe - Nom 3 in. diam (or smaller) Schedule 10 (or heavier) steel pipe.
 - Copper Tubing - Nom 3 in. diam (or smaller) Type L (or heavier) copper tubing
 - Copper Pipe - Nom 3 in. diam (or smaller) Regular (or heavier) copper pipe.
 - Conduit - Nom 3 in. diam (or smaller) electrical metallic tubing or steel conduit.
 - Pipe Covering* - (Optional) - Max 1 in. thick hollow cylindrical heavy density (min 3.5 pcf) glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt strip tape supplied with the product. A nom annular space of 1-1/2 in. is required within the firestop system. The T Rating is 1 hr when 1 in. thick pipe covering is used. The T Rating is 0 hr. when pipe covering is less than 1 in. or is omitted.
See Pipe and Equipment Covering - Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
 - Packing Material - Min 4 in. thickness of min 4.0 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material.
 - Fill, Void or Cavity Material* - Sealant - Min 1/2 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall.
- *Bearing the UL Classification Marking

32 THROUGH-PENETRATION FIRESTOP

NTS


System No. C-AJ-2164
F Rating -- 2 HR
T Rating -- 0 hr

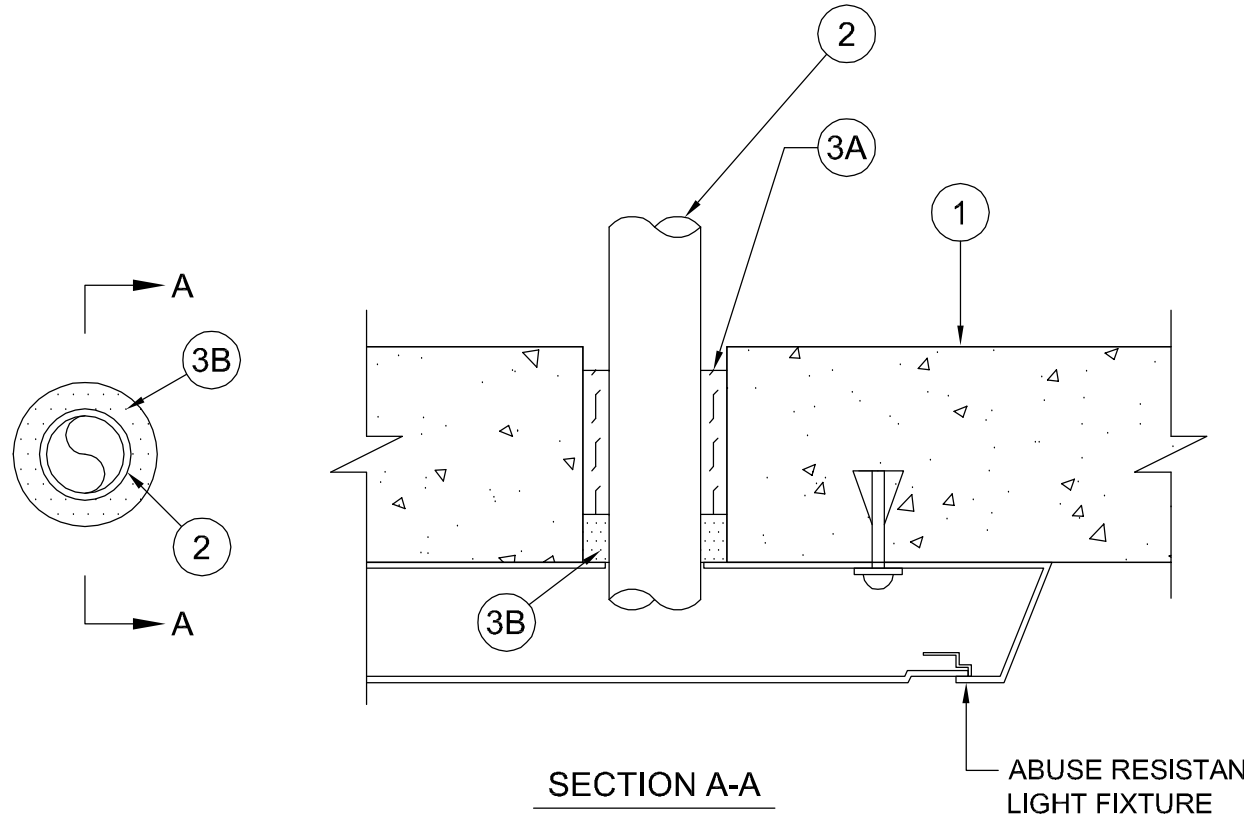

- Floor or Wall Assembly -- Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diam of opening is 3 in.
 - Through Penetrants -- One nonmetallic pipe to be centered within the firestop system. Annular space between pipe and edge of opening to be nom 9/16 in. Pipe to be rigidly supported on both sides of floor-ceiling assembly. The following types and sizes of nonmetallic pipes may be used:
 - Polyvinyl Chloride (PVC) Pipe -- Nom 1-1/2 in. diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 - Chlorinated Polyvinyl Chloride (CPVC) Pipe -- Nom 1-1/2 in. diam (or smaller) SDR13.5 CPVC pipe for use in closed (process or supply) piping systems.
 - Firestop System -- The firestop system shall consist of the following:
 - Forming Materials* -- Min 3 in. thickness foamed into opening as a permanent form. Forming material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- CF810, CF812 or CF511 Foam Sealant
 - Fill, Void or Cavity Material* -- Sealant -- Min 1 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC -- FS-ONE Sealant
- *Bearing the UL Classification Mark


34 THROUGH-PENETRATION FIRESTOP

NTS

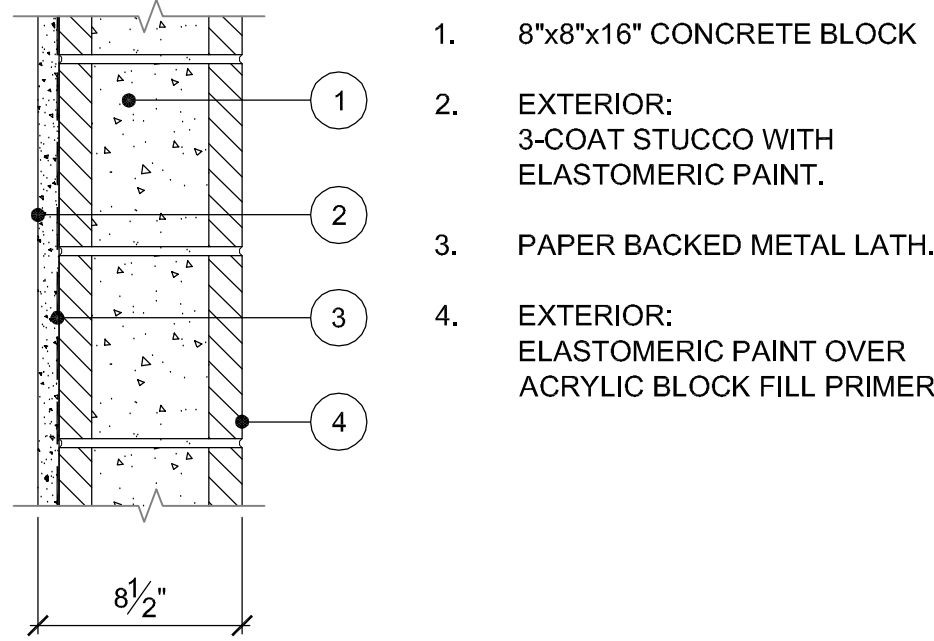


21 WALL TYPE E - EXTERIOR (2 HOUR) UL NO. U905

1 1/2" = 1'-0"

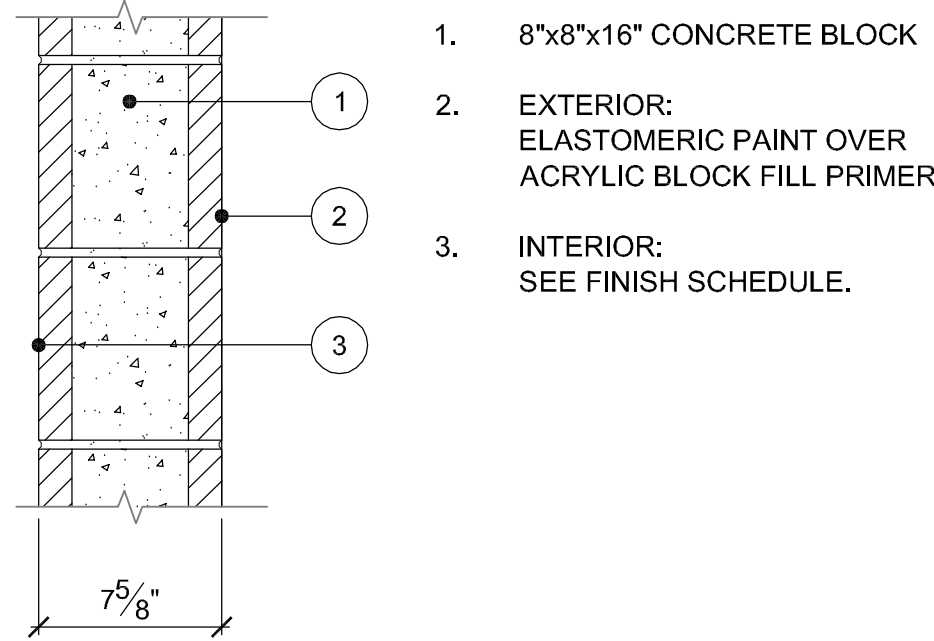


22 WALL TYPE F - EXTERIOR (2 HOUR) UL NO. U905

1 1/2" = 1'-0"

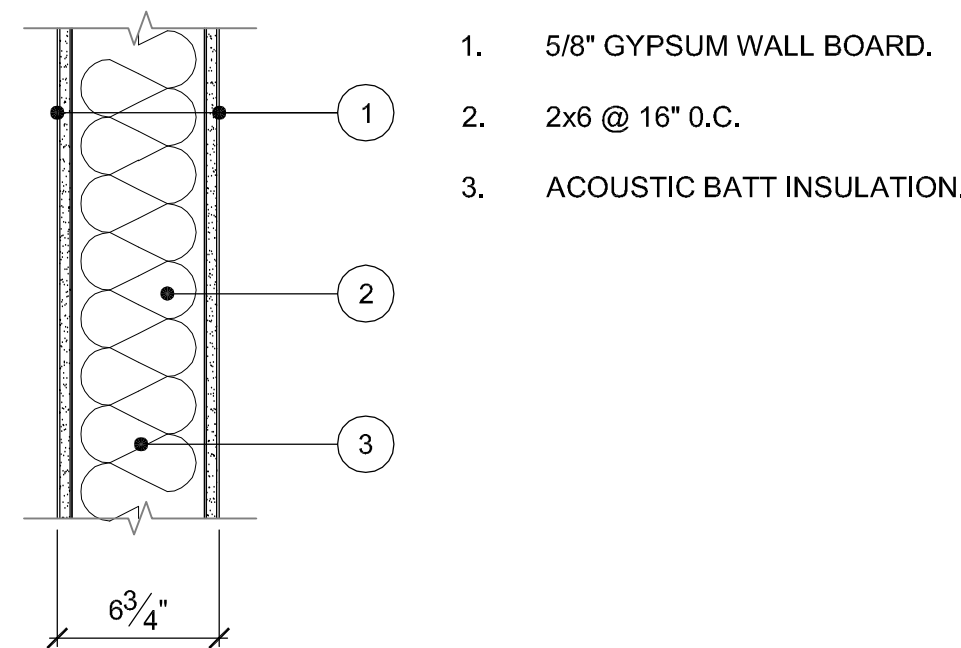


23 WALL TYPE G - INTERIOR (NON-RATED)

1 1/2" = 1'-0"

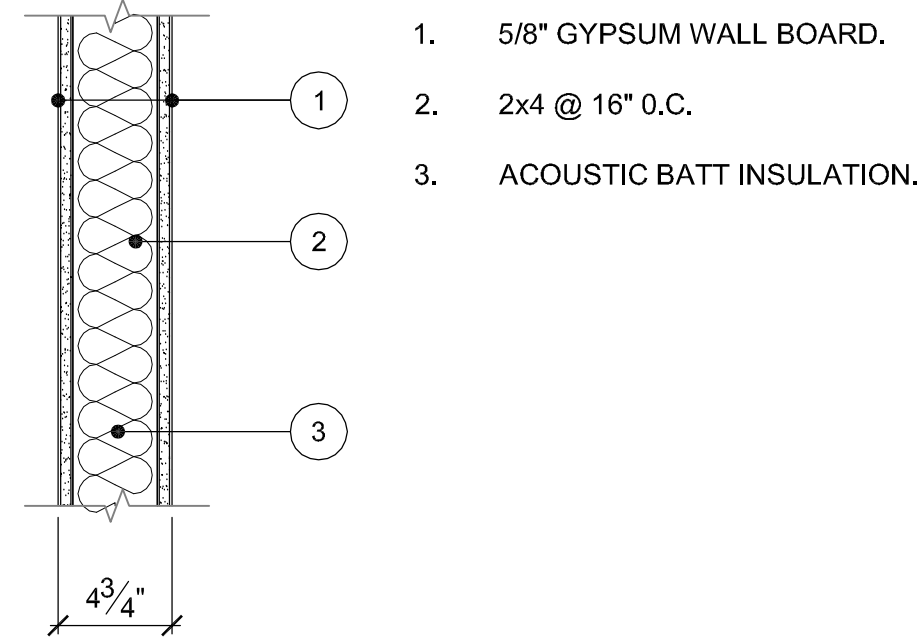


11 WALL TYPE A - INTERIOR (NON-RATED)

1 1/2" = 1'-0"

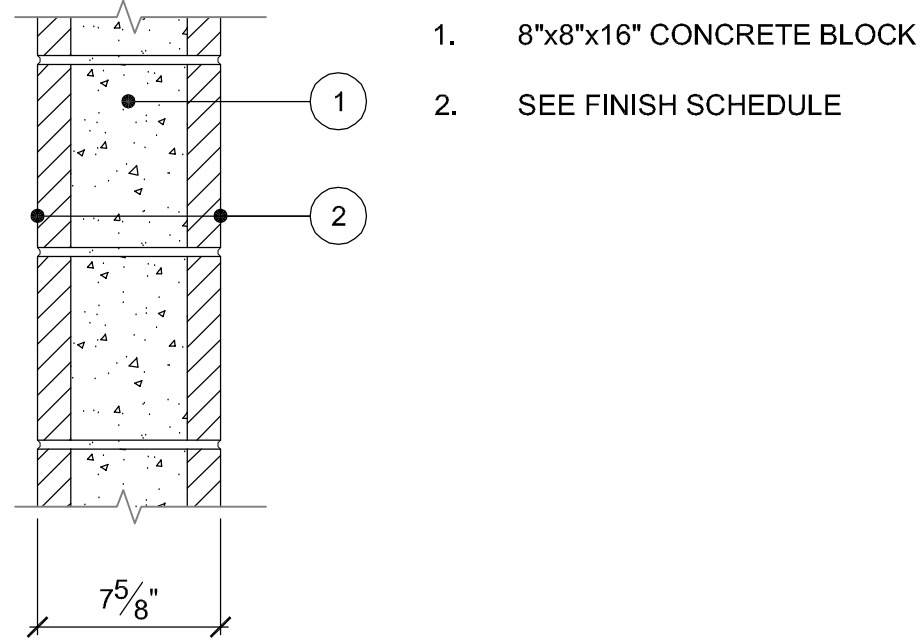


12 WALL TYPE B - INTERIOR (2 HOUR) UL NO. U905

1 1/2" = 1'-0"

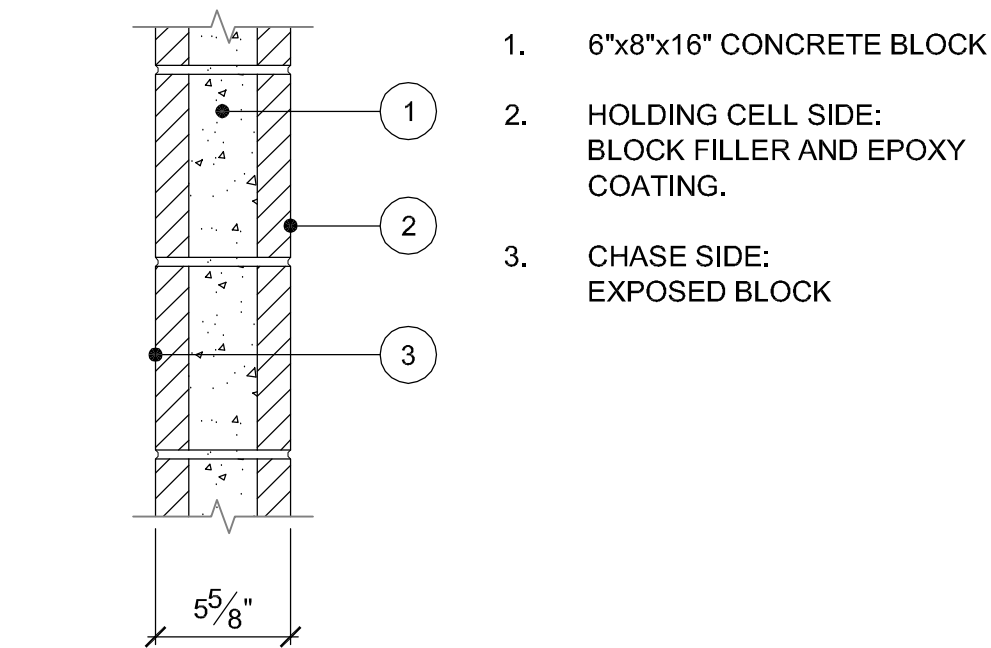

13 WALL TYPE C - INTERIOR (2 HOUR) UL NO. U906

1 1/2" = 1'-0"

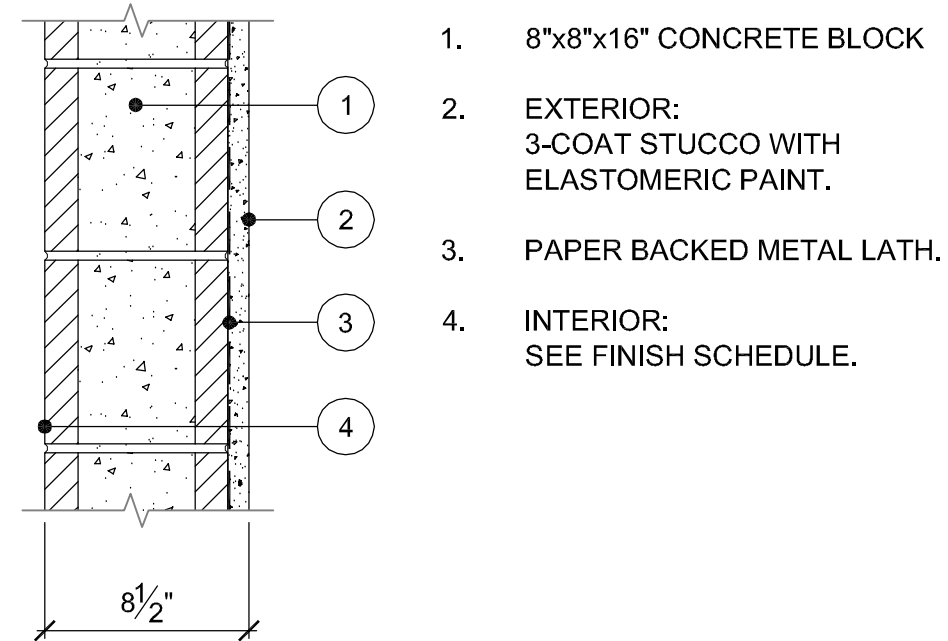

14 WALL TYPE D - EXTERIOR (2 HOUR) UL NO. U905

1 1/2" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

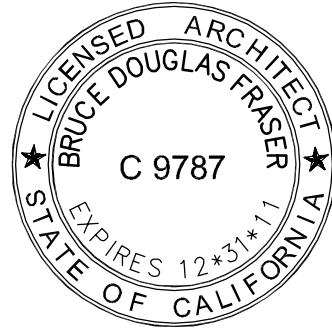

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**PHASE I
WALL TYPES, FIRE
PROTECTION**


SHEET #

A8.4


\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A9.1 - Phase 1 Architectural Details.dwg, 6/20/2011 12:54:29 PM, R09905

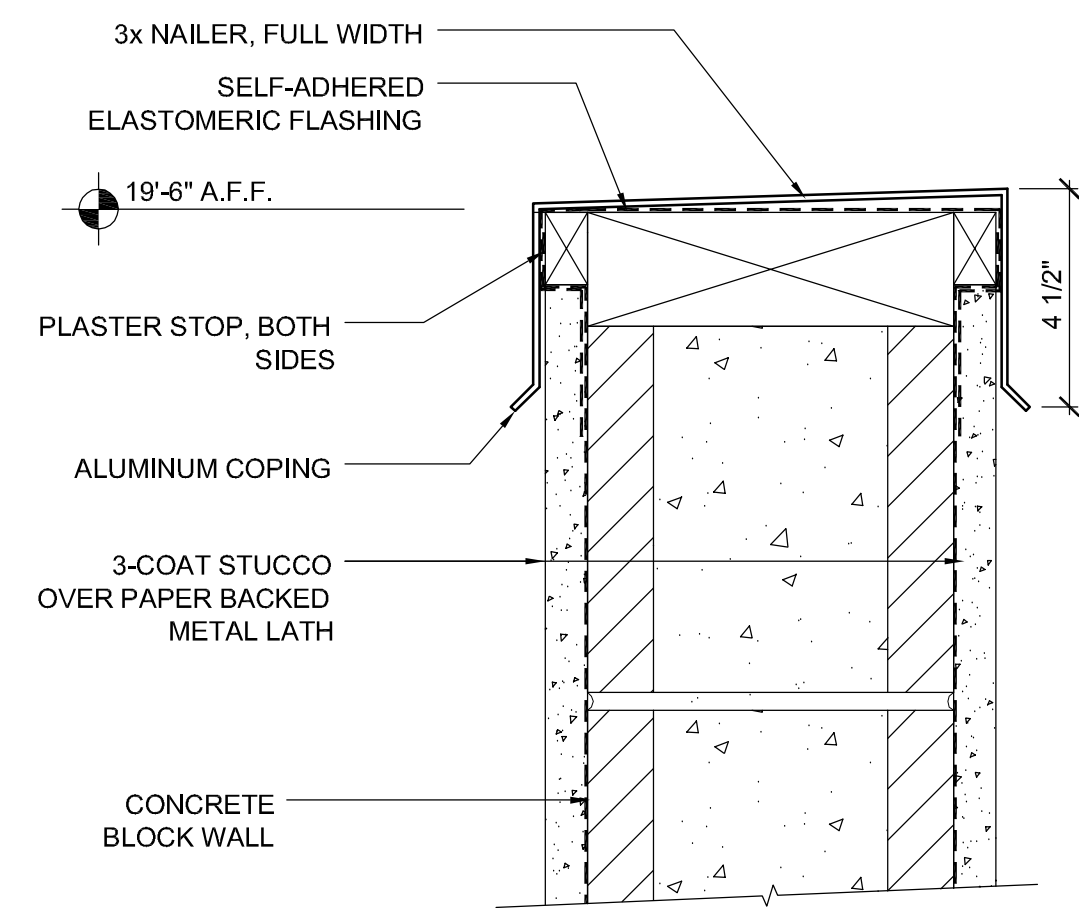


51 PARAPET COPING (CMU)
3"= 1'-0"

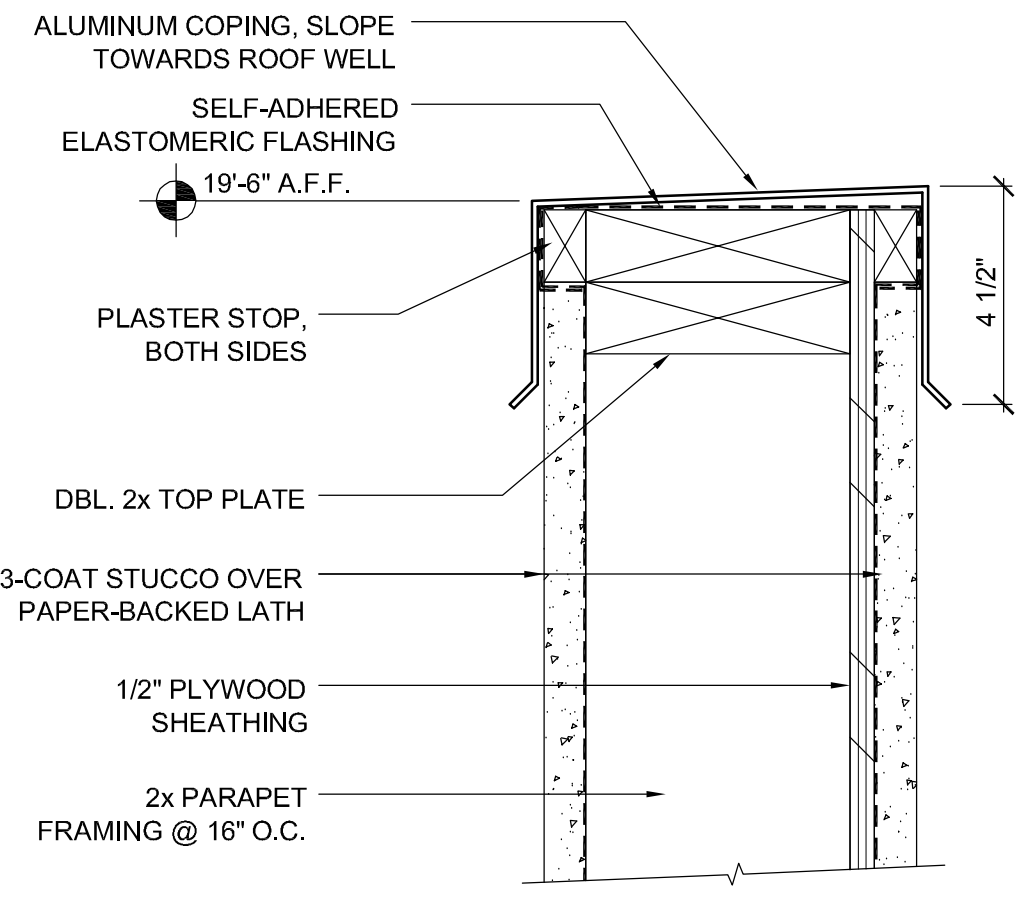


41 PARAPET COPING
3"= 1'-0"

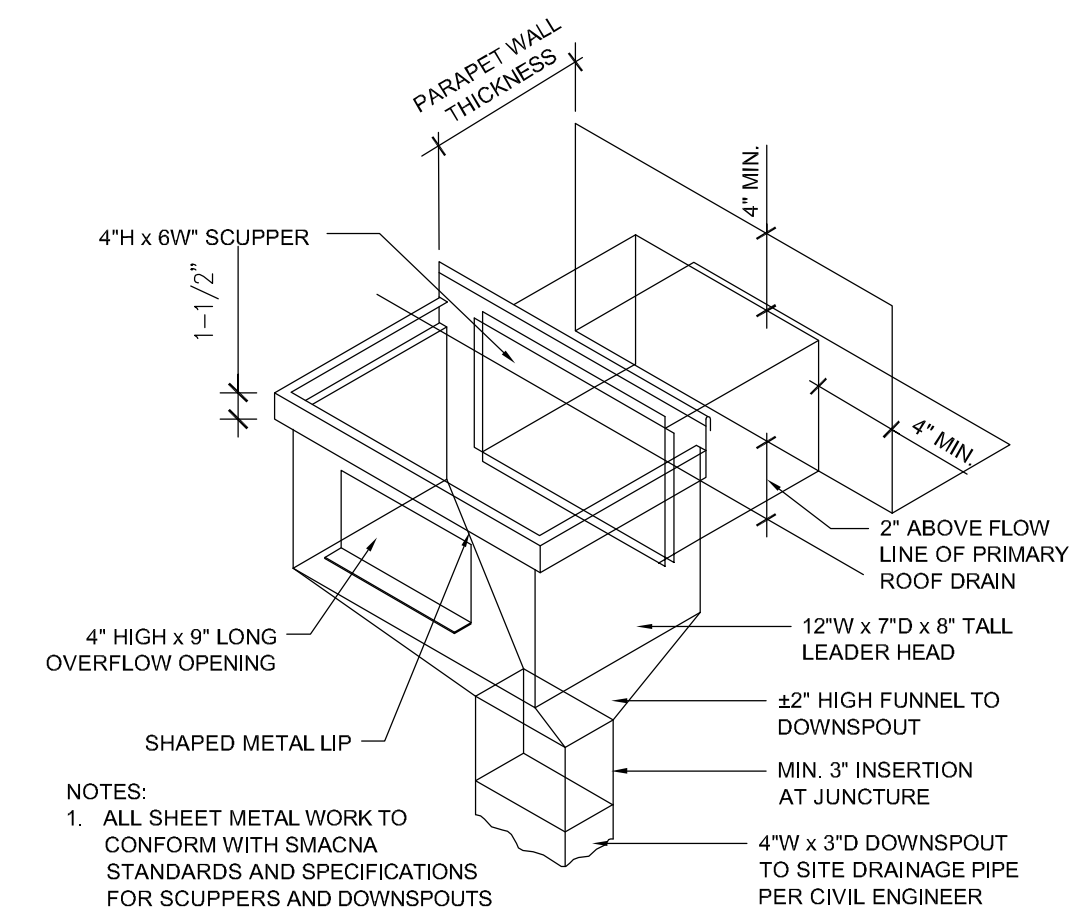


31 SCUPPER & LEADER HEAD
SCALE = NONE

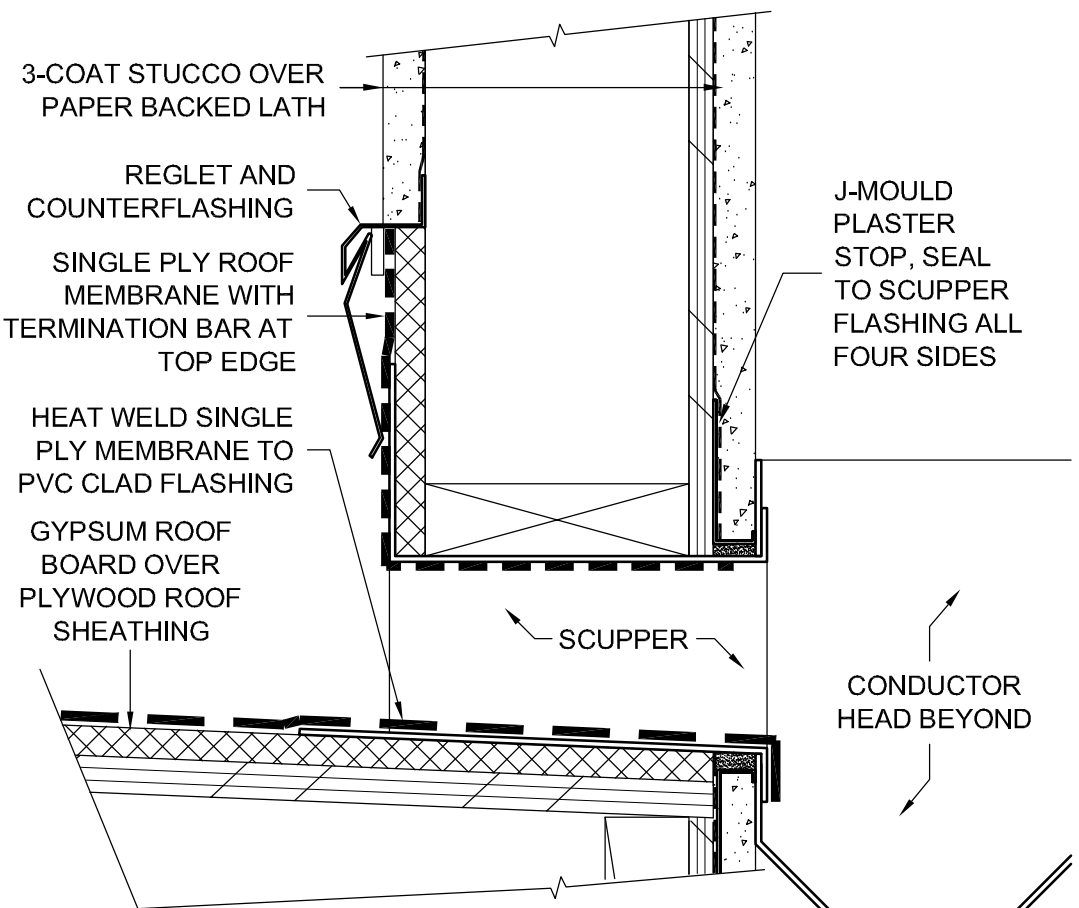


21 ROOF WELL HEAD WALL
3"= 1'-0"

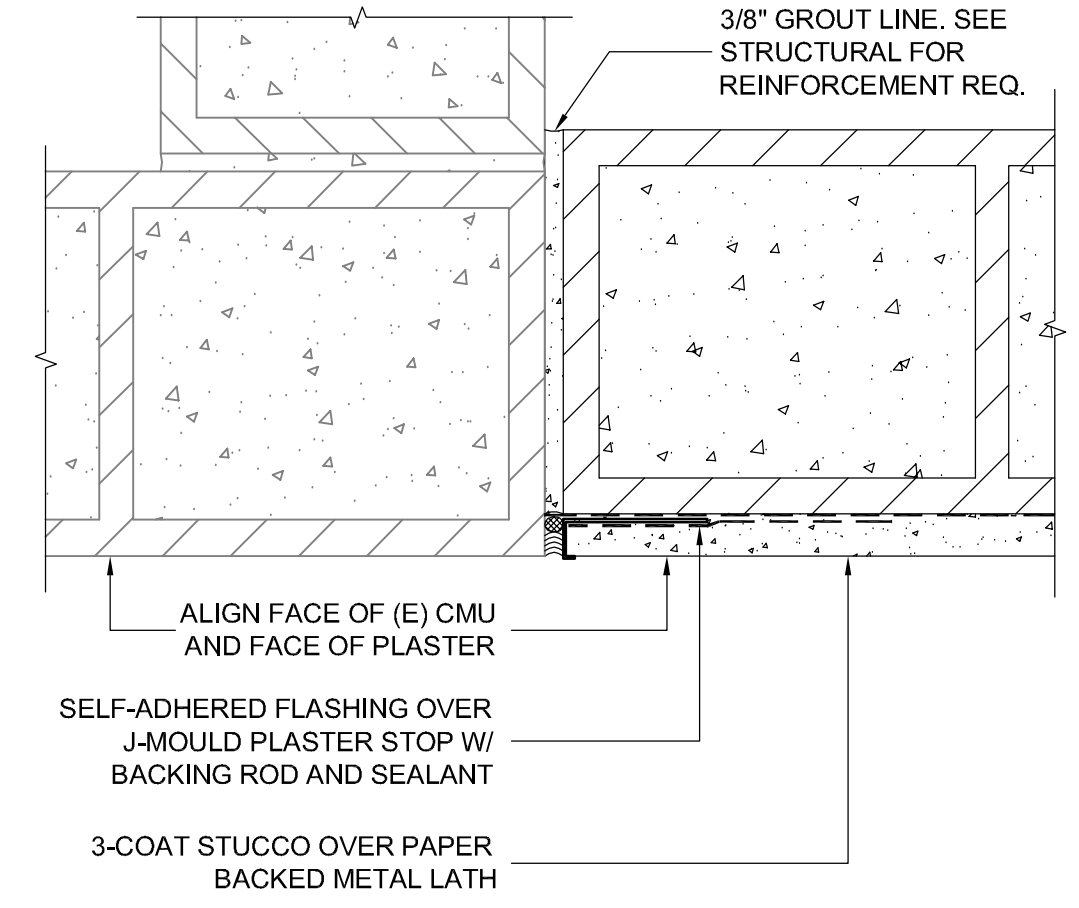


11 CMU ALIGNMENT TO (E)
3"= 1'-0"

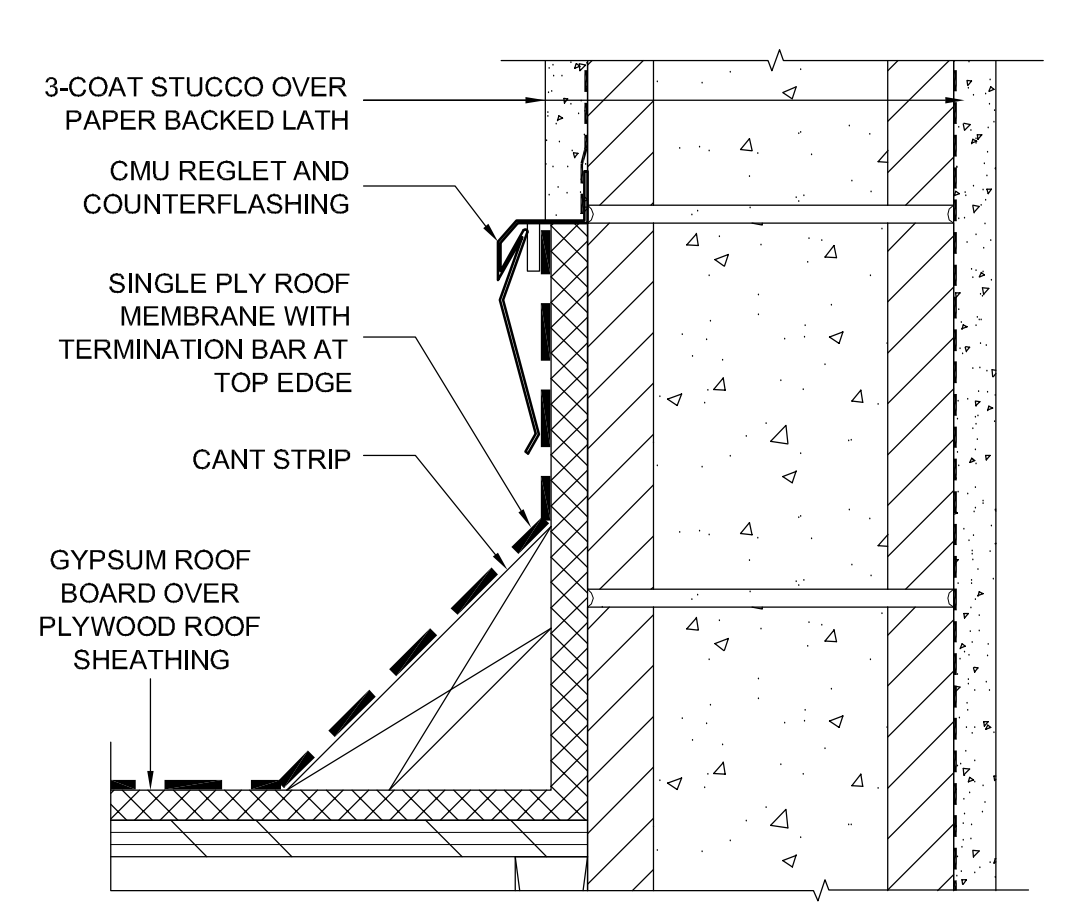


52 PARAPET COPING (CMU)
3"= 1'-0"

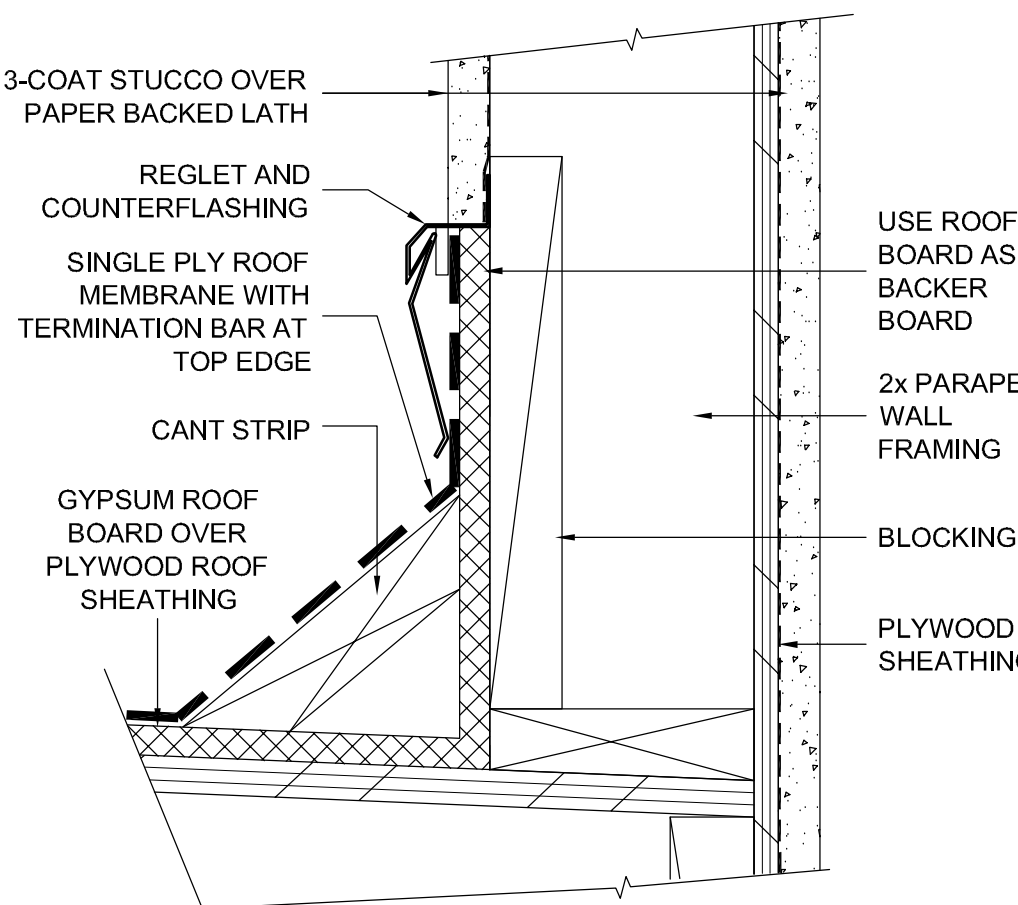


42 ROOF WELL HEAD WALL
3"= 1'-0"

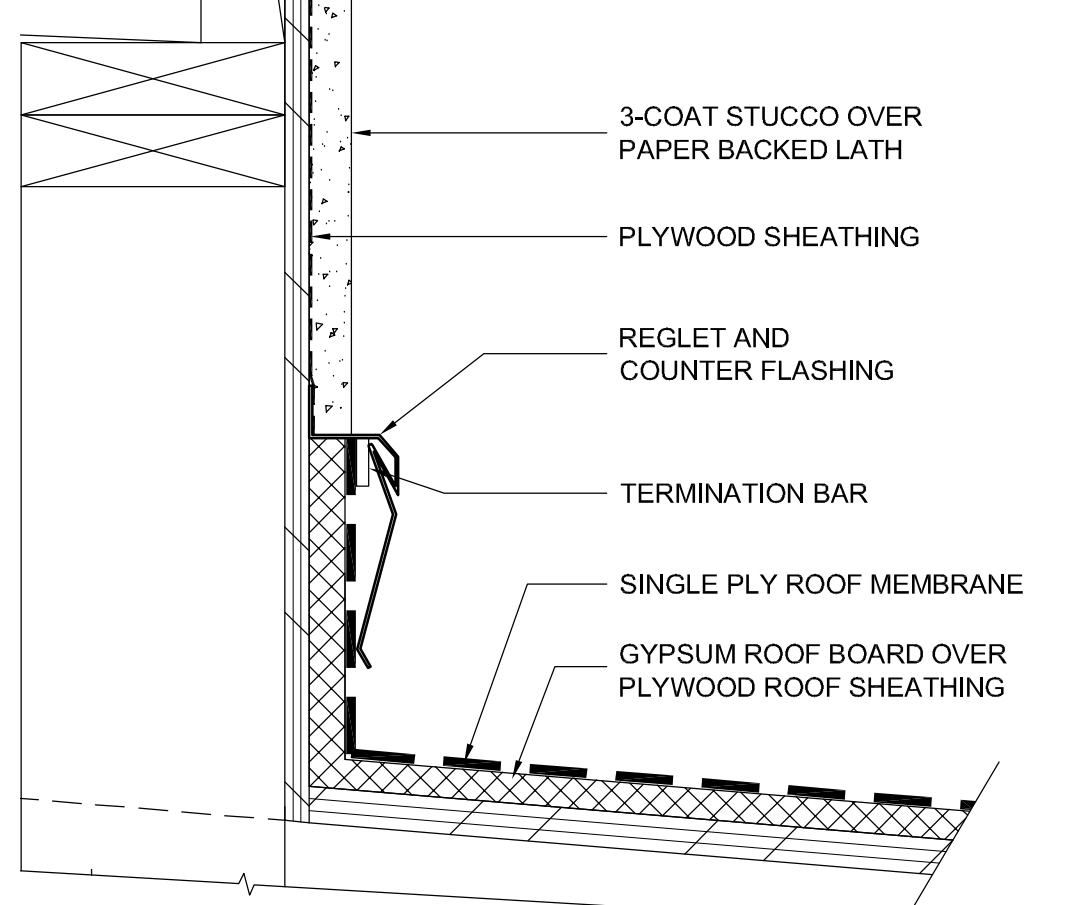


32 HEAD WALL
3"= 1'-0"

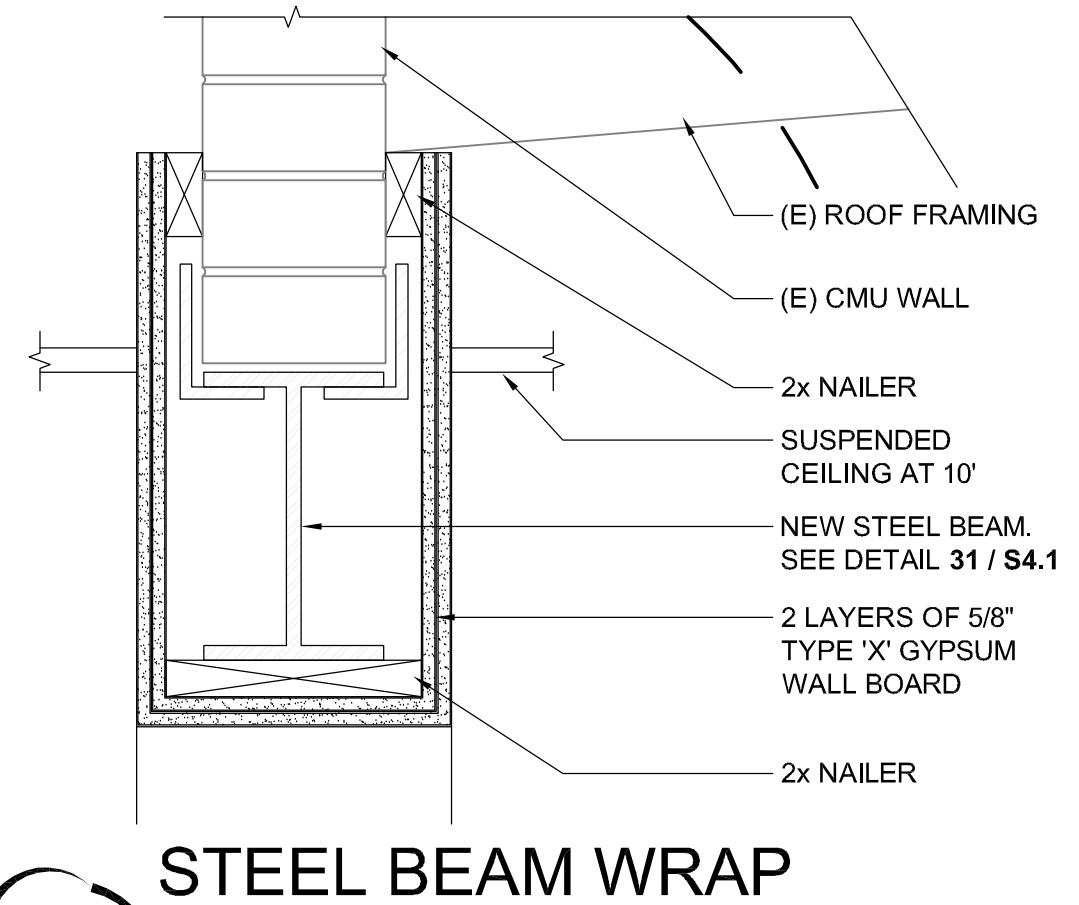


22 STEEL BEAM WRAP (NON-RATED)
1 1/2"= 1'-0"

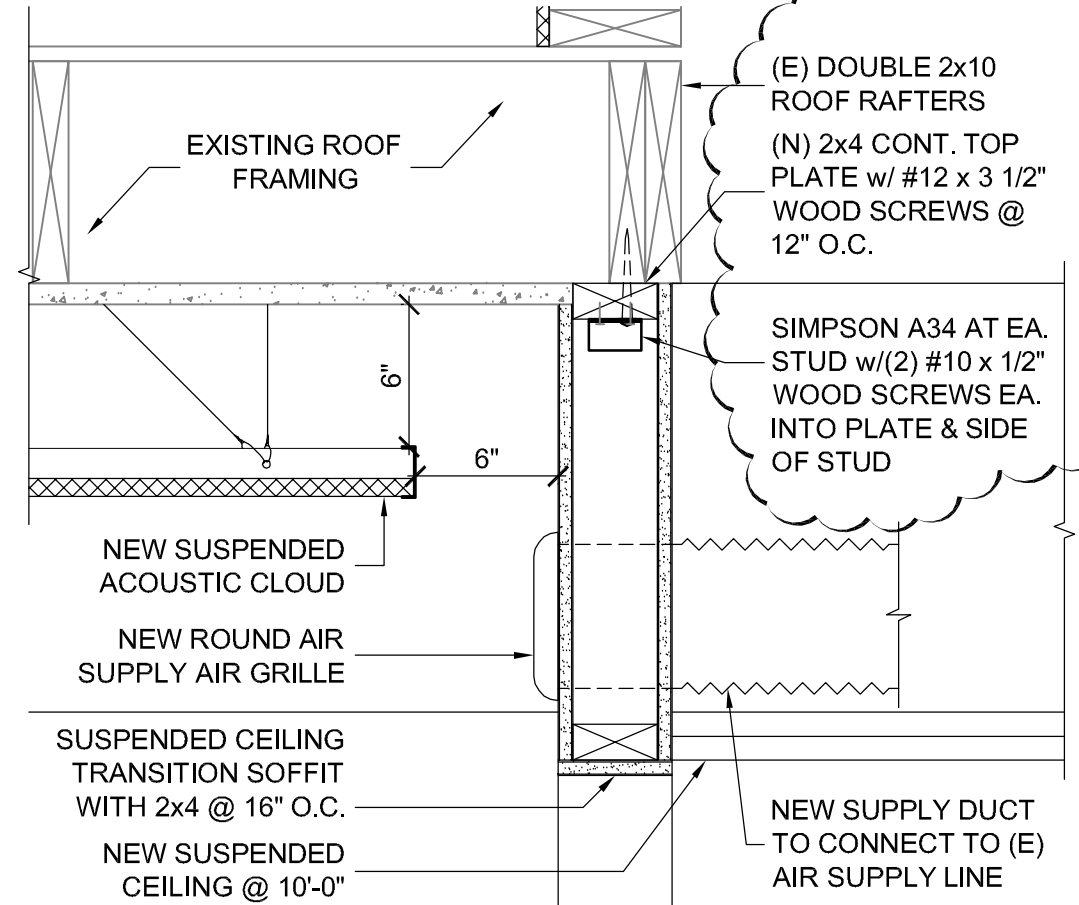


12 LOBBY CEILING TRANS.
1 1/2"= 1'-0"

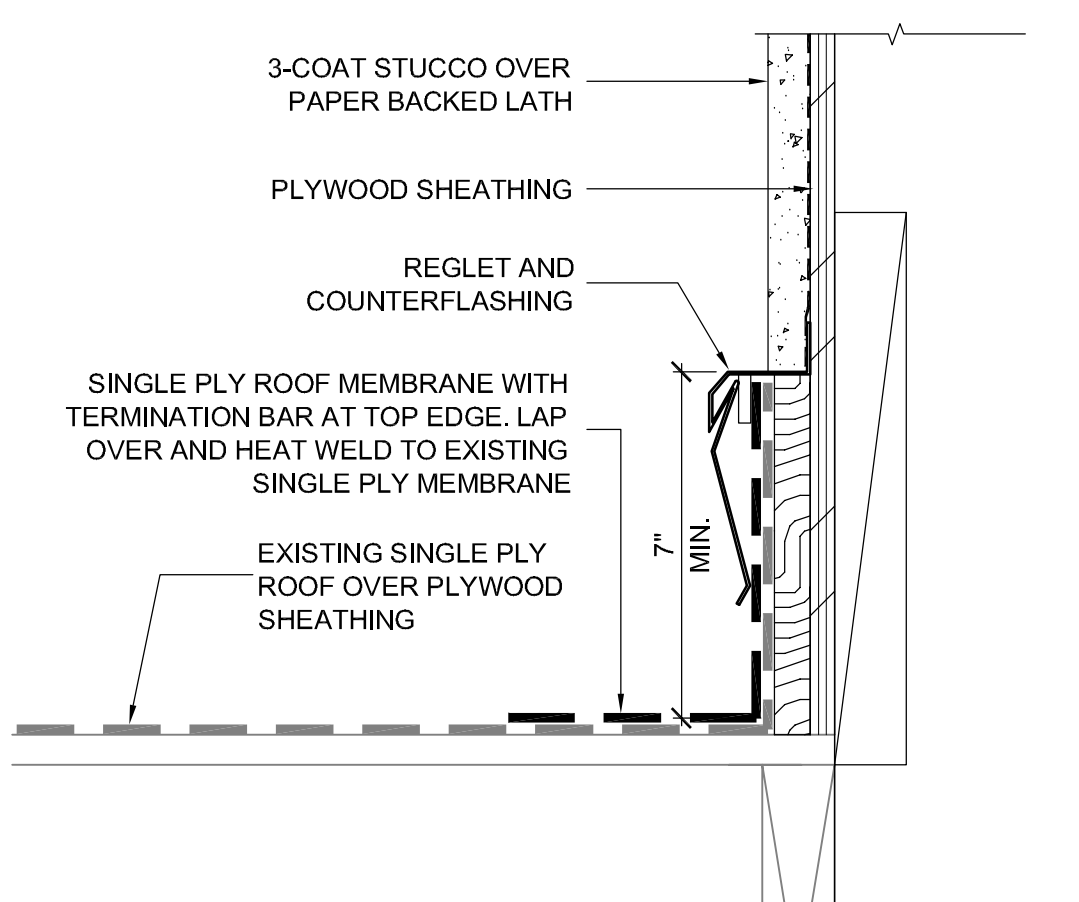


53 RAKE WALL AT EXISTING
3"= 1'-0"

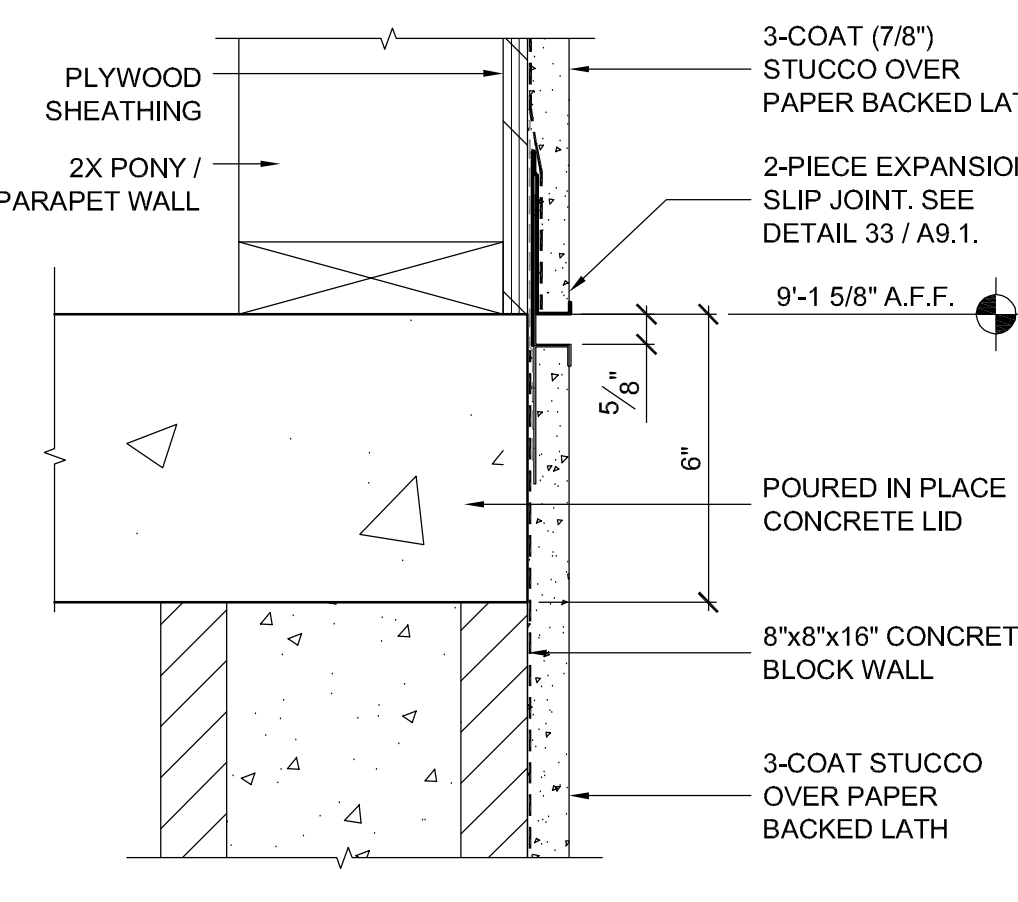


43 EXPANSION JOINT
3"= 1'-0"

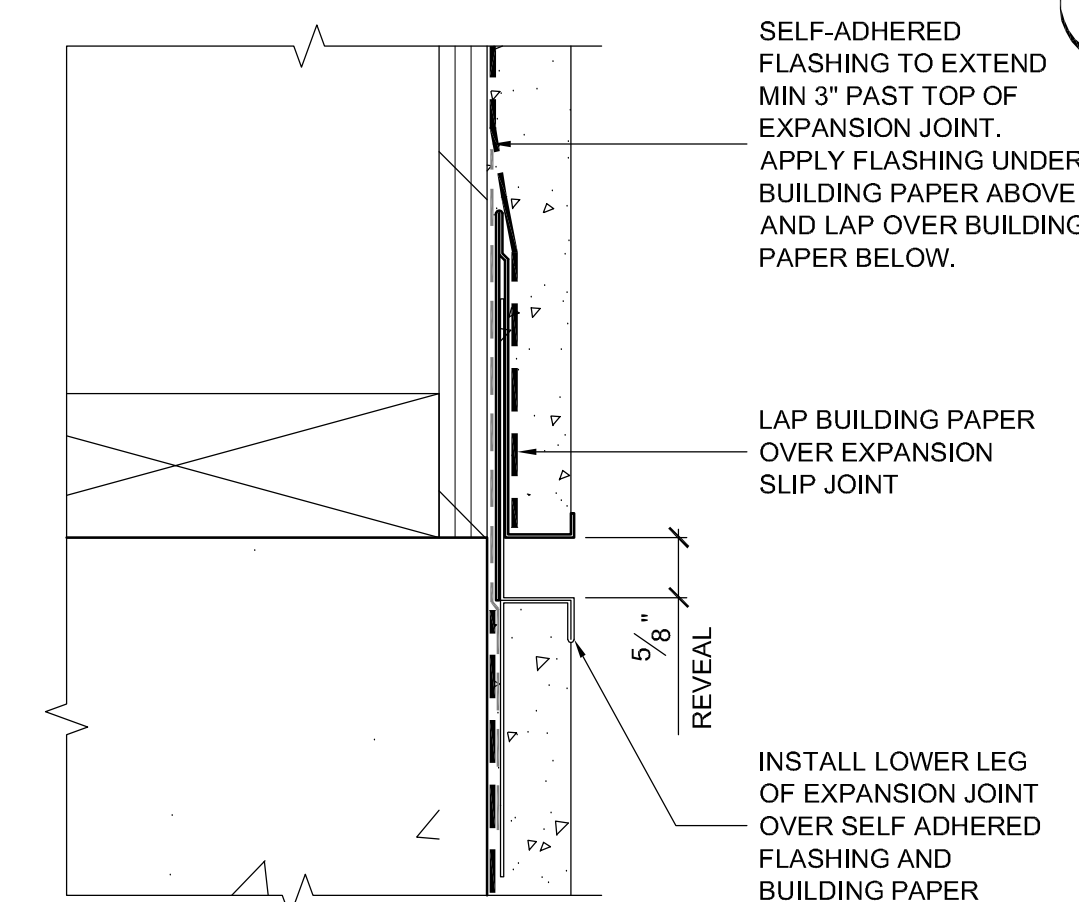


33 EXPANSION JOINT
6"= 1'-0"

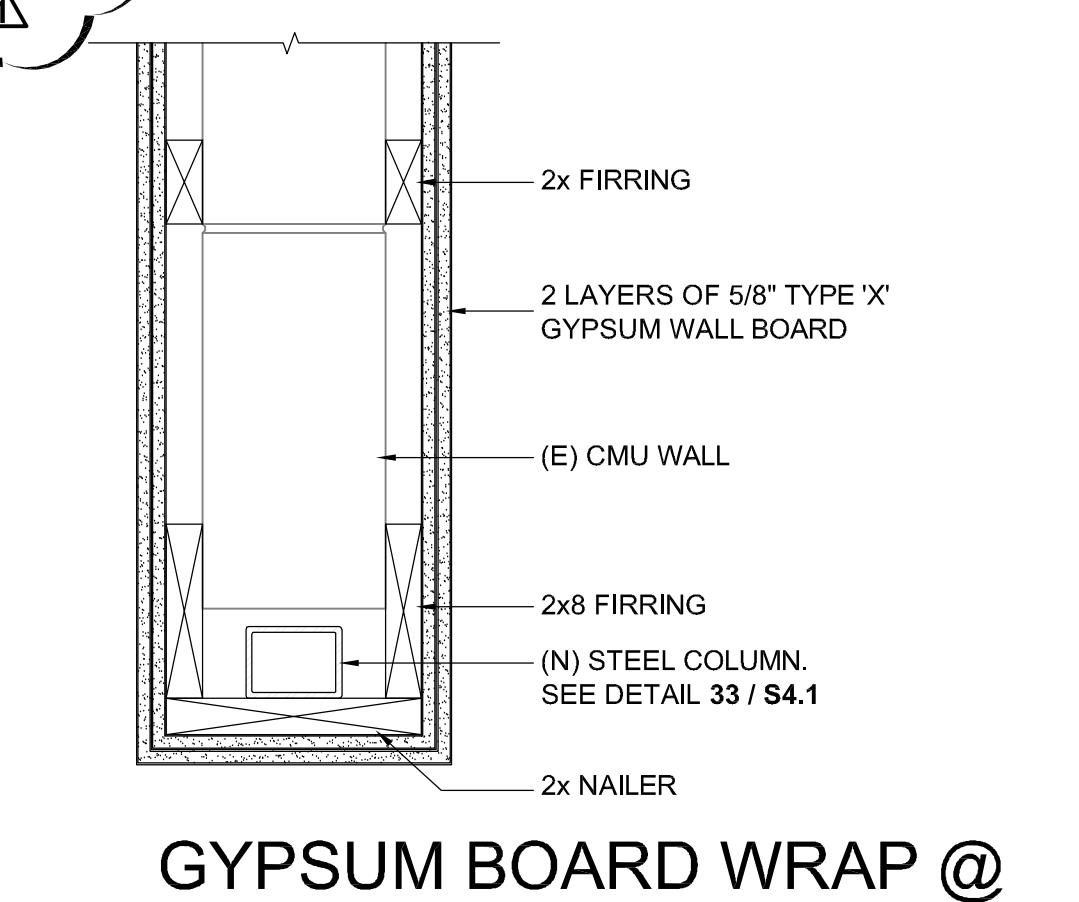


23 GYPSUM BOARD WRAP @ CMU JAMB (NON-RATED)
1 1/2"= 1'-0"

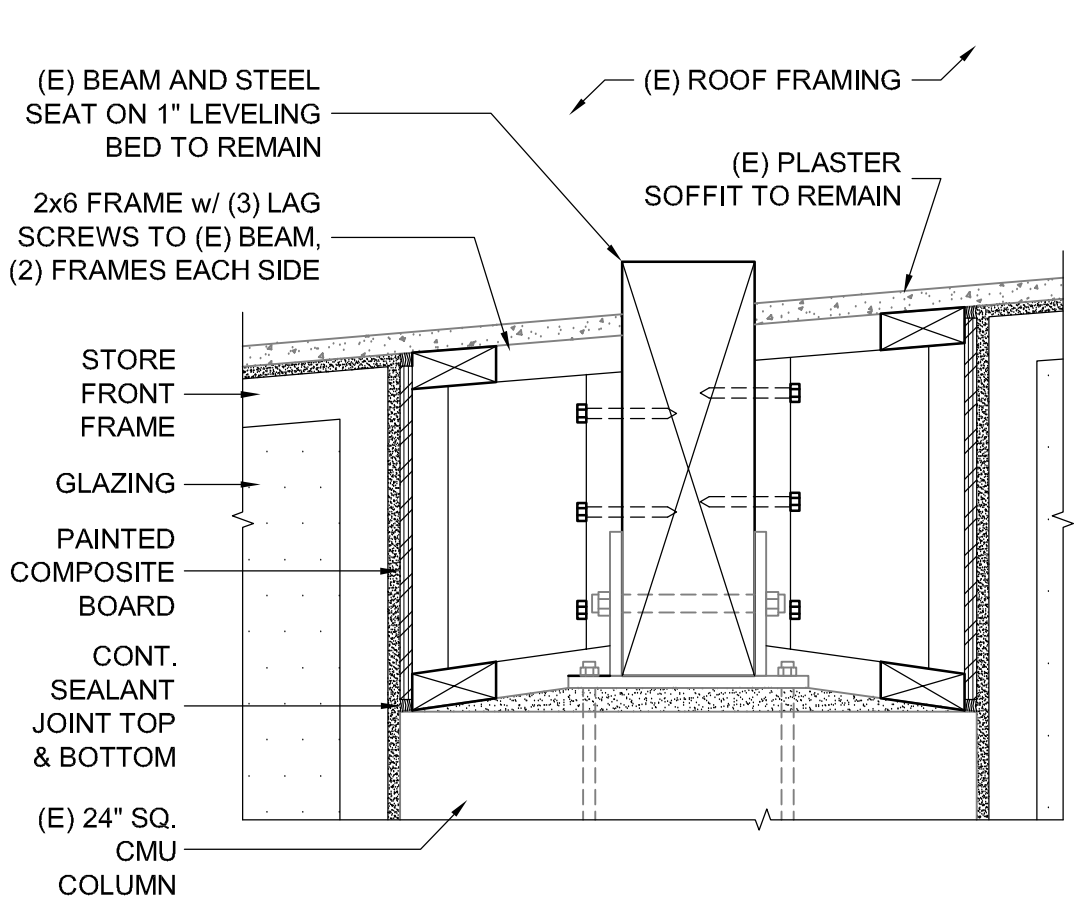


13 INFILL AT GLU-LAM BEAMS
1 1/2"= 1'-0"

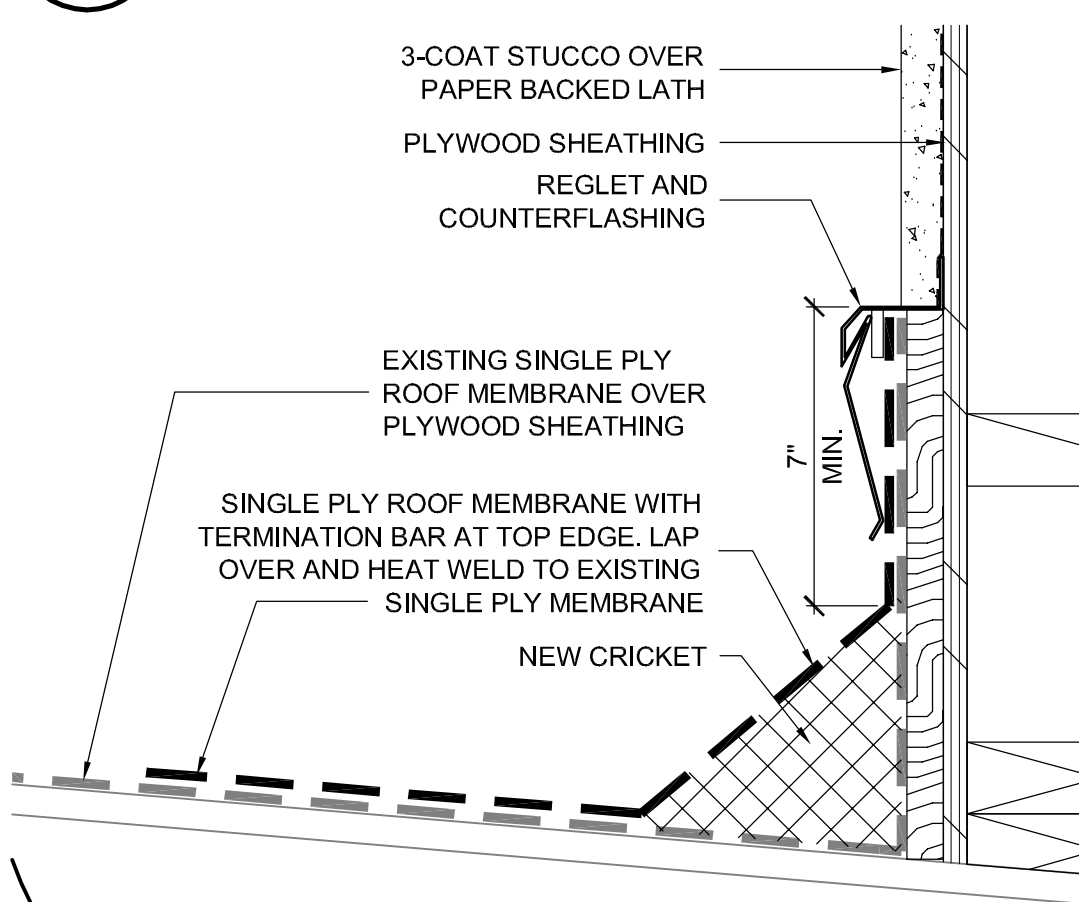


54 ROOF CRICKET
3"= 1'-0"

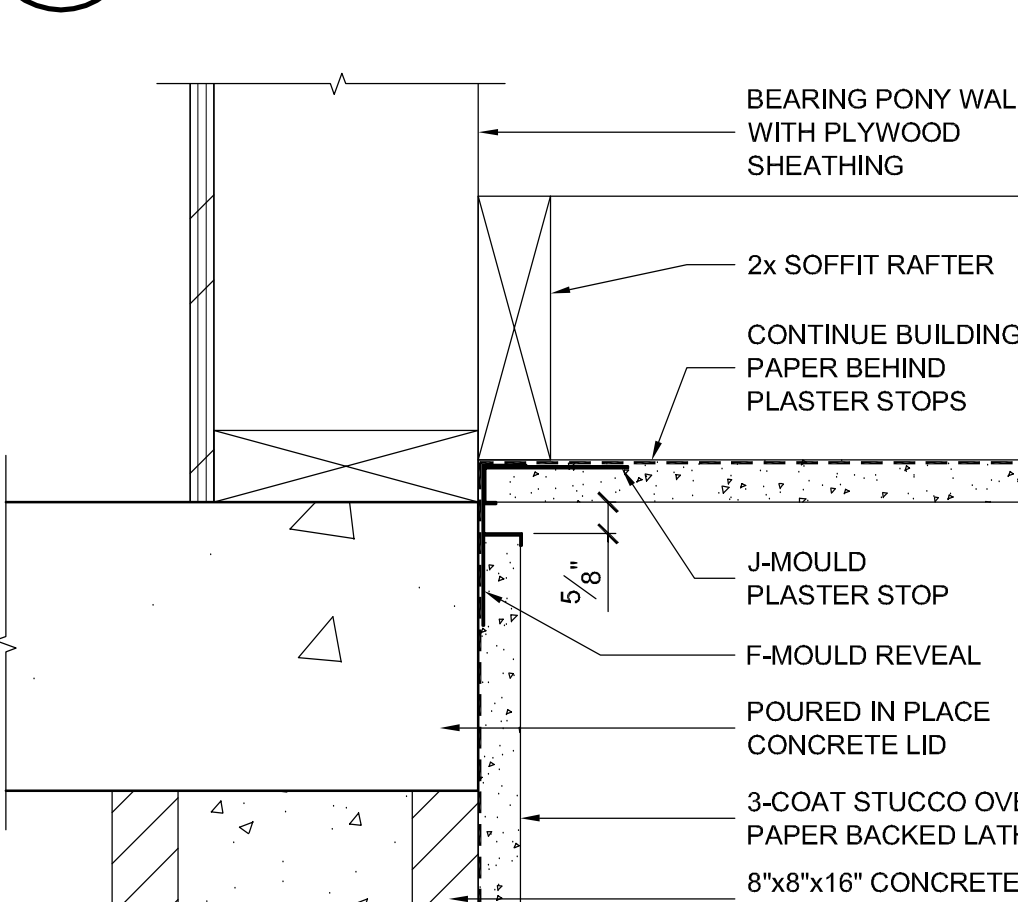


44 SOFFIT AT WALL
3"= 1'-0"

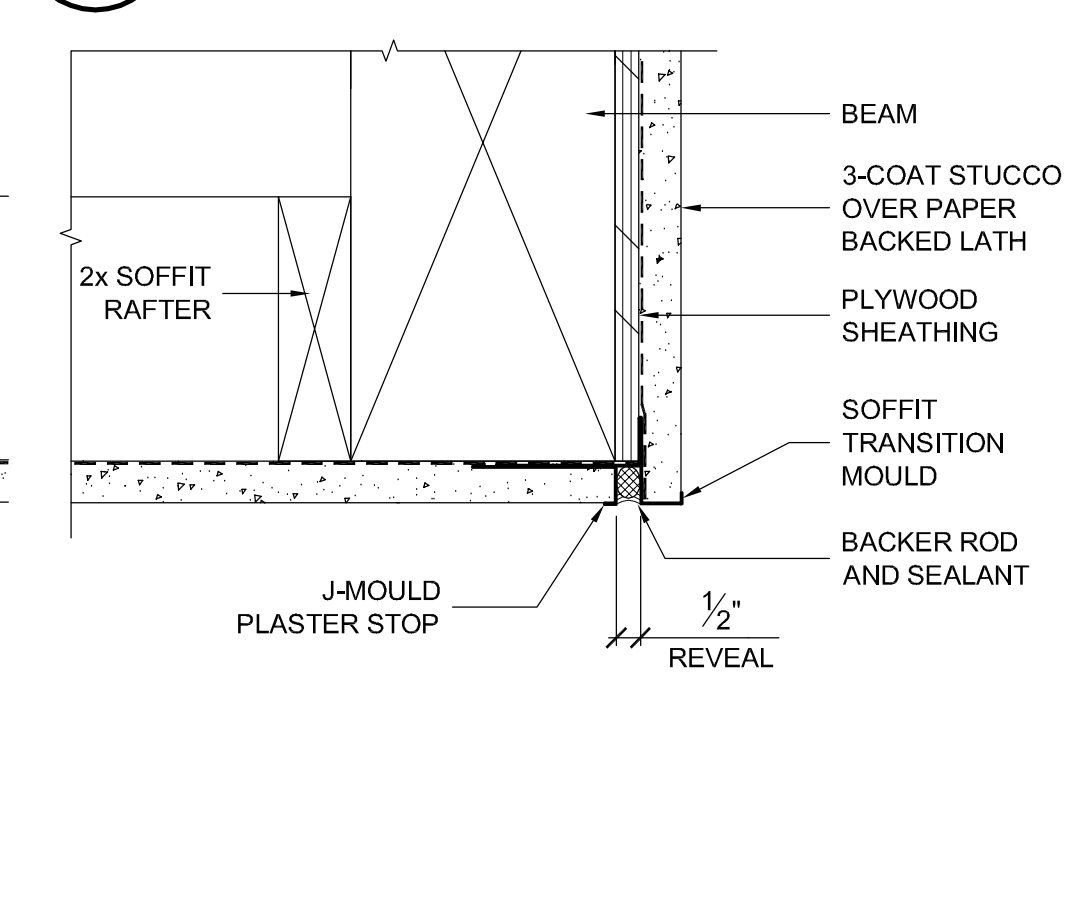

34 SOFFIT EDGE
3"= 1'-0"

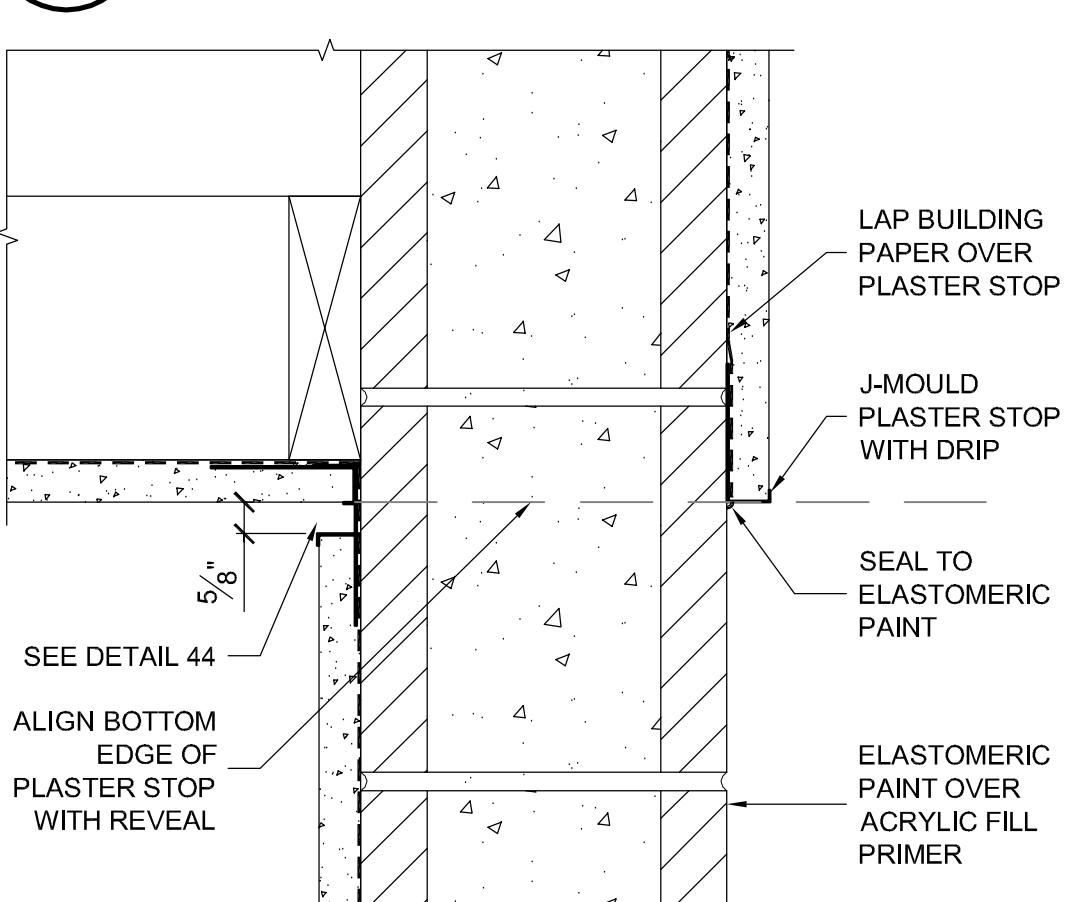

24 SOFFIT EDGE
3"= 1'-0"

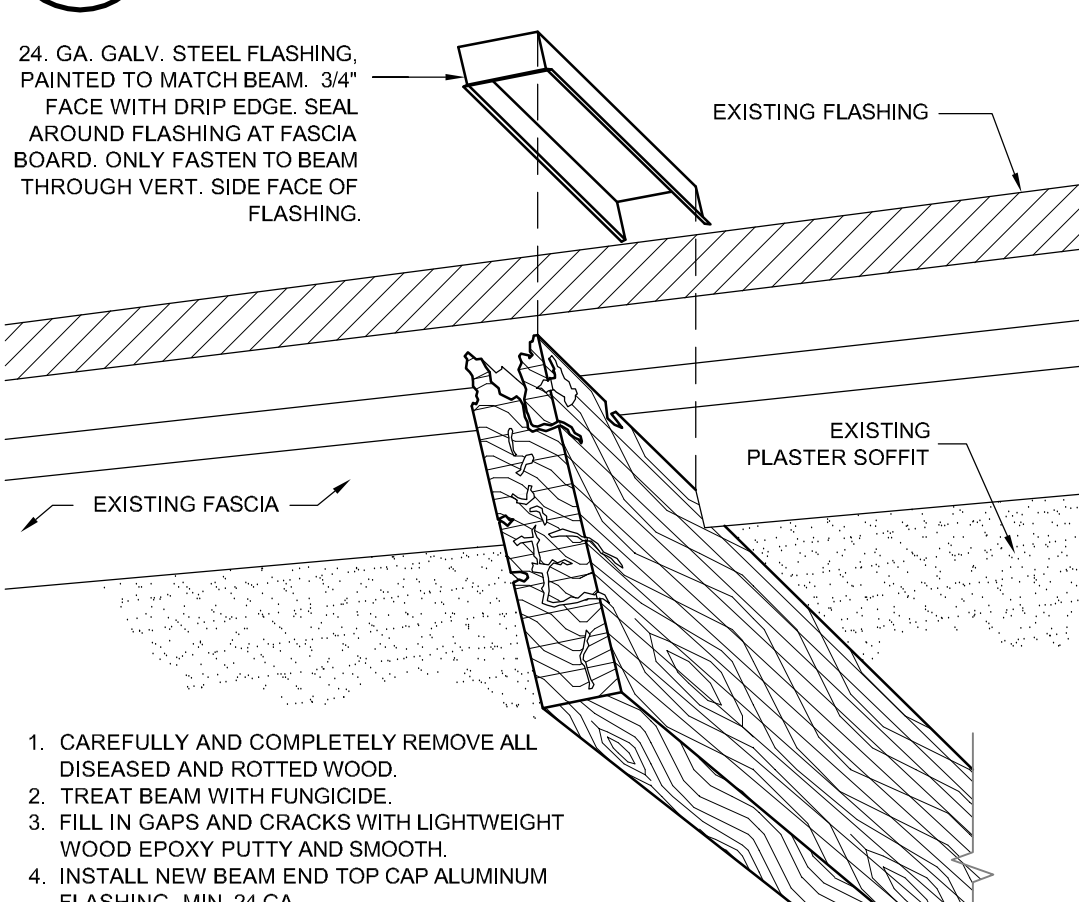

14 GLU-LAM REPAIR
N.T.S.

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

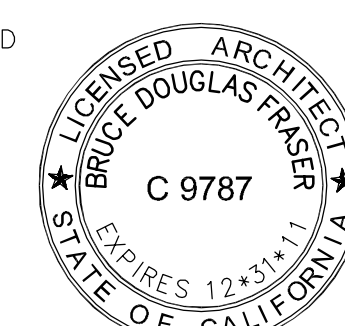

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.


SHEET TITLE

**ARCHITECTURAL
DETAILS**


SHEET #

A9.1

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\A9.1 - Phase 1 Architectural Details.dwg, 6/20/2011 2:05:08 PM, PDF995

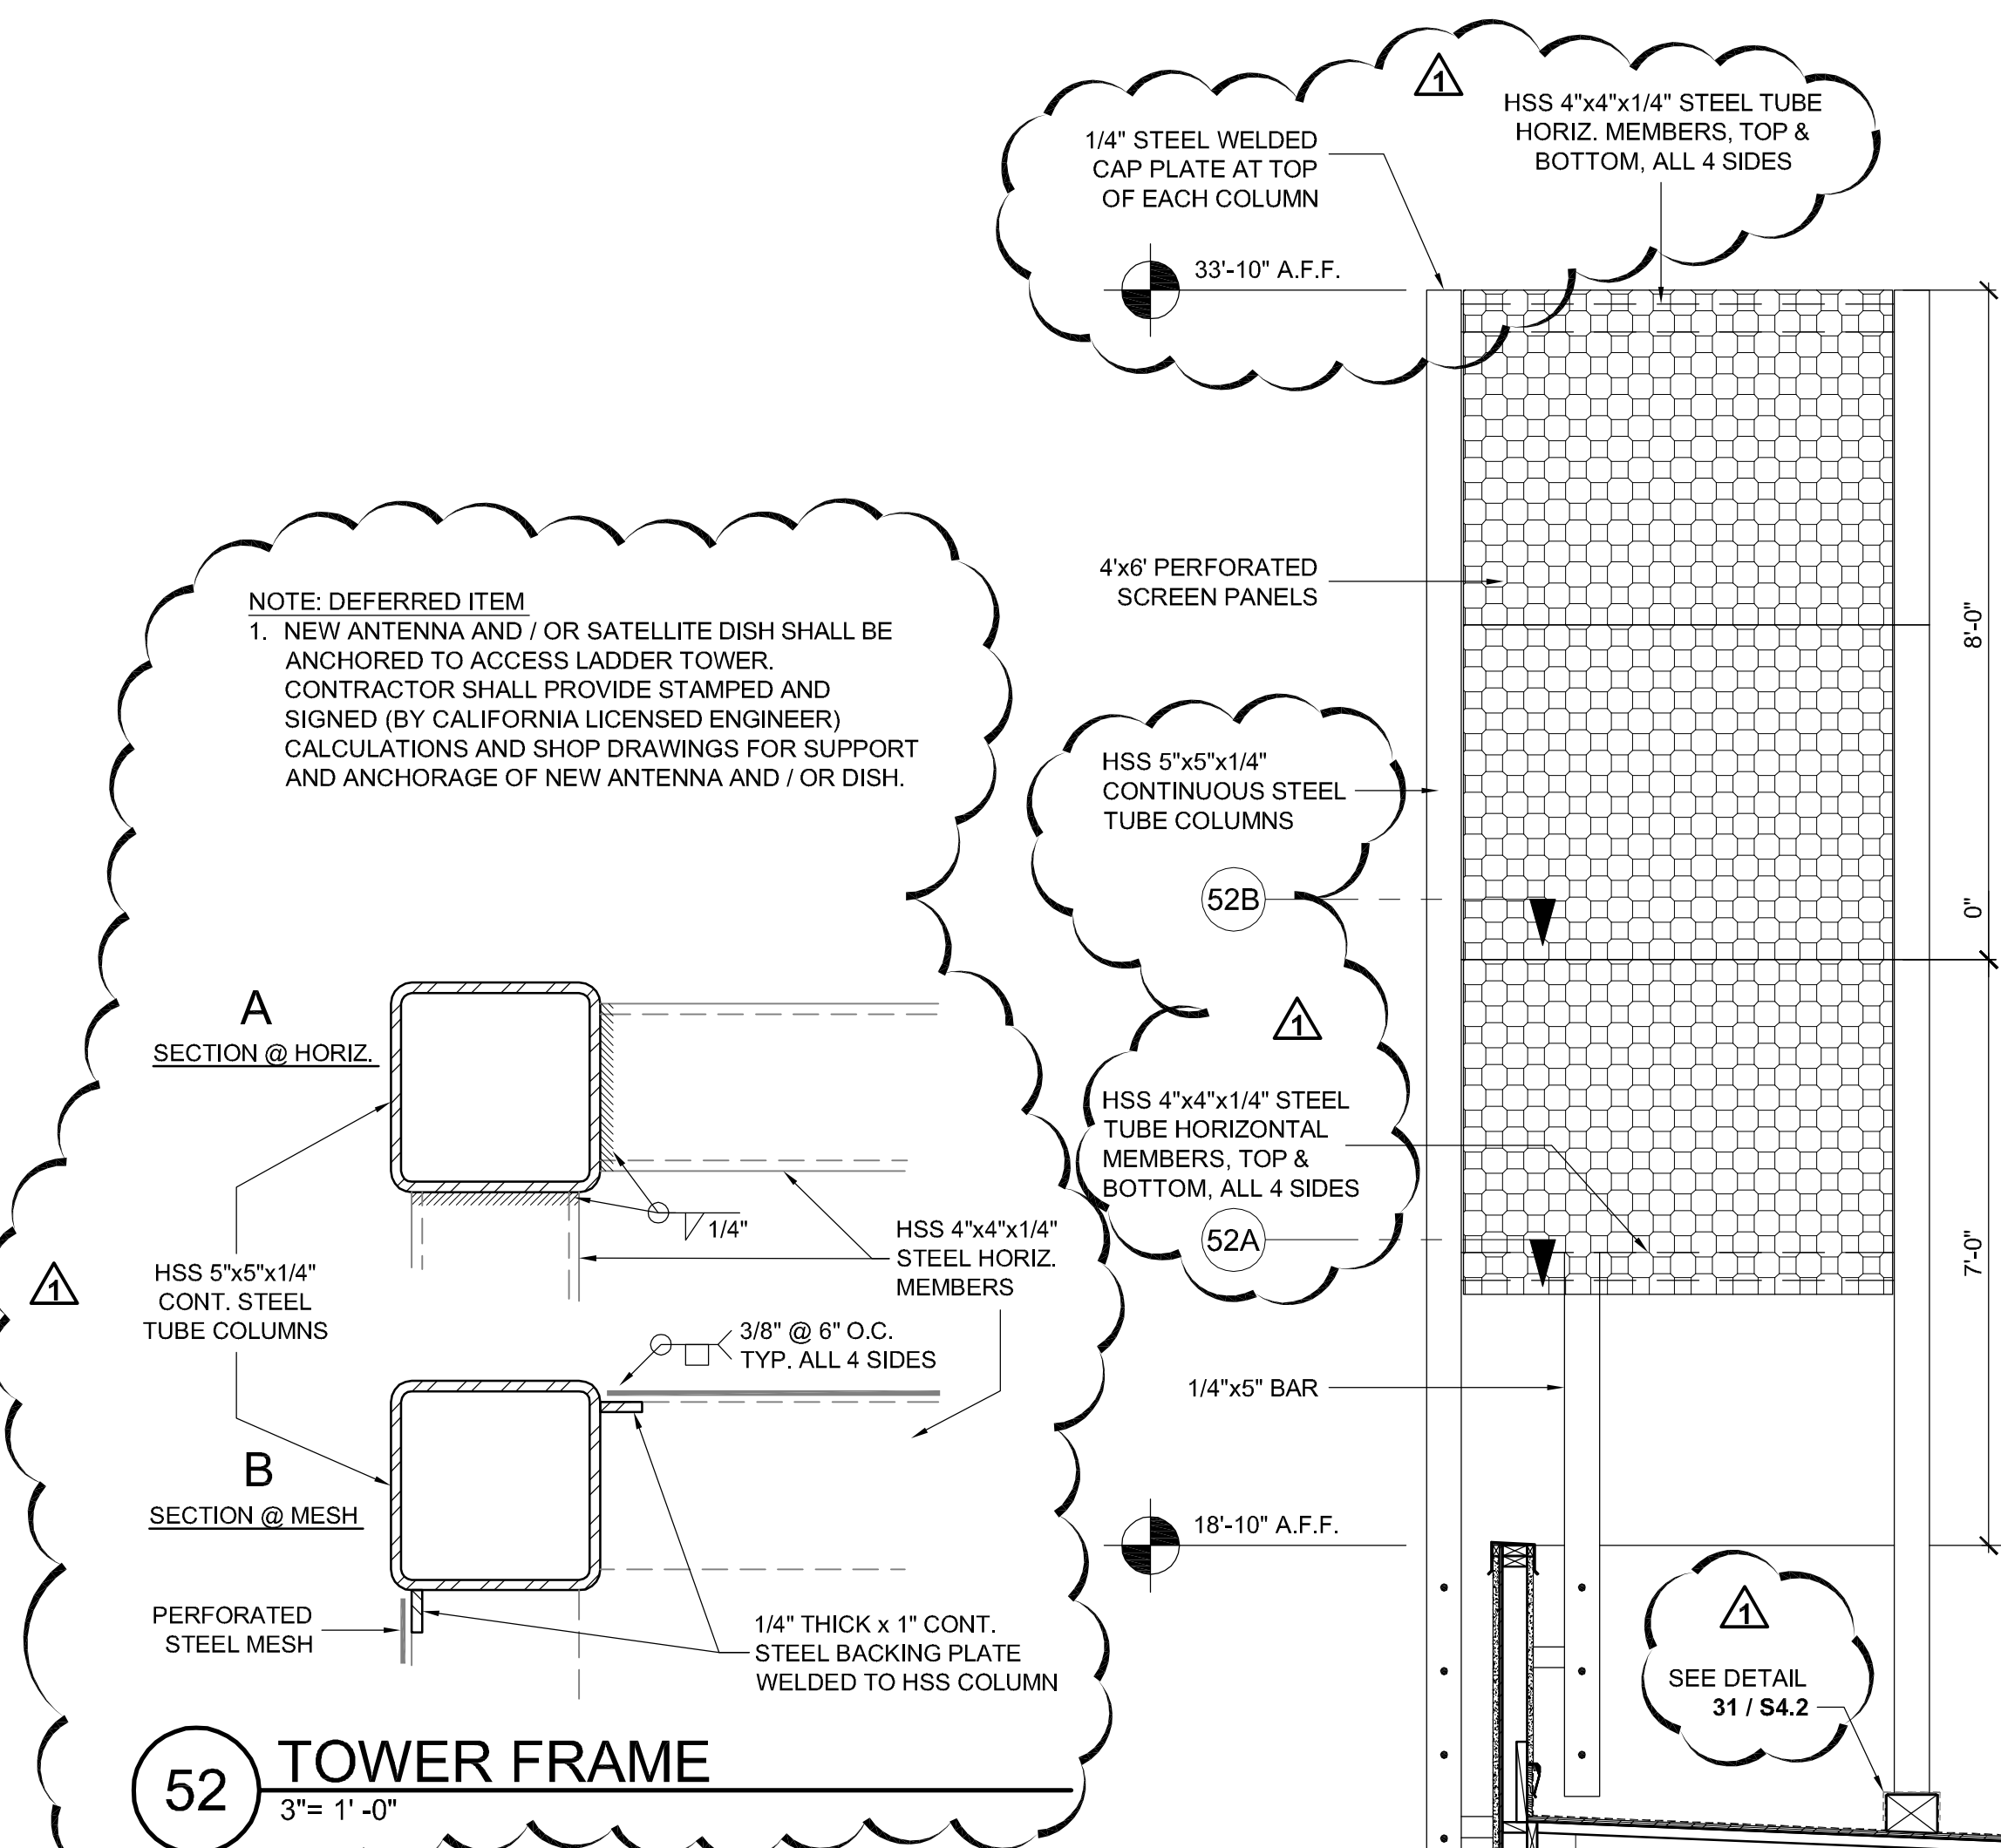


53 ANGLE BRACKETS
3"= 1'-0"

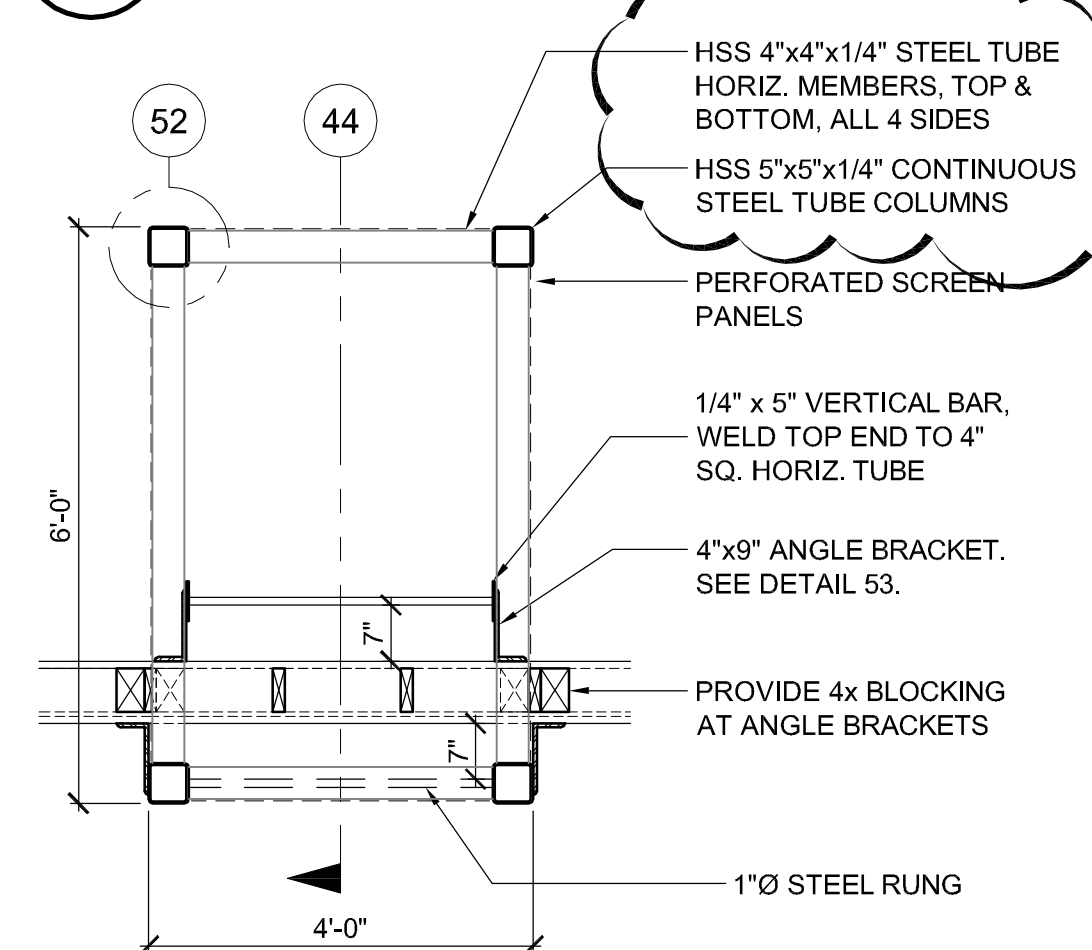


54 ACCESS LADDER PLAN
1/2"= 1'-0"



44 ACCESS LADDER TOWER SECTION
1/2"= 1'-0"

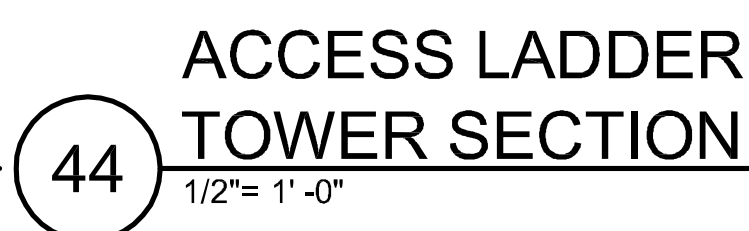


33 SUN CONTROL DEVICE
3"= 1'-0"

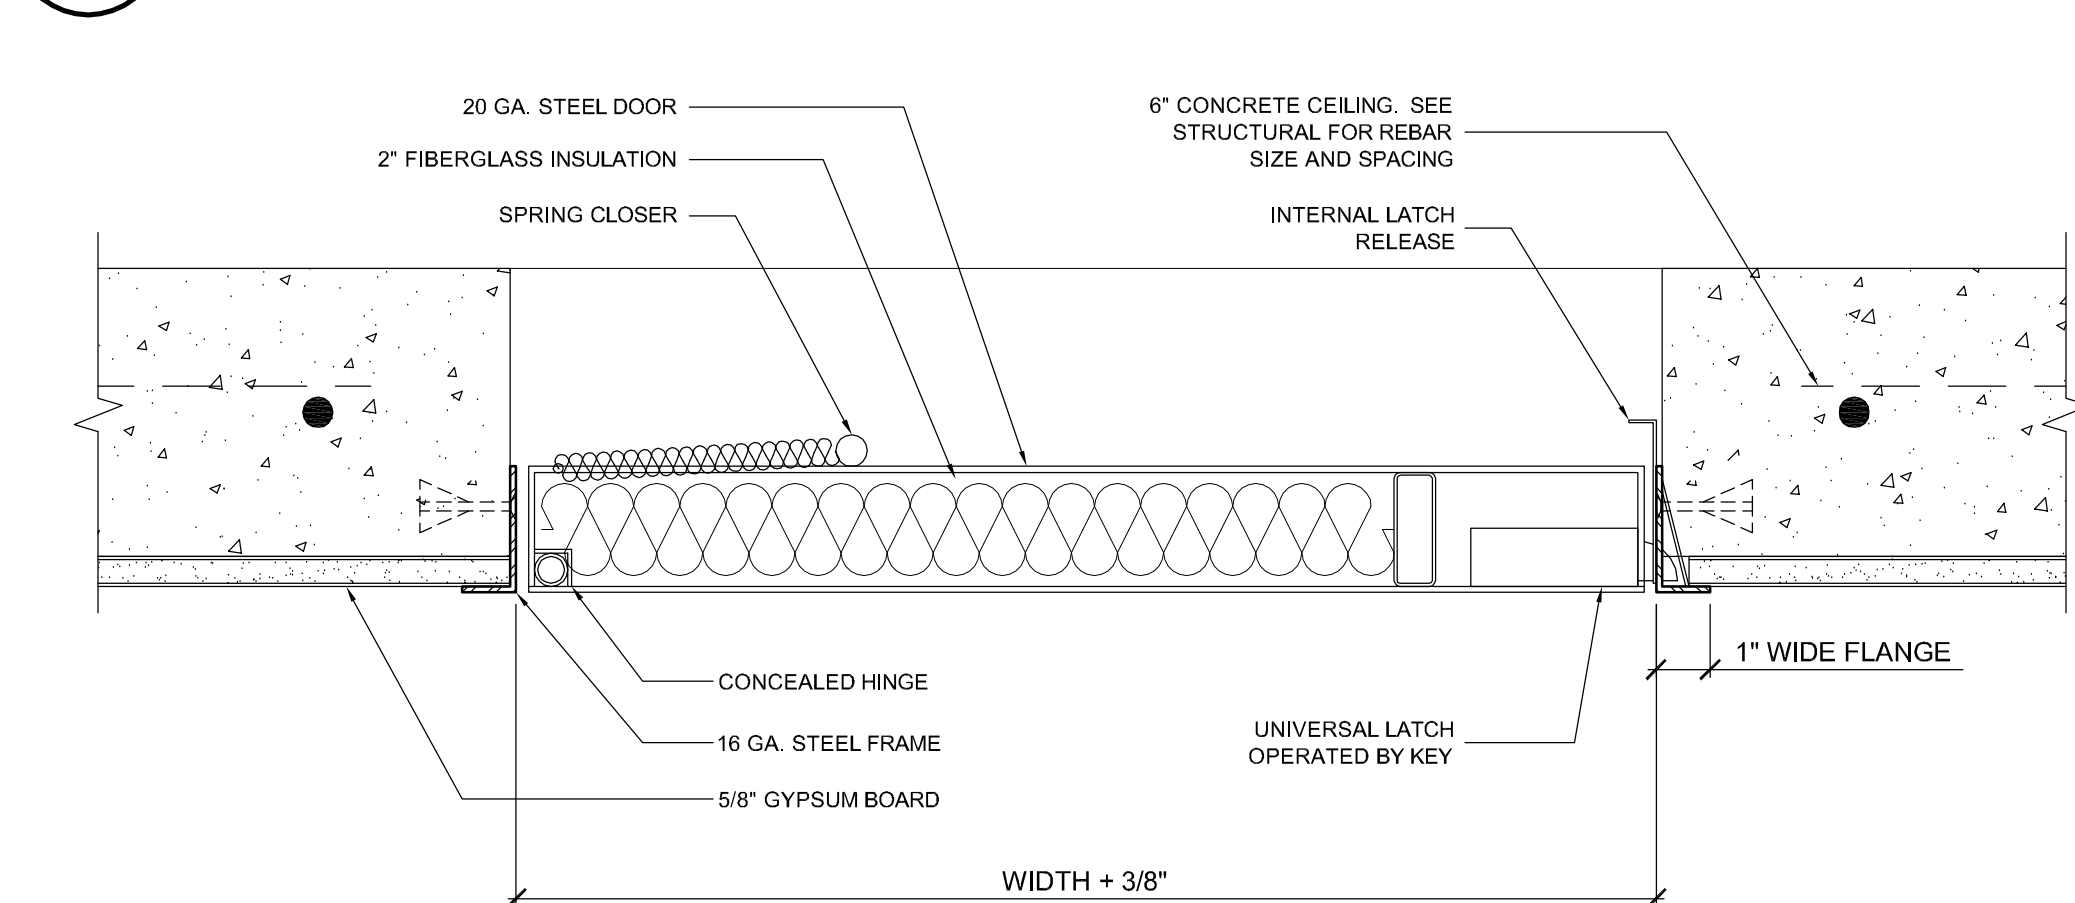

34 ATTIC ACCESS DOOR (3-Hour Rated Warnock Hersey International FW-5050)
3"= 1'-0"

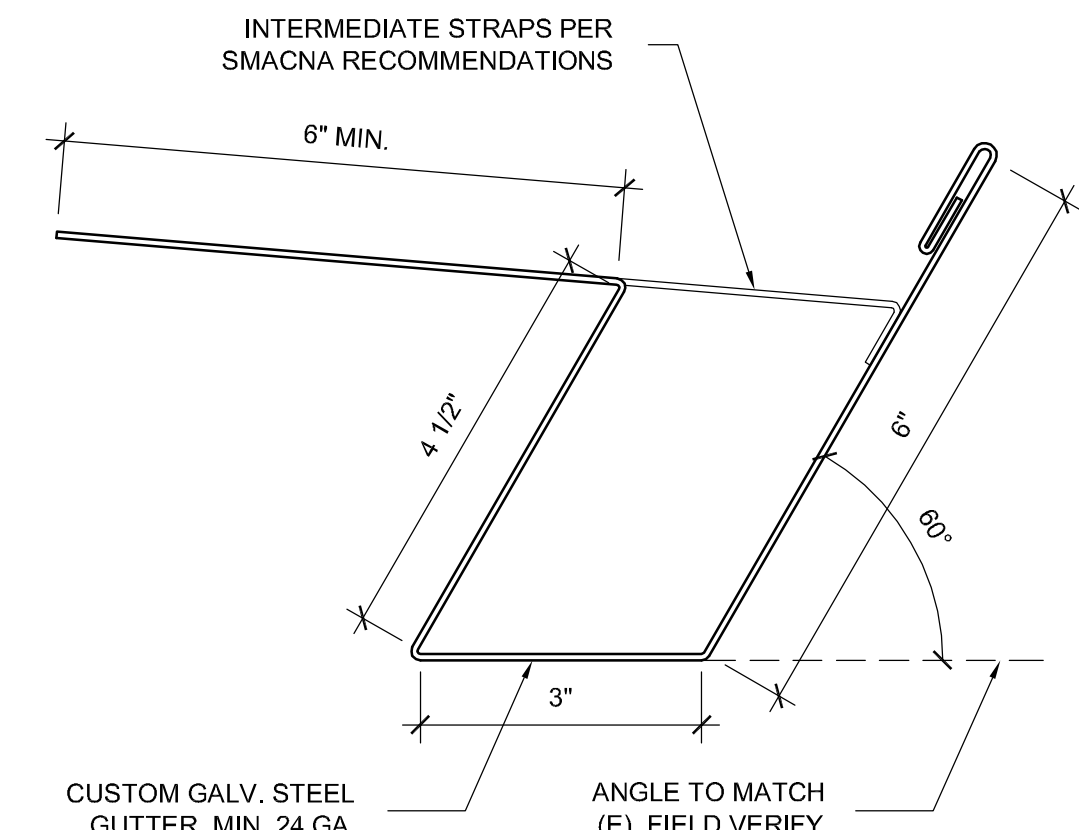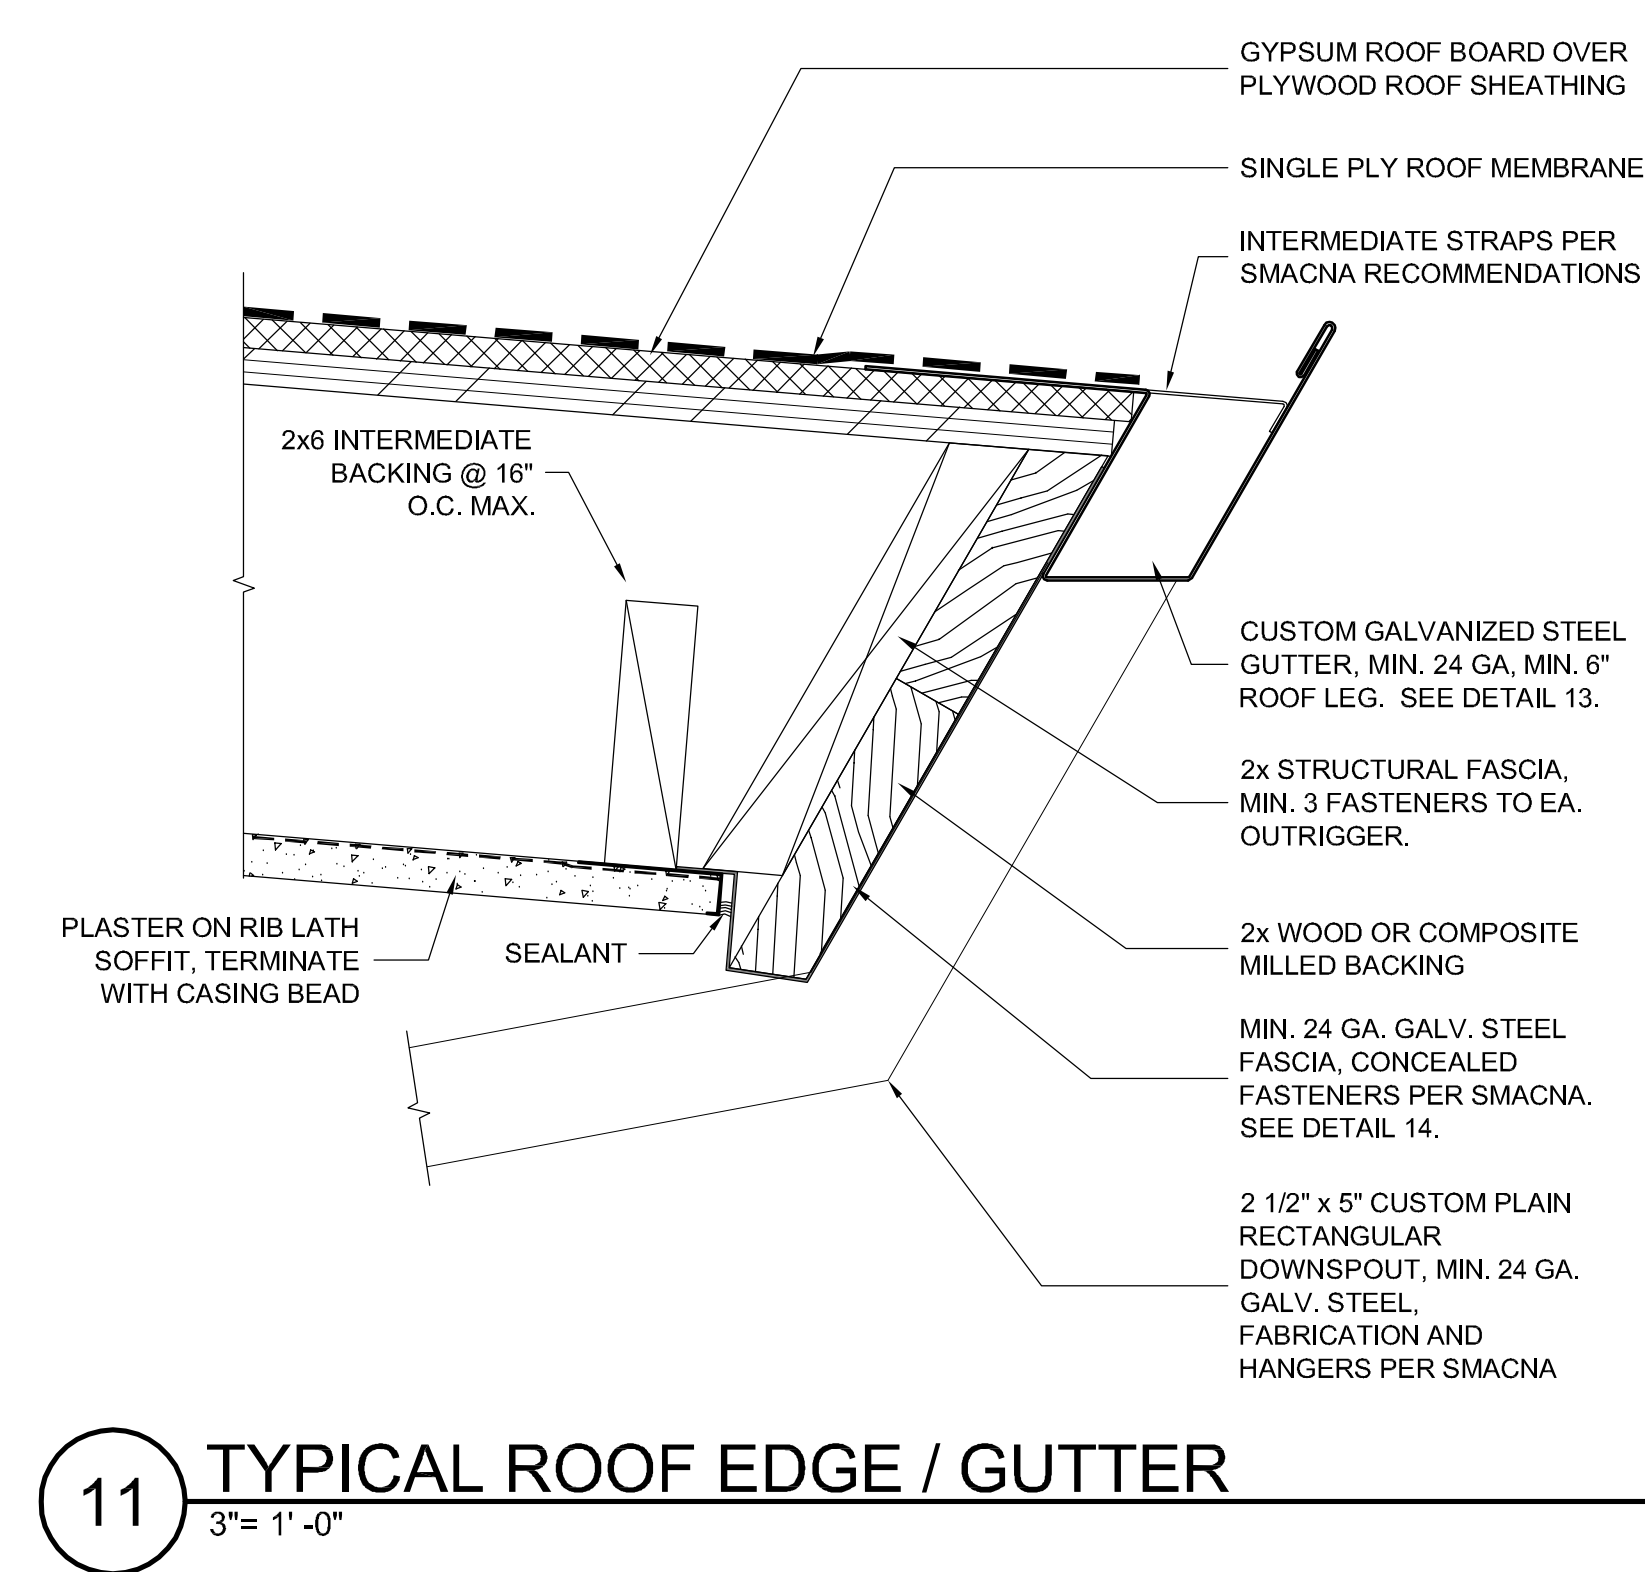

13 TYPICAL GUTTER
6"= 1'-0"

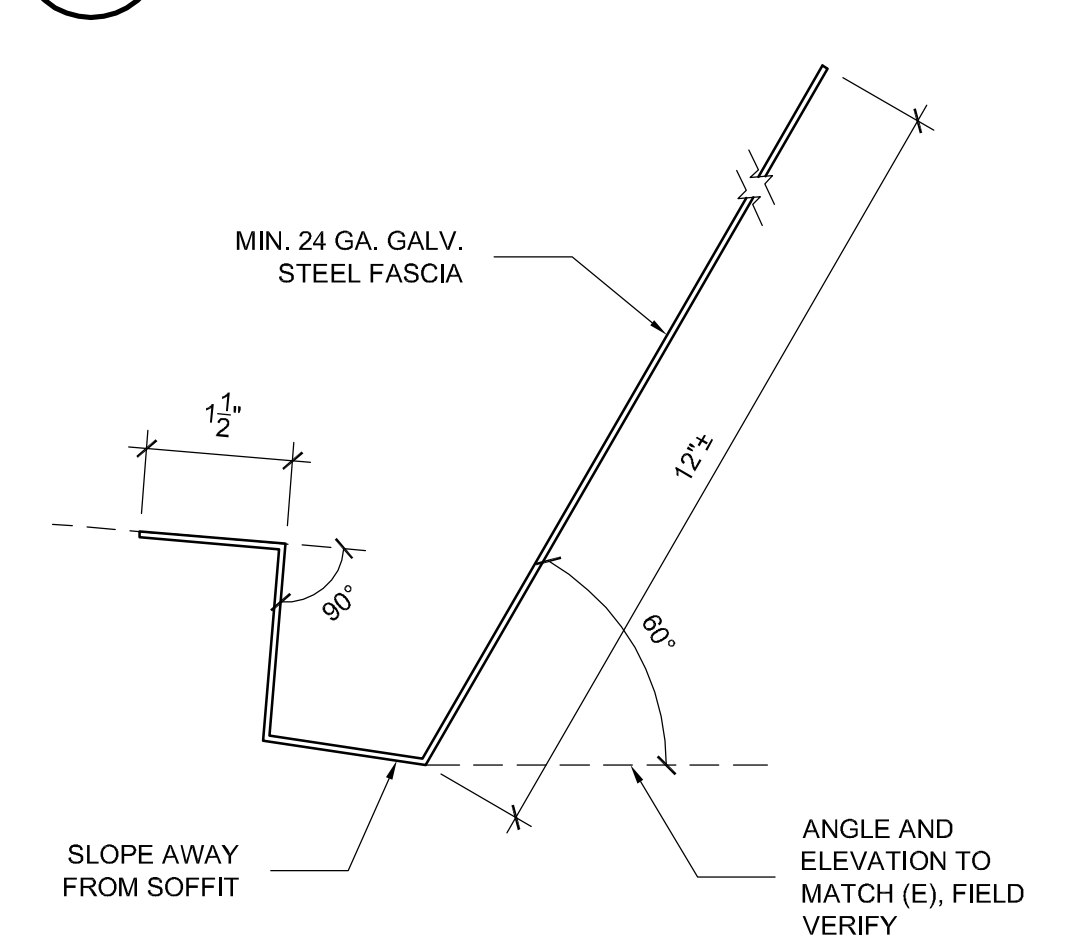

14 TYPICAL FASCIA
6"= 1'-0"

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

FRASER SEIPLE ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

BRUCE DOUGLAS FRASER
C 9787
EXPIRES 12/31/11
STATE OF CALIFORNIA

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE



ARCHITECTURAL DETAILS

SHEET #

A9.2

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I, SS.1 - Phase I and Phase II Composite Reference Signage Floor Plan.dwg, 4/29/2011 5:08:19 PM, PDF995

SIGN	LOCATION	COPY	NOTES (SIGN SIZE W x H)
A.01	ENTRY LANDING WALL	SUPERIOR COURT OF CALIFORNIA + SAN JOAQUIN COUNTY + MANTECA BRANCH	32"H X 240"L SIGN BOARD
A.02	ENTRY LANDING WALL	315	12" DIMENSIONAL NUMBERS
A.03	ENTRY RAMP AT SIDEWALK	(international accessibility symbol)	9" x 9" WHITE ON BLUE, POST MOUNT
B.01	LEFT LEAF OF DOOR 1.1	ENTRANCE ONLY + (international accessibility symbol)	2" LETTERING AT BACK OF GLASS
B.02	RIGHT LEAF OF DOOR 1.1	(state seal) + SUPERIOR COURT OF CALIFORNIA + SAN JOAQUIN COUNTY + MANTECA BRANCH	1" AND 2" LETTERING AT BACK OF GLASS, 6" X 6" SYMBOL
B.03	LEFT LEAF OF DOOR 1.2	(red "no passage" symbol) + EXIT ONLY + NOT AN ENTRANCE	2" LETTERING AT BACK OF GLASS
B.04	RIGHT LEAF OF DOOR 1.2	(red "no passage" symbol) + EXIT ONLY + NOT AN ENTRANCE	2" LETTERING AT BACK OF GLASS
B.05	FREESTANDING SIGN FRAME	(state seal) + (right to search notification) + (prohibited items notification) + (medical advisement)	36" W 48" H LAMINATED PAPER SIGN WITH CLEAR COVER
B.06	WALL RIGHT OF DOOR 1.3	COURTROOM 1 + (two interchangeable message strips, for "in session" and for bench officer's name)	9" X 9", BRAILLE
B.07	WALL RIGHT OF DOOR 1.3	(proper attire, no food, assistive listening available)	9" X 9", ALIGN WITH SIGN ABOVE
B.08	WALL RIGHT OF DOOR 1.3	EXIT ROUTE + (accessibility symbol)	6" X 9", BRAILLE
B.09	WALL RIGHT OF OPENING TO CLERICAL AREA	EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.10	WALL OPPOSITE SCREENING LINE	(directory)	36" X 48"
B.11	SURFACE OF DOOR 2.1	AUTHORIZED ENTRY ONLY	6" X 6", BRAILLE
B.12	WALL RIGHT OF DOOR 2.1	TO EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.13	SURFACE OF DOOR 2.2	(male symbol)	12" TRIANGLE
B.14	WALL LEFT OF DOOR 2.2	MEN + (male, accessibility symbols)	6" X 9", BRAILLE
B.15	WALL RIGHT OF DOOR 2.3	WOMEN + (female, accessibility symbols)	6" X 9", BRAILLE
B.16	SURFACE OF DOOR 2.3	(female symbol)	12" CIRCLE
B.17	RIGHT LEAF OF DOOR 2.4	(red "no passage" symbol) + EXIT ONLY + ENTER FROM CENTER STREET	2" LETTERING AT BACK OF GLASS
B.18	WALL RIGHT OF DOOR 2.4	EXIT + EMERGENCY ONLY + ALARM WILL SOUND	6" X 6", BRAILLE
B.19	SURFACE OF DOOR 2.5	FIRE SPRINKLER RISER	6" X 6", BRAILLE
B.20	WALL ABOVE SERVICE WINDOW	(interchangeable message strip)	18" X 6"
B.21	WALL ABOVE SERVICE WINDOW	(interchangeable message strip)	18" X 6"
B.22	WALL ABOVE SERVICE WINDOW	(interchangeable message strip)	18" X 6"
B.23	WALL ABOVE SERVICE WINDOW	(interchangeable message strip)	18" X 6"
B.24	SURFACE OF DOOR 2.8	AUTHORIZED ENTRY ONLY	6" X 6", BRAILLE
B.25	WALL RIGHT OF DOOR 2.8	TO EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.26	SIDE LITE RIGHT OF DOOR 2.12	SUPERVISOR + (interchangeable message strip)	6" X 6", BRAILLE
B.27	WALL RIGHT OF DOOR 2.9	TO EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.28	WALL RIGHT OF DOOR 2.11	TO EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.29	WALL LEFT OF DOOR 2.10	CONFERENCE	6" X 6", BRAILLE
B.30	WALL RIGHT OF DOOR 2.9	COURTROOM 2 + (two interchangeable message strips, for "in session" and for bench officer's name)	9" X 9", BRAILLE
B.31	WALL RIGHT OF DOOR 2.9	(proper attire, no food, assistive listening available)	9" X 9", ALIGN WITH SIGN ABOVE
B.32	SURFACE OF DOOR 2.6	JANITOR + ELECTRICAL SWITCHGEAR	6" X 6", BRAILLE
B.33	WALL RIGHT OF DOOR 2.13	MANAGER + (interchangeable message strip)	6" X 6", BRAILLE
B.34	WALL RIGHT OF DOOR 2.14	STORAGE	6" X 6", BRAILLE
B.35	WALL RIGHT OF DOOR 2.15	EXIT ROUTE + (accessibility symbol)	6" X 9", BRAILLE
B.36	WALL RIGHT OF DOOR 2.16	JURY + (interchangeable message slot, for "in use")	6" X 6", BRAILLE
B.37	SURFACE OF DOOR 2.17	(unisex symbols)	12" TRIANGLE IN CIRCLE
B.38	WALL LEFT OF DOOR 2.17	RESTROOM + (unisex accessibility symbol)	6" X 9", BRAILLE
B.39	WALL OF DOOR 2.26	TO EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.40	WALL RIGHT OF DOOR 2.26	COURTROOM 2	6" X 6", BRAILLE
B.41	WALL LEFT OF DOOR 2.18	RESTROOM + (unisex accessibility symbol)	6" X 9", BRAILLE
B.42	SURFACE OF DOOR 2.18	(unisex symbols)	12" TRIANGLE IN CIRCLE
B.43	RIGHT OF DOOR 2.20	(interchangeable message strip, for bench officer's name)	6" X 6"
B.44	WALL LEFT OF DOOR 2.19	RESTROOM + (unisex accessibility symbol)	6" X 9", BRAILLE
B.45	SURFACE OF DOOR 2.19	(unisex symbols)	12" TRIANGLE IN CIRCLE
B.46	WALL LEFT OF DOOR 2.21	EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.47	SIDE LITE LEFT OF DOOR 2.21	AUTHORIZED ENTRY ONLY	2 INCH LETTERING
B.48	SURFACE OF DOOR 2.22	ELECTRONIC EQUIPMENT	6" X 6", BRAILLE
B.49	SURFACE OF DOOR 2.24	AUDIOVISUAL EQUIPMENT	6" X 6", BRAILLE
B.50	SURFACE OF DOOR 2.25	EVIDENCE	6" X 6", BRAILLE
B.51	WALL RIGHT OF DOOR 1.14	(international accessibility symbol)	6" X 6" WHITE ON BLUE
B.52	WALL LEFT OF DOOR 1.14	EXIT + ALARM WILL SOUND (accessibility symbol)	6" X 9", BRAILLE
B.53	WALL RIGHT OF DOOR 1.9	HOLDING 7	6" X 6", BRAILLE
B.54	WALL LEFT OF DOOR 1.8	HOLDING 6	6" X 6", BRAILLE
B.55	WALL LEFT OF DOOR 1.7	HOLDING 5	6" X 6", BRAILLE
B.56	WALL SURFACE	EXIT ROUTE + (accessibility symbol)	6" X 9", BRAILLE
B.57	WALL RIGHT OF DOOR 1.13	TO EXIT + (accessibility symbol)	6" X 9", BRAILLE
B.58	SURFACE OF DOOR 1.5	AUTHORIZED ENTRY ONLY	6" X 6", BRAILLE
B.59	WALL RIGHT OF DOOR 1.4	HOLDING	6" X 6", BRAILLE
B.60	SURFACE OF DOOR 1.6	AUTHORIZED ENTRY ONLY	6" X 6", BRAILLE
B.61	SURFACE OF DOOR 2.7	ELECTRICAL SWITCHGEAR + EQUIPMENT YARD	6" X 6", BRAILLE
B.62	WALL SURFACE	EXIT ROUTE + (accessibility symbol)	6" X 9", BRAILLE

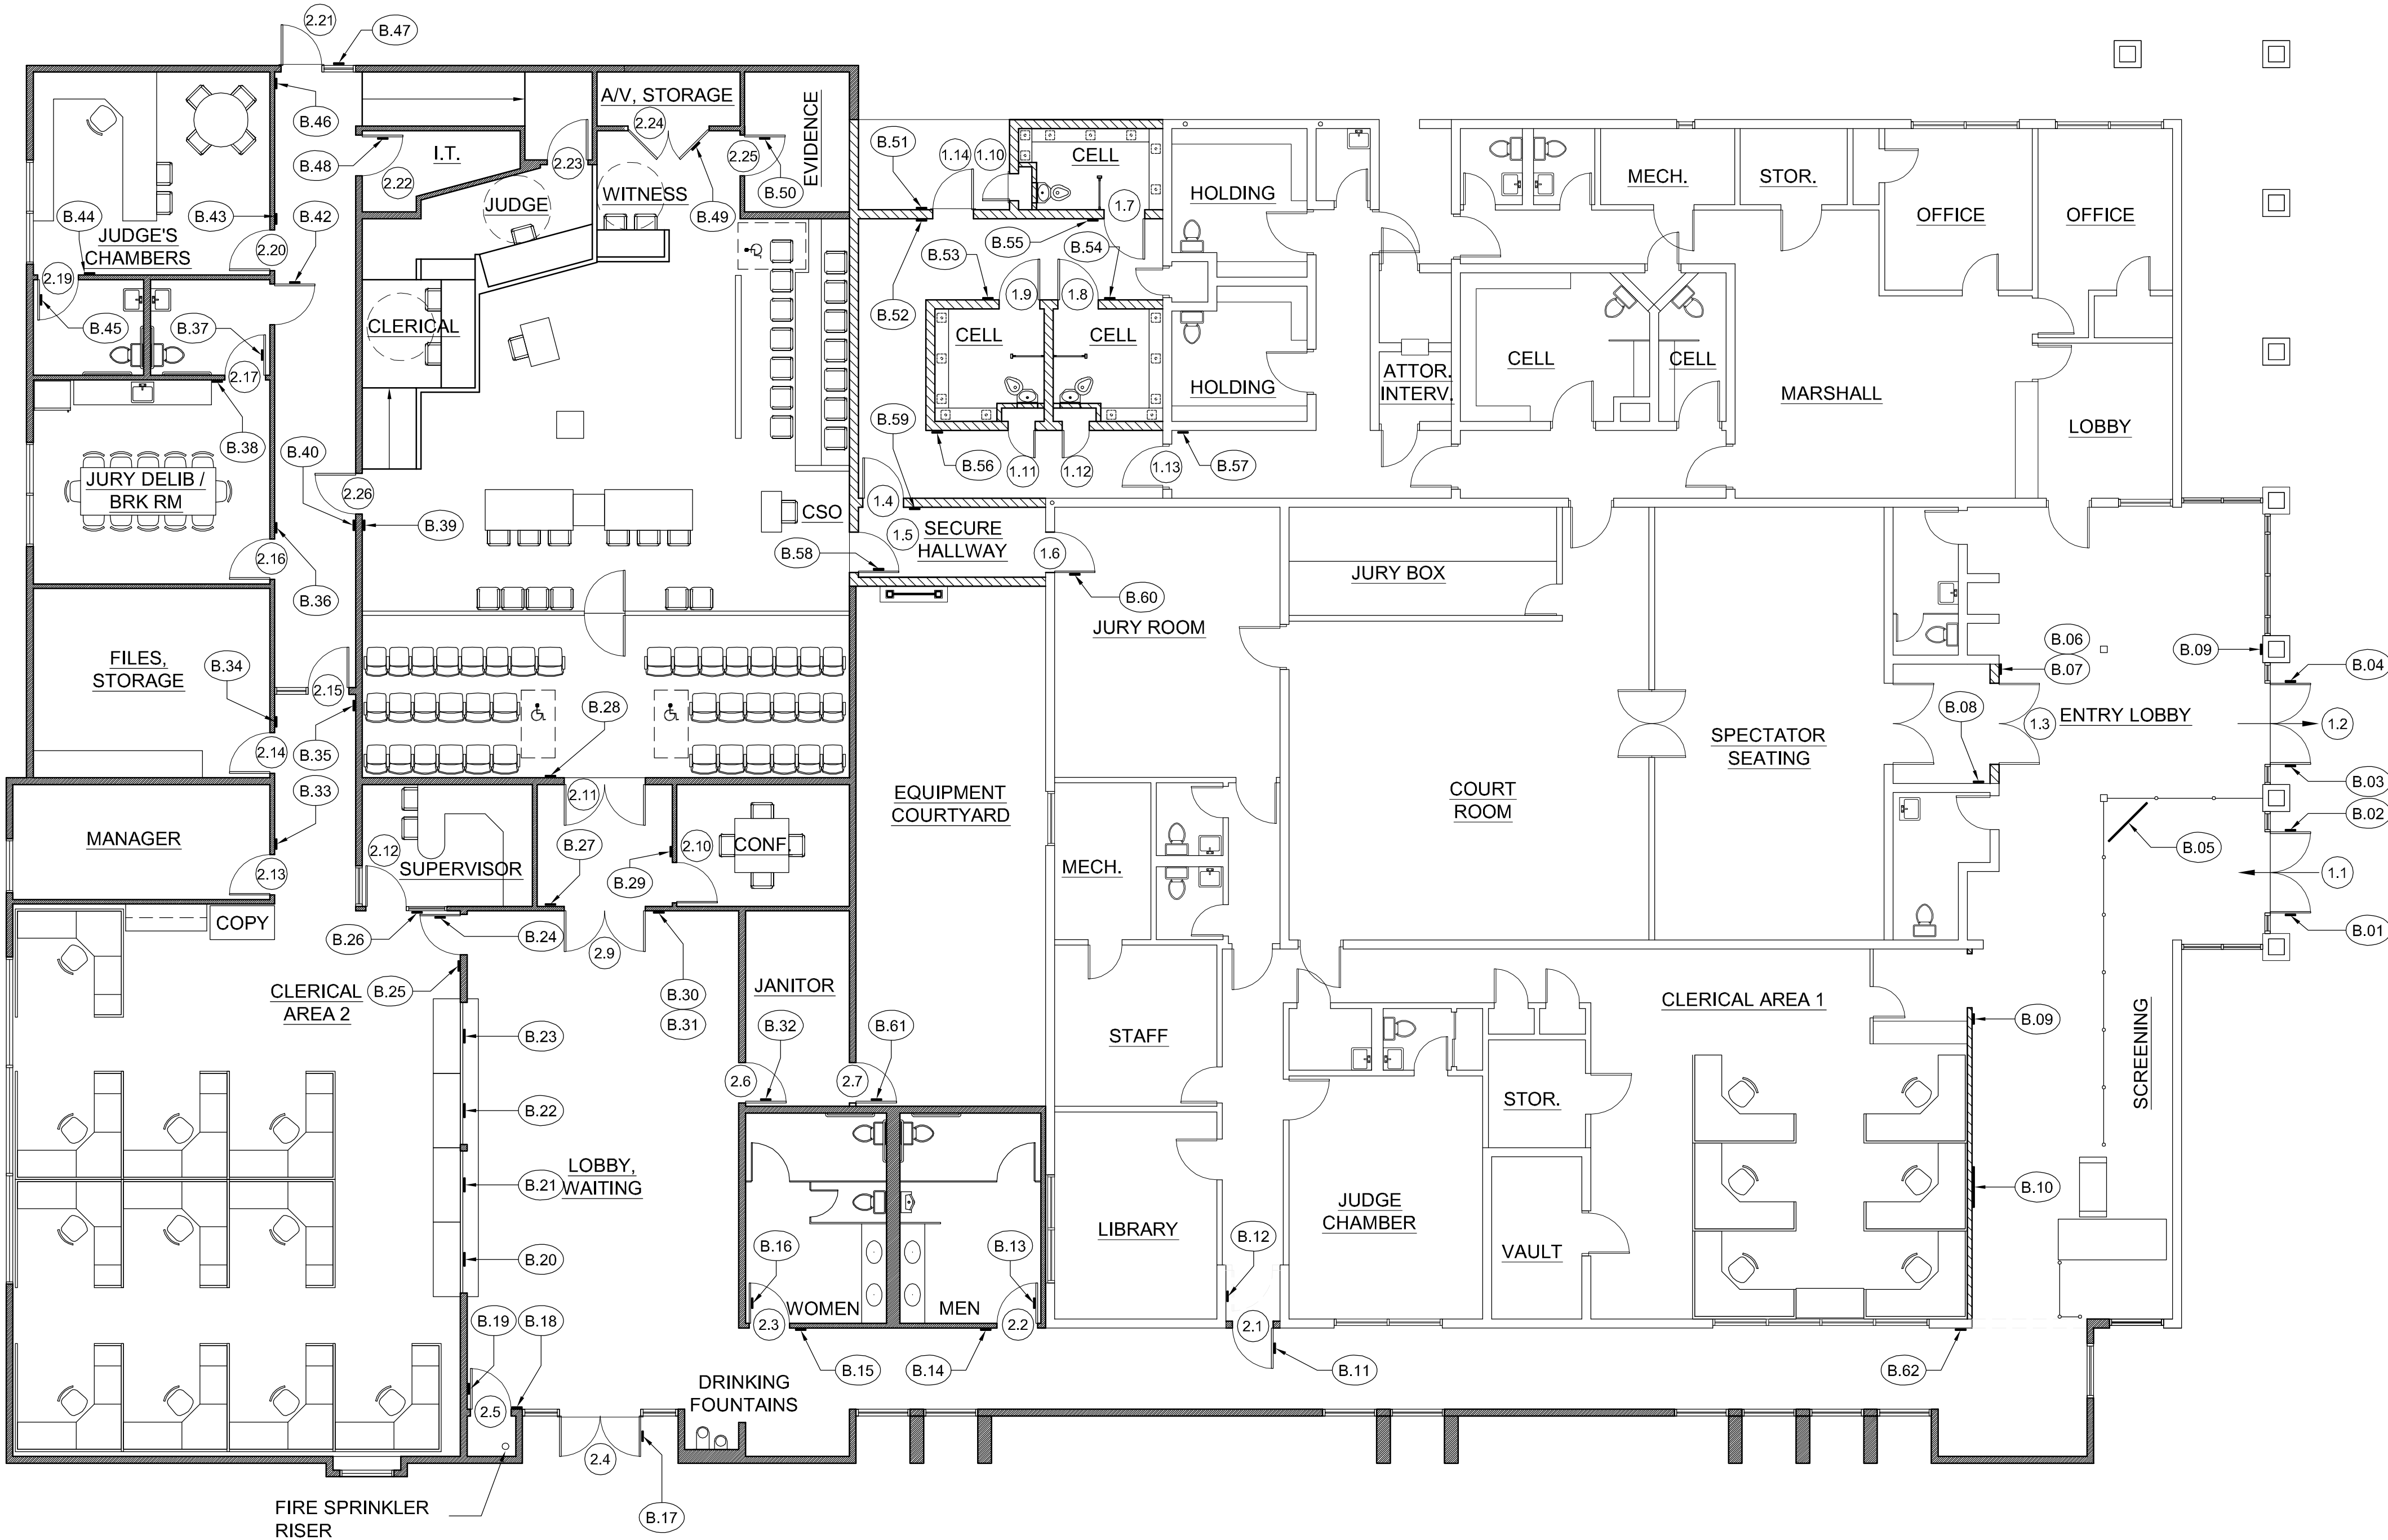

PHASE I & PHASE II SIGNAGE FLOOR PLAN

SCALE: 1/8" = 1'-0"

PHASE II IS NOT A PART OF THIS APPROVAL
AND IS SHOWN FOR REFERENCE ONLY

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

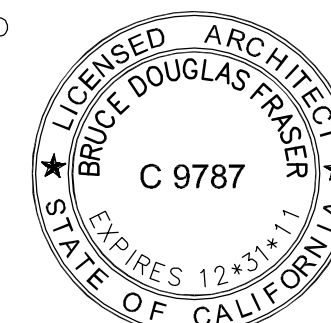

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

PHASE I & PHASE II SIGNAGE FLOOR PLAN

SHEET #

SS.1

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase I\SS.1 - Phase I and Phase II Composite Reference Signage Floor Plan.dwg, 4/29/2011 5:09:28 PM, PDF995

SIGNAGE GENERAL NOTES


1. SEE SHEET A1.2 FOR LOCATION OF SITE SIGNAGE.
2. EXIT SIGNS SHALL COMPLY WITH THE PROVISIONS OF THE 2007 CALIFORNIA BUILDING CODE SECTION 1011.
3. SIGNS THAT IDENTIFY, DIRECT TO OR GIVE INFORMATION ABOUT PERMANENT BUILDING ROOMS AND SPACES SHALL MEET ALL REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES, SECTION 4.30, AND CALIFORNIA BUILDING CODE, TITLE 24, PART 2, VOLUME 1, SECTION 1117.B.5.
4. ACCESSIBLE SIGNAGE SHALL INCLUDE CONTRACTED GRADE 2 BRAILLE, WITH DOTS 1/10" ON CENTERS IN EACH CELL WITH 2/10" SPACE BETWEEN CELLS, MEASURED FROM THE SECOND COLUMN OF DOTS IN THE FIRST CELL TO THE FIRST COLUMN OF DOTS IN THE SECOND CELL, AND RAISED A MINIMUM OF 1/40TH INCH ABOVE THE BACKGROUND.
5. ACCESSIBLE SIGNAGE SHALL HAVE CHARACTERS RAISED AND PICTORIAL SYMBOLS RAISED 1/32" ABOVE THE BACKGROUND. LETTERS SHALL BE SANS SERIF UPPER CASE, 5/8" TO 2" HEIGHT, CONTRASTING WITH THE BACKGROUND, AND WITH A CHARACTER WIDTH-TO-HEIGHT RATIO BETWEEN 3:5 AND 1:10, AND A STROKE WIDTH-TO-HEIGHT RATIO BETWEEN 1:5 AND 1:10; PICTORIAL SYMBOLS SHALL HAVE A MINIMUM OUTSIDE DIMENSION OF 6".
6. SIGNS WILL BE MOUNTED AT 60" FROM THE FINISHED FLOOR SURFACE TO THE CENTER OF THE SIGN UNLESS OTHERWISE NOTED.




21 A.01
NOT TO SCALE




32 B.09
SCALE: 1/8" = 1'-0"

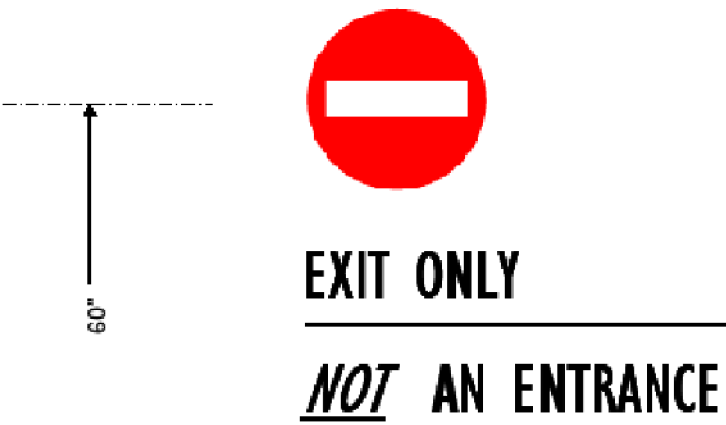


22 B.04
SCALE: 1/8" = 1'-0"

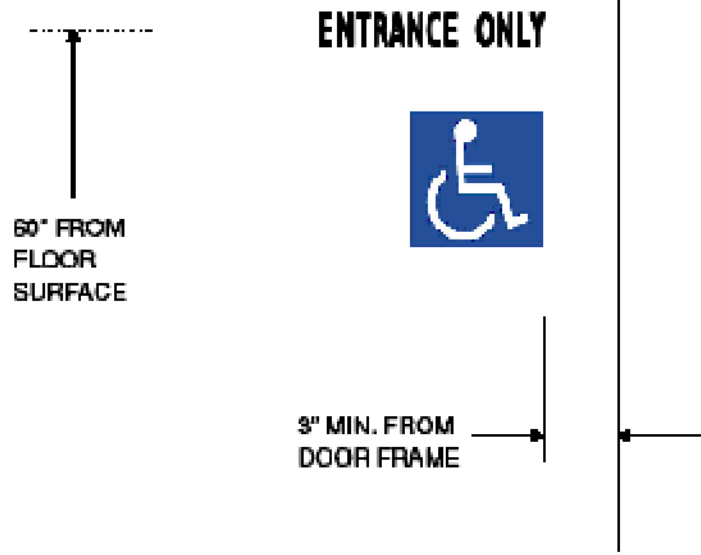


12 B.01
SCALE: 1/8" = 1'-0"

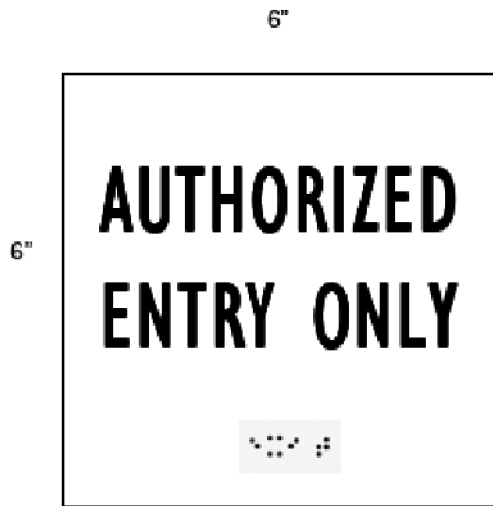

33 B.11
SCALE: 1/8" = 1'-0"

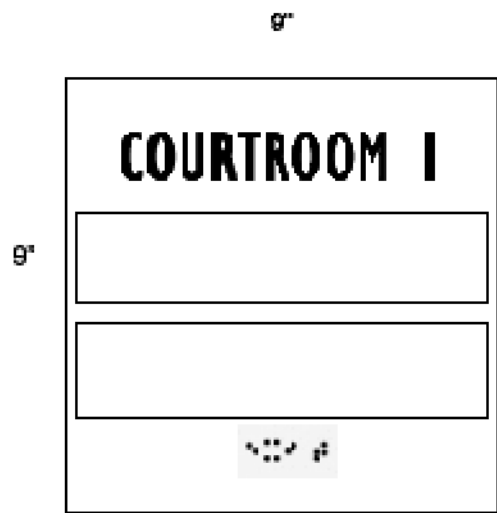

23 B.06
SCALE: 1/8" = 1'-0"

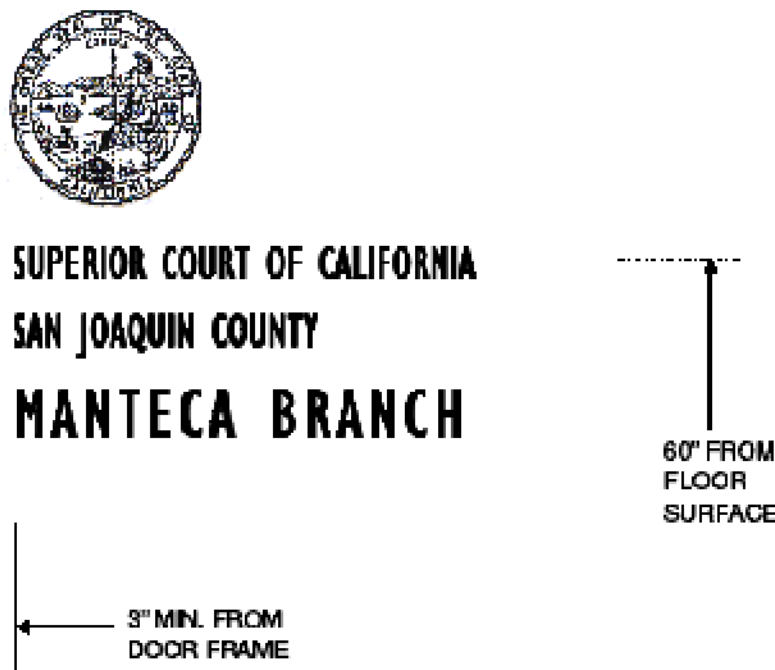


13 B.02
SCALE: 1/8" = 1'-0"



34 B.12
SCALE: 1/8" = 1'-0"



24 B.08
SCALE: 1/8" = 1'-0"

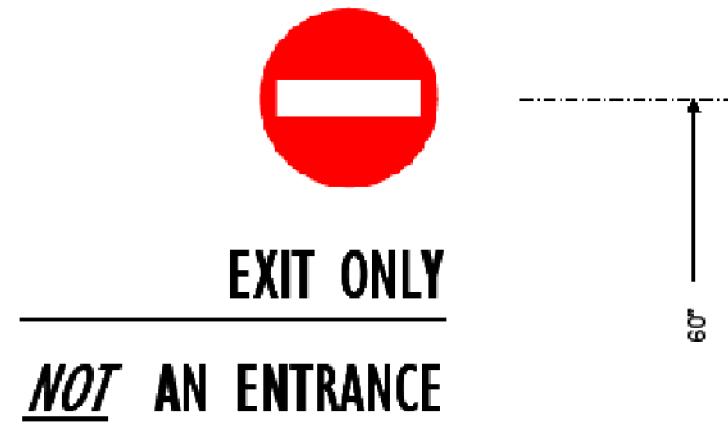

14 B.03
SCALE: 1/8" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

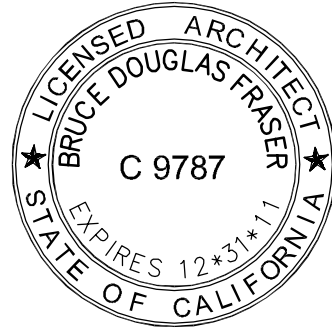

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I
SIGN GRAPHICS**

SHEET #

SS.2

\\John\Manteca Courthouse_1007\Drawings\Sheets\Phase 1\S1.0 - Structural Notes.dwg, 6/14/2011 9:39:10 AM, P05995

GENERAL STRUCTURAL NOTES

GENERAL NOTES

- THE FOLLOWING NOTES, TYPICAL DETAILS AND SCHEDULES SHALL APPLY TO ALL PHASES OF THIS PROJECT UNLESS OTHERWISE SHOWN OR NOTED.
- SPECIFIC NOTES AND DETAILS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS.
- ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE MINIMUM STANDARDS OF THE 2010 EDITION OF THE CALIFORNIA BUILDING CODE (CBC) AND SUCH OTHER REGULATING AGENCIES EXERCISING AUTHORITY OVER ANY PORTION OF THE WORK. THE CONTRACTOR SHALL HAVE A COPY OF THE CBC ON THE JOB SITE.
- THE "CONTRACT OR CONSTRUCTION DOCUMENTS" SHALL CONSIST OF THESE NOTES, DETAILS, SCHEDULES, PLANS, AND DRAWINGS, AS WELL AS ATTACHED SPECIFICATIONS.
- ALL SPECIFICATIONS, INCLUDING BUT NOT LIMITED TO MATERIALS AND PRODUCTS, SHALL BE THOSE PUT FORTH IN THE "CONTRACT OR CONSTRUCTION DOCUMENTS". NO SUBSTITUTIONS SHALL BE PERMITTED TO BE USED OR ASSUMED TO BE USED IN THE BIDDING OR CONSTRUCTION PROCESS WITHOUT WRITTEN APPROVAL BY THE ENGINEER OF RECORD.
- THE CONTRACTOR SHALL EXAMINE THE "CONTRACT OR CONSTRUCTION DOCUMENTS" AND SHALL NOTIFY THE ARCHITECT OR ENGINEER OF ANY DISCREPANCIES HE MAY FIND BEFORE PROCEEDING WITH THE WORK.
- ALL INFORMATION ON EXISTING CONDITIONS SHOWN ON DRAWINGS ARE BASED ON BEST PRESENT KNOWLEDGE AVAILABLE, BUT WITHOUT GUARANTEE OF ACCURACY. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS AT THE SITE AND SHALL NOTIFY THE ARCHITECT OR ENGINEER OF ANY DISCREPANCIES BETWEEN ACTUAL SITE CONDITIONS AND INFORMATION SHOWN ON OR IN THE "CONTRACT OR CONSTRUCTION DOCUMENTS" BEFORE PROCEEDING WITH WORK.
- THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ARCHITECT OR ENGINEER OF ANY CONDITION WHICH IN HIS OPINION MIGHT ENDANGER THE STABILITY OF THE STRUCTURE OR CAUSE DISTRESS OF THE STRUCTURE.
- ALL WORK SHALL CONFORM TO THE BEST PRACTICE PREVAILING IN THE VARIOUS TRADES COMPRISING WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE WORK OF ALL TRADES.
- THESE "CONTRACT OR CONSTRUCTION DOCUMENTS" REPRESENT THE FINISHED STRUCTURE, AND DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES.
- INSPECTION AND APPROVAL FOR FABRICATOR'S SHOPS USED FOR FABRICATION OF STRUCTURAL LOAD BEARING MEMBERS, COMPONENTS, MATERIALS OR ASSEMBLIES SHALL CONFORM TO CBC SECTION 1704.2.
 - LABELING (AS REQUIRED OR SPECIFIED) SHALL BE PROVIDED IN ACCORDANCE WITH CBC SECTION 1703.5.
 - EVALUATION AND FOLLOW-UP INSPECTION SERVICES (AS REQUIRED OR SPECIFIED), SHALL CONFORM TO CBC SECTION 1703.6.
- THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS FOR INFORMATION NOT COVERED BY THESE DRAWINGS AND GENERAL NOTES.
- THE CONTRACTOR SHALL PROVIDE TEMPORARY BRACING AND SHORING FOR ALL STRUCTURAL MEMBERS AS REQUIRED FOR STRUCTURAL STABILITY OF THE STRUCTURE DURING ALL PHASES OF CONSTRUCTION.
- THE CONTRACTOR SHALL TAKE ALL STEPS NECESSARY TO ENSURE PROPER ALIGNMENT OF THE STRUCTURE AFTER THE INSTALLATION OF ALL STRUCTURAL AND FINISH MATERIALS. THIS SHALL INCLUDE ANY NECESSARY PRELOADING OF THE STRUCTURE TO DETERMINE FINAL POSITION OF THE COMPLETED WORK.
- OBSERVATION VISITS TO THE PROJECT SITE BY FIELD REPRESENTATIVES OF ARCHITECT AND/OR ENGINEER (SUPPORT SERVICES) SHALL NOT INCLUDE INSPECTIONS OF SAFETY OR PROTECTIVE MEASURES, NOR CONSTRUCTION PROCEDURES, TECHNIQUES OR METHODS. ANY SUPPORT SERVICES PERFORMED BY ARCHITECT OR ENGINEER DURING ANY PHASE OF CONSTRUCTION, SHALL BE DISTINGUISHED FROM CONTINUOUS AND DETAILED INSPECTION SERVICES (AS REQUIRED BY ANY REGULATING GOVERNMENTAL AGENCY, e.g. LOCAL BUILDING DEPARTMENT) PROVIDED BY OTHERS. THESE SUPPORT SERVICES, WHETHER OF MATERIAL OR WORK, ARE PERFORMED SOLELY FOR THE PURPOSE OF ASSISTING IN QUALITY CONTROL, AND IN ACHIEVING CONFORMANCE WITH CONTRACT DOCUMENTS, BUT DO NOT GUARANTEE CONTRACTORS PERFORMANCE AND SHALL NOT BE CONSTRUED AS SUPERVISION OF CONSTRUCTION.
- PROVIDE OPENINGS AND SUPPORTS AS REQUIRED PER TYPICAL DETAILS AND NOTES FOR MECHANICAL, PLUMBING, AND ELECTRICAL EQUIPMENT, VENTS, DUCTS, PIPING, ETC. ALL MECHANICAL, PLUMBING AND ELECTRICAL EQUIPMENT SHALL BE PROPERLY "SWAY BRACED" AGAINST LATERAL FORCES.
- THESE NOTES, DETAILS, DRAWINGS AND SPECIFICATIONS (CONTRACT OR CONSTRUCTION DOCUMENTS) DO NOT CARVE NECESSARY PROVISIONS FOR CONSTRUCTION SAFETY. THESE DOCUMENTS AND ALL PHASES OF CONSTRUCTION HEREBY CONTEMPLATED ARE TO BE GOVERNED, AT ALL TIMES, BY APPLICABLE PROVISIONS OF THE CURRENT CALIFORNIA OCCUPATIONAL SAFETY AND HEALTH ACT.
- WHERE ANY CONFLICT OCCURS BETWEEN THE REQUIREMENTS OF FEDERAL, STATE AND LOCAL LAWS, CODES, ORDINANCES, RULES AND REGULATIONS, THE MOST STRINGENT SHALL GOVERN.
- REFER TO ARCHITECTURAL DRAWINGS TO COORDINATE WITH STRUCTURAL DRAWINGS. ANY DISCREPANCY BETWEEN THESE DRAWINGS SHALL BE REFERRED TO THE ARCHITECT OR ENGINEER FOR CLARIFICATION BEFORE START OF CONSTRUCTION.
- WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS.
- DRAWINGS (NOTES, SCHEDULES, DETAILS AND PLANS) SHALL HAVE PRECEDENCE OVER STRUCTURAL CALCULATIONS.
- IN THE EVENT THAT CERTAIN FEATURES OF THE CONSTRUCTION ARE NOT FULLY SHOWN ON THE DRAWINGS OR CALLED FOR IN THE GENERAL NOTES OR SPECIFICATIONS, THEN THEIR CONSTRUCTION SHALL BE OF THE SAME CHARACTER AS FOR SIMILAR CONDITIONS THAT ARE SHOWN OR CALLED FOR.
- CONTRACTOR SHALL HAVE A COPY OF PROJECT SOILS/GEOTECHNICAL/FOUNDATION INVESTIGATION ON THE JOB SITE.
- ASTM DESIGNATION AND ALL STANDARDS REFER TO THE LATEST AMENDMENTS.
- THESE STRUCTURAL "CONTRACT OR CONSTRUCTION DOCUMENTS" SHALL NOT BE MODIFIED WITHOUT PRIOR WRITTEN APPROVAL OF THE ENGINEER.
- ONLY "APPROVED" STRUCTURAL WORKING DRAWINGS AND "CONTRACT OR CONSTRUCTION DOCUMENTS" ARE PERMITTED TO BE USED FOR CONSTRUCTION ON THIS PROJECT. ALL OTHER DRAWINGS OR DOCUMENTS ARE OBSOLETE AND ARE NOT PERMITTED ON THE JOB SITE, NOR SHALL THEY BE USED FOR ANY CONSTRUCTION PURPOSES. CONTRACTORS USING UNAPPROVED DRAWINGS OR DOCUMENTS ARE SOLELY RESPONSIBLE FOR ALL WORK NOT PERFORMED IN ACCORDANCE WITH THE "APPROVED" DRAWINGS.
- SEE ARCHITECTURAL DRAWINGS FOR ALL FIRE PROTECTION REQUIREMENTS.

SHOP DRAWING AND CONTRACTOR SUBMITTAL REVIEW

- SHOP DRAWINGS OR CONTRACTOR SUBMITTALS SHOULD BE PROVIDED FOR THE FABRICATION (OR MIXING) OF THE FOLLOWING (BUT NOT LIMITED TO) COMPONENTS OR ELEMENTS.
 - CONCRETE (AND/OR GROUT) MIX DESIGNS.
 - STRUCTURAL STEEL.
 - TRUSSES.
 - FIRE SPRINKLERS.
 - REINFORCING STEEL.
 - PRECAST CONCRETE OR TILT-UP PANELS.
 - SUBSTITUTE OR ALTERNATE MATERIALS.
 - FORMWORK AND SHORING.
 - ELEVATORS.
 - PROJECT CONTRACTOR SHALL BE RESPONSIBLE FOR PRODUCTION AND APPROVAL OF ALL SHOP DRAWINGS.
 - WHEN PROJECT CONTRACTOR SUBMITS SHOP DRAWINGS OR OTHER SUBMITTALS TO ARCHITECT/ENGINEER FOR REVIEW, SUBMITTAL PACKAGE SHALL CONTAIN SUFFICIENT COPIES THAT ARCHITECT/ENGINEER MAY RETAIN A COMPLETE COPY OF SUBMITTAL PACKAGE. IN ADDITION, PROJECT CONTRACTOR SHALL ALLOW SUFFICIENT TIME TO THOROUGHLY REVIEW SUBMITTAL PACKAGE (10 WORKING DAYS, MINIMUM).
 - REVIEW OF SHOP DRAWINGS OR CONTRACTOR SUBMITTAL BY ARCHITECT/ENGINEER DOES NOT IN ANY WAY CONSTITUTE APPROVAL OF SUBMITTAL PACKAGE. ARCHITECT/ENGINEER'S REVIEW IS FOR GENERAL CONFORMANCE WITH THE DESIGN CONCEPT AND CONTRACT DOCUMENTS. REVIEW SHALL NOT BE CONSTRUED AS RELIEVING PROJECT CONTRACTOR FROM COMPLIANCE WITH THE CONTRACT DOCUMENTS.
- ### DEMOLITION NOTES
- SAFETY NOTE:
 - IT IS SOLELY THE CONTRACTORS RESPONSIBILITY TO COMPLY WITH THE PERTINENT SECTIONS, AS THEY APPLY TO THIS PROJECT, OF THE "CONSTRUCTION SAFETY ORDERS" ISSUED BY THE STATE OF CALIFORNIA, LATEST EDITION, AND ALL O.S.H.A. REQUIREMENTS.
 - THE ARCHITECT, STRUCTURAL ENGINEER, AND THE OWNER DO NOT ACCEPT ANY RESPONSIBILITY FOR THE CONTRACTORS FAILURE TO COMPLY WITH THESE REQUIREMENTS.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADEQUATE DESIGN AND CONSTRUCTION OF ALL FORMS. FORMS SHALL ALSO BE ADEQUATELY BRACED AND SHORED.
 - SHORE BEAMS WHERE NECESSARY TO MAINTAIN THE STRUCTURAL INTEGRITY OF THE EXISTING STRUCTURE.
 - NOTIFY THE STRUCTURAL ENGINEER OF ANY DISCREPANCIES BETWEEN THE PLANS AND EXISTING STRUCTURE.
 - CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND LOCATION OF ALL SHORING.

FOUNDATION NOTES

- BASIS: CBC CHAPTER 18 AND PROJECT SOILS ENGINEERING AND GEOLOGIC HAZARDS REPORT BY EARTH SYSTEMS PACIFIC, FILE NO.: SL16437-SA, DATED MAY 3, 2011.
- ALLOWABLE SOIL BEARING PRESSURE:
DEAD LOAD PLUS LIVE LOAD: 1,800 P.S.F.
- UNEXPECTED SOIL CONDITIONS: ALLOWABLE VALUES AND FOUNDATION DESIGN ARE BASED UPON SOIL CONDITIONS SHOWN BY TEST BORINGS. ACTUAL SOIL CONDITIONS WHICH DEViate APPRECIABLY FROM THAT SHOWN IN THE TEST BORINGS SHALL BE REPORTED TO THE PROJECT SOILS ENGINEER IMMEDIATELY.
- SEE SOILS OR FOUNDATION INVESTIGATION FOR COMPACTION, FILL, BACKFILLING, AND SITE PREPARATION REQUIREMENTS AND PROCEDURES.
- EXCAVATE TO REQUIRED DEPTHS AND DIMENSIONS (AS INDICATED IN DRAWINGS AND PROJECT SOILS REPORT), CUT SQUARE AND SMOOTH WITH FIRM LEVEL BOTTOMS. CARE SHALL BE TAKEN NOT TO OVER-EXCAVATE FOUNDATION AT LOWER ELEVATION AND PREVENT DISTURBING OF SOILS AROUND HIGHER ELEVATION.
- FOOTINGS SHALL BE POURED IN NEAT EXCAVATIONS, WITHOUT SIDE FORMS WHENEVER POSSIBLE.
- CARRY ALL FOUNDATIONS TO REQUIRED DEPTHS INTO COMPACTED FILL OR NATURAL SOIL (AS PER STRUCTURAL PLANS AND DETAILS, AND PROJECT SOILS REPORT).
- FOUNDATIONS SHALL NOT BE POURED UNTIL ALL REQUIRED REINFORCING STEEL, SLEEVES, INSERTS, CONDUITS, PIPES, ETC. AND FORMWORK IS PROPERLY PLACED AND INSPECTED BY THE LOCAL BUILDING OFFICIAL/INSPECTOR.
- THE SIDES AND BOTTOMS OF EXCAVATIONS WHICH ARE TO HAVE CONCRETE CONTACT MUST BE MOISTENED SEVERAL TIMES JUST PRIOR TO POURING UPON THEM.
- DE-WATER FOOTINGS, AS REQUIRED, TO MAINTAIN DRY WORKING CONDITIONS.
- ALL FOUNDATION EXCAVATIONS SHALL BE INSPECTED AND APPROVED BY PROJECT SOILS ENGINEER, PRIOR TO FORMING AND PLACEMENT OF REINFORCING OR CONCRETE.

RETAINING WALL NOTES

- SEE PROJECT SOILS INVESTIGATION (IF PROVIDED) AND SPECIFIC RETAINING WALL DETAILS FOR ADDITIONAL REQUIREMENTS. PROJECT SOILS INVESTIGATION SHALL TAKE PRECEDENCE OVER THESE NOTES AND SPECIFIC RETAINING WALLS DETAILS.
- BEFORE BACKFILLING WALL, A GRANULAR DRAINAGE MATERIAL (SEE NOTE #3) SHALL BE PLACED BEHIND THE WALL IN A CONTINUOUS 12" (MIN.) WIDE STRIP. THE DRAINAGE MATERIAL SHALL EXTEND THE FULL HEIGHT OF WALL UP TO 12" BELOW TOP OF THE HIGHER GRADE.
- GRANULAR DRAINAGE MATERIAL SHALL CONSIST OF GRAVEL OR CRUSHED STONE, AND SHALL BE FREE OF ORGANIC MATERIAL, CLAY OR OTHER DELETERIOUS MATERIAL.
- DRAINAGE AND BACKFILL MATERIAL SHALL NOT BE PLACED UNTIL CONCRETE AND/OR MASONRY HAS REACHED DESIGN STRENGTH.
- BACKFILLING AND COMPACTION:
 - FREE-STANDING WALLS - DO NOT BACKFILL WALL UNTIL 7 DAYS (MIN.) AFTER PLACING OF CONCRETE OR SOLID GROUTING OF WALL IS COMPLETED. BACKFILL MATERIAL SHALL BE PLACED IN CONTINUOUS 12" LIFTS (FOR ENTIRE LENGTH OF WALL) AND COMPACTED WITH LIGHTWEIGHT TAMPERS. DO NOT FRAME WOOD STUD WALLS OR JOIST FLOORS, OR POUR CONCRETE SLABS (AT TOP OF RETENTION) UNTIL 7 DAYS (MIN.) AFTER BACKFILLING AND COMPACTION OPERATION IS COMPLETED.
 - TOP-RESTRAINED WALLS (STRUCTURAL CONCRETE SLAB OR WOOD FLOOR ANCHORED AT TOP OF WALL) - WALL SHALL BE SECURELY SHORED AND BRACED PRIOR TO BACKFILLING AND COMPACTION OPERATION IS BEGUN. BACKFILLING AND COMPACTION OPERATIONS MAY BEGIN AFTER WALL HAS REACHED DESIGN STRENGTH AND SHORING COMPLETED. BACKFILL MATERIAL SHALL BE PLACED IN CONTINUOUS 12" LIFTS (FOR ENTIRE LENGTH OF WALL) AND COMPACTED WITH LIGHTWEIGHT TAMPERS. SHORING SHALL REMAIN IN PLACE UNTIL BACKFILLING AND COMPACTION IS COMPLETED AND CONCRETE SLAB (AT TOP OF WALL) HAS REACHED DESIGN STRENGTH OR WOOD FLOOR FRAMING IS COMPLETED AND INSPECTED.
- ALL FOOTINGS SHALL BE POURED AGAINST UNDISTURBED GROUND OR APPROVED (BY SOILS ENGINEER) FILL.
- CONTRACTOR SHALL NOTIFY ARCHITECT OR ENGINEER IF SUPERIMPOSED LOADING OCCURS FROM ADJACENT EXISTING FOUNDATIONS OR OTHER STRUCTURES WITHIN A DISTANCE EQUAL TO THE OVERALL HEIGHT OF THE WALL.
- MAXIMUM UPHILL SLOPE BEHIND WALL (UNLESS OTHERWISE NOTED) SHALL BE 1 (VERTICAL) TO 3 (HORIZONTAL).
- A 4" (MIN.) DIAMETER PERFORATED DRAIN PIPE (WITH PERFORATIONS PLACED DOWNWARD) SHALL BE PLACED AT THE TOP OF THE FOOTING AND COMPLETELY SURROUNDED BY GRANULAR DRAINAGE MATERIAL (SEE NOTE #3). DRAIN PIPE SHALL HAVE A MINIMUM 2% SLOPE TO DAYLIGHT.
- BEFORE GRANULAR DRAINAGE MATERIAL AND BACKFILL IS PLACED, THE ENTIRE BACKSIDE (RETENTION SIDE) OF WALL SHALL BE THOROUGHLY WATERPROOFED.
- A SYNTHETIC PERMEABLE FABRIC SHALL BE INSTALLED BETWEEN GRAVEL DRAINAGE MATERIAL (SEE NOTE #2) AND BACKFILL MATERIAL, TO PREVENT INFILTRATION OF NATIVE SOILS OR BACKFILL MATERIAL INTO DRAINAGE MATERIAL.

CONCRETE

- ALL CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH (f'_c) OF 3,000 P.S.I. AT 28 DAYS. ALL CONCRETE SHALL BE REGULAR WEIGHT (UNLESS SPECIFICALLY NOTED OTHERWISE).
- ALL CONCRETE WORK SHALL COMPLY WITH CBC CHAPTER 19 AND ACI 318-08 AND LATEST EDITION OF ACI MANUAL OF CONCRETE PRACTICE.
- SPECIAL INSPECTION (AS REQUIRED OR SPECIFIED) SHALL CONFORM TO CBC CHAPTER 17.
- CEMENT SHALL BE PORTLAND CEMENT TYPE I OR II AND SHALL CONFORM TO ASTM C150.
- AGGREGATES SHALL CONFORM TO ASTM C33.
- WATER SHALL CONFORM TO ASTM C1602.
- WHERE NOT SPECIFICALLY DETAILED, THE MINIMUM CONCRETE COVER ON REINFORCING STEEL SHALL BE:
 - CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH OR WEATHER: 3"
 - CONCRETE PLACED AGAINST FORMS, BUT EXPOSED TO EARTH OR WEATHER: 2"
 - SLABS, WALL & JOISTS, NOT EXPOSED TO EARTH OR WEATHER: 1 1/2"
 - BEAMS, GIRDERS & COLUMNS, NOT EXPOSED TO EARTH OR WEATHER: 1 1/2"

CONCRETE (CONTINUED)

- REINFORCING BARS LARGER THAN #8 ARE NOT PERMITTED UNLESS SPECIFICALLY DETAILED OR NOTED OTHERWISE.
- MINIMUM LAP FOR ALL REINFORCING BARS AT SPLICES: (SPLICES TO BE STAGGERED)

#3, #4-----24"

#6-----36"

#8-----60"

#5-----30"

#7-----53"
- THE MINIMUM RADIUS OF BEND FOR REINFORCING STEEL (MEASURED ON THE INSIDE OF BAR) SHALL BE AS FOLLOWS:

#3-----1 1/4"

#4-----1 1/2"

#5-----1 7/8"

#6-----2 1/4"

#7-----2 5/8"

#8-----3"
- ALL ANCHOR BOLTS USED IN CONCRETE CONSTRUCTION SHALL HAVE A MINIMUM TOTAL EMBEDMENT AS FOLLOWS, U.N.O.:

5/8" DIA OR SMALLER-----7"

3/4" DIA-----8"

7/8" DIA-----9"

1" DIA-----10"
- LOCATION OF ALL CONSTRUCTION JOINTS, OTHER THAN SPECIFIED, SHALL BE APPROVED BY ARCHITECT/ENGINEER PRIOR TO POURING. CONSTRUCTION JOINTS SHALL BE THOROUGHLY AIR AND WATER CLEANED AND HEAVILY ROUGHENED SO AS TO EXPOSE COARSE AGGREGATES. ALL SURFACES TO RECEIVE CONCRETE SHALL BE MAINTAINED CONTINUOUSLY WET AT LEAST THREE HOURS IN ADVANCE OF POURING.
- ALL REINFORCING STEEL, ANCHOR BOLTS, DOWELS, INSERTS AND ANY OTHER HARDWARE TO BE SET IN CONCRETE SHALL BE WELL SECURED IN POSITION PRIOR TO POURING OF CONCRETE.
- ARCHITECT OR ENGINEER AND INSPECTOR SHALL BE NOTIFIED FOR REINFORCING INSPECTION 24 HOURS, MINIMUM, PRIOR TO PLACING ANY CONCRETE.
- CONTRACTOR SHALL OBTAIN APPROVAL FROM ARCHITECT/ENGINEER PRIOR TO PLACING SLEEVES, PIPES, DUCTS, CHASES, CORING AND OPENINGS ON OR THROUGH STRUCTURAL CONCRETE BEAMS, WALLS, FLOORS AND ROOF SLABS, UNLESS SPECIFICALLY DETAILED OR NOTED. ALL PIPES OR CONDUITS PASSING THROUGH CONCRETE MEMBERS SHALL BE SLEEVED WITH STANDARD STEEL PIPES. SEE DETAIL FOR SLEEVE AT FOUNDATION.
- FORMWORK DESIGN AND REMOVAL SHALL CONFORM TO CBC SECTION 1906.
- VIBRATE ALL CONCRETE (INCLUDING SLABS ON GRADE) AS IT IS PLACED, WITH A MECHANICAL VIBRATOR OPERATED BY EXPERIENCED PERSONNEL. THE VIBRATOR SHALL BE USED TO CONSOLIDATE THE CONCRETE, NOT TRANSPORT IT. REINFORCING AND FORMS SHALL NOT BE VIBRATED.
- FORM REMOVAL: REMOVE FORMS IN ACCORDANCE WITH THE FOLLOWING SCHEDULE:

SIDE FORMS OF FOOTINGS: MINIMUM 48 HOURS

EDGE FORMS OF SLAB ON GRADE, STRIP 1: MINIMUM 24 HOURS

WALL/RETAINING WALL FORMS: 72 HOURS & 70% OF DESIGN STRENGTH

COLUMN FORMS: 72 HOURS & 70% OF DESIGN STRENGTH
- CONCRETE SHALL NOT FREE FALL MORE THAN SIX FEET. USE TREMIE, PUMP OR OTHER APPROVED METHODS.
- CONCRETE SHALL BE MAINTAINED IN A MOIST CONDITION FOR A MINIMUM OF 5 DAYS AFTER PLACEMENT.
- CONTRACTOR MAY USE CONCRETE ADMIXTURES AS A CONSTRUCTION MEANS AND METHODS TO EXECUTE "CONTRACT OR CONSTRUCTION DOCUMENTS". USE OF ADMIXTURE IS SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.
- MIX DESIGNS SHALL BE PREPARED BY AN APPROVED TESTING LABORATORY, SIGNED BY A LICENSED ENGINEER AND SHALL BE SUBMITTED TO THE PROJECT STRUCTURAL ENGINEER OF RECORD FOR APPROVAL.
- ONLY ONE GRADE OF CONCRETE SHALL BE ALLOWED ON PROJECT SITE AT ANY ONE TIME.
- UNLESS SPECIFICALLY DETAILED OR NOTED OTHERWISE, CONSTRUCTION AND CONTROL JOINTS SHALL BE PROVIDED IN ALL CONCRETE SLABS, AND SHALL BE LOCATED SUCH THAT THE AREA WITHIN JOINTS DOES NOT EXCEED 375 SQ. FT., AND IS ROUGHLY SQUARE.

- FOR ALL STRUCTURAL SLABS (SUSPENDED OR ONGRADE) WHERE ARCHITECTURAL "EXPOSED" CONDITIONS ARE DESIRED, GENERAL CONTRACTOR SHALL PROVIDE CONTROL JOINT LAYOUT FOR REVIEW BY ARCHITECT OR ENGINEER.
- EVERY OPENING (EXCEEDING 24" IN EITHER DIRECTION) SHALL HAVE A MINIMUM OF 2 #5 (U.N.O.) DIRECTLY ADJACENT TO ALL SIDES AS WELL AS TOP AND BOTTOM (UNLESS AT FOUNDATION). REINFORCING BARS SHALL EXTEND A MINIMUM OF 24" PAST EDGE OF OPENING.

5/8" DIA OR SMALLER-----4"

3/4" DIA-----5"

7/8" DIA-----6"
 - AT THE END, AS WELL AS TOP, OF WALLS SHALL BE A MINIMUM OF 2 #5 CONTINUOUS (U.N.O.).
 - CONCRETE STRENGTH SHALL BE VERIFIED BY STANDARD CYLINDER TESTS (IN ACCORDANCE WITH CBC SECTION 1905) MADE BY AN APPROVED TESTING LABORATORY.
 - CONCRETE PLACED DURING FREEZING OR NEAR-FREEZING WEATHER SHALL CONFORM TO CBC SECTION 1905.12.

CONCRETE BLOCK CONSTRUCTION

- CONCRETE BLOCK UNITS (AS REFERENCED IN CBC CHAPTER 21; MASONRY) SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH (f'_m) OF 1,500 P.S.I. ALL CONCRETE BLOCK CONSTRUCTION SHALL BE SOLID GROUTED AND CONFORM TO CBC 2105.2.2.1.
 - A.A.C. (AUTOCURED AERATED CONCRETE) MASONRY UNITS AND CONSTRUCTION ARE NOT ALLOWED.
- CONCRETE BLOCK MASONRY UNITS:
 - CONFORM TO CBC SECTION 2103.1 AND ASTM C90, HOLLOW LOAD BEARING CONCRETE MASONRY UNITS.
 - OPEN-END MASONRY UNITS (SPEED BLOCK) ARE ACCEPTABLE (EXCEPT FOR ARCHITECTUALLY EXPOSED CONDITIONS).
 - MEDIUM-WEIGHT AGGREGATE.
- MORTAR:
 - MORTAR SHALL CONFORM TO CBC SECTION 2103.8, ASTM C270, AND ARTICLES 2.1 AND 2.6A OF TMS 602-08/ACI 530.1-08/ASCE 6-08.
 - MORTAR SHALL BE TYPE "M" OR "S"
 - MORTAR SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 1,800 P.S.I. AT 28 DAYS.
- GROUT:
 - GROUT SHALL CONFORM TO CBC SECTION 2103.12, ASTM C476, AND ARTICLE 2.2 OF TMS 602-08/ACI 530.1-08/ASCE 6-08.
 - GROUT SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 2,000 P.S.I. AT 28 DAYS.
- REQUIREMENTS FOR CONCRETE BLOCK CONSTRUCTION SHALL CONFORM TO THE FOLLOWING:
 - CONCRETE BLOCK CONSTRUCTION SHALL CONFORM TO CBC SECTION 2104 AND TMS 602-08/ACI 530.1-08/ASCE 6-08.
 - EVERY OPENING (EXCEEDING 24" IN EITHER DIRECTION) SHALL HAVE A MINIMUM OF 2 #5 (U.N.O.) DIRECTLY ABOVE, BELOW (UNLESS AT FOUNDATION) AND ADJACENT TO BOTH SIDES. REINFORCING BARS SHALL EXTEND A MINIMUM OF 24" PAST EDGE OF OPENING.
 - AT THE END OF ALL WALLS SHALL BE A MINIMUM OF 2 #5 VERTICAL.
 - AT THE TOP OF ALL WALLS SHALL BE A MINIMUM OF 2 #3 HORIZONTAL.
 - DOWEL CONCRETE BLOCK WALLS AND COLUMNS TO SUPPORTING CONCRETE WITH BARS OF THE SAME SIZE AND SPACING AS VERTICAL. SEE NOTES FOR MINIMUM LENGTH OF SPLICE.
 - BOND SHALL BE PROVIDED BY LAPPING UNITS IN SUCCESSIVE VERTICAL COURSES (RUNNING BOND). STACK BOND OR MECHANICAL ANCHORAGE SHALL NOT BE USED UNLESS SPECIFICALLY NOTED OR DETAILED OTHERWISE.
 - AT THE TIME OF LAYING ALL MASONRY UNITS SHALL BE FREE OF EXCESSIVE DUST AND DIRT.
 - GROUTING OPERATIONS, MAXIMUM GROUT POUR HEIGHT AND USE OF CLEANOUTS SHALL CONFORM TO TMS 602-08/ACI 530.1-08/ASCE 6-08. SPECIFICATIONS ARTICLE 3.5 AND TABLE 7. CLEANOUTS (IF REQUIRED) SHALL BE PROVIDED BY SUITABLE "C" OPENINGS IN THE FACE SHELLS IN THE BOTTOM COURSE OF EACH CELL TO BE GROUTED, OR OTHER APPROVED LOCATIONS (SEE DETAILS PROVIDED). THE CLEANOUTS SHALL BE SEALED AFTER INSPECTION AND BEFORE GROUTING.
 - ALL CELLS SHALL BE FILLED SOLIDLY WITH GROUT. GROUT SHALL BE WORKABLE MIX SUITABLE FOR PUMPING WITHOUT SEGREGATION AND SHALL BE THOROUGHLY MIXED. GROUT SHALL BE PLACED BEFORE INITIAL SET OR HARDENING OCCURS. GROUT SHALL BE CONSOLIDATED BY MECHANICAL VIBRATION DURING PLACING AND RECONSOLIDATED AFTER EXCESS MOISTURE HAS BEEN ABSORBED BUT BEFORE WORKABILITY IS LOST. THE GROUTING OF ANY SECTION OF A WALL SHALL BE COMPLETED IN ONE DAY WITH NO INTERRUPTIONS GREATER THAN ONE HOUR.
 - WHEN THE GROUTING IS STOPPED FOR ONE HOUR OR LONGER, HORIZONTAL CONSTRUCTION JOINTS SHALL BE FORMED BY STOPPING THE POUR OF GROUT APPROXIMATELY 1-1/2" ABOVE OR BELOW A BED JOINT.
 - ALL REINFORCING SHALL BE PLACED AND SECURED PRIOR TO GROUTING. REINFORCEMENT SHALL BE TMS 602-08/ACI 530.1-08/ASCE 6-08, SECTION 1.15.
- REINFORCING BARS LARGER THAN #8 ARE NOT PERMITTED UNLESS SPECIFICALLY DETAILED OR NOTED OTHERWISE.
- SPECIAL INSPECTION (AS REQUIRED OR SPECIFIED) SHALL CONFORM TO CBC CHAPTER 17.
- AT ALL SPLICES IN REINFORCING (STAGGER SPLICES), LAP (MIN.) BARS AS FOLLOWS:

#3 - 16"

#4 - 20"

#5 - 25"

#6 - 30"

#7 - 35"

#8 - 40"
- THE MINIMUM RADIUS OF BEND FOR REINFORCING STEEL (MEASURED ON THE INSIDE OF THE BAR) SHALL BE AS FOLLOWS:

#3 - 1 1/4"

#4 - 1 1/2"

#5 - 1 5/8"

#6 - 2 1/4"

#7 - 2 5/8"

#8 - 3"
- ALL ANCHOR BOLTS USED IN CONCRETE BLOCK CONSTRUCTION SHALL HAVE A MINIMUM TOTAL EMBEDMENT AS FOLLOWS:

5/8" DIA OR SMALLER-----4"

3/4" DIA-----5"

7/8" DIA-----6"
- LOCATION OF ALL CONSTRUCTION/CONTROL JOINTS, OTHER THAN THOSE SPECIFIED, SHALL BE APPROVED BY THE ARCHITECT/ENGINEER PRIOR TO PLACEMENT.
- UNLESS SPECIFICALLY DETAILED OR NOTED OTHERWISE, VERTICAL CONTROL JOINTS SHALL BE PROVIDED IN ALL CONCRETE BLOCK WALLS, AND SPACED AT A DISTANCE APPROXIMATELY EQUAL TO WALL HEIGHT, (BUT NOT GREATER THAN 24' O.C.). CONTROL JOINTS SHALL EXTEND FULL HEIGHT OF WALL. CONTROL JOINTS SHALL NOT BE REQUIRED WHEN WALL LENGTH DOES NOT EXCEED 1.5 TIMES THE WALL HEIGHT.
- CONCRETE BLOCK WALLS (OF ONE STORY OR TALLER) SHALL BE SECURELY BRACED AND SHORED, BY PROJECT CONTRACTOR, DURING ALL PHASES OF CONSTRUCTION.
- WHEN AMBIENT TEMPERATURE FALLS BELOW 40°F, CONSTRUCTION SHALL CONFORM TO CBC SECTION 2104.3
- WHEN AMBIENT TEMPERATURE FALLS EXCEEDS 90°F, CONSTRUCTION SHALL CONFORM TO CBC SECTION 2104.4

REINFORCING STEEL

- ALL REINFORCING STEEL SHALL BE DEFORMED INTERMEDIATE GRADE BARS CONFORMING TO ASTM A615, GRADE 60 ($F_y = 60$ K.S.I.) UNLESS OTHERWISE NOTED.
 - GRADE 40 MAY BE USED FOR #4 BARS AND SMALLER.
- REINFORCING STEEL SHALL NOT BE WELDED, UNLESS SPECIFICALLY NOTED OTHERWISE.
- WELDING OF REINFORCING STEEL (WHERE SPECIFICALLY NOTED OR DETAILED) SHALL CONFORM TO ACI 318-08, SECTION 3.5.2 AND AWS D1.4. WELDED REBAR SHALL BE LOW-ALLOY STEEL CONFORMING TO ASTM A706.
- TO HOLD REINFORCING BARS IN THEIR TRUE POSITION AND PREVENT DISPLACEMENT, STANDARD TIE AND ANCHORAGE DEVICES MUST BE PROVIDED. PLACING OF REINFORCEMENT SHALL CONFORM TO CBC SECTION 1907.5.
- SHOP DRAWINGS FOR FABRICATION OF ANY REINFORCING STEEL SHALL BE APPROVED BY CONTRACTOR AND SUBMITTED TO ARCHITECT OR ENGINEER, FOR HIS REVIEW, PRIOR TO FABRICATION.
- REFER TO CONCRETE AND CONCRETE BLOCK NOTES FOR MINIMUM SPLICE LENGTH AND MINIMUM RADIUS OF BEND, OF REINFORCING STEEL.
- STAGGER SPLICES IN REINFORCING STEEL, UNLESS SPECIFICALLY NOTED OTHERWISE.
- ALL REINFORCING BAR BENDS SHALL BE MADE COLD.
- FABRICATION, ERECTION AND PLACEMENT OF REINFORCING STEEL SHALL CONFORM TO CONCRETE REINFORCING STEEL INSTITUTE OF STANDARD PRACTICE.
- ALL WELDED WIRE MESH SHALL CONFORM TO ASTM A185. LAP ALL WIRE MESH TWO MODULES.
- REINFORCING STEEL SHALL BE CLEAN OF RUST, GREASE OR OTHER MATERIAL LIKELY TO IMPAIR BOND.
- EPOXY-COATED REINFORCEMENT (WHERE SPECIFICALLY NOTED OR DETAILED) SHALL CONFORM TO ASTM A775.

STRUCTURAL STEEL AND WELDING

- ALL STRUCTURAL STEEL CONSTRUCTION SHALL CONFORM TO AISC 360-05 AND AISC 341-05.
 - FABRICATION OF ALL STRUCTURAL STEEL SHALL BE DONE IN THE SHOP OF AN APPROVED FABRICATOR. INSPECTION AND APPROVAL FOR FABRICATOR'S SHOPS USED FOR FABRICATION OF STRUCTURAL LOAD BEARING MEMBERS, COMPONENTS, MATERIALS OR ASSEMBLIES SHALL CONFORM TO CBC SECTION 1704.2.
- ALL STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING SPECIFICATIONS:
 - ANGLES, CHANNELS, PLATES, BARS, ROUNDS, AND OTHER MISCELLANEOUS SHAPES SHALL CONFORM TO ASTM A-36 AND SHALL HAVE A MINIMUM YIELD STRESS (F_y) OF 36 K.S.I.
 - WIDE-FLANGE SHAPES SHALL CONFORM TO ASTM A992 AND SHALL HAVE A MINIMUM YIELD STRESS (F_y) OF 50 K.S.I.
 - STEEL PIPE COLUMNS SHALL BE WELDED SEAMLESS PIPE CONFORMING TO ASTM A-53, GRADE B, AND SHALL HAVE A MINIMUM YIELD STRESS (F_y) OF 35 K.S.I.
 - STRUCTURAL TUBE COLUMNS SHALL BE ASTM A500 GRADE B, AND SHALL HAVE A MINIMUM YIELD STRESS (F_y) OF 46 K.S.I.
- SPECIAL INSPECTION SHALL BE PROVIDED FOR ALL STRUCTURAL STEEL AND WELDING, IN ACCORDANCE WITH CBC CHAPTER 17.
- ALL STRUCTURAL STEEL SHALL BE FABRICATED, ERECTED AND WELDING IN ACCORDANCE WITH AISC SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS (AISC 360-05) AND CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGE (AISC 303-05).
- ALL WELDING SHALL BE DONE BY QUALIFIED AND CERTIFIED WELDERS.
- NO FIELD WELDING PERMITTED, UNLESS SPECIFICALLY NOTED OTHERWISE.
- SHOP DRAWINGS FOR THE FABRICATION OF ANY STRUCTURAL STEEL SHALL BE APPROVED BY CONTRACTOR AND SUBMITTED TO ARCHITECT OR ENGINEER FOR HIS REVIEW, PRIOR TO FABRICATION.
- NO HOLES OTHER THAN THOSE SPECIFICALLY DETAILED SHALL BE ALLOWED THROUGH STRUCTURAL STEEL MEMBERS. BURNING OF HOLES IS NOT PERMITTED.
- ALL STRUCTURAL STEEL SHALL BE PAINTED ONE SHOP COAT AND FIELD TOUCHED-UP, AS NECESSARY, WITH APPROVED "ZINC RICH" OR OTHER HIGH QUALITY EXTERIOR PRIMER.
- ALL BOLTS SHALL CONFORM TO ASTM, A-307 (U.N.O.).
- ALL WELDING SHALL CONFORM TO AWS D1.1 AND D1.8 SPECIFICATIONS FOR WELDING. (E-70XX ELECTRODES).
- ALL HEADED STUDS (FOR CONCRETE ANCHORAGE) SHALL BE MANUFACTURED BY NELSON OR APPROVED EQUAL.
- WHERE FILLET WELD SIZE IS NOT INDICATED, USE AWS' MINIMUM SIZE BASED ON THE THICKNESS OF THE THINNER PART BEING WELDED, AS SPECIFIED IN AISC SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS (AISC 360-05), SECTION J2.2.
- ALL BUTT WELDS TO BE FULL PENETRATION, UNLESS SPECIFICALLY NOTED OTHERWISE.
- WELDER QUALIFICATION REQUIREMENTS, WELDING PROCEDURE AND WELDING ELECTRODES FOR ALL STRUCTURAL STEEL (EXCEPT STRUCTURAL SHEET STEEL, SEE STEEL DECKING) SHALL CONFORM TO CBC SECTIONS 1704.3.1 AND 2204.1.
- PROVIDE HOT DIP GALVANIZING OR 3" MINIMUM CONCRETE COVER AROUND ALL STRUCTURAL STEEL BELOW GRADE.
- STRUCTURAL STEEL EMBEDDED INTO CONCRETE OR MASONRY SHALL BE UNPAINTED.

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007



971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/17/11

SIGNED

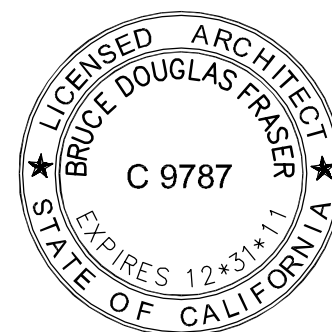

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

GENERAL STRUCTURAL NOTES

SHEET #

S1.0

GENERAL STRUCTURAL NOTES (CONTINUED)

ABBREVIATIONS

LUMBER/TIMBER

1. LUMBER GRADES, MINIMUM (U.N.O.): DOUGLAS FIR-LARCH
- 2x STUDS, BLOCKING & PLATES:
BEARING WALLS #2 OR BETTER
NON-BEARING WALLS #2 OR BETTER
2x JOISTS #1 OR BETTER
4x BEAMS #1 OR BETTER
6x BEAMS SELECT STRUCTURAL BETTER
EXPOSED (INT/EXT) #1 OR BETTER
NON-EXPOSED #2 OR BETTER
4x POSTS #1 OR BETTER
6x POSTS
2. FOUNDATION SILL PLATES SHALL BE CALIFORNIA REDWOOD (CLOSE GRAIN) OR PRESERVATIVE-TREATED (SEE CBC SECTION 2303.1.8) DOUGLAS FIR. SEE SHEAR WALL SCHEDULES AND FOUNDATION PLAN FOR ANCHOR BOLT SIZE AND SPACING. SEE FASTENERS NOTE #10 AND CARPENTRY/FRAMING NOTE #6.
3. PLYWOOD SHALL BE STRUCTURAL I WITH EXTERIOR GLUE, AS GRADED BY THE APA. PLYWOOD SHALL CONFORM TO CBC SECTION 2303.1.4 AND UNITED STATES PRODUCT STANDARD PS 1 OR PS 2 (FOR O.S.B.).
4. ALL SAWN LUMBER OR TIMBER SHALL CONFORM TO CBC SECTION 2303.1.1.
5. MAXIMUM MOISTURE CONTENT FOR ALL STRUCTURAL MEMBERS SHALL NOT EXCEED 19% (UNLESS SPECIFICALLY NOTED OTHERWISE).
6. TREAT ENDS OF ALL CUT PRESERVATIVE TREATED LUMBER.

FASTENERS

1. NAILING FOR FRAMING SHALL BE WITH 'COMMON' NAILS (U.N.O.).
2. LAG SCREWS SHALL BE SCREWED INTO PREDRILLED HOLES. CLEARANCE HOLE FOR THE SHANK PORTION AND LEAD HOLE FOR THREADED PORTION SHALL BE DRILLED IN ACCORDANCE WITH U.D.S.-05 SECTION 11.1.3.
3. BOLTS (BOLT HEAD AND NUT) SHALL HAVE STANDARD CAST IRON MALLEABLE IRON WASHERS (UNLESS USED WITH METAL SIDE PLATES OR ANGLES).
4. BOLT HOLES THROUGH LUMBER SHALL BE DRILLED 1/16" LARGER THAN BOLT DIAMETER.
5. ALL BOLTS SHALL CONFORM TO ASTM A-307.
6. BOLT TIGHTENING: TAKE UP SNUG AND RETIGHTEN AT THE LATEST PRACTICABLE TIME DURING CONSTRUCTION.
7. NAILS SHALL NOT BE DRIVEN CLOSER THAN 1/2 OF THEIR LENGTH, NOT CLOSER TO THE EDGE OF THE MEMBER THAN 1/4 LENGTH, EXCEPT FOR SHEATHING.
8. SUB-BORE WHEN NAILS TEND TO SPLIT WOOD. SUB-BORE FOR 20d AND LARGER NAILS. DRILL DIAMETER SHALL BE 0.75 TIMES NAIL DIAMETER.
9. PROVIDE 3"x3"x1/4" STEEL PLATE WASHER (AS PER CBC SECTION 2308.12.8) AT ALL SHEAR WALL SILL PLATE ANCHOR BOLTS.
10. FASTENERS IN PRESERVATIVE-TREATED LUMBER SHALL BE STAINLESS STEEL, SILICON BRONZE, COPPER OR HOT-DIP ZINC COATED GALVANIZED STEEL FASTENERS.
A. ZINC-COATED FASTENERS SHALL CONFORM TO ASTM A153.

CARPENTRY/FRAMING

1. CARPENTRY AND FRAMING SHALL CONFORM TO CBC SECTION 2308.
A. SEE CBC TABLE 2304.9.1 FOR MINIMUM NAILING REQUIREMENTS.
2. METAL FRAMING ANGLES, ANCHORS, CLIPS, STRAPS, TIES, HOLD-DOWNS, ETC. SHALL BE MANUFACTURED BY 'SIMPSON STRONG-TIE CO' OR AN APPROVED (SEE CBC SECTION 1715.1) EQUAL.
3. PLYWOOD USED IN ROOFS, FLOORS AND DECKS, SHALL BE PLACED WITH FACE GRAIN PERPENDICULAR TO SUPPORTS. PLYWOOD SHEETS SHALL BE STAGGERED.
4. FACE NAIL ALL DOUBLE (AND TRIPLE) 2x STUDS AND JOISTS TOGETHER WITH 16d AT 12" O.C., STAGGER NAILS TOP & BOTTOM.
5. PROVIDE 2x SOLID FIRE BLOCKING IN ALL STUD WALLS AT 8'-0" (MAX.) VERTICAL SPACING.
6. UNLESS OTHERWISE NOTED, THE MINIMUM SILL PLATE BOLTING SHALL BE 1/2" DIA. X 10" ANCHOR BOLT AT 8'-0" O.C. THERE SHALL BE A MINIMUM OF TWO BOLTS PER PLATE WITH ONE BOLT WITHIN 8" TO 12" OF EACH END OF PLATE. SEE LUMBER/TIMBER NOTE #2 AND FASTENERS NOTE #10.
A. AT ALL BUILDINGS OVER 2 STORIES PROVIDE 1/2" DIA X 10" ANCHOR BOLT @ 4'-0" O.C., MINIMUM, U.N.O..
7. INTERIOR NON-BEARING, NON-SHEAR, STUD WALL SILL PLATES MAY BE SECURED TO CONCRETE SLABS WITH 'HILTI' TYPE X-U (WITH 1" MINIMUM EMBEDMENT) SHOT PINS @ 16" O.C. WITH STEEL WASHERS INSTALLATION SHALL CONFORM TO ICC ESR-2268.
8. IN GENERAL, PLYWOOD PANEL EDGES (FOR SHEAR WALLS, ROOFS, FLOORS AND DECKS) SHALL BEAR ON FRAMING MEMBERS (2x MINIMUM) AND BUTT ALONG THEIR CENTER LINES.
9. PLACE BEAMS WITH NATURAL CAMBER UPWARD.
10. PROVIDE CONTINUOUS DOUBLE 2x WALL WIDTH (2x4, MIN) AT TOP OF ALL BEARING WALLS AND 2x WALL WIDTH BOTTOM OR SILL PLATE AT BOTTOM OF WALL. UNLESS OTHERWISE SPECIFICALLY NOTED OR DETAILED SPLICES IN CONTINUOUS DOUBLE 2x TOP PLATES SHALL BE LAPPED 4'-0" (MIN.) WITH 16d AT 3" O.C. (STAGGERED).
11. WHERE WOOD STUD WALLS ABUT CONCRETE OR MASONRY WALLS, THE END STUD (P.T.D.F. OR REDWOOD) SHALL BE BOLTED TO CONCRETE/MASONRY WITH 5/8" DIA. A.B. (WITH EMBEDMENT OF 2/3 WALL THICKNESS) 12" FROM TOP AND BOTTOM OF STUD AND AT 4'-0" O.C.
12. PROVIDE 2x SOLID BLOCKING BETWEEN ALL JOISTS AND RAFTERS AT ALL SUPPORTS AND UNDER ALL PARTITIONS. PROVIDE DOUBLE 2x JOISTS DIRECTLY BELOW ALL INTERIOR PARTITION WHERE FRAMING IS PARALLEL. PROVIDE 2x SOLID BLOCKING (OR APPROVED BRIDGING) AT 8'-0" O.C. BETWEEN 2x12 AND LARGER JOIST AND RAFTERS. BLOCKING SHALL BE FULL DEPTH OF JOISTS AND RAFTERS.
13. NO STRUCTURAL MEMBERS (JOISTS, PLATES, STUDS, BEAMS, COLUMNS, GIRDER, POST, TRUSS, ETC.) SHALL BE NOTCHED, CUT OR DRILLED (EXCEPT FOR THOSE HOLES REQUIRED FOR BOLTING) UNLESS SPECIFICALLY NOTED (SEE NOTE #14 & #15) OR DETAILED OTHERWISE, OR WITH WRITTEN APPROVAL FROM ARCHITECT/ENGINEER.
14. HOLES AND NOTCHES IN JOISTS:
A. NOTCHING AT THE ENDS OF ROOF OR CEILING JOISTS SHALL NOT EXCEED ONE-FOURTH THE JOIST DEPTH. NOTCHES IN THE TOP & BOTTOM OF JOISTS (2x SAWN LUMBER) SHALL NOT EXCEED ONE SIXTH THE DEPTH AND SHALL NOT BE LOCATED IN THE MIDDLE THIRD OF THE SPAN.
B. HOLES BORED IN JOISTS SHALL NOT EXCEED ONE THIRD OF JOIST DEPTH AND SHALL BE LOCATED WITHIN MIDDLE 2/3 OF SPAN AND WITHIN THE MIDDLE THIRD OF JOISTS DEPTH (2" MINIMUM CLEAR TOP AND BOTTOM).
15. HOLES AND NOTCHES IN STUDS, PLATES AND SILLS: BORED HOLES MAY BE PLACED IN STUDS, PLATES AND SILLS PROVIDED THEY ARE ACCURATELY CENTERED ABOUT STUD, SPACED A MINIMUM OF 12" APART AND HOLE DIAMETER DOES NOT EXCEED 25% OF STUD WIDTH. STUDS MAY BE NOTCHED PROVIDED NOTCH DEPTH DOES NOT EXCEED 25% OF STUD WIDTH. WHEN BORED HOLE EXCEEDS 25% OF STUD WIDTH, REINFORCE PLATE, SILL OR STUDS AS FOLLOWS:
A. PLATES: 1-1/2" X 1/8" STRAP EACH SIDE OF PLATE NAILED WITH 8 - 16d NAILS EACH SIDE OF HOLE. HOLES OVER 40% OF THE PLATE WIDTH ARE NOT PERMITTED IN ANY PLATE. ANY PIPE OR CONDUIT REQUIRING A HOLE LARGER THAN 40% OF THE PLATE WIDTH SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY.
B. SILLS: SPLICE IN A MANNER SIMILAR TO PLATES ABOVE, AT HOLES BETWEEN 25% AND 40% OF SILL WIDTH. SILLS MAY BE COMPLETELY CUT ON EACH SIDE OF A PIPE OR CONDUIT PROVIDED AN ADDITIONAL ANCHOR BOLT OR 6 - 16d IS PLACED WITHIN 9" OF THE END OF THE SILL, EACH SIDE OF THE PIPE OR CONDUIT.
C. STUDS: BLOCK ON EACH SIDE OF STUD WITH BLOCK OF SAME MATERIAL AND DIMENSION AS STUD. EXTEND 2 STUD WIDTHS EACH SIDE OF HOLE AND PROVIDE 3 - 16d NAILS TO STUD EACH SIDE OF HOLE. BORED HOLES GREATER THAN 40%, BUT LESS THAN 80% OF THE WIDTH OF THE STUD ARE PERMITTED, WHERE EACH STUD IS DOUBLED AND NOT MORE THAN TWO SUCCESSIVE DOUBLE STUDS ARE SO BORED AND EACH BORED STUD IS REINFORCED AS ABOVE.
D. BORED HOLES SHALL NOT BE LOCATED AT THE SAME SECTION OF STUD AS A CUT OR NOTCH.
16. PLYWOOD SHEAR WALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH CBC SECTION 2306.3. NO OPENINGS ARE ALLOWED IN SHEAR WALLS, UNLESS SPECIFICALLY NOTED OR DETAILED.
A. PROVIDE 3"x3"x1/4" STEEL PLATE WASHERS AT ANCHOR BOLTS AT ALL SHEAR WALLS.
B. SEE ALSO FASTENERS NOTE NO. 9
17. FRAMING AROUND FLUES AND CHIMNEYS SHALL CONFORM TO CBC SECTION 2304.5.
18. PIPES IN WALLS SHALL CONFORM TO CBC SECTION 2308.9.8.

STRUCTURAL 'GLUED-LAMINATED' LUMBER

1. ALL GLUED-LAMINATED LUMBER OR TIMBER SHALL BE OF THE FOLLOWING:
A. STANDARD GLUED-LAMINATED BEAMS (G.L.B.) SHALL BE 2400F DOUGLAS FIR, (24F-V8 DFD) INDUSTRIAL APPEARANCE GRADE AND CONFORM TO ASTM D3737 AND AITC 190.1. (24F-V4-D/DF MAY BE USED FOR SIMPLE SPANS AS SPECIFIED ON FRAMING PLANS)
F_b = 2,400 P.S.I.
F_v = 165 P.S.I.
F_a = 450 P.S.I.
E = 1,800,000 P.S.I.
- B. ROSBORO BIGBEAMS (R.B.B.) SHALL BE 2.1E AND CONFORM TO ANSI A190.1-2:
F_b = 3,000 P.S.I. (2,800 P.S.I. FOR 7x BEAMS)
F_v = 300 P.S.I.
F_a = 650 P.S.I.
E = 2,100,000 P.S.I.
2. THE MANUFACTURE OF THE GLUED-LAMINATED LUMBER SHALL BE IN ACCORDANCE WITH THE LATEST STANDARD SPECIFICATIONS FOR STRUCTURAL GLUE-LAMINATED TIMBER BY THE AITC
3. AITC INSPECTION CERTIFICATES SHALL BE SUPPLIED TO THE BUILDING OFFICIAL FOR APPROVAL, PRIOR TO INSTALLATION.
4. BEAMS SHALL BE END SEALED AGAINST THE ELEMENTS/WEATHER AND LOAD WRAPPED FOR PROTECTION DURING SHIPMENT.
5. THE BEAMS SHALL HAVE STANDARD CAMBER UNLESS SPECIFICALLY CALLED OUT OTHERWISE ON DRAWINGS.
6. SHOP DRAWINGS FOR THE FABRICATION OF GLUE-LAMINATED TIMBER, SHALL BE APPROVED BY CONTRACTOR AND SUBMITTED TO THE ARCHITECT/ENGINEER FOR HIS REVIEW, PRIOR TO INSTALLATION.
7. GLUED-LAMINATED BEAMS SHALL NOT BE NOTCHED, OR HAVE HOLES DRILLED THROUGH UNLESS SPECIFICALLY NOTED OTHERWISE.
8. INSPECTION AND APPROVAL FOR FABRICATOR'S SHOPS USED FOR FABRICATION OF STRUCTURAL LOAD BEARING MEMBERS, COMPONENTS, MATERIALS OR ASSEMBLIES SHALL CONFORM TO CBC SECTION 1704.2.
A. LABELING (AS REQUIRED OR SPECIFIED) SHALL BE PROVIDED IN ACCORDANCE WITH CBC SECTION 1703.5.
B. EVALUATION AND FOLLOW-UP INSPECTION SERVICES (AS REQUIRED OR SPECIFIED), SHALL CONFORM TO CBC SECTION 1703.6.

'REDBUILT' STRUCTURAL COMPOSITE LUMBER AND PLYWOOD WEB TRUSSES

1. ALL STRUCTURAL COMPOSITE LUMBER OR TIMBER SHALL BE OF THE FOLLOWING:
A. STANDARD LAMINATED VENEER LUMBER (LVL) MATERIAL SHALL CONFORM TO ASTM D5456:
F_b = 2,900 P.S.I.
F_v = 285 P.S.I.
F_a = 750 P.S.I.
E = 2,000,000 P.S.I.
2. STANDARD LVL MATERIAL SHALL BE 'REDLAM LAMINATED VENEER LUMBER' AS MANUFACTURED BY REDBUILT (ICC ESR-2993).
3. BEAMS SHALL BE END SEALED AGAINST THE ELEMENTS/WEATHER AND LOAD WRAPPED FOR PROTECTION DURING SHIPMENT
4. BEAMS SHALL HAVE STANDARD CAMBER UNLESS SPECIFICALLY CALLED OUT OTHERWISE ON DRAWINGS.
5. BEAMS SHALL NOT BE NOTCHED, OR HAVE HOLES DRILLED THROUGH UNLESS SPECIFICALLY NOTED OTHERWISE.
6. ALL PREFABRICATED PLYWOOD WEB TRUSSES (I-JOISTS) SHALL CONFORM TO ASTM D5055.
A. PLYWOOD WEB TRUSSES SHALL BE 'RED-I' JOISTS AS MANUFACTURED BY REDBUILT (ICC ESR-2993 AND ESR-2994)
7. EACH TRUSS SHALL BE LEGIBLY BRANDED, MARKED OR OTHERWISE HAVE PERMANENTLY AFFIXED THERETO THE FOLLOWING INFORMATION LOCATED WITHIN 2 FEET OF THE CENTER OF THE SPAN ON THE FACE OF THE BOTTOM CHORD:
A. IDENTITY OF THE COMPANY MANUFACTURING THE TRUSS.
B. THE DESIGN LOAD.
C. THE SPACING OF THE TRUSSES.
8. PRIOR TO FABRICATION OF TRUSSES, CONTRACTOR SHALL SUBMIT TRUSS DESIGN, CALCULATIONS AND DETAILS (AS PROVIDED BY TRUSS MANUFACTURER) TO ARCHITECT/ENGINEER FOR HIS REVIEW, AND TO THE LOCAL BUILDING DEPARTMENT FOR THEIR APPROVAL.
9. TRUSSES SHALL BEAR ON 'BEARING WALLS' ONLY.
10. INTERIOR NON-BEARING WALLS' SHALL BE ISOLATED FROM VERTICAL TRUSS LOADS.
11. TRUSSES SHALL BE BLOCKED AS PER MANUFACTURER'S RECOMMENDATIONS IN ADDITION TO:
A. ALL BEARING POINTS
B. RIDGE
12. TRUSSES SHALL BE INSTALLED WITH ALL BEARING HARDWARE, BRIDGING, BLOCKING, BRACING, PRE-NOTCHED BEARING PLATES OR BEVELED BEARING PLATES AS PER MANUFACTURER'S RECOMMENDATIONS AND THESE DRAWINGS. THE PRECEDING ITEMS SHALL BE INSTALLED PRIOR TO ANY TRUSS LOADING.
13. IF TRUSSES ARE TO BE STORED PRIOR TO ERECTION, THEY SHALL BE STORED IN A VERTICAL POSITION AND PROTECTED FROM THE WEATHER.
14. TEMPORARY CONSTRUCTION LOADS SHALL NOT BE PLACED ON TRUSSES UNTIL TRUSSES ARE SECURED AND ALL ERECTION HARDWARE (BLOCKING, BRIDGING, BRACING, BEARING HARDWARE, ETC.) HAS BEEN PLACED. TEMPORARY CONSTRUCTION LOADS SHALL NOT EXCEED ROOF LIVE LOAD.
15. IF ERECTION BRACING IS SPECIFIED, THEN BRACING SHALL REMAIN IN PLACE UNTIL FLOOR/ROOF SHEATHING IS PLACED AND NAILED (OR FASTENED).
16. PROVIDE FLOOR TRUSS (OR 2x BLOCKING @ 2' O.C.) BELOW ALL INTERIOR WALLS, UNLESS OTHERWISE NOTED OR DETAILED.
17. TRUSS DESIGN CRITERIA:
ROOF: DEAD LOAD = 16 P.S.F.
LIVE LOAD = 20 P.S.F.
FLAT ROOF = 20 P.S.F.
ROOF SLOPE EQUAL TO OR GREATER THAN 4/12 = 20 P.S.F.
DEFLECTION = L/240, DEAD PLUS LIVE LOAD
18. INSPECTION AND APPROVAL FOR FABRICATOR'S SHOPS USED FOR FABRICATION OF STRUCTURAL LOAD BEARING MEMBERS, COMPONENTS, MATERIALS OR ASSEMBLIES SHALL CONFORM TO CBC SECTION 1704.2.
A. LABELING (AS REQUIRED OR SPECIFIED) SHALL BE PROVIDED IN ACCORDANCE WITH CBC SECTION 1703.5.
B. EVALUATION AND FOLLOW-UP INSPECTION SERVICES (AS REQUIRED OR SPECIFIED), SHALL CONFORM TO CBC SECTION 1703.6.

OPEN WEB TRUSSES

1. OPEN WEB TRUSSES SHALL BE MANUFACTURED BY REDBUILT (ICC ESR-1774), OR APPROVED EQUAL.
A. INSPECTION AND APPROVAL FOR FABRICATOR'S SHOPS USED FOR FABRICATION OF STRUCTURAL LOAD BEARING MEMBERS, COMPONENTS, MATERIALS OR ASSEMBLIES SHALL CONFORM TO CBC SECTION 1704.2.
2. EACH TRUSS SHALL BE LEGIBLY BRANDED, MARKED OR OTHERWISE HAVE PERMANENTLY AFFIXED THERETO THE FOLLOWING INFORMATION LOCATED WITHIN 2 FEET OF THE CENTER OF THE SPAN ON THE FACE OF THE BOTTOM CHORD:
A. IDENTITY OF THE COMPANY MANUFACTURING THE TRUSS.
B. THE DESIGN LOAD.
C. THE SPACING OF THE TRUSSES.
3. PRIOR TO FABRICATION OF TRUSSES, CONTRACTOR SHALL SUBMIT TRUSS DESIGN, CALCULATIONS AND DETAILS (AS PROVIDED BY TRUSS MANUFACTURER) TO ARCHITECT/ENGINEER FOR HIS REVIEW AND TO THE LOCAL BUILDING DEPARTMENT FOR THEIR APPROVAL.
4. TRUSSES SHALL BEAR ON 'BEARING WALLS' ONLY.
A. INTERIOR NON-BEARING WALLS' SHALL BE ISOLATED FROM VERTICAL TRUSS LOADS.
5. TRUSSES SHALL BE BLOCKED AS PER MANUFACTURER'S RECOMMENDATIONS IN ADDITION TO:
A. ALL BEARING POINTS.
B. RIDGE.
6. TRUSSES SHALL BE INSTALLED WITH ALL BEARING HARDWARE, BRIDGING, BLOCKING, BRACING, PRE-NOTCHED BEARING PLATES OR BEVELED BEARING PLATES AS PER MANUFACTURER'S RECOMMENDATIONS AND THESE DRAWINGS. THE PRECEDING ITEMS SHALL BE INSTALLED PRIOR TO ANY TRUSS LOADING.
7. SEE TRUSS PROFILES (AS PROVIDED).
8. IF TRUSSES ARE TO BE STORED PRIOR TO ERECTION, THEY SHALL BE STORED IN A VERTICAL POSITION AND PROTECTED FROM THE WEATHER.
9. TEMPORARY CONSTRUCTION LOADS SHALL NOT BE PLACED ON TRUSSES UNTIL TRUSSES ARE SECURED AND ALL ERECTION HARDWARE (BLOCKING, BRIDGING, BRACING, BEARING HARDWARE, ETC.) HAS BEEN PLACED. TEMPORARY CONSTRUCTION LOADS SHALL NOT EXCEED ROOF LIVE LOAD.
10. IF ERECTION BRACING IS SPECIFIED, THEN BRACING SHALL REMAIN IN PLACE UNTIL FLOOR/ROOF SHEATHING IS PLACED AND NAILED (OR FASTENED).
11. TRUSS DESIGN CRITERIA:
ROOF: DEAD LOAD = 16 P.S.F.
LIVE LOAD = 20 P.S.F.
FLAT ROOF = 20 P.S.F.
ROOF SLOPE EQUAL TO OR GREATER THAN 4/12 = 20 P.S.F.
DEFLECTION = L/240, DEAD PLUS LIVE LOAD

STRUCTURAL DESIGN VALUES

WIND DESIGN DATA

BASIC WIND SPEED (3-SEC GUST) 85 MPH
WIND IMPORTANCE FACTOR I = 1.15
WIND EXPOSURE(S) B
APPLICABLE INTERNAL PRESSURE COEFFICIENT .18

EARTHQUAKE DESIGN DATA

SEISMIC IMPORTANCE FACTOR I = 1.25
OCCUPANCY CATEGORY III
MAPPED SPECTRAL RESPONSE ACCELERATIONS S₁ = .905 S₁ = .311
SITE CLASS D
SPECTRAL RESPONSE COEFFICIENTS S_{0s} = 0.69 S_{0i} = 0.37
SEISMIC DESIGN CATEGORY D
BASIC SEISMIC - FORCE RESISTING SYSTEM(S) 13. LIGHT-FRAMED WALLS SHEATHED WITH PLYWOOD

7. SPECIAL REINFORCED MASONRY SHEAR WALLS

DESIGN BASE SHEAR V_{16s} = 47.8K V_{16v} = 39.2K
SEISMIC RESPONSE COEFFICIENT(S) C_s = .133 / .173
RESPONSE MODIFICATIONS FACTOR(S) R = 6.5 / 5.0
ANALYSIS PROCEDURE USED EQUIVALENT LATERAL FORCE PROCEDURE (ASCE 7 12.8)

LIVE LOAD DATA

ROOF LIVE LOAD 20 psf

@ A.B. ABV. ACI ASC	AT ANCHOR BOLT ABOVE AMERICAN CONCRETE INSTITUTE AMERICAN INSTITUTE OF STEEL CONSTRUCTION AMERICAN INSTITUTE OF TIMBER CONSTRUCTION	I.B.C. I.C.C. I.D. IN. INT.	INTERNATIONAL BUILDING CODE INTERNATIONAL CODE COUNCIL INSIDE DIAMETER INCH, INCHES INTERIOR
ATC	LL LIVE LOAD ALUM. ALUMINUM A.O.R. ARCHITECT OF RECORD APA AMERICAN PLYWOOD ASSOCIATION A.P.B. ANTHONY POWER BEAM APPROX. APPROXIMATELY ARCH. ARCHITECTURE ASTM AMERICAN SOCIETY OF TESTING AND MATERIALS	JST., JSTS.	JOIST, JOISTS
ATR AWS A.Y.C.	ALL THREAD ROD AMERICAN WELDING SOCIETY ALASKAN YELLOW CEDAR	LL LIVE LOAD LTWT. L.S.L. L.V.L.	LIVE LOAD LIGHTWEIGHT LAMINATED STRAND LUMBER LAMINATED VENEER LUMBER
BLDG. BLK. BLKG. BIM. BMS. B.O. BOT. BRG. BT. BTR.	BUILDING BLOCK BLOCKED BLOCKING BEAM BEAMS BOTTOM OF BOTTOM BEARING BETWEEN BETTER	MAX. M.B. M.B.M. MECH. MFR. MIN. M.L. MTD. MTL.	MAXIMUM MACHINE BOLT METAL BUILDING MANUFACTURER MECHANICAL MANUFACTURED MINIMUM MICRO-LAM BEAM MOUNTED METAL
CAC CANT. CBC C.J. C.J.P. C.I. CLG. CLR. C.M.U. COL. CONC. CONC. BLK. CONN. CONST. CONT. C.O.S.	CALIFORNIA ADMINISTRATIVE CODE CANTILEVER CALIFORNIA BUILDING CODE CONTROL JOINT COMPLETE JOINT PENETRATION CENTERLINE CEILING CLEAR CONCRETE MASONRY UNIT COLUMN CONCRETE CONCRETE BLOCK CONNECTION CONSTRUCTION CONTINUOUS CORNER OF STUD	(N) N.T.S.	NEW NOT TO SCALE
Ø Ø DBL. DCW DET. DEMO DF. DIAG. D.L. D.S.A. DWGS.	DIAMETER PENNY DOUBLE DEMAND CRITICAL WELD DETAIL DEMOLITION DOUGLAS FIR DIAGONAL DEAD LOAD DIVISION OF STATE ARCHITECT DRAWINGS	O.A. O.C. O.D. O.S.B. OSHPD	OVERALL ON CENTER OUTSIDE DIAMETER ORIENTED STRAND BOARD OFFICE OF STATE HEALTH PLANNING AND DEVELOPMENT
EA. ELEC. ELEV. EMBED. E.N. E.O.R. EQUIP. E.S. E.S.R. E.W. EXIST., (E) EXT.	EACH ELECTRIC, ELECTRICAL ELEVATION EMBEDDED, EMBEDMENT EDGE NAILING ENGINEER OF RECORD EQUIPMENT EXTRA STRONG ENGINEERING SERVICE REPORT EACH WAY EXISTING EXTERIOR	PEN. PL. PLYWD. P.J.P. P.O.C. P.S.I. P.S.L P.T.D.F. P.W.	PENETRATION PLATE PLYWOOD PARTIAL JOINT PENETRATION PORT ORFORD CEDAR POUNDS PER SQUARE INCH PARALLEL STRAND LUMBER (PARALAM) PRESSURE TREATED DOUGLAS FIR PUDDLE WELD
FAB. FDN. FOUND. F.F. FLR. F.O. F.O.C. F.O.C.B. F.O.S. F.P. FRMG. FT. FTG.	FABRICATED FOUNDATION FINISH FLOOR FLOOR FACE OF FACE OF CONCRETE FACE OF CONCRETE BLOCK FACE OF STUD FULL PENETRATION FRAMING FOOT, FEET FOOTING	Q.A. Q.C.	QUALITY ASSURANCE QUALITY CONTROL
GA. G.L.B. GYP. BD.	GAUGE GLU-LAMINATED BEAM GYPSUM BOARD	RBB RBS REDWOOD REBAR REINF. RET. REQD	ROSBORO BIGBEAM REDUCED BEAM SECTION REDWOOD REINFORCING BAR REINFORCEMENT RETAINING REQUIRED
HDR. HD. HOR., HORIZ. H.S.B. H.S.S. HT.	HEADER HOLD-DOWN HORIZONTAL HIGH STRENGTH BOLT HOLLOW STEEL SECTION HEIGHT	RBB RBS REDWOOD REBAR REINF. RET. REQD	ROSBORO BIGBEAM REDUCED BEAM SECTION REDWOOD REINFORCING BAR REINFORCEMENT RETAINING REQUIRED
		S.F. SHT. SHTG SIM. (SIM) SLRS SQ. S.S. STAGGDD STAND. STD. STL. S.W. SW SSW	SQUARE FEET SHEET SHEATHING SIMILAR SEISMIC LOAD RESISTING SYSTEM SQUARE SELECT STRUCTURAL STAGGERED STANDARD STEEL SLOT WELD STRONG WALL STEEL STRONG WALL
		T&G T.O. T.O.C. T.O.F. T.O.S. T.O.W. T.S. TYP. (TYP)	TONGUE AND GROOVE TOP OF TOP OF CONCRETE TOP OF FOOTING TOP OF SLAB TOP OF WALL TUBE SECTION TYPICAL
		UNBLKD. U.O.N., U.N.O. U.R.M.	UNBLOCKED UNLESS OTHERWISE NOTED UNREINFORCED MASONRY
		VERT. V.I.F.	VERTICAL VERIFY IN FIELD
		w/ WD. W.S.M.F. WSS WT. W.W.M.	WITH WOOD WELDED STEEL MOMENT FRAME WELDED STEEL STUD WEIGHT WELDED WIRE MESH

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007



971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

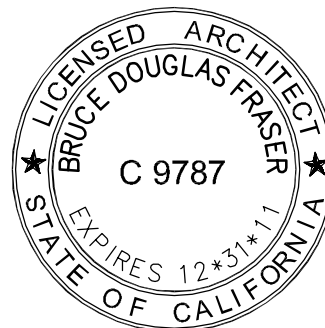

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

GENERAL
STRUCTURAL
NOTES,
ABBREVIATIONS

SHEET #

S1.1

SHEARWALL SCHEDULE

SYMBOL	SHEATHING (2)	NAILING (1)	SILL PLATE CONNECTION	HOLDOWN ANCHOR (5)
A	1/2" PLYWOOD (1)	10d @ 6 / 6 / 12" O.C.	5/8"Ø (14) @32" O.C. (3)	
B	1/2" PLYWOOD (1)	10d @ 4 / 4 / 12" O.C.	5/8"Ø (14) @32" O.C. (3)	

SHEARWALL SCHEDULE NOTES:

- "COMMON" TYPE NAILS.
A. FASTENERS IN PRESERVATIVE-TRATED LUMBER SHALL BE STAINLESS STEEL, SILICON BRNZE, COPPER OR HOT DIP ZINC COATED GALVANIZED STEEL FASTENERS.
B. ZINC-COATED FASTENERS SHALL CONFORM TO A.S.T.M. A153.
- STRUCTURAL 1 DOUGLAS FIR-LARCH PLYWOOD WITH ALL EDGES BLOCKED.
- 2x P.T.D.F. SILL PLATE, MINIMUM TWO ANCHOR BOLTS PER PLATE WITH ONE ANCHOR BOLT 6" TO 12" FROM EACH END OF PLATE. PROVIDE 3"x3"x1/4" PLATE WASHERS AT ALL ANCHOR BOLTS.
- 3x P.T.D.F. SILL PLATE MINIMUM TWO ANCHOR BOLTS PER PLATE WITH ONE ANCHOR BOLT 6" TO 12" FROM EACH END OF PLATE. PROVIDE 3"x3"x1/4" PLATE WASHERS AT ALL ANCHOR BOLTS.
- "SIMPSON STRONG TIE" OR APPROVED EQUAL.
- SPACED EVENLY.
- ALL EDGES BLOCKED.
- SHEATHING SHALL BE CONTINUOUS ENTIRE HEIGHT OF WALL (FLOOR TO FLOOR, OR FLOOR TO ROOF).
- CONTINUE SHEATHING (AND NAILING) OVER SIDE OF HEADER OR BEAM DIRECTLY ABOVE SHEAR WALL.
- CONTINUE SHEATHING (AND NAILING) OVER SIDE OF POST AT END OF SHEAR WALL.
- 3x (MINIMUM) STUDS AND BLOCKING AT ALL ABUTTING PANEL EDGES. STAGGER NAILING AT ALL ADJOINING PANEL EDGES.
- PLYWOOD BOTH SIDES: PANEL JOINTS SHALL BE OFFSET TO FALL ON DIFFERENT FRAMING MEMBERS OR FRAMING SHALL BE 3x (MINIMUM). NAILS SHALL BE STAGGERED ON EACH SIDE.
- STAGGER NAILING AT SILL / BOTTOM PLATE.
- HILTI KWIK BOLT TZ
A. 3 5/8" EMBED
B. ICC - ESR 1917
C. SEE SPECIAL INSPECTION NOTES, SHEET S1.2

SPECIAL INSPECTIONS

A. SPECIAL INSPECTION GENERAL NOTES

- ALL SPECIAL INSPECTION SHALL BE PROVIDED IN ACCORDANCE WITH CBC SECTION 1704 AND 1705.
- WHERE SPECIAL INSPECTION IS REQUIRED, ALL INSPECTION OR TESTING SHALL BE PROVIDED BY AN "APPROVED AGENCY" IN ACCORDANCE WITH CBC SECTION 1702.1, 1703.1 AND 1704.1
- SPECIAL INSPECTORS SHALL KEEP RECORDS OF INSPECTIONS. THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL, AND TO THE ARCHITECT OR ENGINEER. REPORTS SHALL INDICATE THAT WORK INSPECTED WAS DONE IN CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION. IF THE DISCREPANCIES ARE NOT CORRECTED, THE DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL, AND TO THE ARCHITECT OR ENGINEER PRIOR TO THE COMPLETION OF THAT PHASE OF WORK. A FINAL REPORT DOCUMENTING REQUIRED SPECIAL INSPECTIONS AND CORRECTION OF ANY DISCREPANCIES NOTED IN THE INSPECTIONS SHALL BE SUBMITTED AT A POINT IN TIME AGREED UPON BY THE PERMIT APPLICANT AND THE BUILDING OFFICIAL PRIOR TO THE START OF WORK.
- SPECIAL INSPECTORS SHALL BE APPROVED BY LOCAL BUILDING OFFICIAL IN ACCORDANCE WITH CBC SECTION 1704.1
A. SPECIAL INSPECTION MAY BE REQUIRED IN ACCORDANCE WITH CBC SECTION 1704.12 AND 1704.13
B. SPECIAL INSPECTION MAY BE REQUIRED FOR SMOKE CONTROL SYSTEMS IN ACCORDANCE WITH CBC 1704.16
- SEE ARCHITECTURAL DRAWINGS FOR SPRAYED FIRE-RESISTANT REQUIREMENTS.
A. SPECIAL INSPECTION MAY BE REQUIRED IN ACCORDANCE WITH CBC SECTION 1704.12 AND 1704.13
B. SPECIAL INSPECTION MAY BE REQUIRED FOR SMOKE CONTROL SYSTEMS IN ACCORDANCE WITH CBC 1704.16
- SEE MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS FOR SPECIAL INSPECTION REQUIREMENTS.
A. SPECIAL INSPECTION MAY BE REQUIRED IN ACCORDANCE WITH CBC SECTION 1707.7 AND 1708.4
B. SPECIAL INSPECTION MAY BE REQUIRED FOR SMOKE CONTROL SYSTEMS IN ACCORDANCE WITH CBC 1704.16
- SEE PROJECT SOILS REPORT FOR ALL SPECIAL INSPECTION REQUIREMENTS FOR EXISTING SOILS CONDITIONS, FILL PLACEMENT AND LOAD-BEARING REQUIREMENTS.
A. SPECIAL INSPECTION MAY BE REQUIRED IN ACCORDANCE WITH CBC SECTION 1704.7, 1704.8, 1704.9, 1704.10 AND 1704.11

B. CONCRETE CONSTRUCTION (1)(2)

VERIFICATION AND INSPECTION	CONTINUOUS	PERIODIC	REMARKS
1. INSPECTION OF REINFORCING STEEL PLACEMENT.		×	SEE NOTE (2)
2. INSPECT BOLTS TO BE INSTALLED IN CONCRETE PRIOR TO AND DURING PLACEMENT OF CONCRETE WHERE ALLOWABLE LOADS HAVE BEEN INCREASED.	×		SEE CBC SECTION 1911.5
3. VERIFYING USE OF REQUIRED DESIGN MIX.		×	
4. AT THE TIME FRESH CONCRETE IS SAMPLED TO FABRICATE SPECIMENS FOR STRENGTH TESTS, PERFORM SLUMP AND AIR CONTROL TESTS, AND DETERMINE THE TEMPERATURE OF THE CONCRETE.	×		SEE NOTE (4)
5. INSPECTION OF CONCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES.	×		
6. INSPECTION FOR MAINTENANCE OF CURING, TEMPERATURE & TECHNIQUES.		×	SEE NOTE (5)
7. VERIFICATION OF IN-SITU CONCRETE STRENGTH, PRIOR TO REMOVAL OF SHORES AND FORMS FROM BEAMS AND STRUCTURAL SLABS.		×	
8. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.		×	

- NOTES:
- SEE CBC SECTION 1704.4 AND TABLE 1704.4
 - SEE CBC SECTION 1708.2 FOR SHEARWALL BOUNDARY REINFORCEMENT REQUIREMENTS.
 - SPECIAL INSPECTION NOT REQUIRED FOR 3 STORY OR LESS BLDG. SUPPORTED BY ROCK OR EARTH FOR THE FOLLOWING:
A. ISOLATED SPREAD FOOTINGS.
B. CONTINUOUS CONCRETE FOOTINGS.
C. NONSTRUCTURAL CONCRETE SLAB ON GRADE.
D. TEST CYLINDERS/SPECIMENS
A. CONCRETE STRENGTH SHALL BE VERIFIED BY STANDARD CYLINDER TESTS (IN ACCORDANCE WITH CBC SECTION 1905) MADE BY AN APPROVED TESTING LABORATORY. CONTRACTOR SHALL MAINTAIN COPIES OF TEST REPORTS AT JOB SITE AND AVAILABLE FOR REVIEW AND INSPECTION BY BUILDING OFFICIALS. MAKE 3. MINIMUM TEST CYLINDERS FOR EACH DAY'S POUR. TEST EACH BATCH OF CYLINDERS AS FOLLOWS: 1 AT 7 DAYS, AND 2 AT 28 DAYS.
B. SEE ALSO REQUIREMENTS A.C.I. SECTION 5.6.
 - SEE A.C.I. 5.11 THRU 5.13

C. MASONRY CONSTRUCTION (1)(2)

VERIFICATION AND INSPECTION	CONTINUOUS	PERIODIC	REMARKS
1. AS MASONRY CONSTRUCTION BEGINS, THE FOLLOWING SHALL BE VERIFIED TO ENSURE COMPLIANCE: A. PROPORTIONS OF SITE-PREPARED MORTAR. B. CONSTRUCTION OF MORTAR JOINTS. C. LOCATION OF REINFORCEMENT, CONNECTORS AND ANCHORAGES.	—	—	
2. THE INSPECTION PROGRAM SHALL VERIFY: A. SIZE AND LOCATION OF STRUCTURAL ELEMENTS. B. TYPE, SIZE AND LOCATION OF ANCHORS, INCLUDING OTHER DETAILS OF ANCHORAGE OF MASONRY TO STRUCTURAL MEMBERS, FRAMES OR OTHER CONSTRUCTION. C. SPECIFIED SIZE, GRADE AND TYPE OF REINFORCEMENT. D. WELDING OF REINFORCING BARS. E. PROTECTION OF MASONRY DURING COLD WEATHER (TEMPERATURES BELOW 40°F) OR HOT WEATHER (TEMPERATURE ABOVE 90°F).	—	—	
3. PRIOR TO GROUTING, THE FOLLOWING SHALL BE VERIFIED TO ENSURE COMPLIANCE: A. GROUT SPACE IS CLEAN. B. PLACEMENT OF REINFORCEMENT AND CONNECTORS. C. PROPORTIONS OF SITE-PREPARED GROUT. D. CONSTRUCTION OF MORTAR JOINTS.	—	—	
4. GROUT PLACEMENT SHALL BE VERIFIED TO ENSURE COMPLIANCE WITH CODE AND CONSTRUCTION DOCUMENT PROVISIONS.	×		
5. PREPARATION OF ANY REQUIRED GROUT SPECIMENS, MORTAR SPECIMENS AND/OR PRISMS SHALL BE OBSERVED.	×		
6. COMPLIANCE WITH REQUIRED INSPECTION PROVISIONS OF THE CONSTRUCTION DOCUMENTS AND THE APPROVED SUBMITTALS SHALL BE VERIFIED.		×	

- NOTES:
- SEE CBC SECTION 1704.5 AND 1708.1
 - SEE TABLE 1704.5.1 AND 1704.5.3

D. STEEL CONSTRUCTION (1)(2)

VERIFICATION AND INSPECTION	CONTINUOUS	PERIODIC	REMARKS
HIGH STRENGTH BOLTING			
1. IDENTIFICATION MARKINGS TO CONFORM TO ASTM STANDARDS SPECIFIED IN APPROVED CONSTRUCTION DOCUMENTS.		×	
2. MANUFACTURER'S CERTIFICATE OF COMPLIANCE REQUIRED.		×	
3. INSPECTION OF HIGH STRENGTH BOLTING: -BEARING-TYPE CONNECTION.		×	SEE CBC SECTION 1704.3.3
4. INSPECTION OF HIGH STRENGTH BOLTING: -SLIP CRITICAL CONNECTION.	×	×	SEE CBC SECTION 1704.3.3
WELDING - STRUCTURAL STEEL (3)			
5. COMPLETE AND PARTIAL PENETRATED GROOVE WELDS.	×		
6. MULTIPASS FILLET WELDS.	×		
7. SINGLE-PASS FILLET $\geq \frac{5}{16}$ "	×		
8. SINGLE-PASS FILLET $\leq \frac{5}{16}$ "		×	
9. FLOOR AND ROOF DECKS.		×	

- NOTES:
- SEE CBC SECTION 1704.3 AND 1707.2
 - SEE CBC TABLE 1707.3
 - EXCEPTION FOR WELDING: THE SPECIAL INSPECTOR NEED NOT BE CONTINUOUSLY PRESENT DURING WELDING OF THE FOLLOWING ITEMS, PROVIDED THE MATERIALS, WELDING PROCEDURES AND QUALIFICATIONS OF WELDERS ARE VERIFIED PRIOR TO THE START OF THE WORK; PERIODIC INSPECTIONS ARE MADE OF THE WORK IN PROGRESS; AND A VISUAL INSPECTION OF ALL WELDS IS MADE PRIOR TO COMPLETION OR PRIOR TO SHIPMENT OF SHOP WELDING.
A. SINGLE-PASS FILLET WELDS NOT EXCEEDING $\frac{3}{4}$ " IN SIZE.
B. FLOOR AND ROOF DECK WELDING.
C. WELDED STUDS WHEN USED FOR STRUCTURAL DIAPHRAGM.
D. WELDED SHEET STEEL FOR COLD-FORMED STEEL FRAMING MEMBERS SUCH AS STUDS AND JOISTS.
E. WELDING OF STAIRS AND RAILING SYSTEMS.

E. WOOD CONSTRUCTION (1)(2)


VERIFICATION AND INSPECTION	CONTINUOUS	PERIODIC	REMARKS
1. PLYWD. SHEAR WALLS.		×	SEE NOTES (2)(3)
2. ROOF AND FLOOR DIAPHRAGMS		×	SEE NOTES (2)(3)
3. DRAG STRUTS		×	SEE NOTES (2)(3)

- NOTES:
- SEE CBC SECTION 1704.6 AND 1707.3
 - NAILING, BOLTING, ANCHORING AND OTHER FASTENING OF COMPONENTS.
 - SPECIAL INSPECTION NOT REQUIRED WHERE FASTENERS SPACING OF THE SHEATHING IS MORE THAN 4"

F. SPECIAL CASES


VERIFICATION AND INSPECTION	CONTINUOUS	PERIODIC	REMARKS
1. HILTI KWIK BOLT TZ INSTALLATION		×	SIMPSON 'KBTZ' (ICC-ES ESR-1917)
2. SIMPSON SET-XP EPOXY INSTALLATION		×	SIMPSON 'SET' (ICC-ES ESR-1772)
3. HILTI KWIK BOLT III (1)		×	SIMPSON KB III (ICC-ES ESR 1385)

- NOTES:
- SEE DETAIL 14 / S1.2

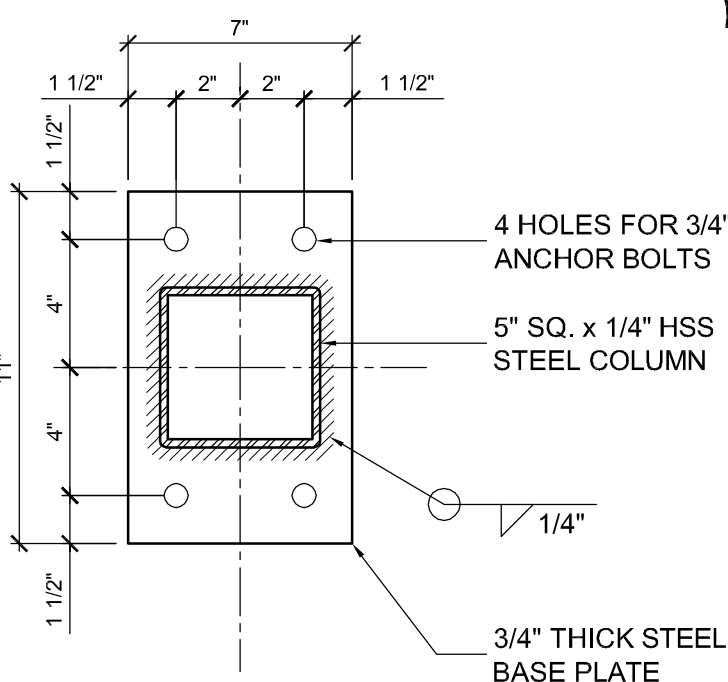


NOTES:
1. SEE FRAMING PLAN AND NOTES

54 BASE PLATE
2" = 1' - 0"

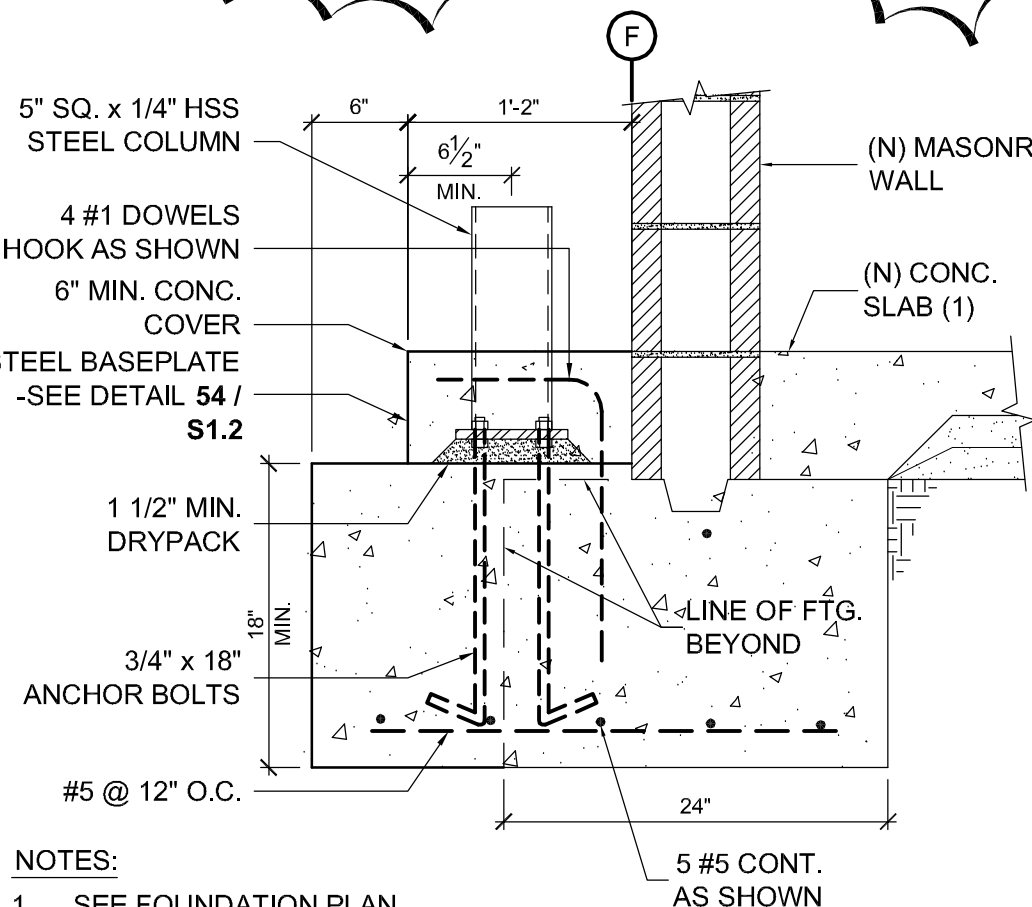


NOTES:
1. SEE FOUNDATION PLAN

44 ACCESS LADDER FOOTING
1" = 1' - 0"

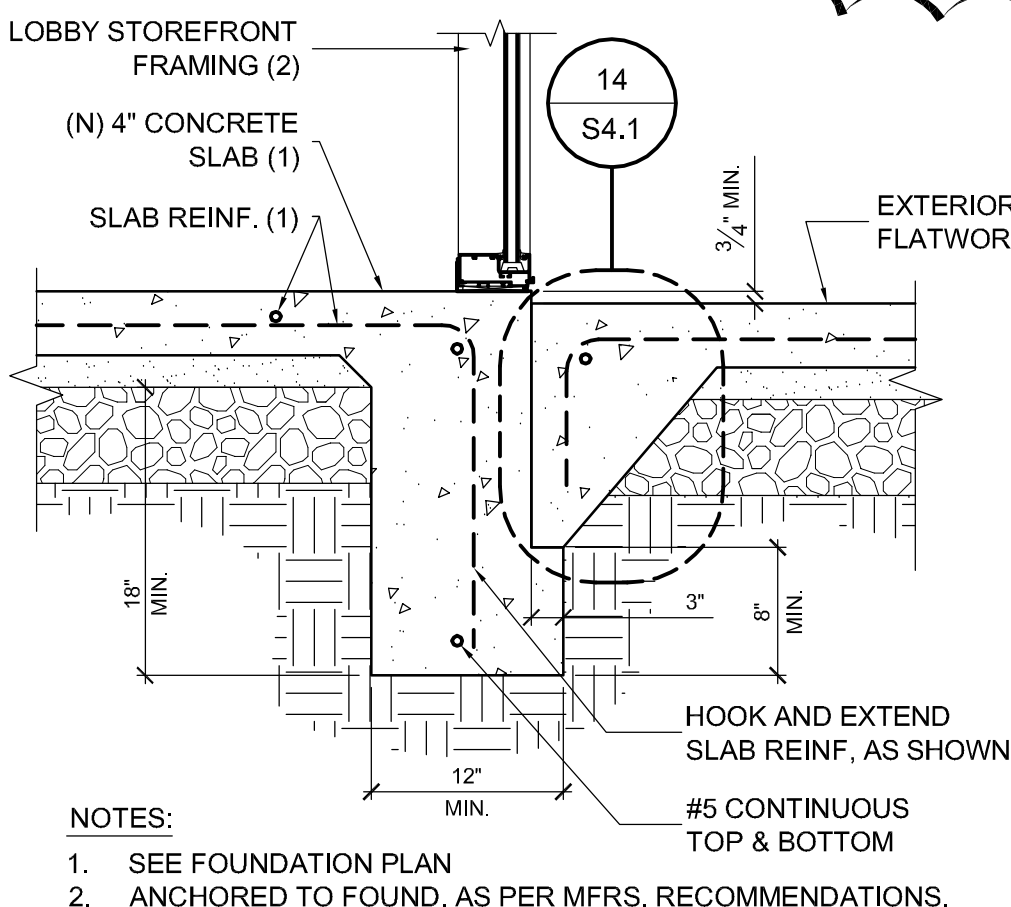

NOTES:
1. SEE FOUNDATION PLAN
2. ANCHORED TO FOUND. AS PER MFRS. RECOMMENDATIONS.

34 NEW FOOTING @ LOBBY
1" = 1' - 0"

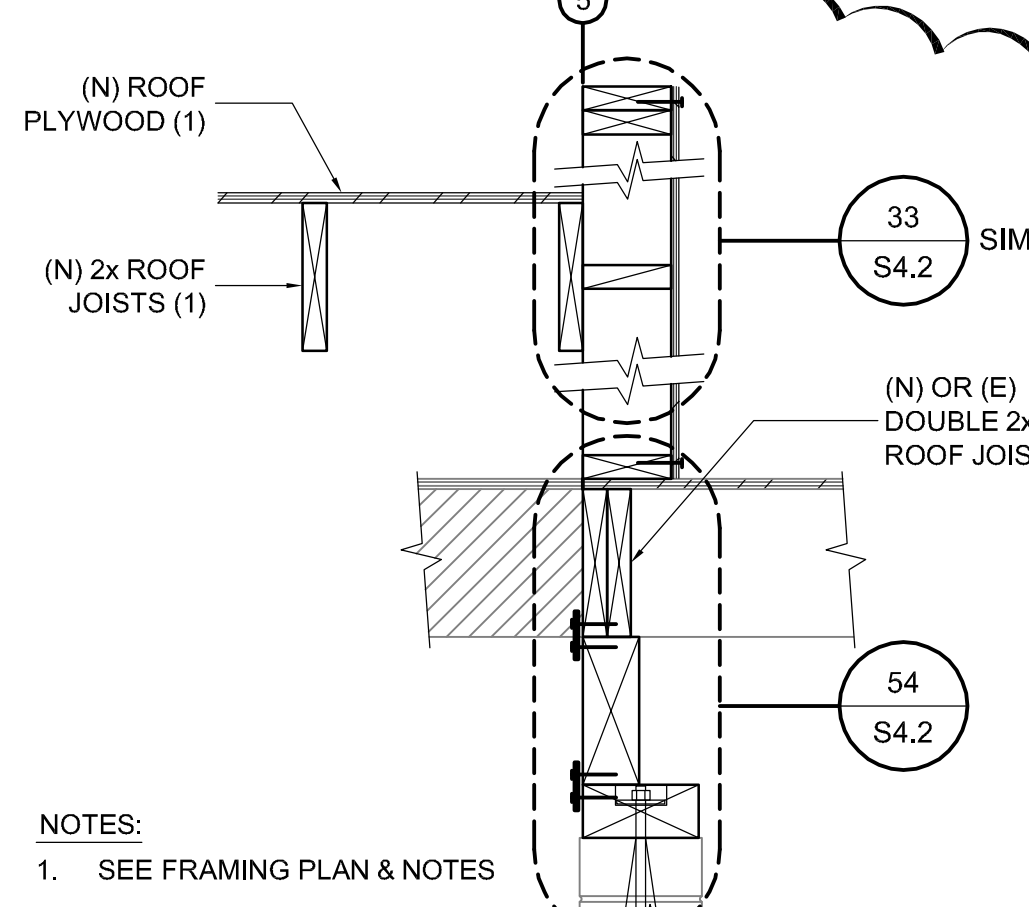

NOTES:
1. SEE FRAMING PLAN & NOTES

24 LINE 5 BETWEEN A & B
1" = 1' - 0"

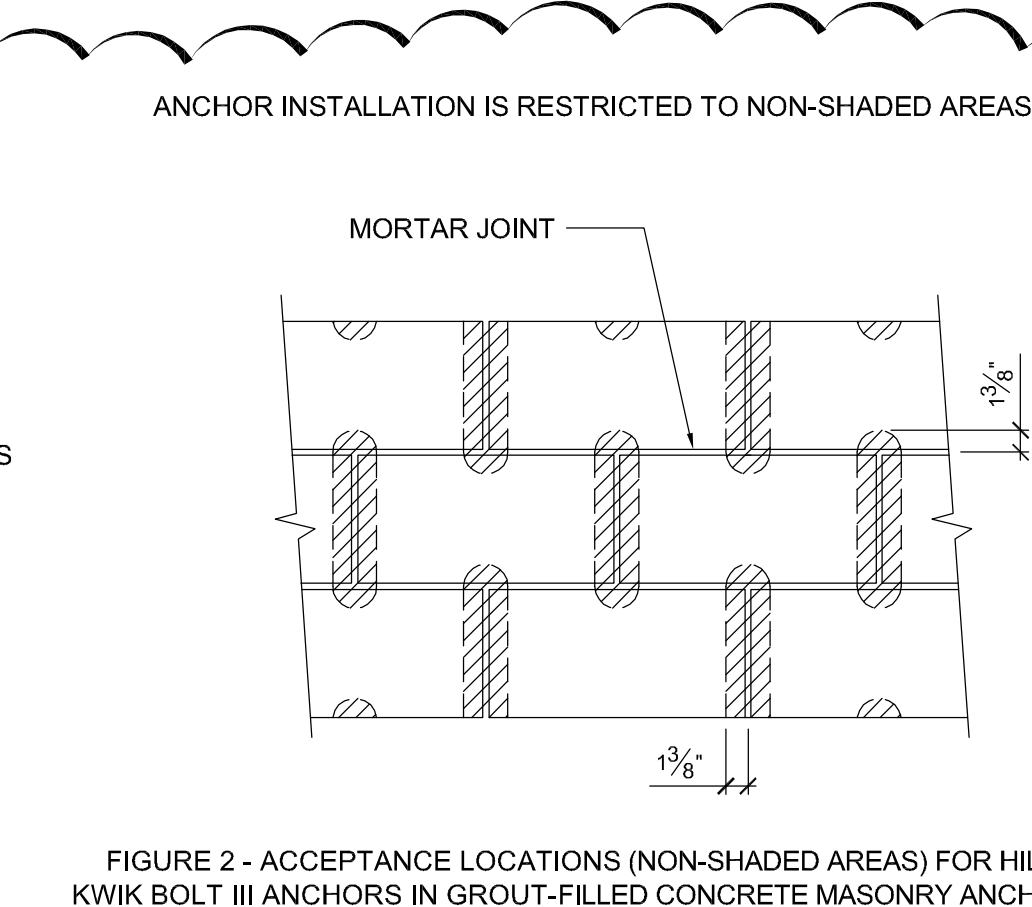


FIGURE 2 - ACCEPTANCE LOCATIONS (NON-SHADED AREAS) FOR HILTI KWIK BOLT III ANCHORS IN GROUT-FILLED CONCRETE MASONRY ANCHORS

14 HILTI KWIK BOLT III
1" = 1' - 0"

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

FRASER
SEIPLE
ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

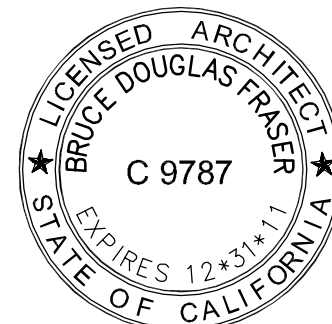

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

SPECIAL
INSPECTIONS


SHEET #

S1.2

\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\S2.1 - Phase I Foundation Plan.dwg, 6/14/2011 3:11:45 PM, PDF995

CONCRETE LID KEYNOTES

- GENERAL TYPICAL NOTES: SEE STRUCTURAL NOTES, SHEET **S1.0 & S1.1**.
A. ALL CONCRETE SHALL BE 3,000 P.S.I. AT 28 DAYS.
B. SEE ARCHITECTURAL DRAWINGS FOR ALL EMBEDDED ITEMS AND NON-STRUCTURAL COMPONENTS ASSOCIATED WITH CONCRETE WORK.
- 6" CONCRETE SLAB WITH #5 @ 12" O.C., EACH WAY, AT MID-DEPTH OF SLAB.
A. SEE DETAIL **23 / S4.2**.
- 8" SOLID GROUTED CMU LINTEL OVER OPENING.
A. SEE DETAIL **42 / S4.2**.
- 2x6 PONY WALL.
A. SEE DETAIL **32 / S4.2** FOR OPENING IN WALL.
- 8" SOLID GROUTED CMU BEARING WALL.
A. SEE DETAIL **53 / S4.1** FOR TYPICAL WALL REINFORCING.
B. SEE DETAIL **44 / S4.2** FOR TYPICAL REINFORCING AT OPENINGS.
C. SEE DETAIL **53 / S4.1** FOR TYPICAL CLEANOUT DETAIL.
D. SEE DETAIL **43 / S4.2** FOR TYPICAL CORNER & INTERSECTING WALL.
E. SEE DETAIL **54 / S4.1** FOR TYPICAL VERTICAL CONTROL JOINT.
- EXISTING CMU WALL TO REMAIN.
- 2x6 DF #2 JOISTS @ 24" O.C.
A. PROVIDE SIMPSON 'LUS' HANGER EACH END.
B. PROVIDE 2x4 DF #2 STRONG-BACK WITH 2-16d EACH CONTACT.
- 6x10 DF #2 BEAM.
A. PROVIDE SIMPSON 'MBHU5.50' HANGER EACH END.
B. 2x6 PARAPET WALL ABOVE.
- EDGE OF CONCRETE LID.
- 2x6 PARAPET WALL ABOVE. SEE DETAIL **11 / S4.2**.
- 2 #5 CONTINUOUS @ SLAB MID HEIGHT.
- SHEAR WALL SHEATHING
A. SHEATHING TO EXTEND FROM TOP OF NEW CONCRETE LID UP TO NEW ROOF FRAMING.
B. SEE SHEARWALL SCHEDULE, SHEET **S1.2**.
- SEE SEHAR WALL SCHEDULE, SHEET **S1.2**.

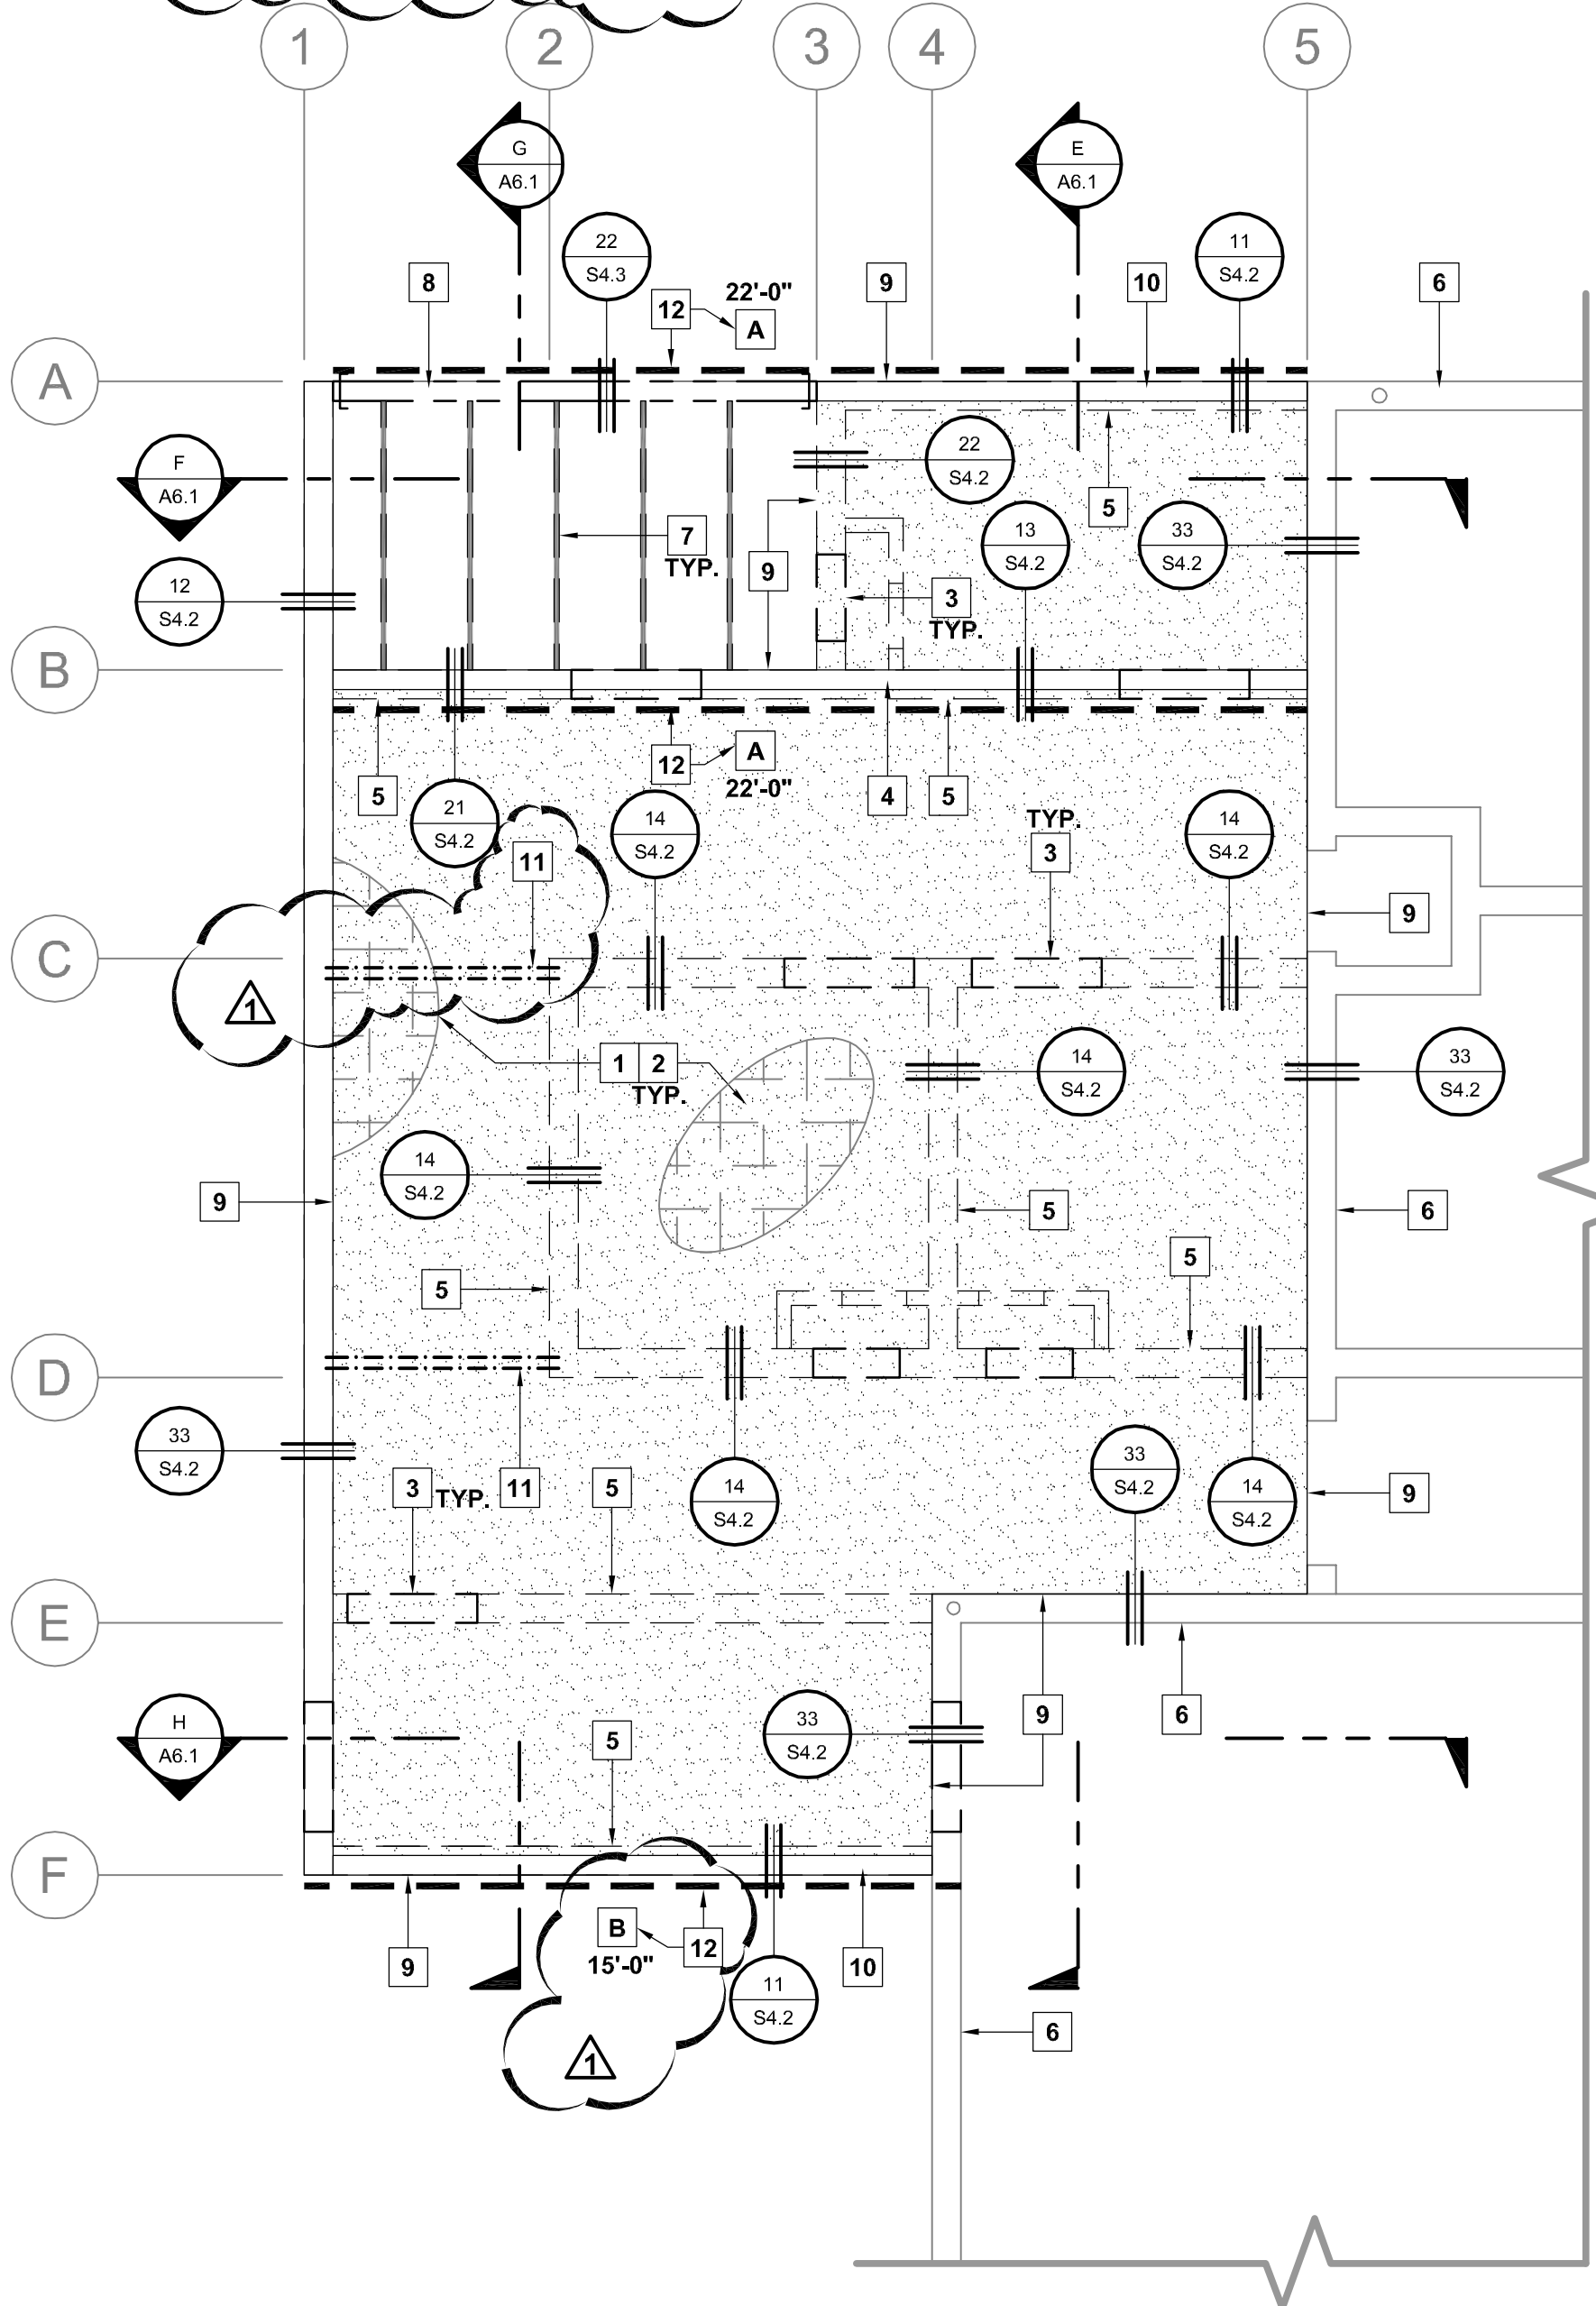


PHASE I CONCRETE LID PLAN
HOLDING CELL ADDITION

SCALE: 1/4" = 1'-0"


FOUNDATION PLAN KEYNOTES

- GENERAL TYPICAL NOTES: SEE STRUCTURAL NOTES, SHEET **S1.0 & S1.1**.
A. ALL CONCRETE SHALL BE 3,000 P.S.I. AT 28 DAYS.
B. SEE ARCHITECTURAL DRAWINGS FOR ALL EMBEDDED ITEMS AND NON-STRUCTURAL COMPONENTS ASSOCIATED WITH CONCRETE WORK.
C. ALL SILL PLATE ANCHOR BOLTS SHALL HAVE 7" (MIN.) EMBEDMENT (TYP. U.N.O.).
- 4" CONCRETE SLAB WITH #3 @ 18" O.C. AT MID-DEPTH OF SLAB OVER 2" CLEAN SAND OVER 10 MIL VAPOR RETARDER OVER 6" FREE DRAINING MATERIAL. SEE PROJECT SOILS REPORT. SEE DETAIL **21 / S4.1**.
- CONCRETE CONTROL JOINTS. SEE DETAIL **22/S4.1**.
A. PROVIDE TOOLED EDGE AT JOINT.
B. VERIFY ALL LOCATIONS OF VISIBLE CONTROL JOINTS WITH ARCHITECT & OWNER FOR PATTERN, LAYOUT AND SPACING.
C. MAX SPACING OF CONTROL JOINTS IS 12'-0".
- 8" SOLID GROUTED CMU BEARING WALL.
A. SEE DETAIL **53 / S4.1** FOR TYPICAL WALL REINFORCING.
B. SEE DETAIL **44 / S4.2** FOR TYPICAL REINFORCING AT OPENINGS.
C. SEE DETAIL **53 / S4.1** FOR TYPICAL CLEANOUT DETAIL.
D. SEE DETAIL **43 / S4.2** FOR TYPICAL CORNER & INTERSECTING WALL.
E. SEE DETAIL **54 / S4.1** FOR TYPICAL VERTICAL CONTROL JOINT.
- EXISTING FOOTING TO REMAIN.
- EXISTING CMU WALL TO REMAIN.
- EXPAND FOOTING AT ROOF ACCESS LADDER COLUMNS(SEE DETAIL 44 / S1.2).
- EXISTING CMU COLUMNS AND FOOTINGS TO REMAIN.
- NEW DOWEL BETWEEN NEW FOOTING AND EXISTING FOUNDATION.
A. #5 DOWEL TOP & BOTTOM. SEE DETAIL 43 / S4.1, SIMILAR.

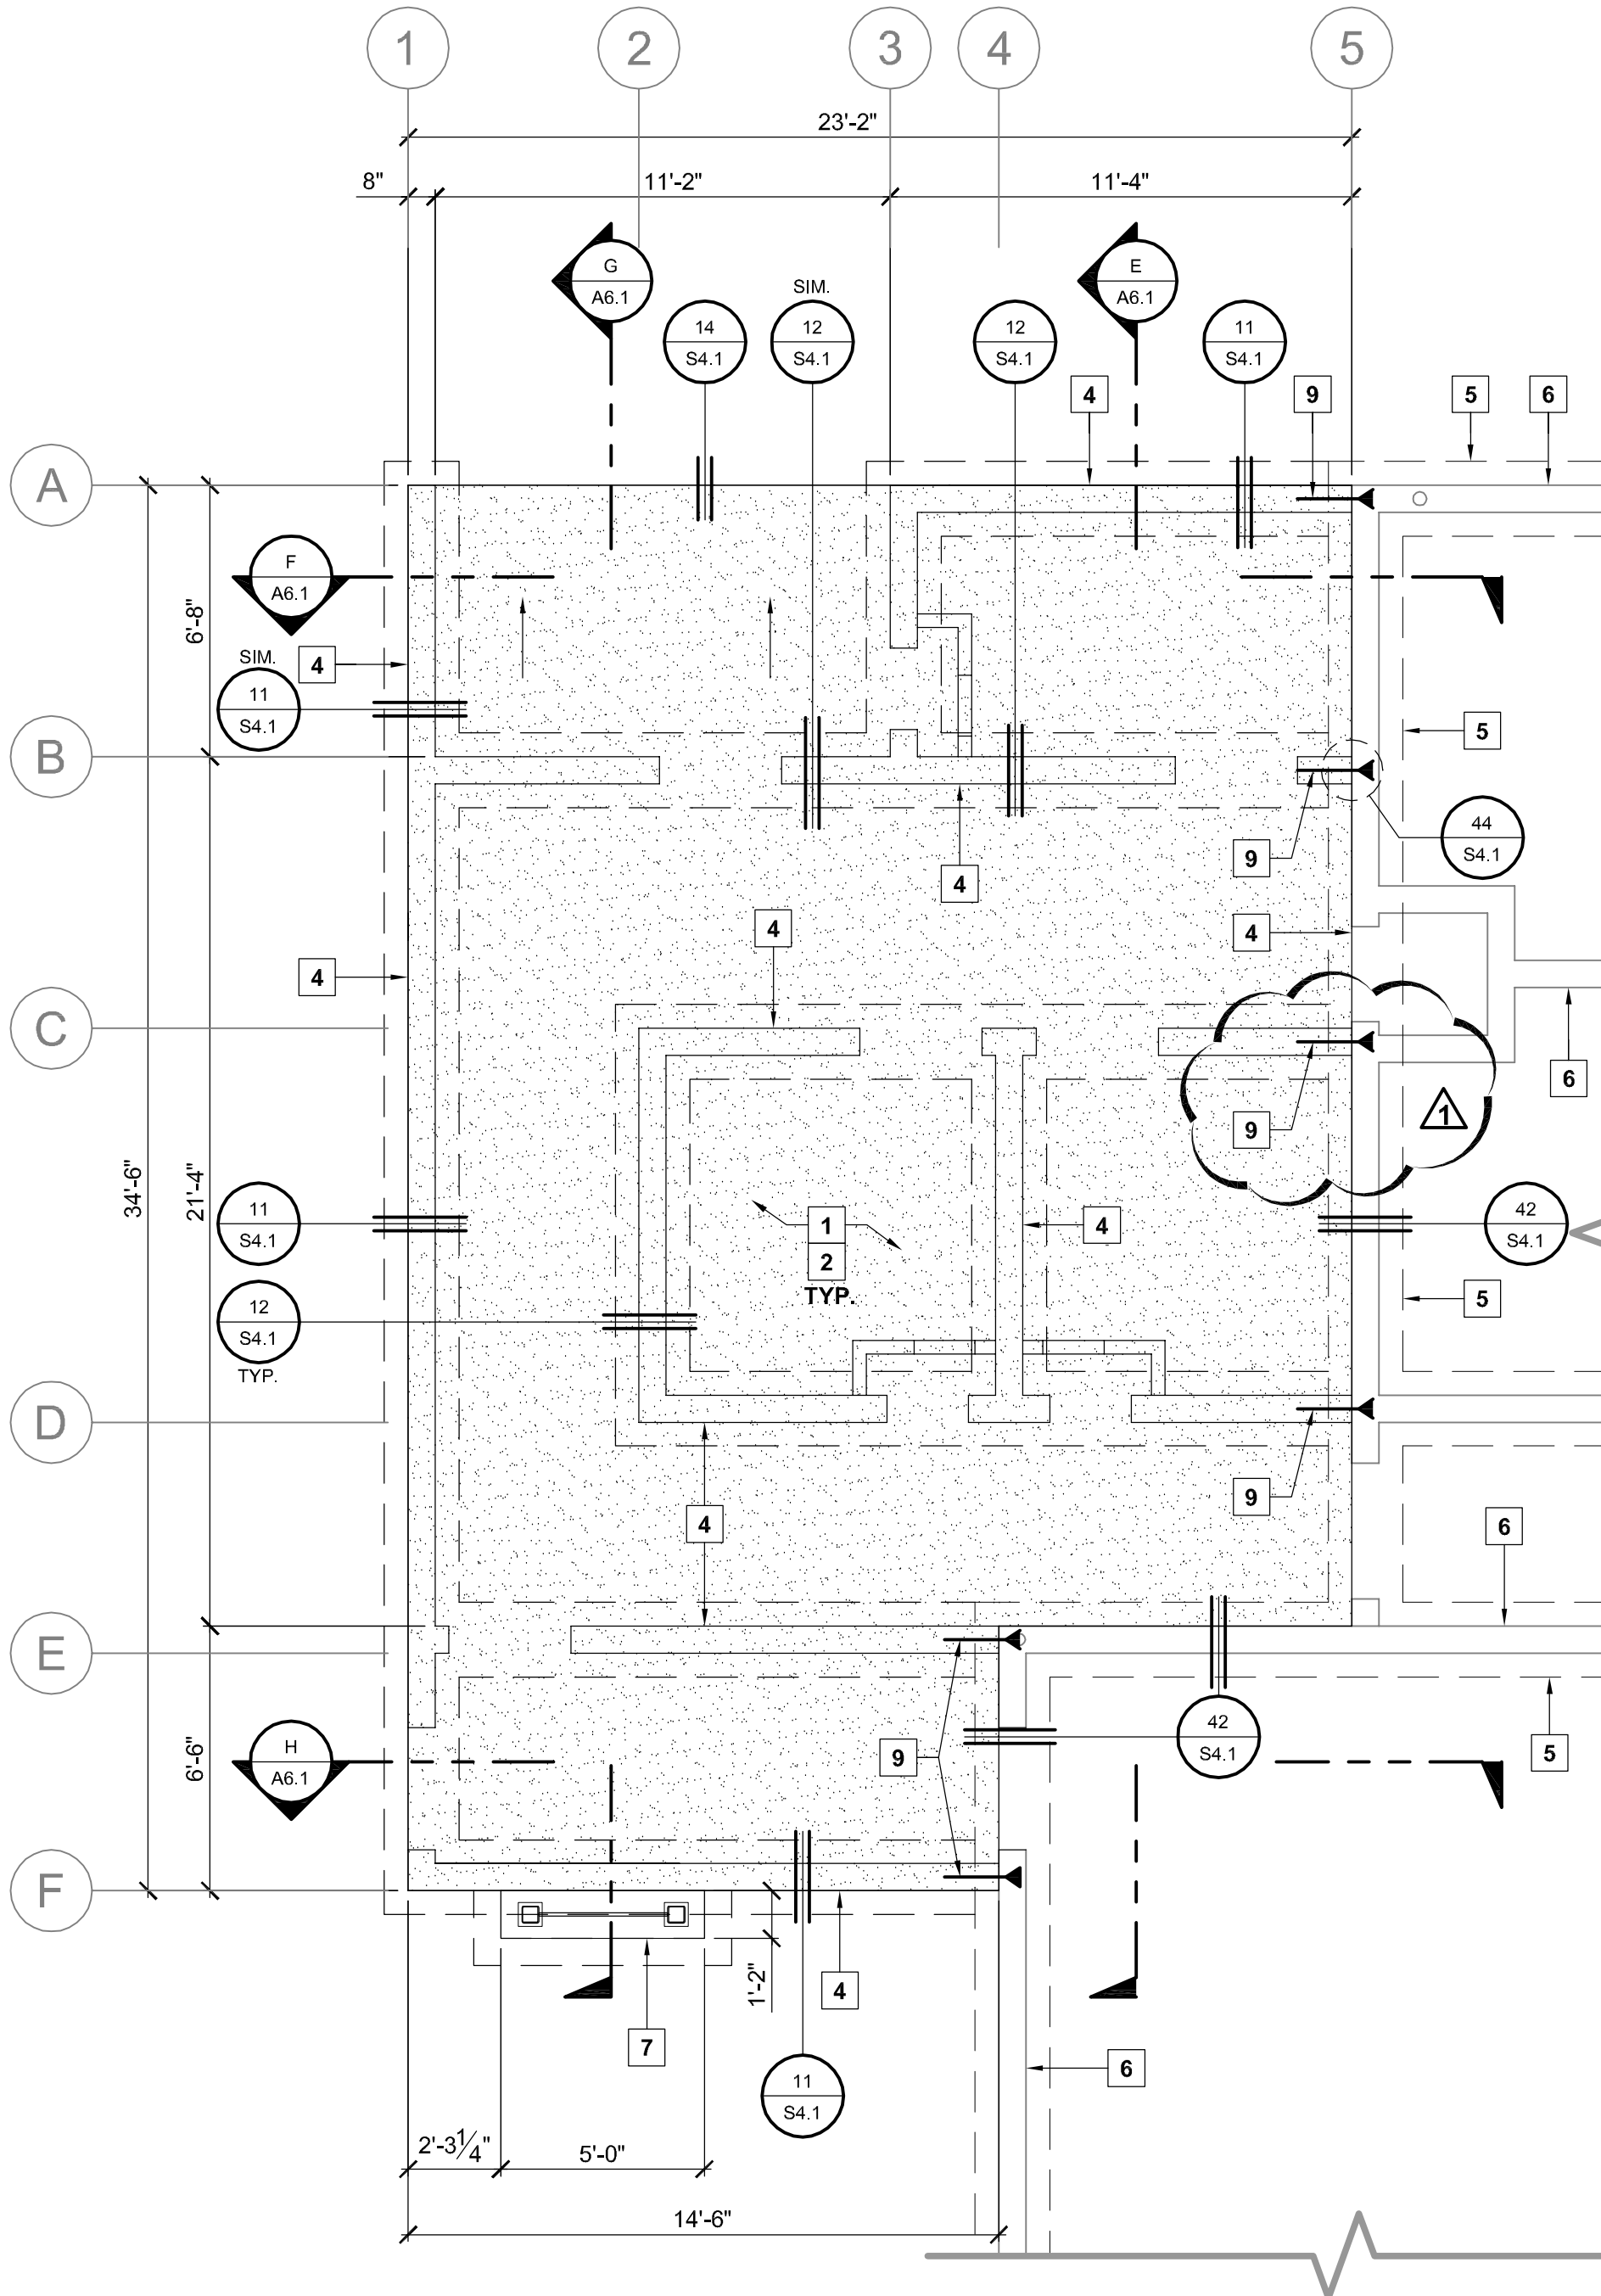


PHASE I FOUNDATION PLAN
HOLDING CELL ADDITION

SCALE: 1/4" = 1'-0"

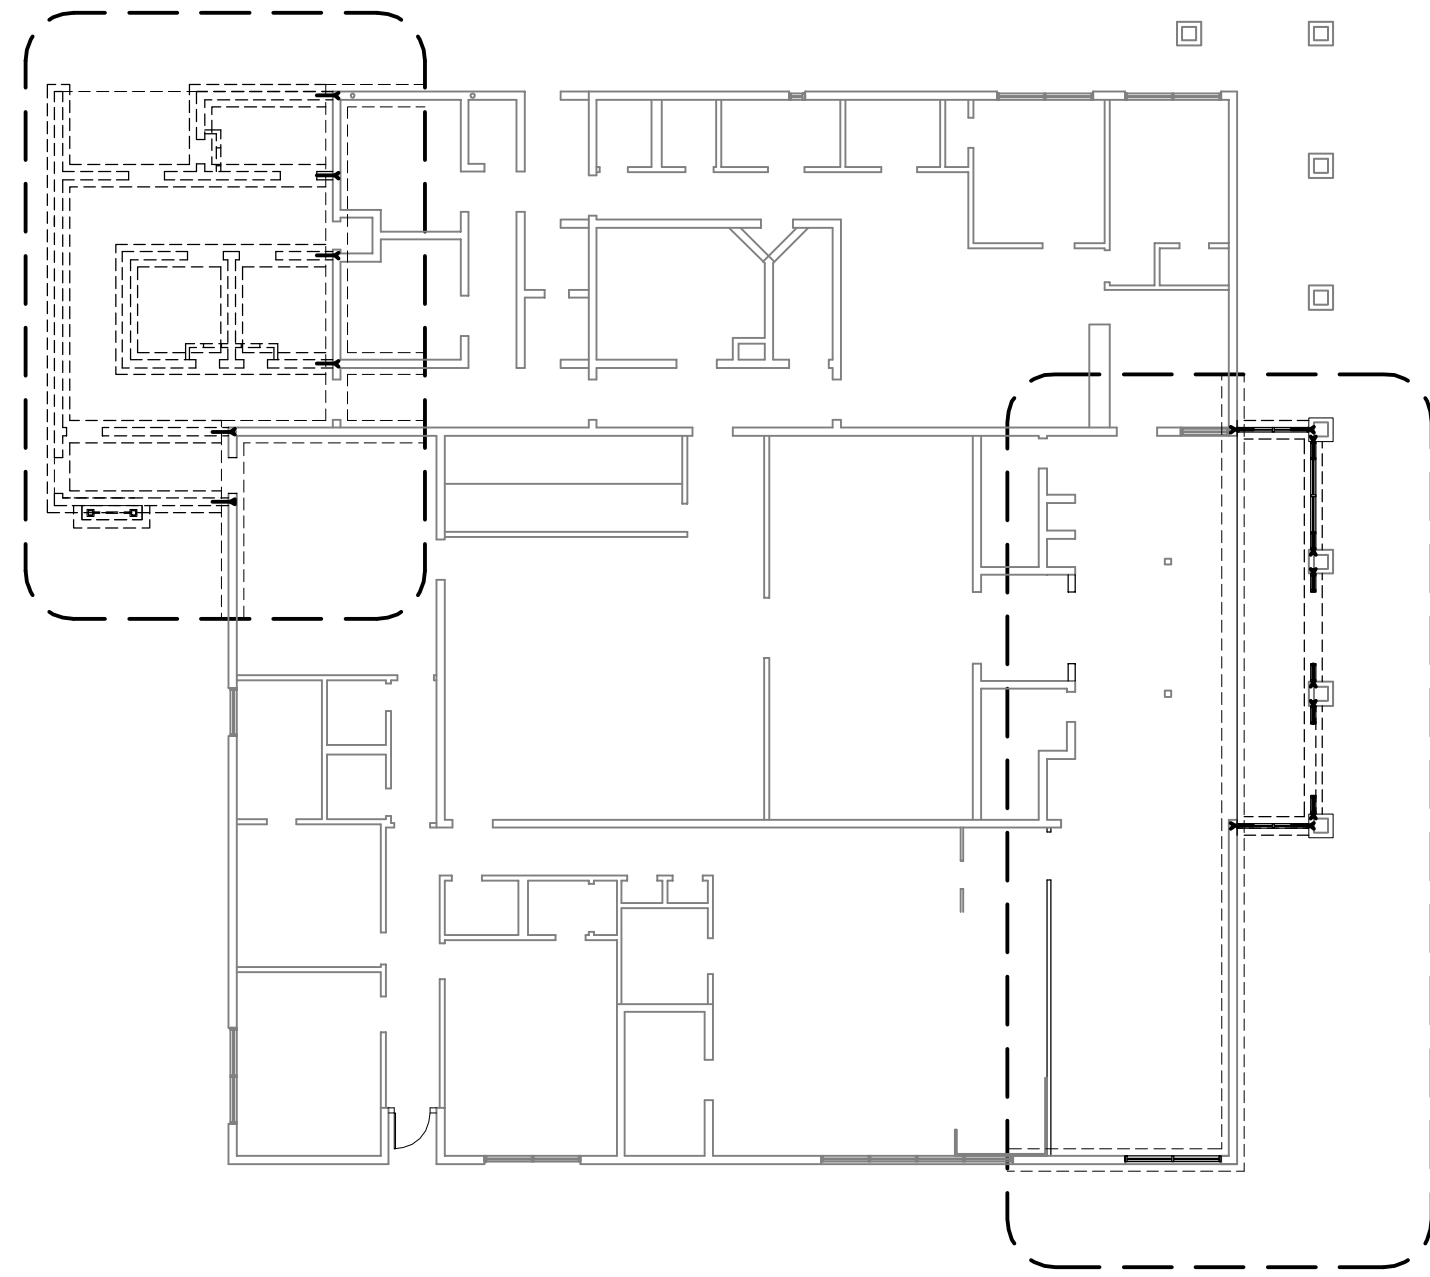

PHASE I KEY PLAN

SCALE: 1/16" = 1'-0"

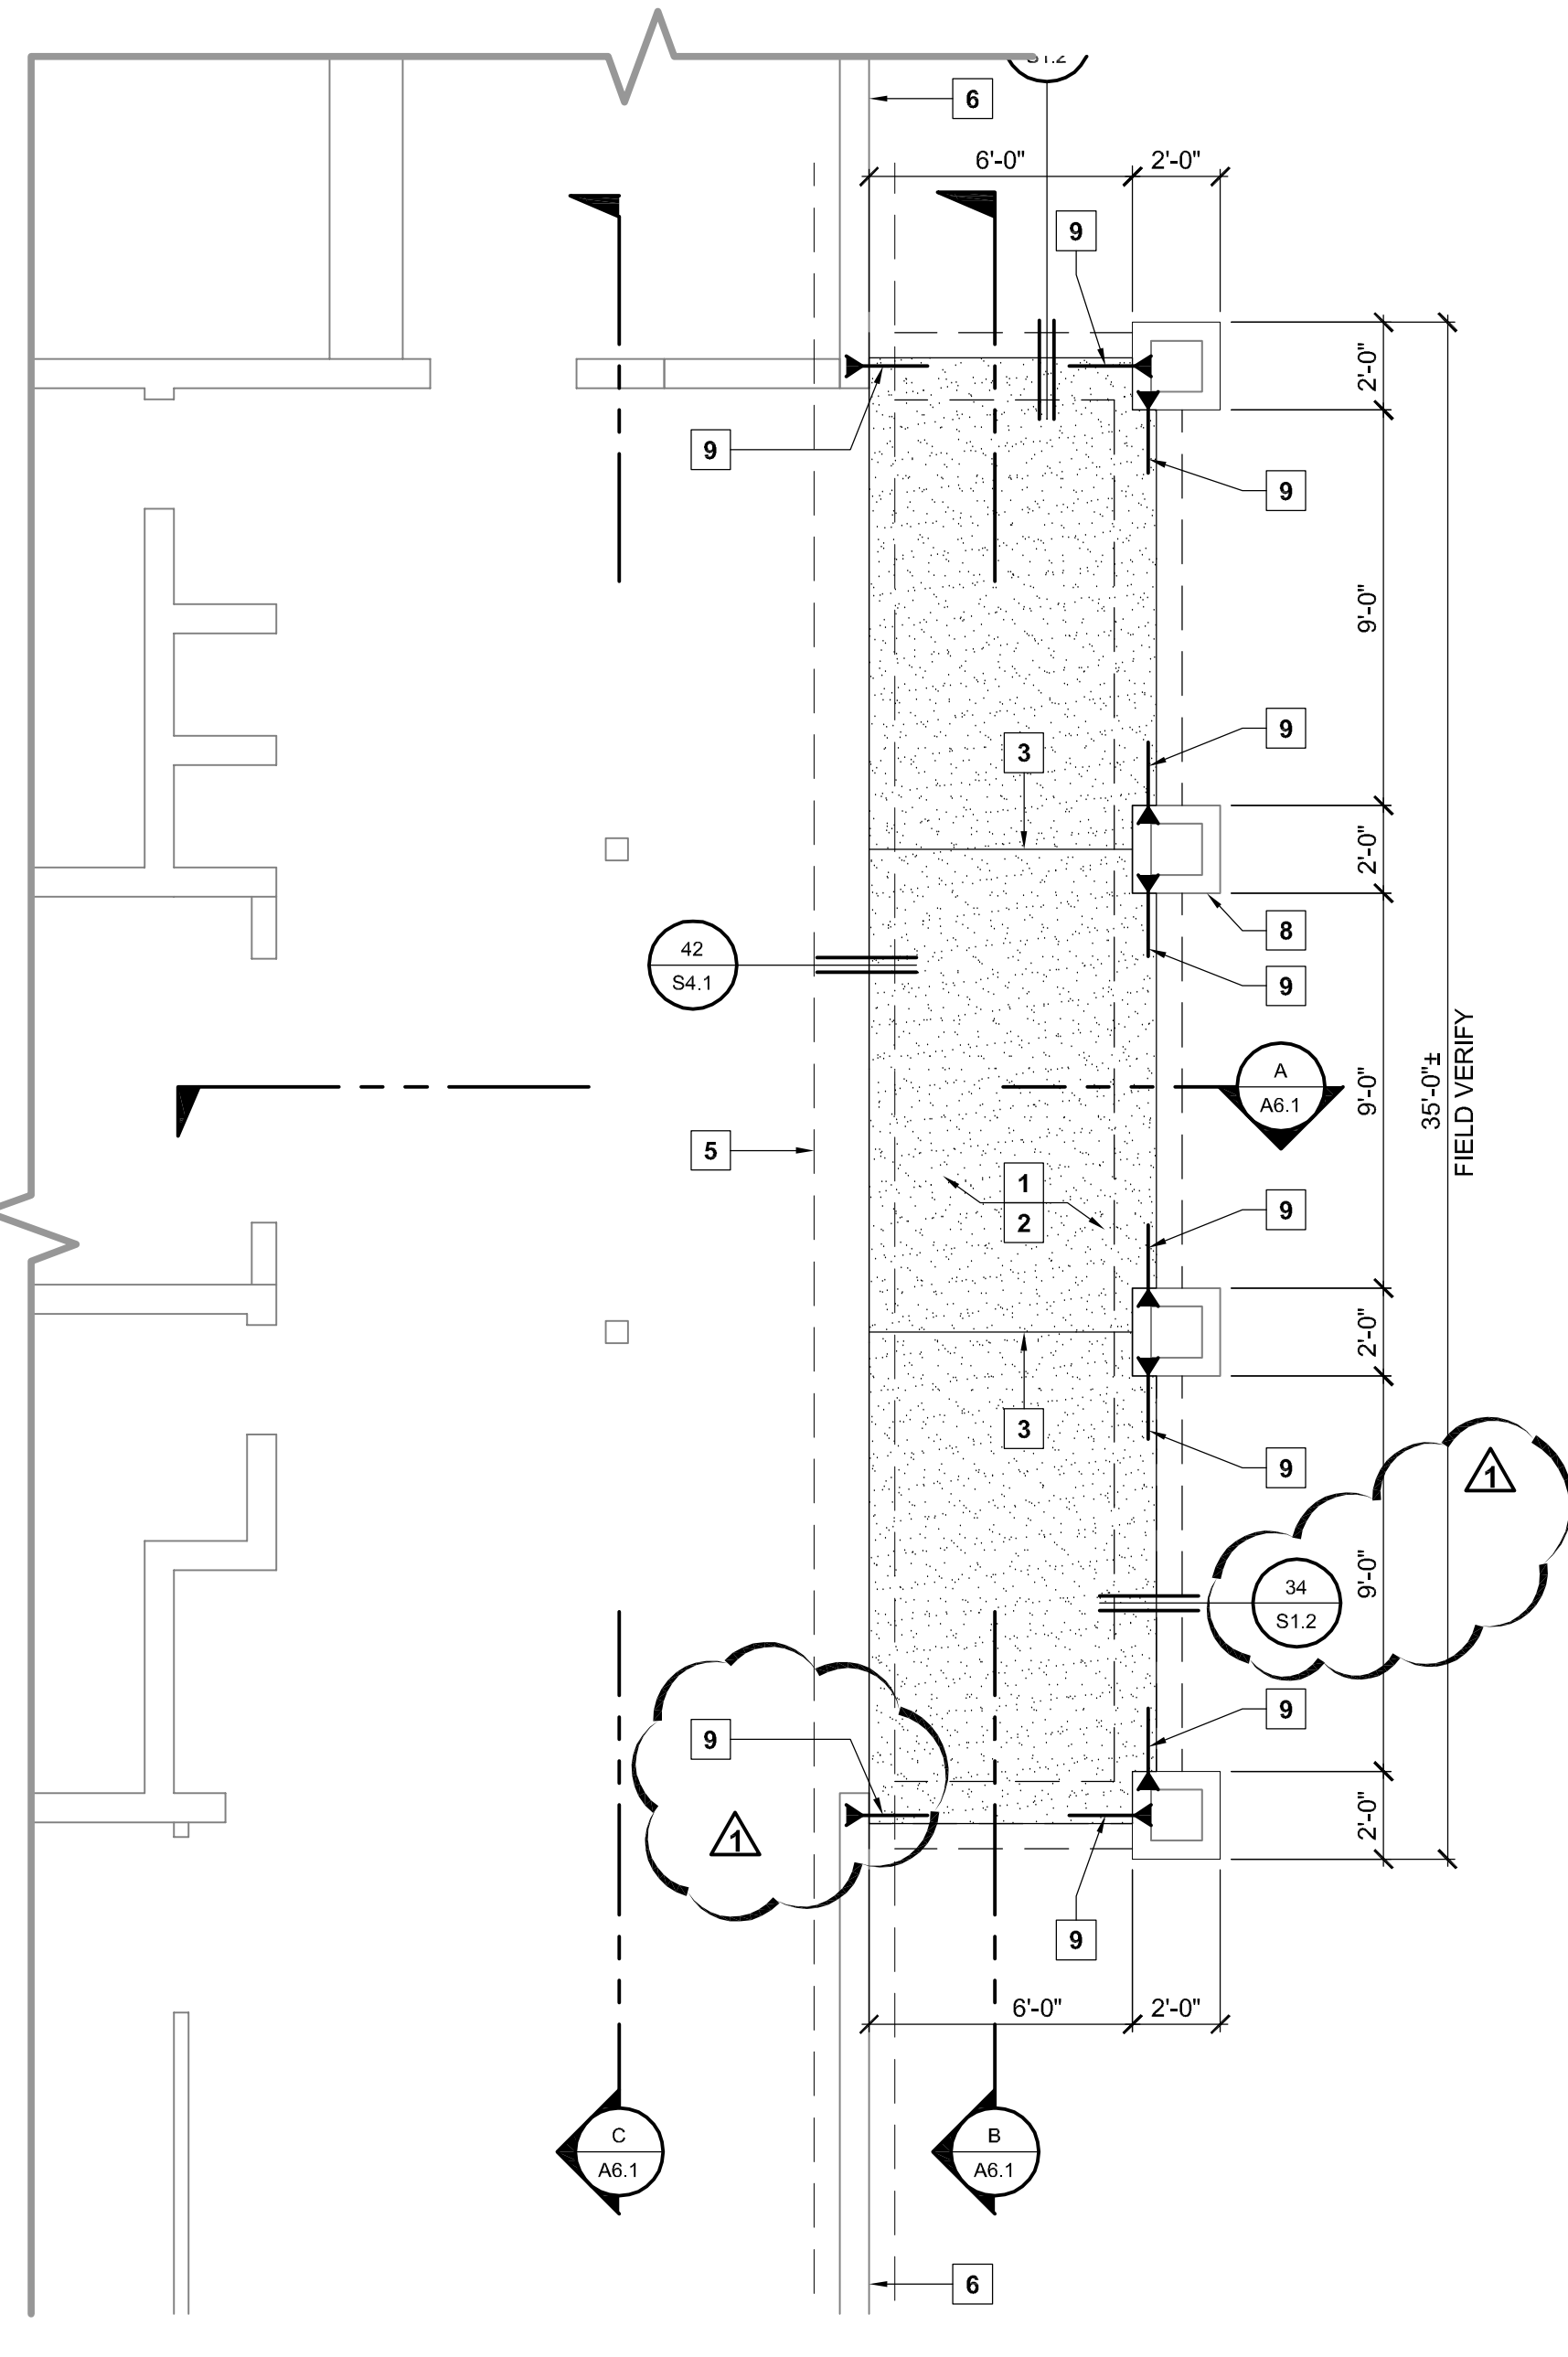

PHASE I FOUNDATION PLAN
LOBBY

SCALE: 1/4" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

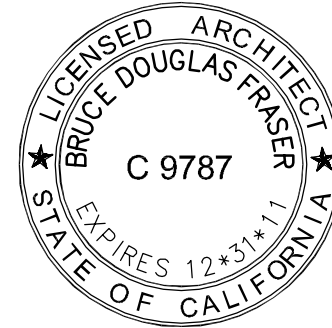

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.



Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I
FOUNDATION
PLAN**

SHEET #

S2.1

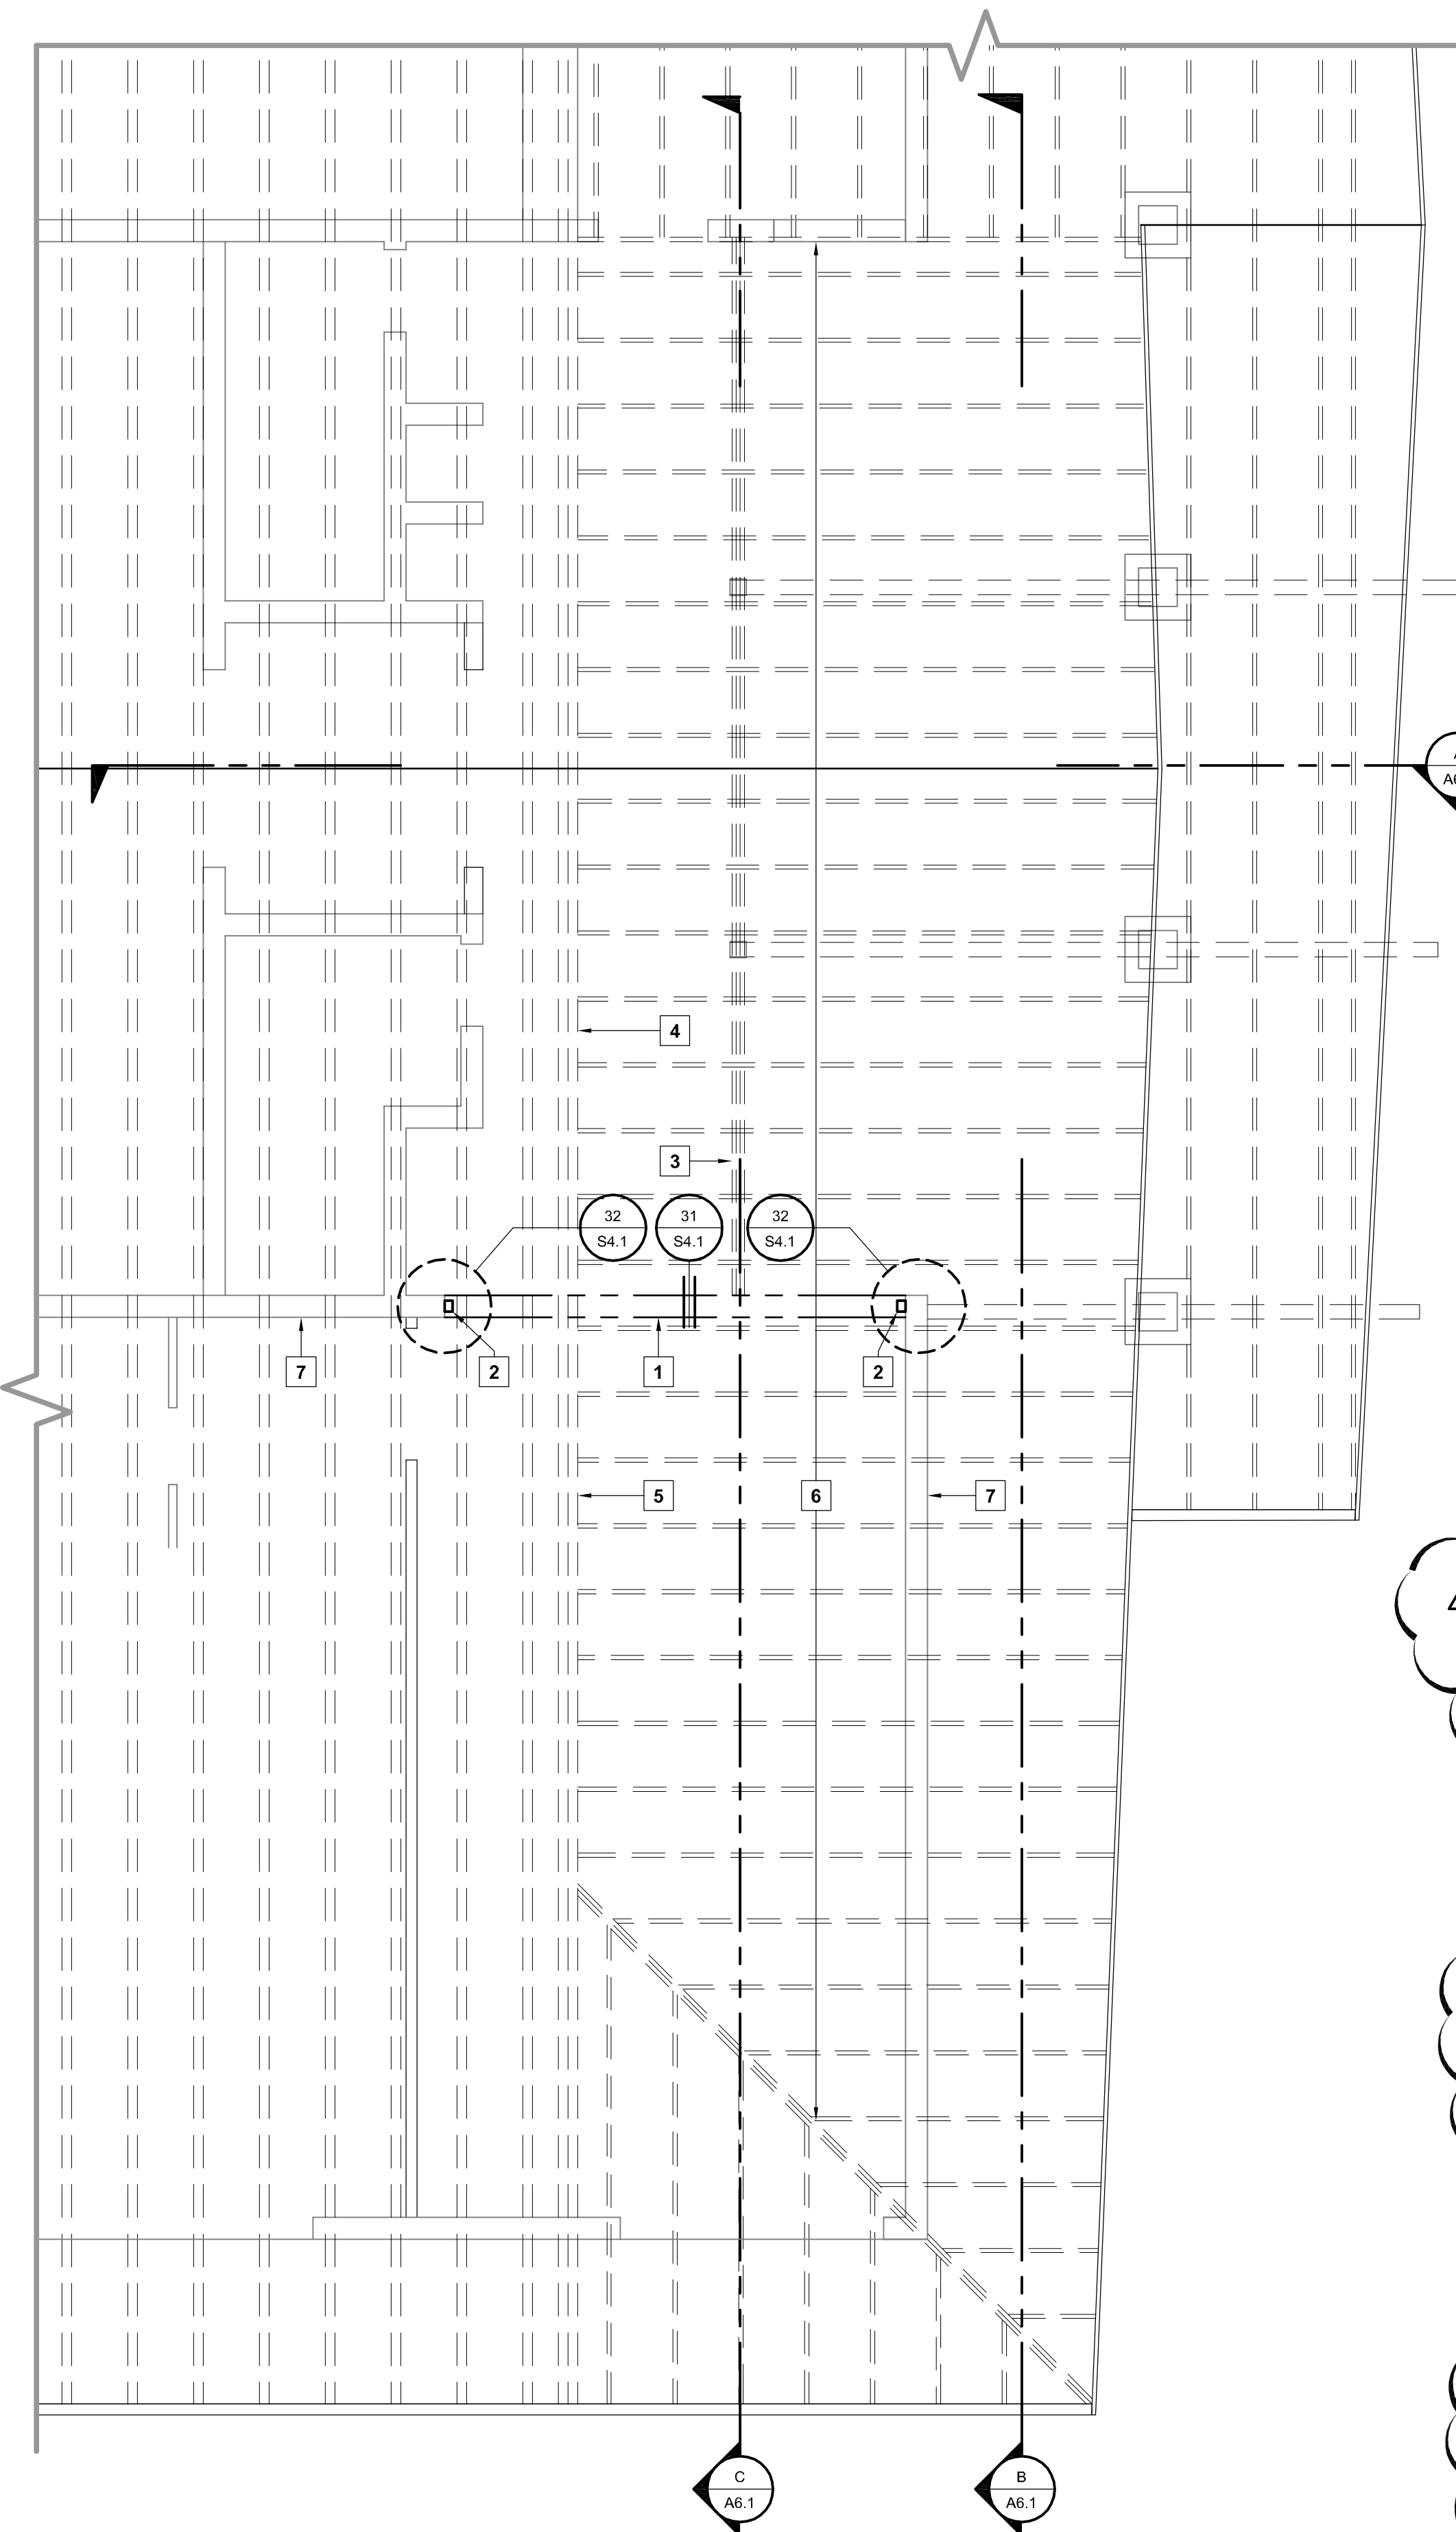

PHASE I ROOF FRAMING PLAN - LOBBY



SCALE: 1/4" = 1'-0"

ROOF FRAMING KEYNOTES

- GENERAL, TYPICAL NOTES: SEE GENERAL STRUCTURAL NOTES, SHEET S1.0 & S1.1.
- REFER TO ARCHITECTURAL PLANS FOR INTERIOR NON-BEARING WALLS, SOFFITS AND EAVE DETAILS, AND MISCELLANEOUS NON-STRUCTURAL DETAILS AND REQUIREMENTS.
- TYPICAL ROOF SHEATHING: 5/8" CDX PLYWOOD.
 - PANEL INDEX 32/16.
 - USE EXTERIOR GRADE WHERE PLYWOOD IS EXPOSED TO WEATHER.
 - NAIL w/ 8d @ 6-6-10" O.C. (TYPICAL U.N.O.).
 - LAY WITH FACE GRAIN PERPENDICULAR TO FRAMING.
 - STAGGER SHEETS.
 - ALL EDGES BLOCKED, SEE DETAIL 34 / S4.3.
- 30" REDBUILT RED-L @ 24" O.C.
 - SEE OPEN WEB TRUSS NOTES, SHEET S1.1.
 - ALL TRUSS ENGINEERING DRAWINGS, TRUSS TYPES, AND DETAILED SHOP DRAWINGS SHALL BE APPROVED BY THE PROJECT ENGINEER OR ARCHITECT PRIOR TO THE INSTALLATION OF THE TRUSS. TRUSS MANUFACTURER SHALL DESIGN ALL TRUSS TO TRUSS HANGERS.
 - ISOLATE INTERIOR NON-BEARING WALLS FROM VERTICAL LOAD PER MANUFACTURER'S RECOMMENDED DETAILS.
- 8" SOLID GROUTED CMU BEARING WALL.
 - SEE DETAIL 51 / S4.2 FOR TYPICAL WALL REINFORCING.
 - SEE DETAIL 44 / S4.2 FOR TYPICAL REINFORCING AT OPENINGS.
 - SEE DETAIL 53 / S4.1 TYPICAL CLEANOUT DETAIL.
 - SEE DETAIL 43 / S4.2 FOR TYPICAL CORNER & INTERSECTING WALL.
 - SEE DETAIL 54 / S4.1 FOR TYPICAL VERTICAL CONTROL JOINT.
 - SEE DETAIL 42 / S4.2 FOR TYPICAL LINTEL OVER OPENING.
- FACE OF BLOCK WALL.
- LOCATION OF VERTICAL CONTROL JOINT AT CMU WALL.
 - SEE DETAIL 54 / S4.1.
- MATCH EXISTING FASCIA.
- SIMPSON 'PA23' STRAP @ 48" O.C. w/ 4x FLAT BLOCKING AT 8" SOLID GROUTED CMU WALL.
 - SEE DETAIL 23 / S4.3.
- SIMPSON 'CMSTC16' STRAP @ 48" O.C. w/ 4x FLAT BLOCKING.
 - EXTEND STRAP 12'-0" MINIMUM.
 - SEE DETAIL 24 / S4.3.
- 2x6 PARAPET WALL.
 - PROVIDE CONTINUOUS DOUBLE TOP PLATE ACROSS THE TOP OF PARAPET WALL. SEE DETAIL 44 / S4.3.
- 2x10 OUTRIGGERS @ 16" O.C.
 - MATCH EXISTING OVERHANG.
 - REMOVE EXISTING ROOF FRAMING AS REQUIRED, SEE NOTE #27.
- (E) 2x10 RAFTERS.
- (E) DOUBLE 2x10 HIP RAFTER.
- 3"Ø STANDARD PIPE PARAPET BRACE.
 - SEE DETAIL 11 / S4.3 FOR TYPICAL CONFIGURATION.
 - SEE DETAILS 12 & 13 S4.3 FOR TYPICAL CONNECTIONS.
 - SCHEDULE 40, ASTM A53, Fy=35 ksi.
- NEW 2x10 ROOF RAFTERS @ 24" O.C. w/ SIMPSON U210TF.
- 2x12 ROOF OVERFRAMING JOISTS TO MATCH (N) ROOF LINE.
 - SEE REFERENCED DETAILS.
 - RIP JOISTS AS REQUIRED TO MATCH NEW ROOF LINE.
- 30" CLEAR SPAN BETWEEN ROOF JOISTS AT HVAC PLENUM.
- 5"x5"x1/4" HSS COLUMN AT EQUIPMENT TOWER.
 - COLUMN CANNOT FALL ON JOIST, PLACE BETWEEN JOISTS.
 - SEE DETAIL 31 / S4.2.
- 6x8 SHAPED NAILER.
 - ROOF TRUSSES SHALL BE DESIGNED FOR A 2,000# POINT LOAD FROM EQUIPMENT TOWER.
- OUTLINE OF NEW AC.1 PHASE I MECHANICAL UNIT.
 - SEE SHEET A3.1 FOR LOCATION.
 - SEE MECHANICAL DRAWINGS.
 - MAX. OPERATING WEIGHT IS 780#.
 - SEE DETAILS 51 / S4.3, 52 / S4.3 AND 53 / S4.3.
- OUTLINE OF PHASE II MECHANICAL UNITS.
 - SEE SHEET A3.1 FOR LOCATION.
 - SEE MECHANICAL DRAWINGS.
 - MAX. OPERATING WEIGHT IS 780#.
 - SEE DETAILS 51 / S4.3, 52 / S4.3 AND 53 / S4.3.
- CENTERLINE OF NEW ROOF TRUSS.
- CENTERLINE OF EXISTING MASONRY WALL.
- ROOF TRUSS, MATCH CENTERLINE OF NEW TRUSS AND EXISTING MASONRY WALL.
- EXISTING DOUBLE 2x10 ROOF HIP RAFTER TO BE REMOVED, SEE NOTE #27.
- NEW PARAPET WALL FRAMING DIRECTLY ABOVE EXISTING OR NEW MASONRY WALL.
- EXISTING ROOF FRAMING TO BE REMOVED.
 - SHORE AND BRACE EXISTING FRAMING AS REQUIRED.
 - SEE DEMO PLAN.
- FACE OF NEW STUD.
- EDGE OF EXISTING ROOF TO BE REMOVED.
- NEW 2x6 STUD WALL BETWEEN HOLDING CELL CONCRETE LID AND ROOF.
 - TYPICAL LINE B.
 - SEE DETAILS 21 / S4.3, 31 / S4.3 AND 13 / S4.2.
 - SEE DETAIL 44 / S4.3 FOR TOP PLATE SPLICE.
- EXISTING ROOF BEAM TO BE REMOVED.
 - SHORE AND BRACE EXISTING FRAMING AS REQUIRED.
 - SEE DEMO PLAN.
- EXISTING STEEL COLUMN EMBEDDED INTO EXISTING CMU WALL, TO REMAIN.
 - PATCH AS REQUIRED.



ROOF FRAMING (AT LOBBY) KEYNOTES

- (N) W12x26 STEEL BEAM UNDER (E) BLOCK WALL.
 - T.O.B. = 10'-6" A.F.F.
 - SEE DETAIL 31 / S4.1 FOR BEAM SECTION AT (E) WALL.
 - SEE DETAIL 32 / S4.1 FOR COLUMN CAP.
 - SEE DETAIL 33 / S4.1 FOR COLUMN BASEPLATE.
- (N) HSS4x3x1/4" STEEL COLUMN.
- (E) 3-2x10 ABOVE GLULAM OUTRIGGERS
- (E) DOUBLE 14" TJI, PITCHED
- (E) DOUBLE 20" TJI, PITCHED
- (E) 2x10 OUTRIGGERS @ 24" O.C.
- (E) CMU WALL TO REMAIN.

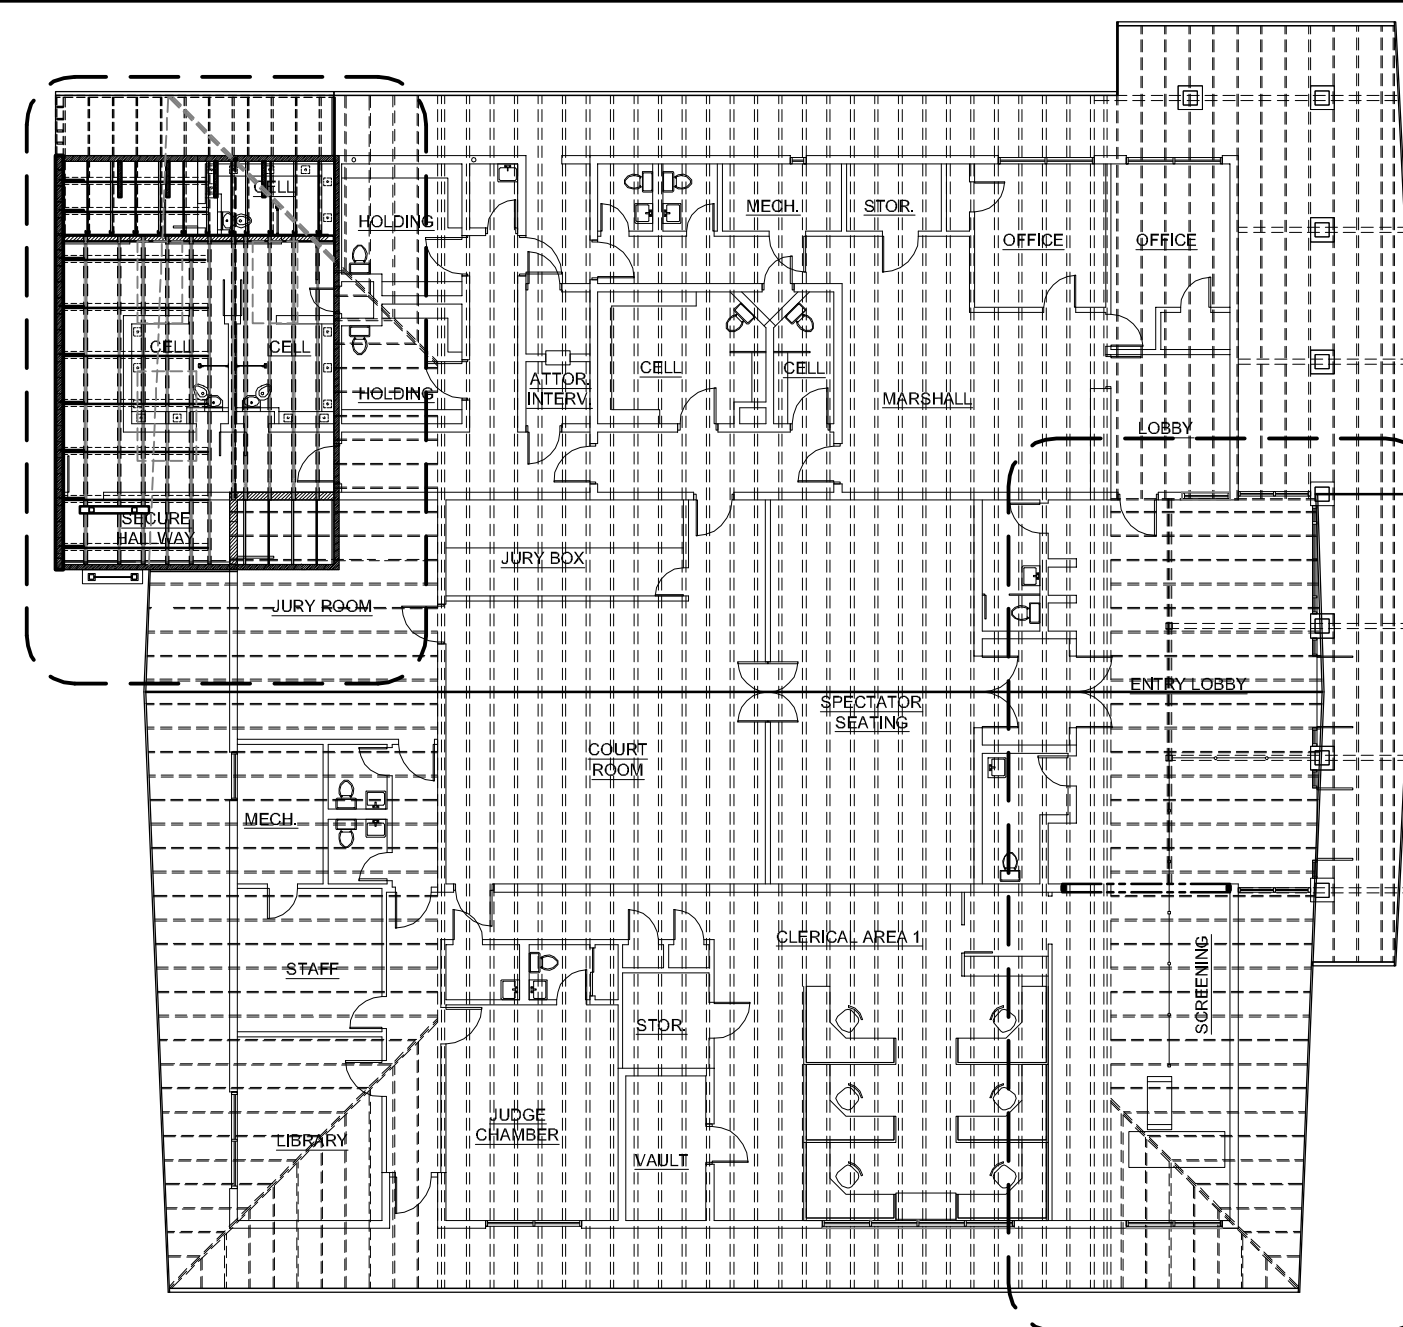

PHASE I KEY PLAN

SCALE: 1/16" = 1'-0"

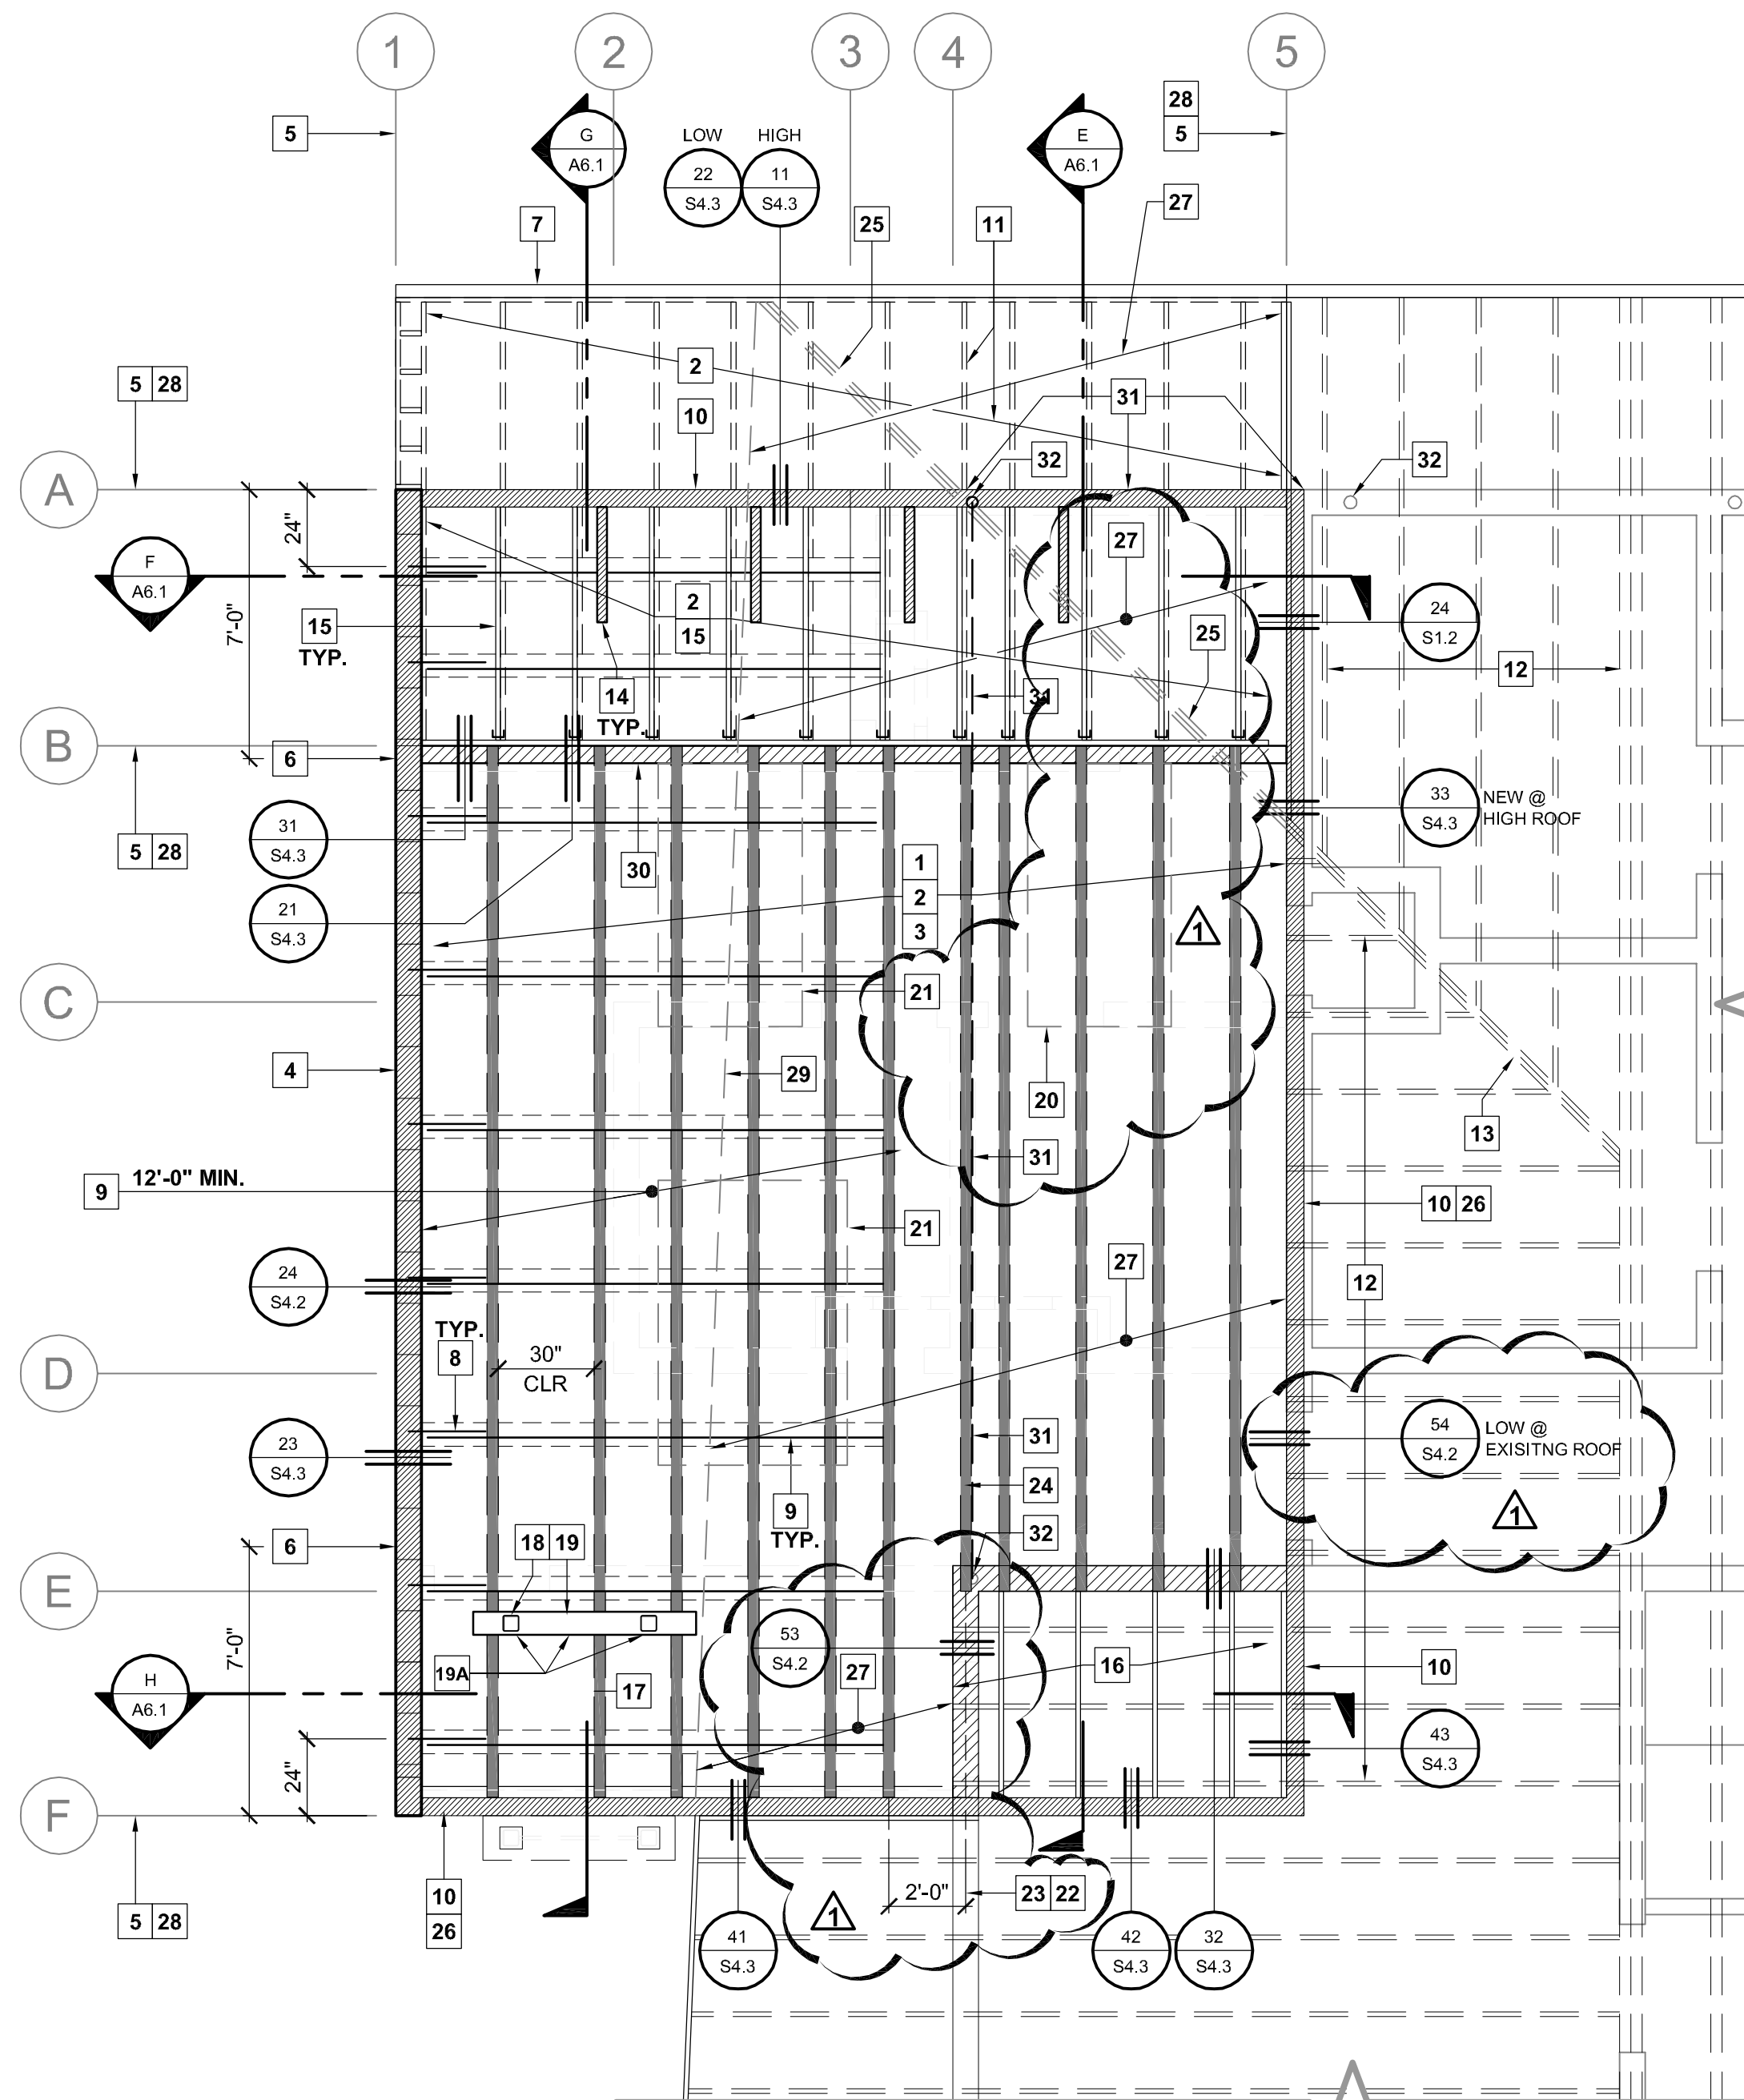

PHASE I ROOF FRAMING PLAN - HOLDING CELL ADDITION

SCALE: 1/4" = 1'-0"

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

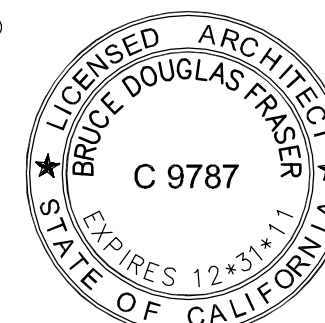

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

























Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I
ROOF FRAMING
PLAN**

SHEET #

S3.1

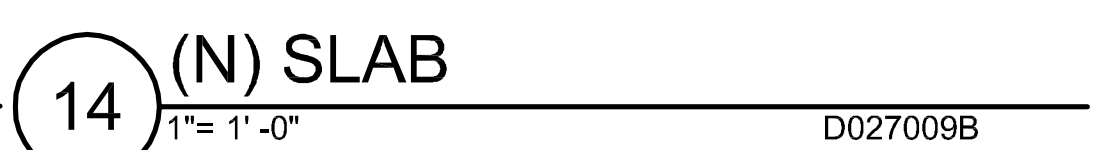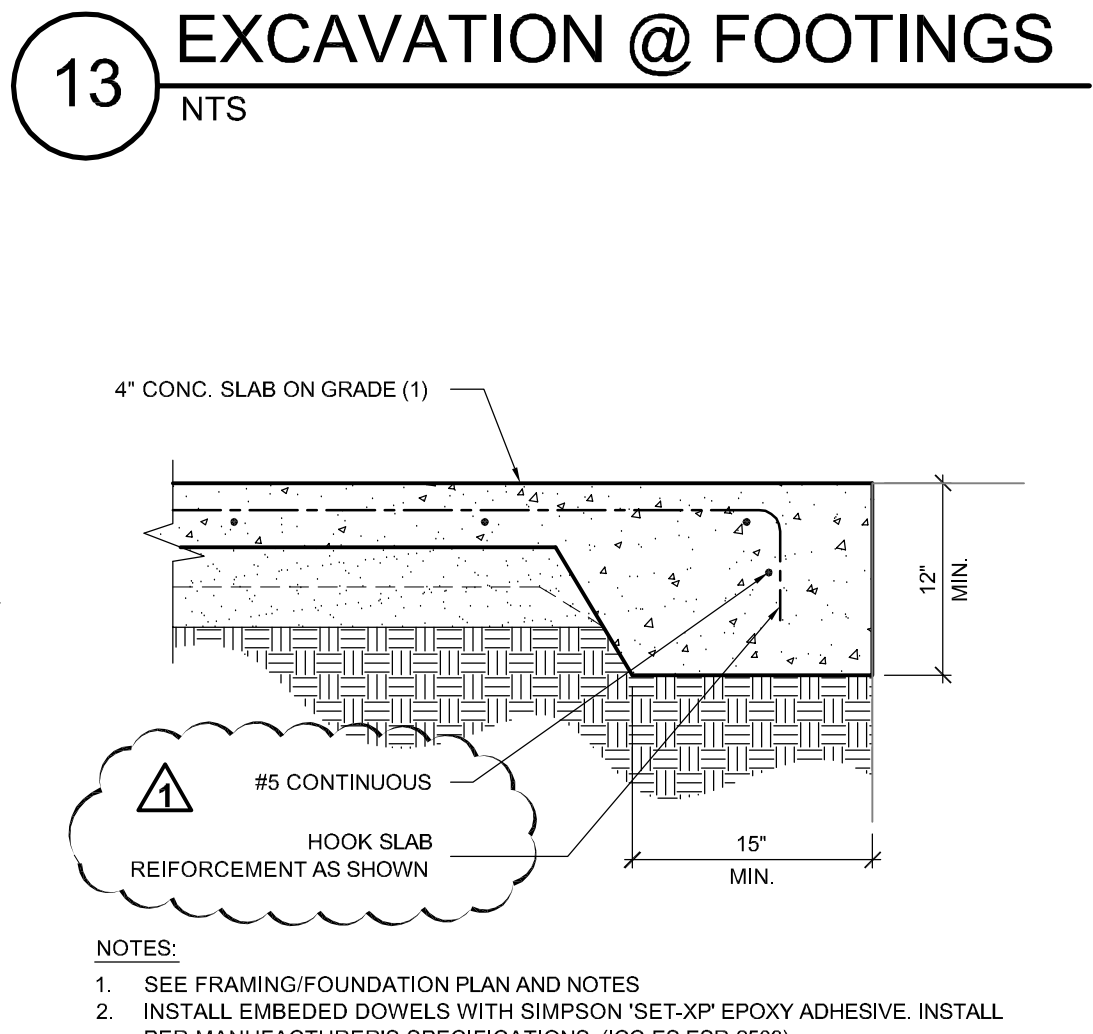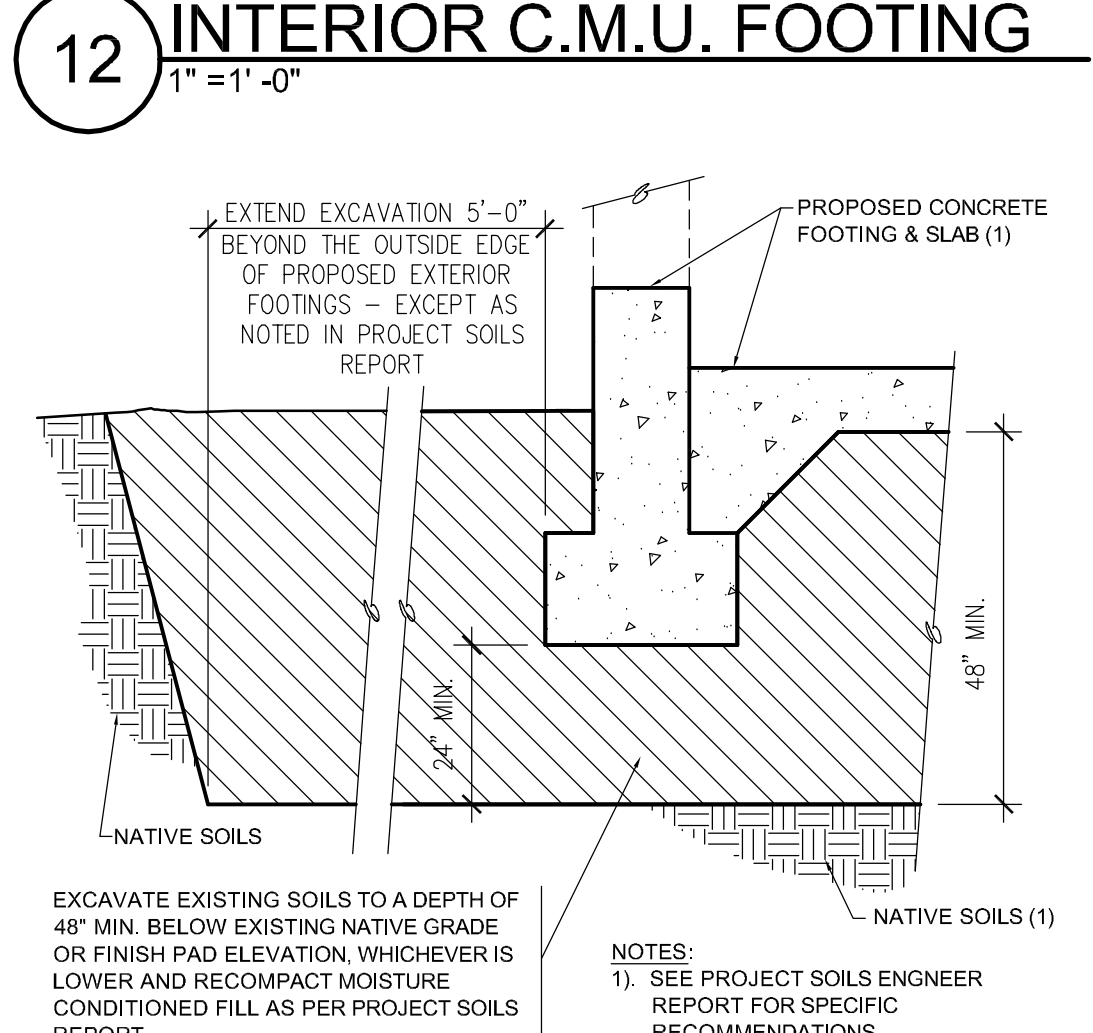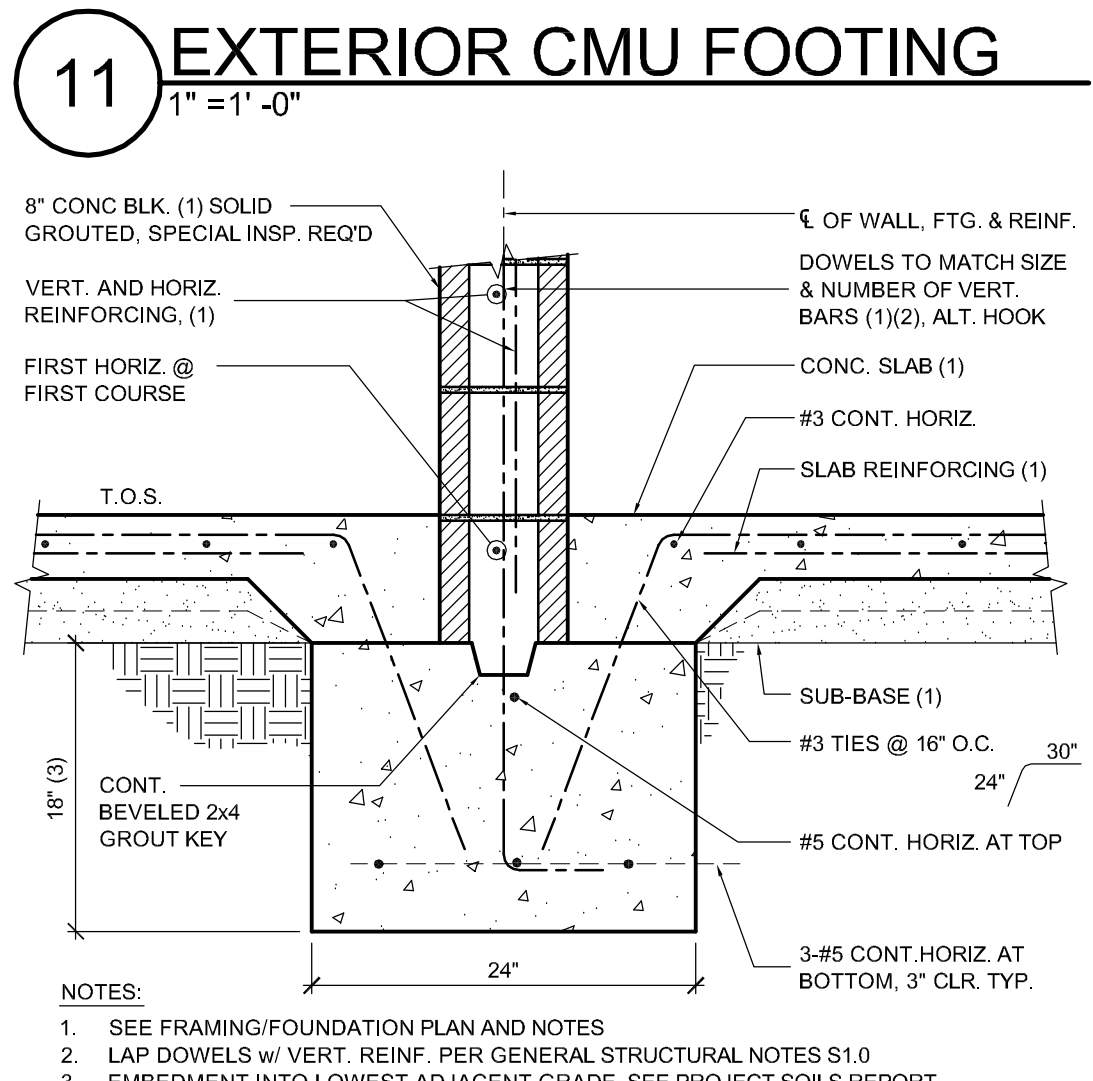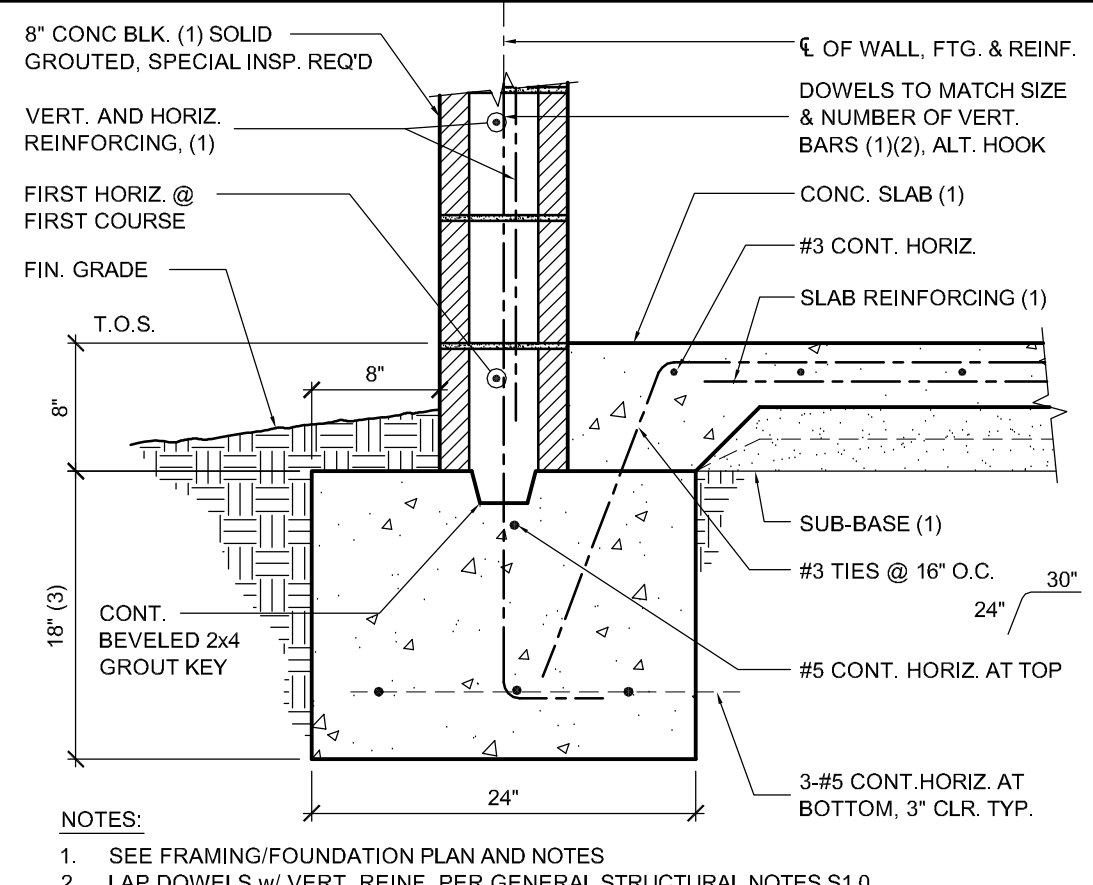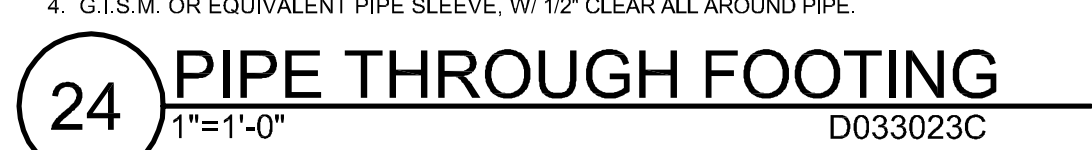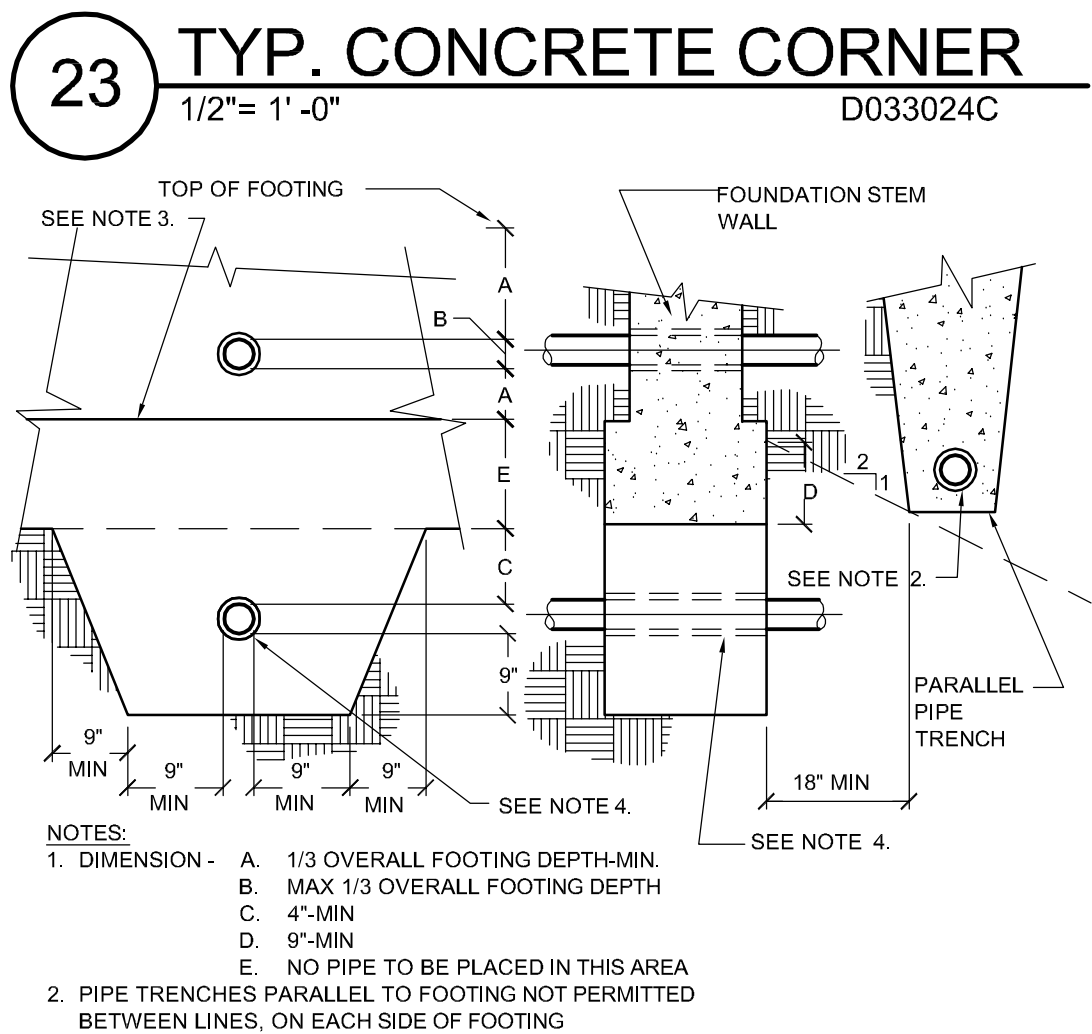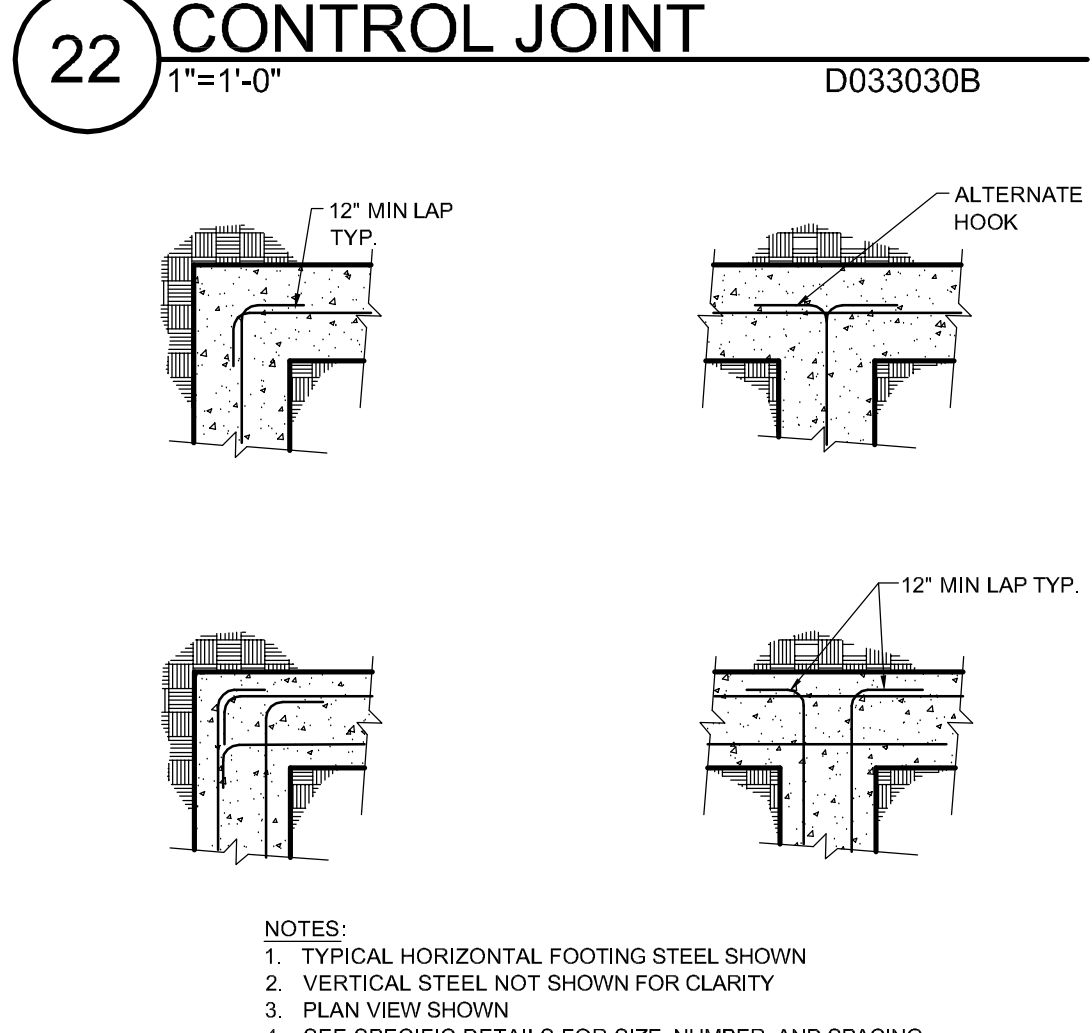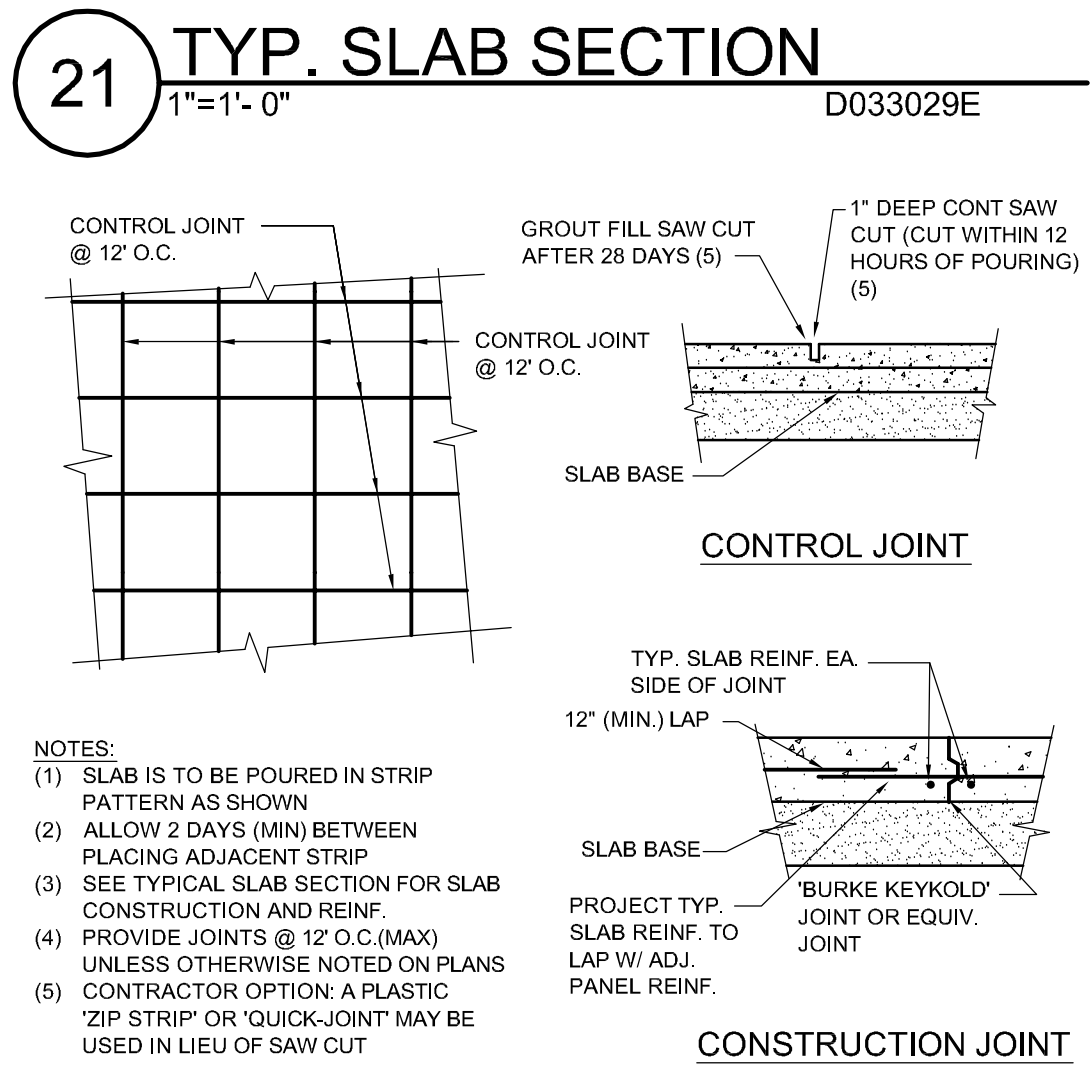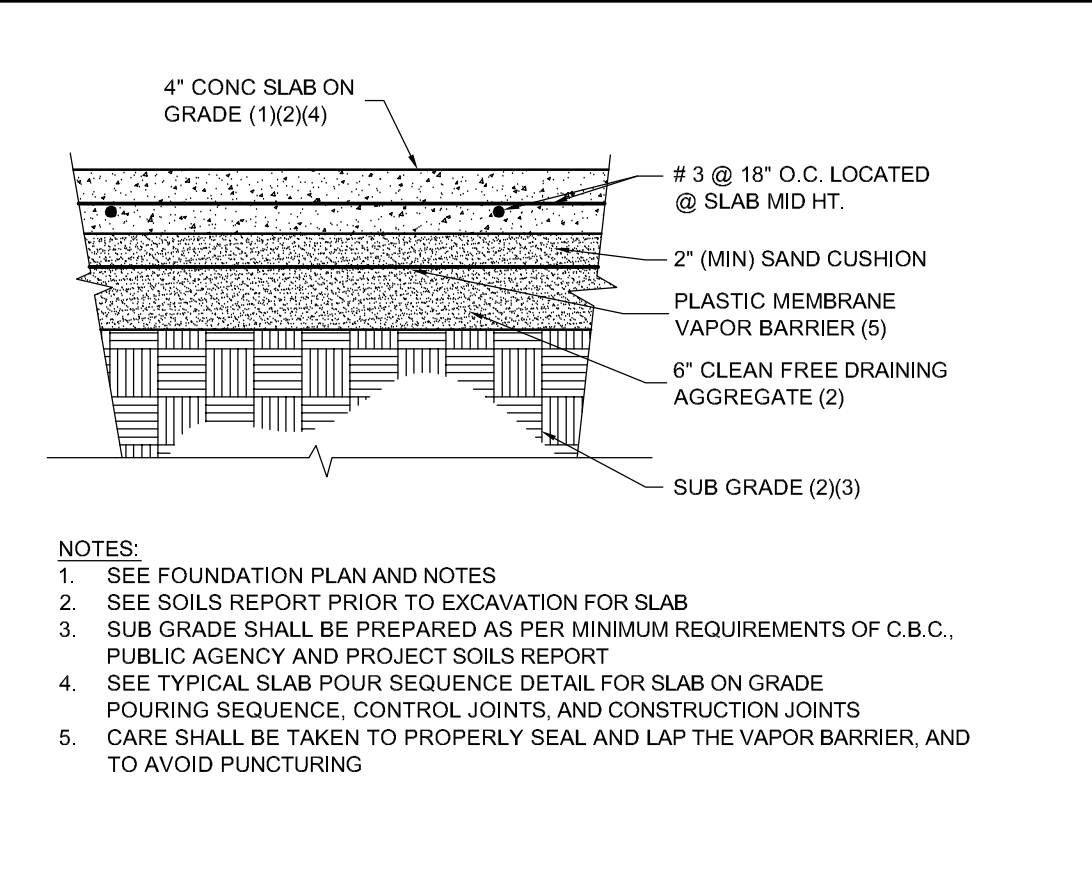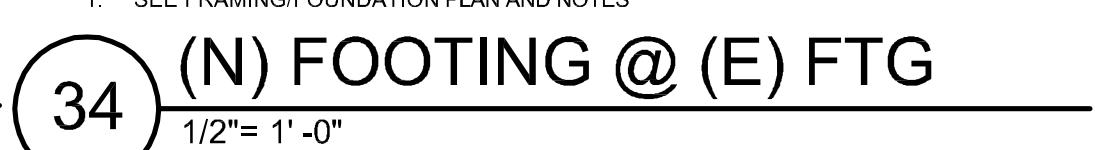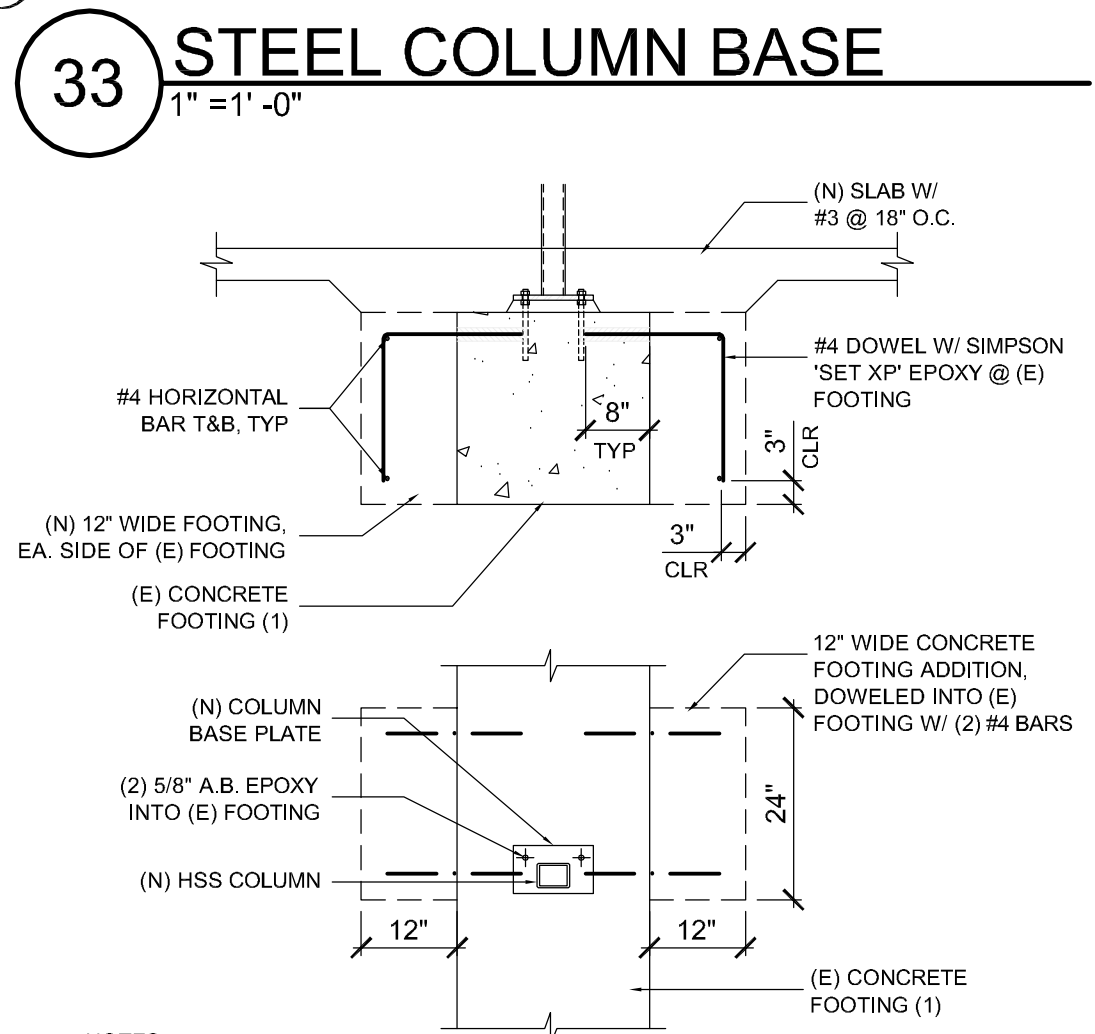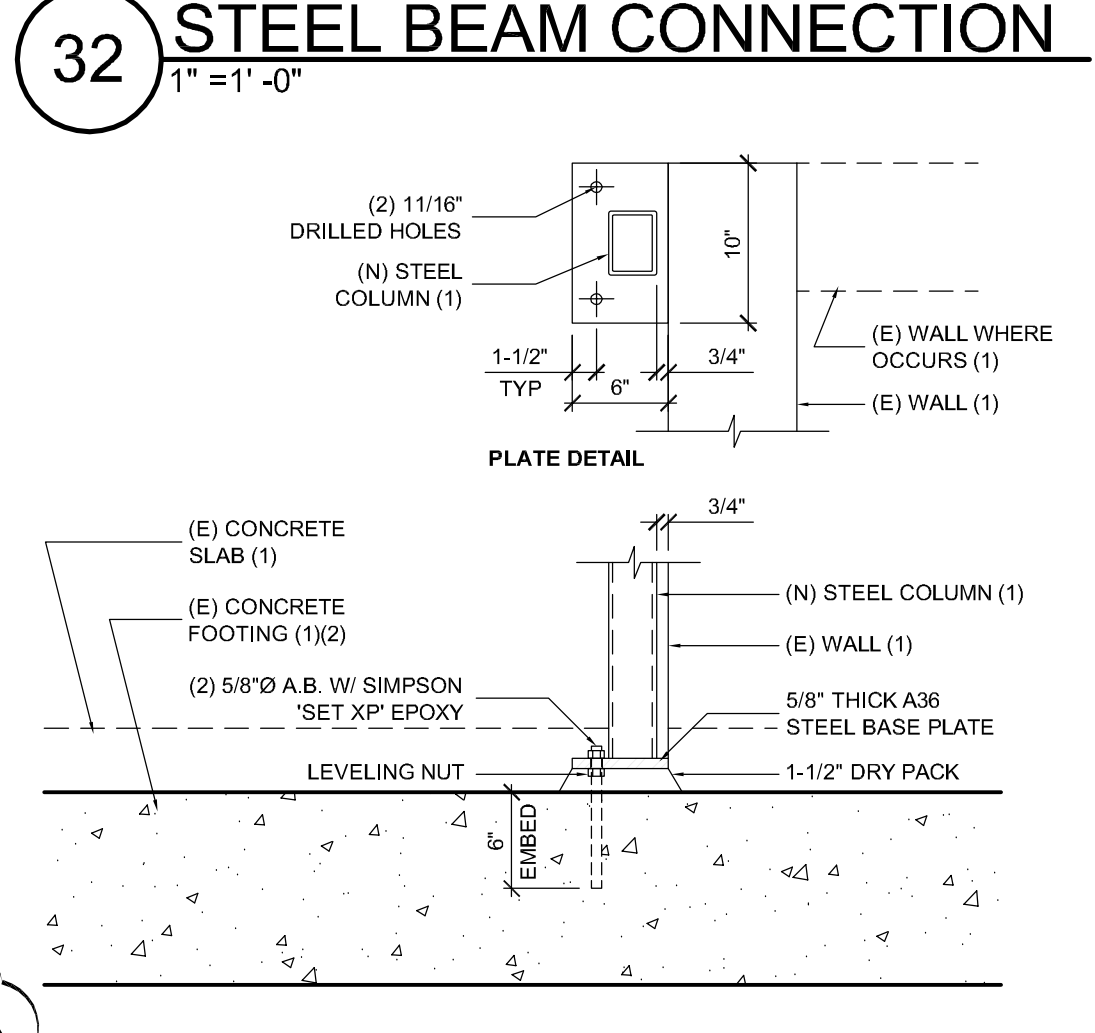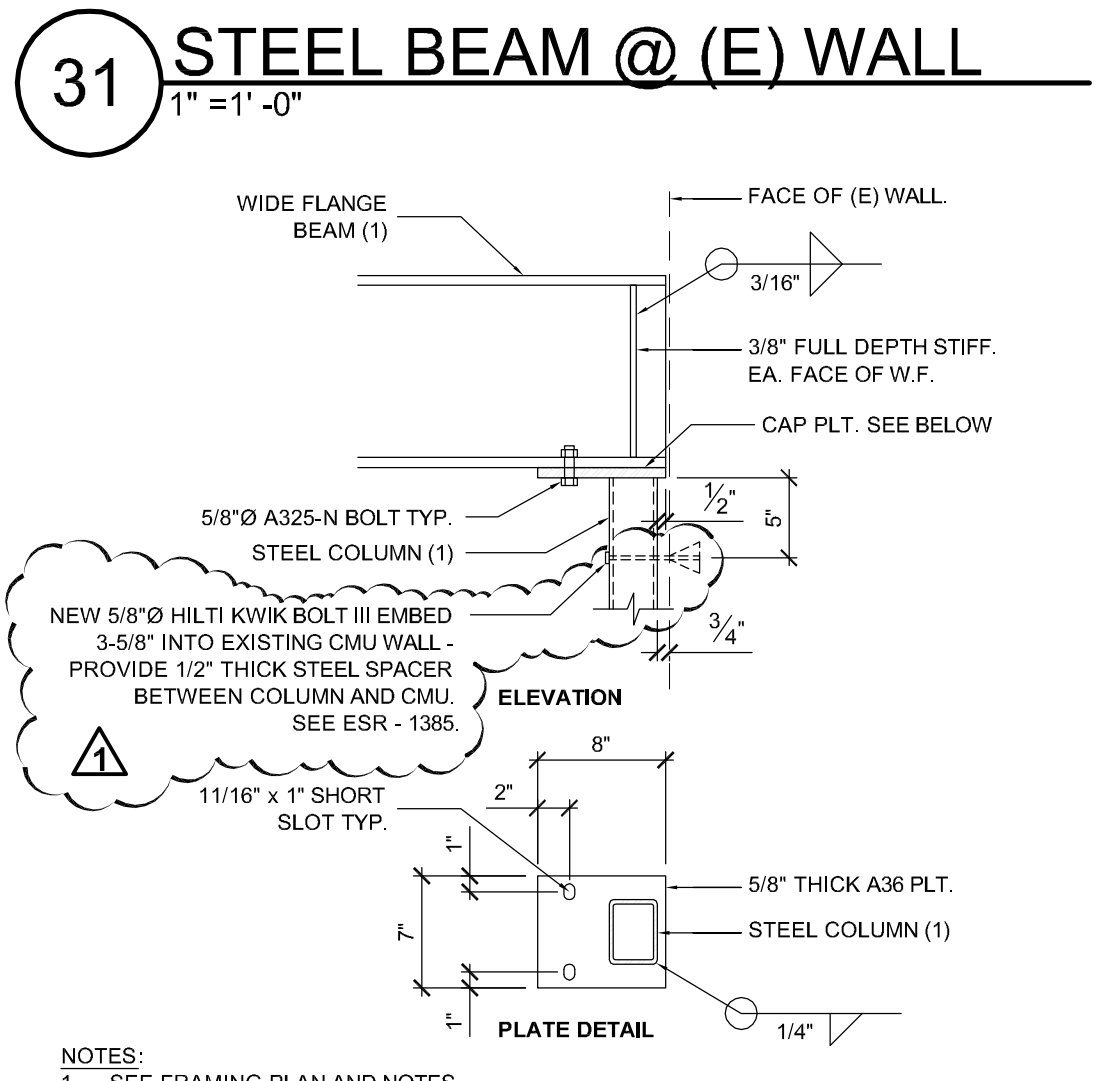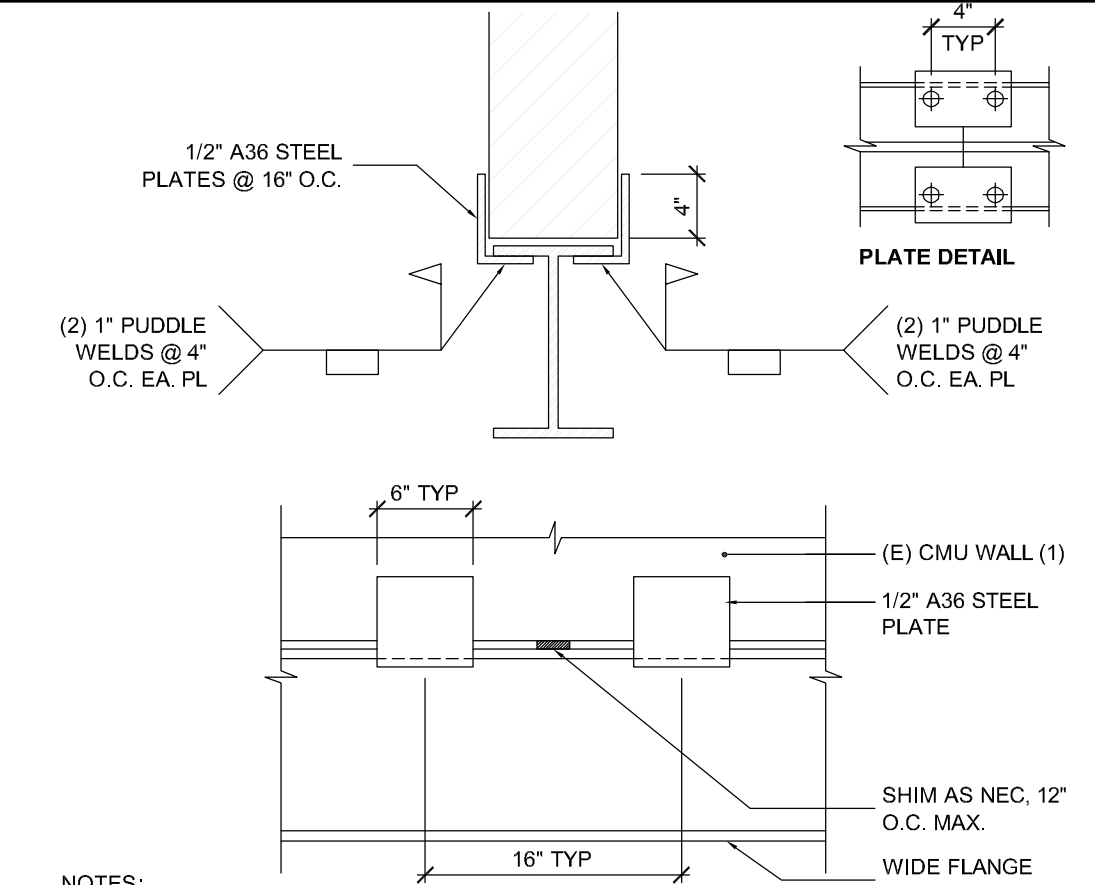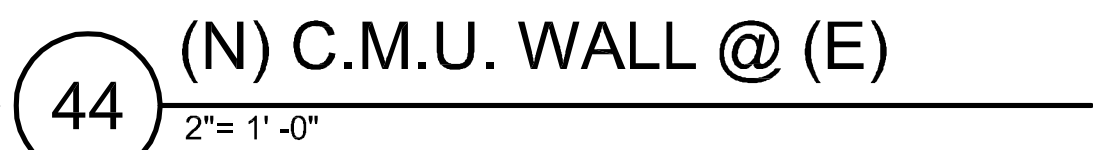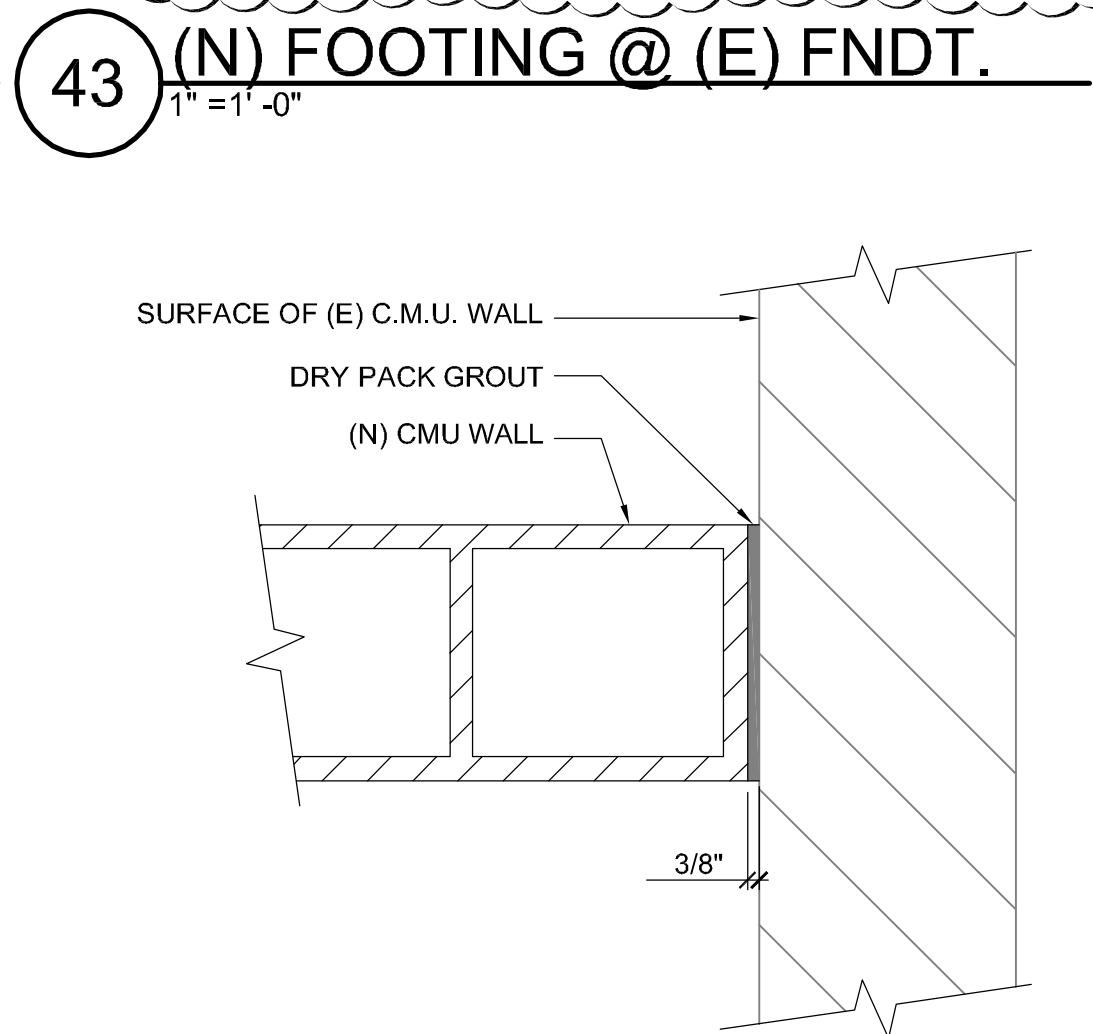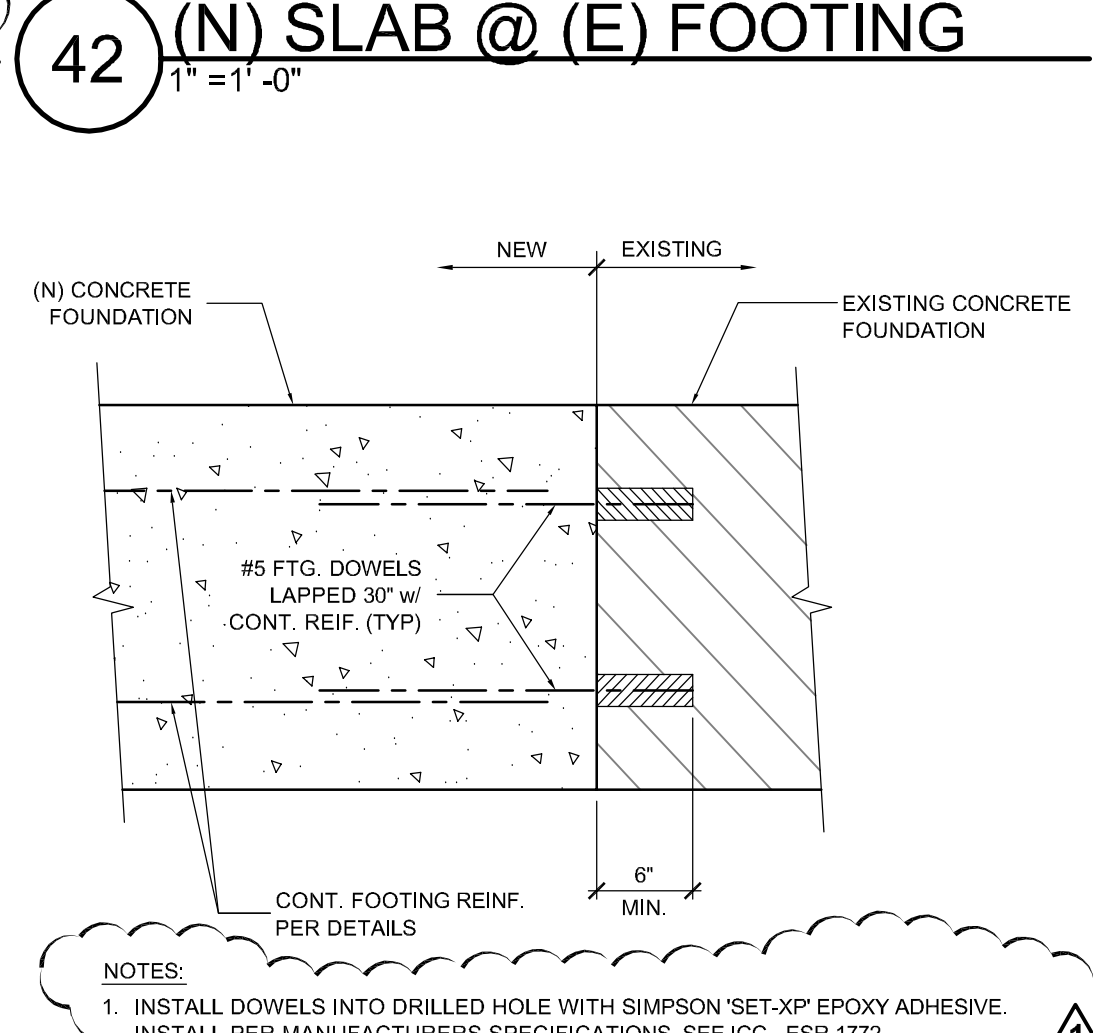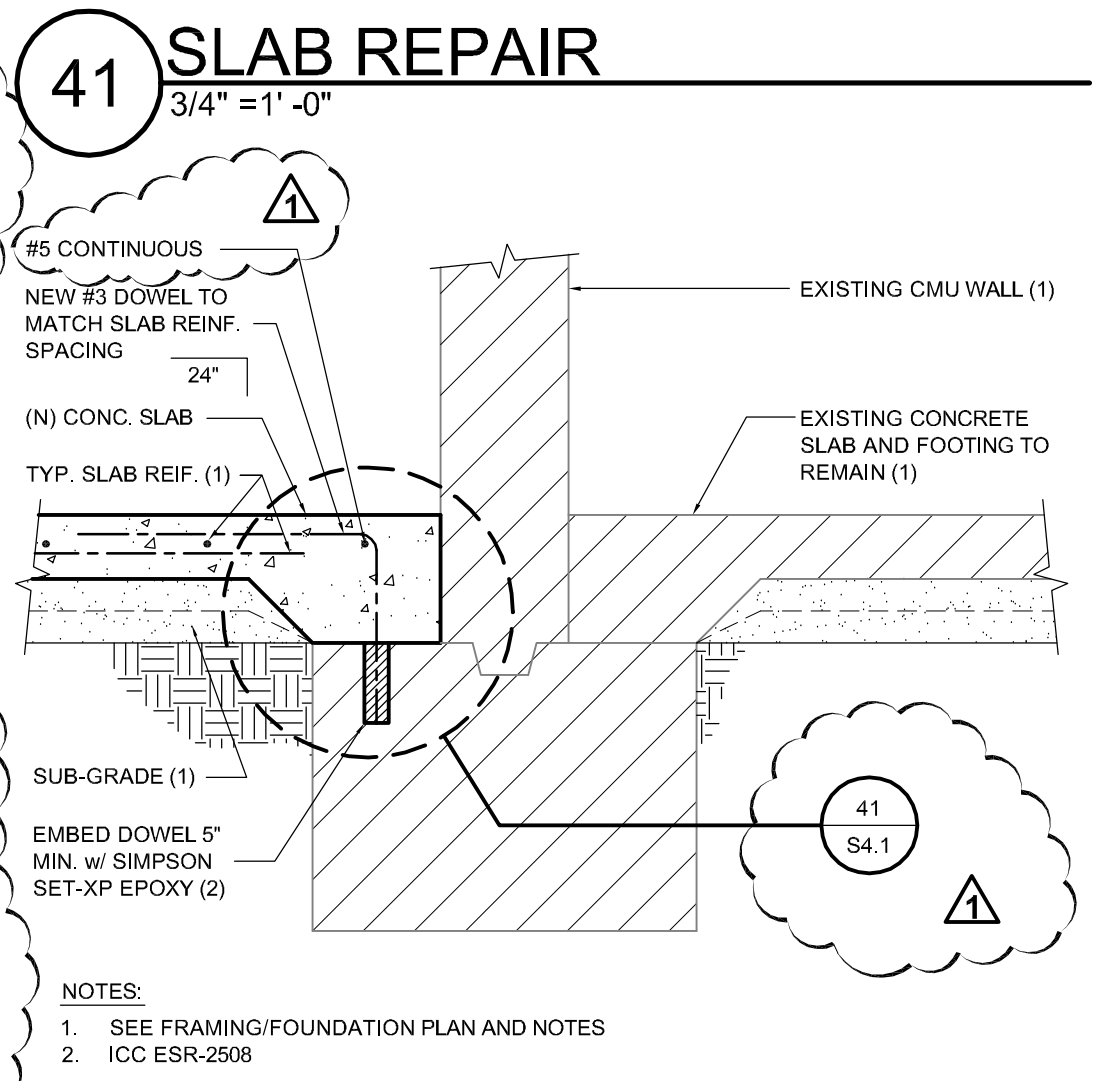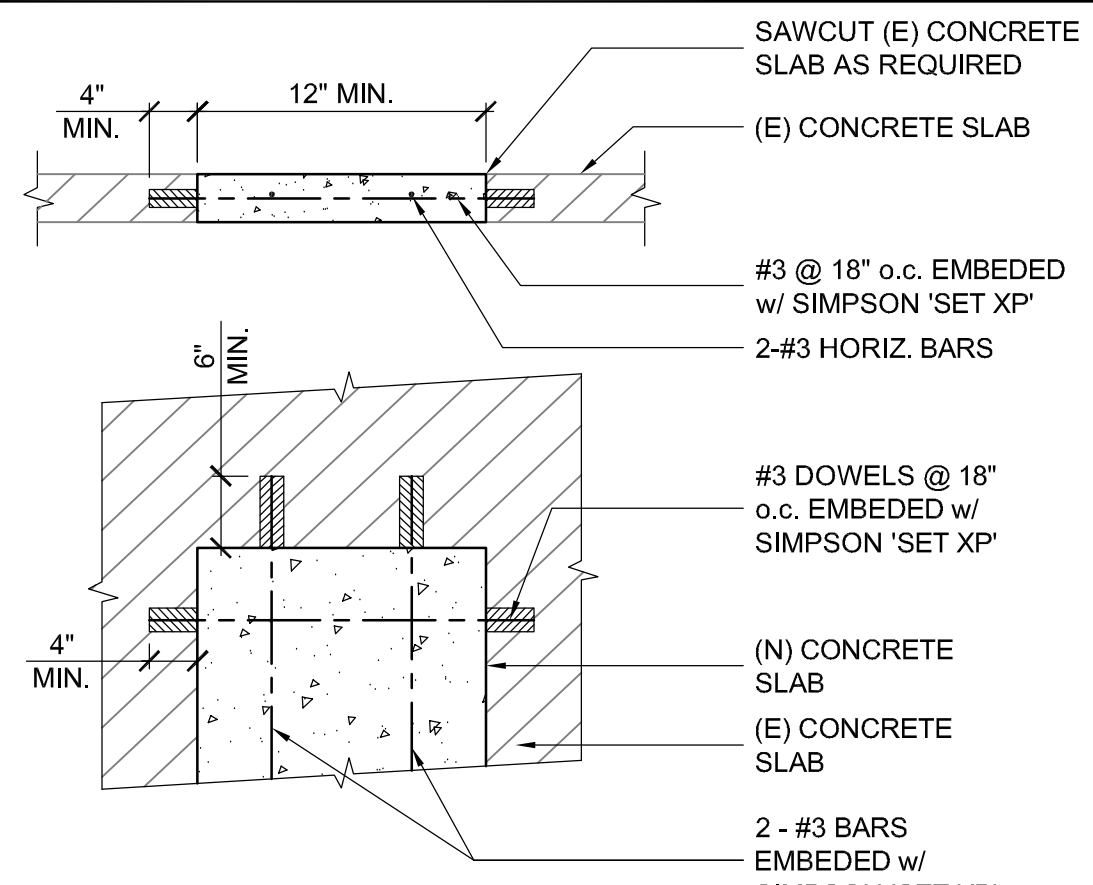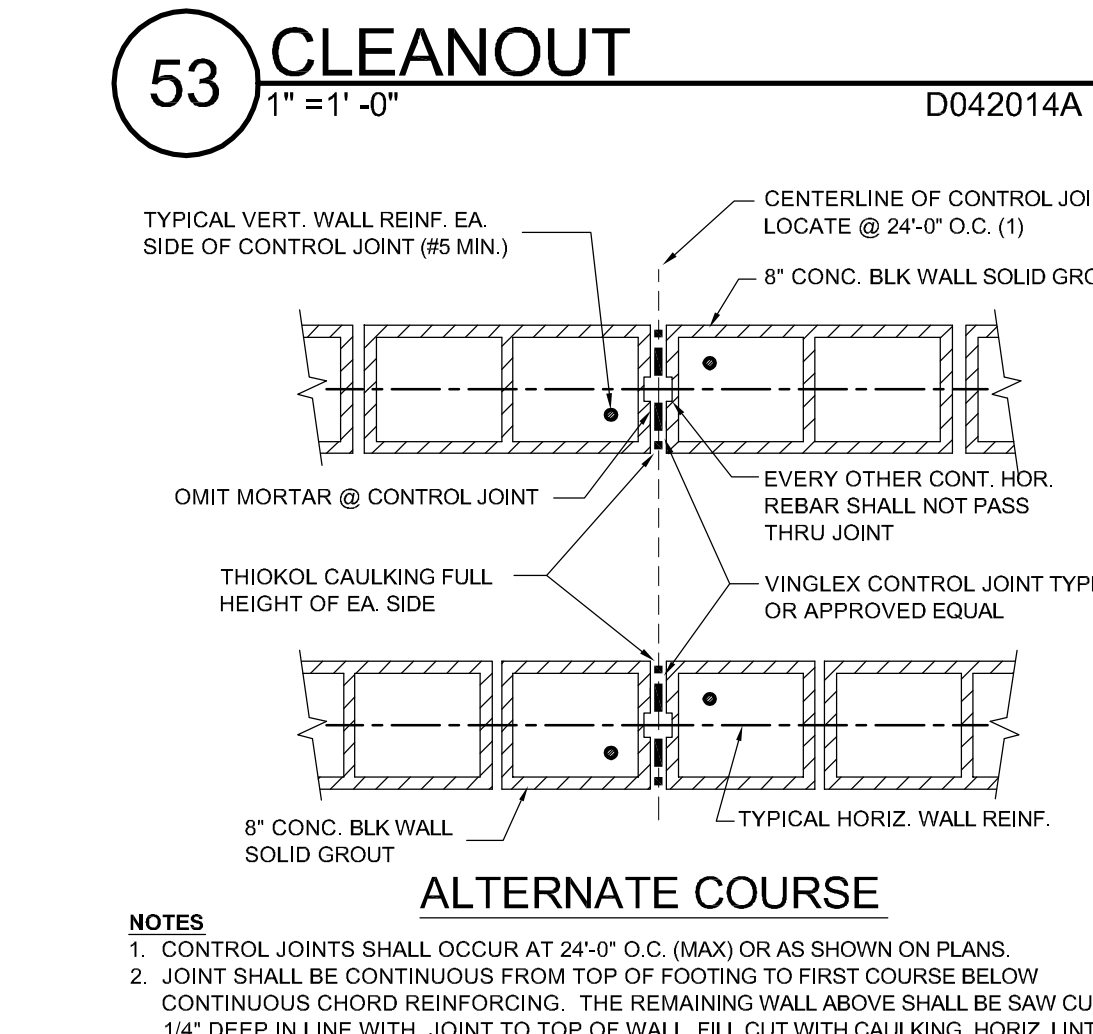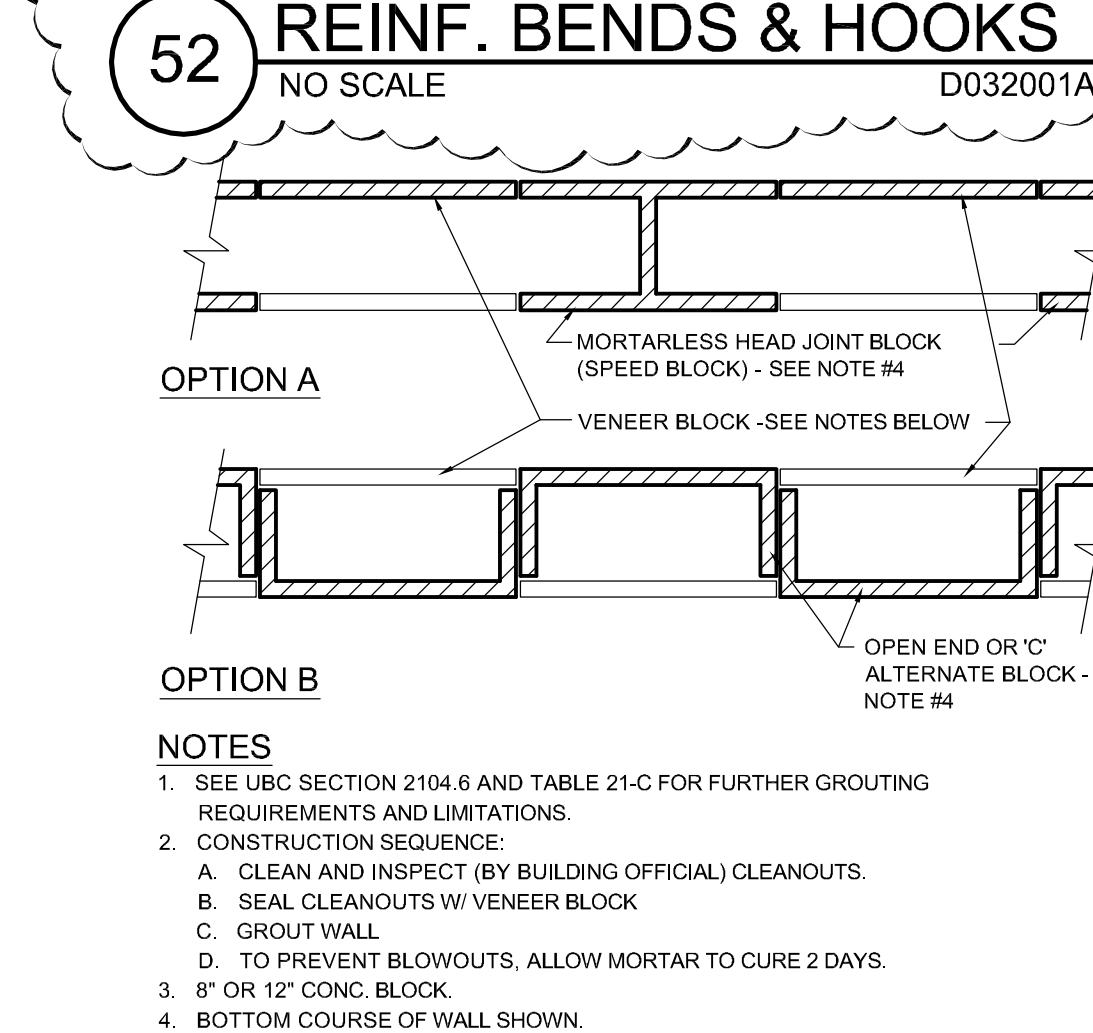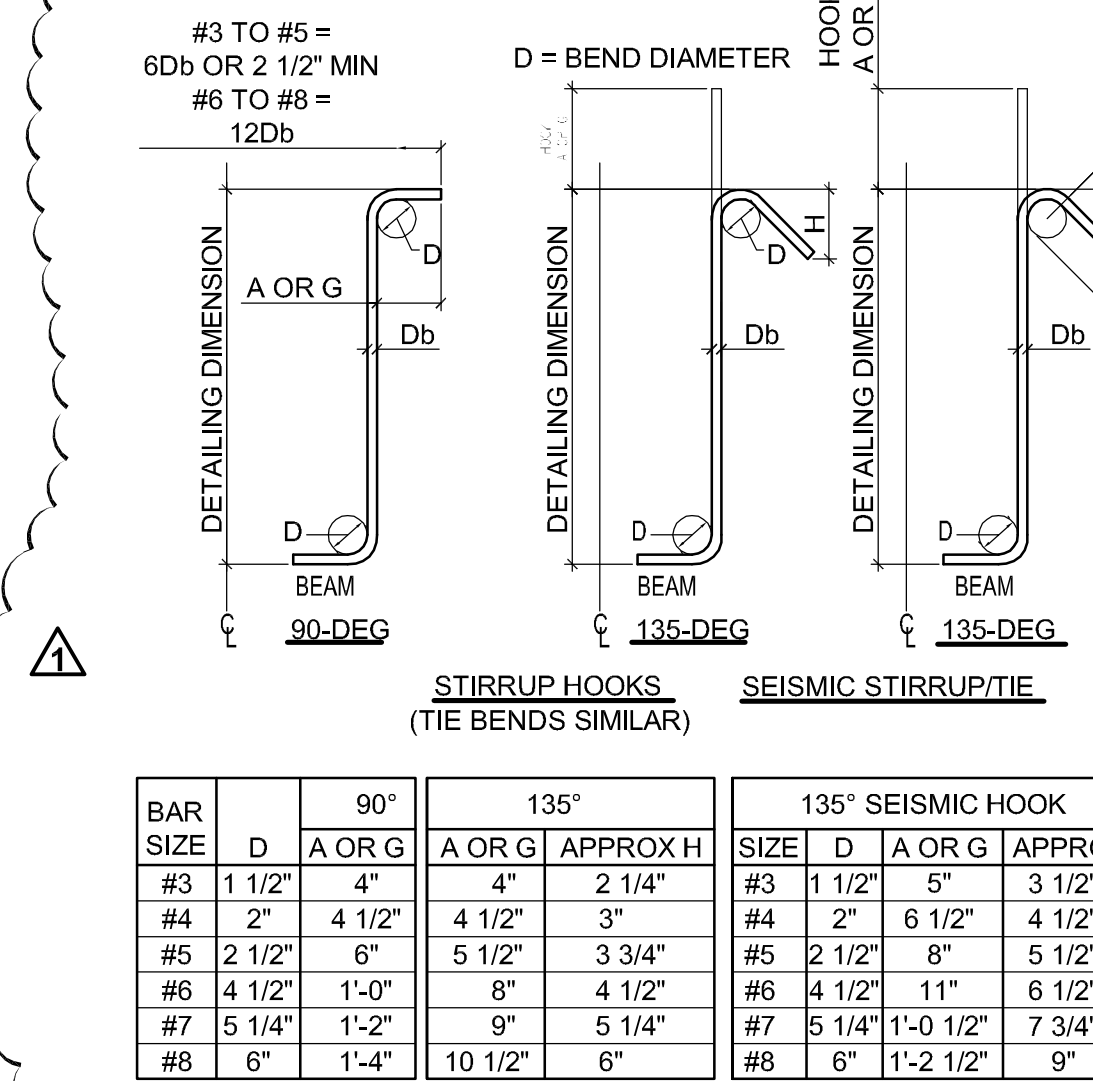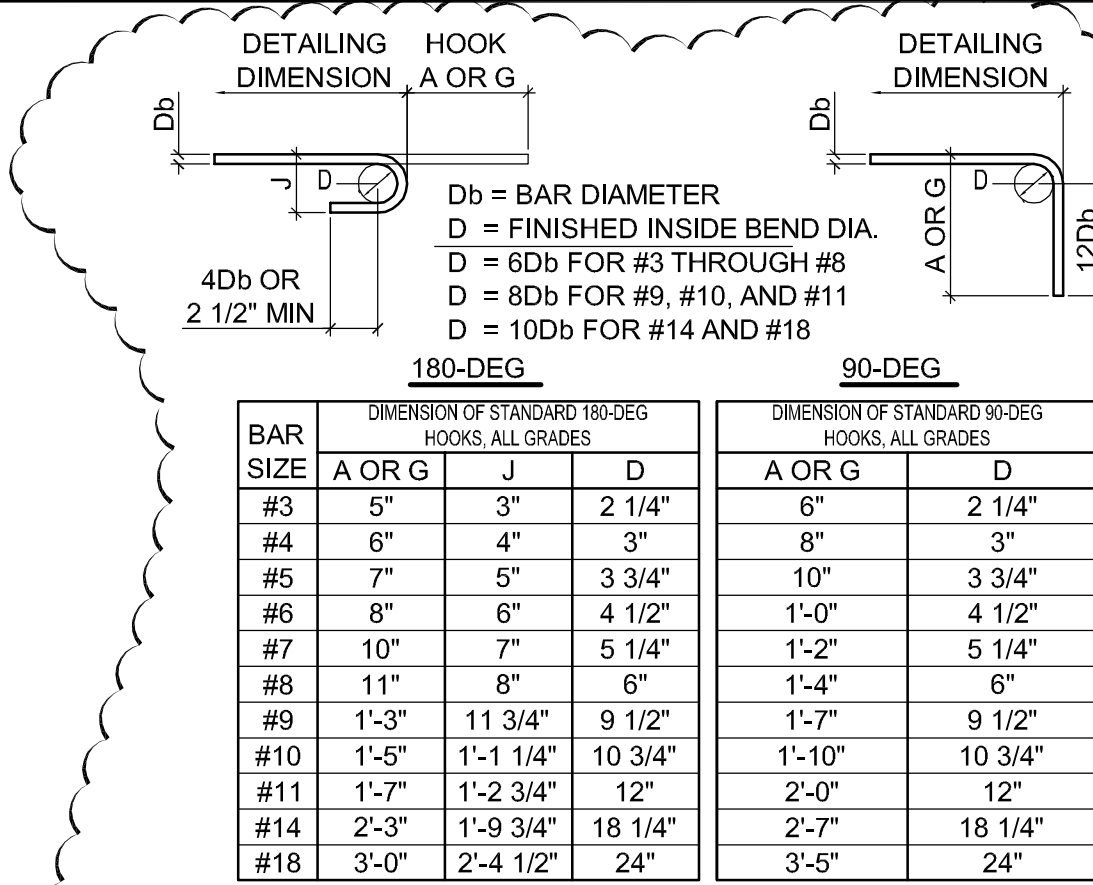

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #

1007

FRASER SEIPLE ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11
06/20/11

SIGNED

LICENSED ARCHITECT
BRUCE DOUGLAS FRASER
C 9787
EXPIRES 12/31/11
STATE OF CALIFORNIA

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

STRUCTURAL DETAILS

SHEET #

S4.1

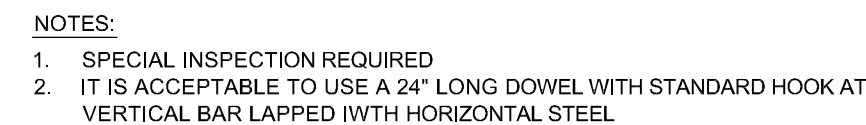

NOTES:

1. SEE FRAMING PLAN & NOTES

NOTES:
1. SEE FRAMING PLAN AND NOTES

NOTES:

1. SEE FRAMING PLAN & NOTES

NOTES:

1. SEE FRAMING PLAN & NOTES

NOTES:

1. SEE FRAMING PLAN & NOTES
2. SEE ARCHITECTURAL PLANS & SECTIONS. MINIMUM INTEL. DEPTH = 16"

NOTES:
1. SEE FRAMING PLAN & NOTES

43 CORNER
1/2" = 1' -0" D042015B

NOTES:
1. SEE FRAMING PLAN & NOTES

23 ELEVATED CONC. SLAB
2"= 1' -0"

NOTES:

1. SEE FRAMING PLAN & NOTES
2. SEE SHEARWALL SCHEDULE

NOTES:
1. SEE DETAIL 23/S4.1 FOR END OF WALL JAMB REINFORCEMENT.

NOTES:
1. SEE DETAIL 33 / S4.2


24 OPENING AT DUCT WORK

NOTES:
1. SEE FRAMING PLAN & NOTES

PROJECT

CLIENT JOB #	ARCHITECT JOB #
--------------	-----------------

1007

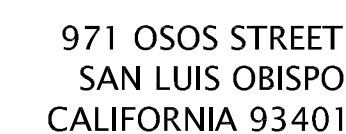

805-544-6161


www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DU

DATES 05/05/11

SIGNED

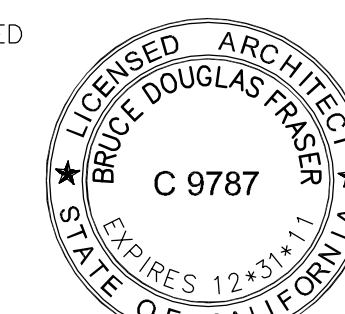

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE


SHEET

S4.2


\\John\Manteca Courthouse 1007\Drawings\Sheets\Phase 1\S4.1 - Phase 1 Structural Details.dwg, 5/2/2011 3:26:05 PM, PDF995

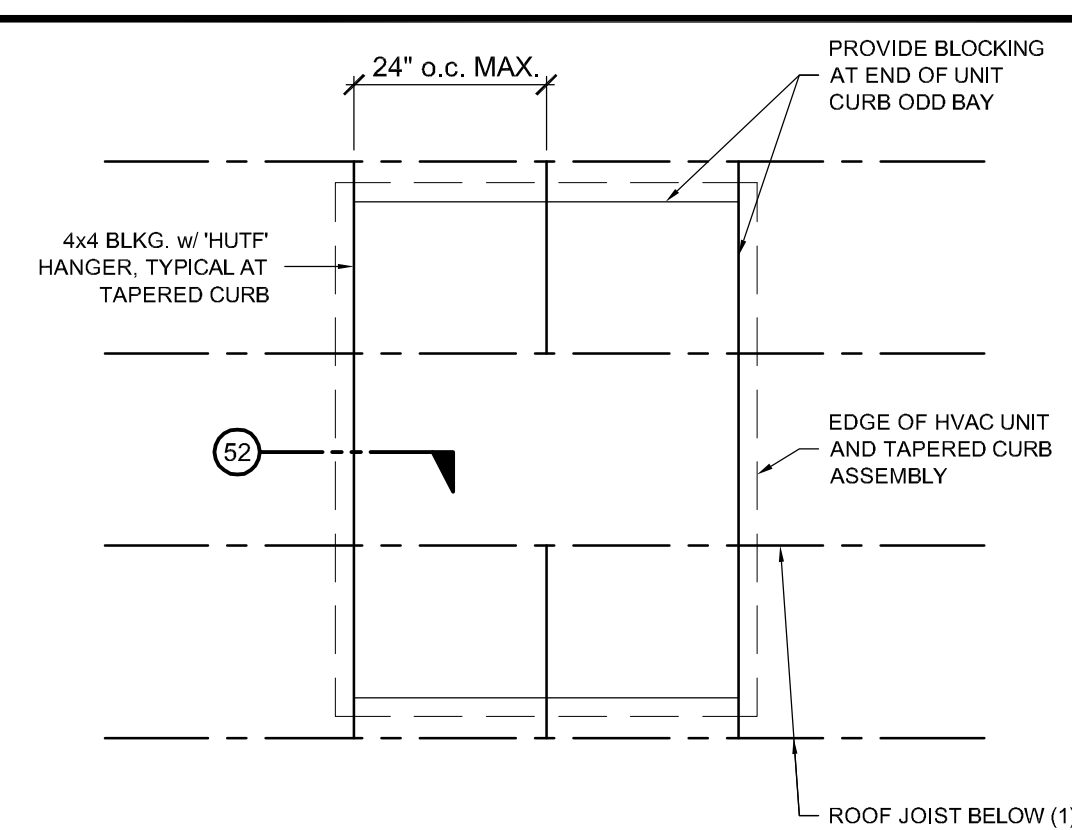


51 HVAC FRAMING PLAN
1/2" = 1' - 0"

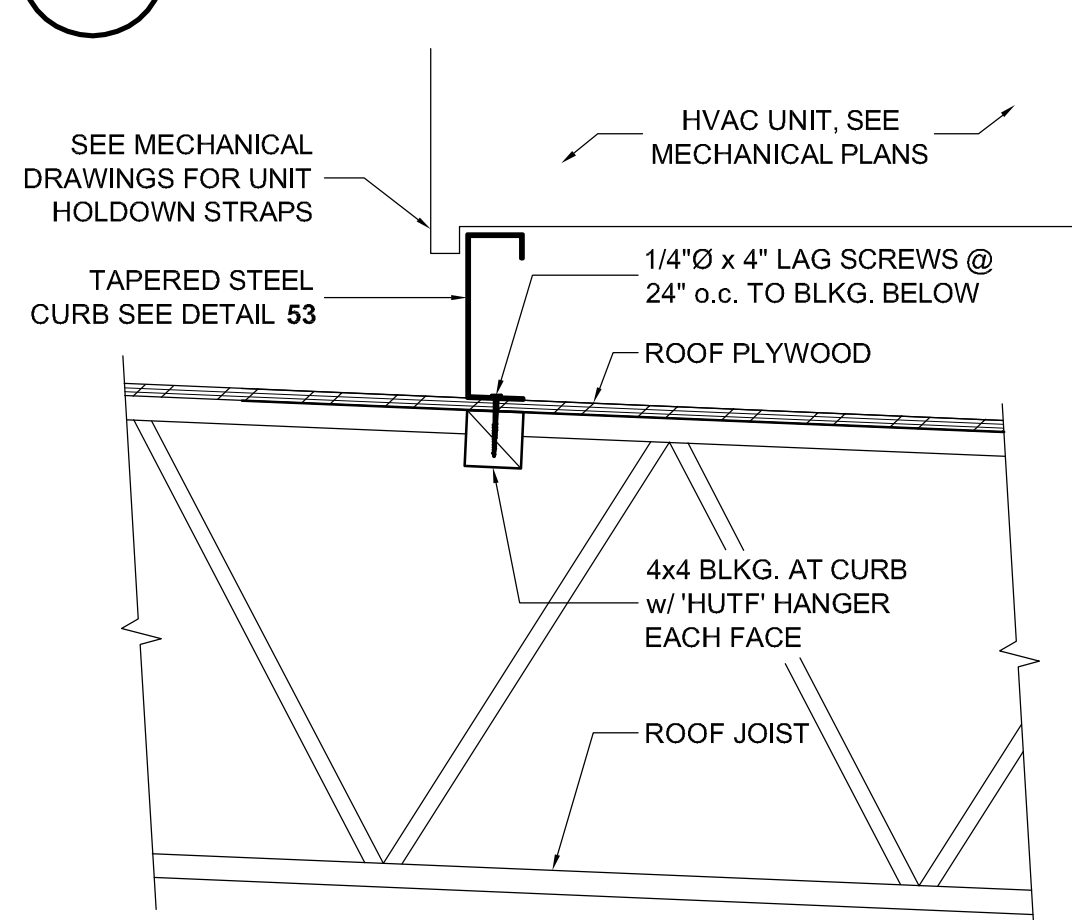


52 ROOF MOUNTED HVAC
1" = 1' - 0"

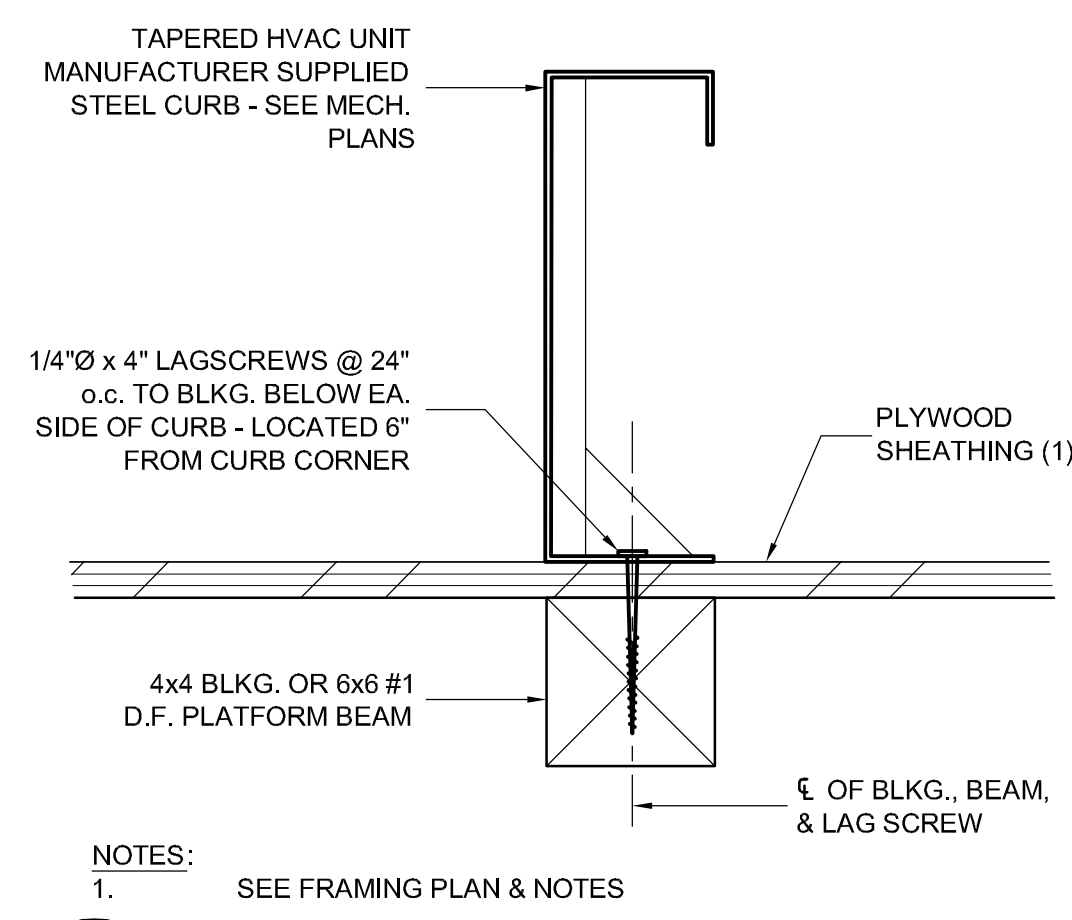


53 HVAC CURB
3" = 1' - 0"

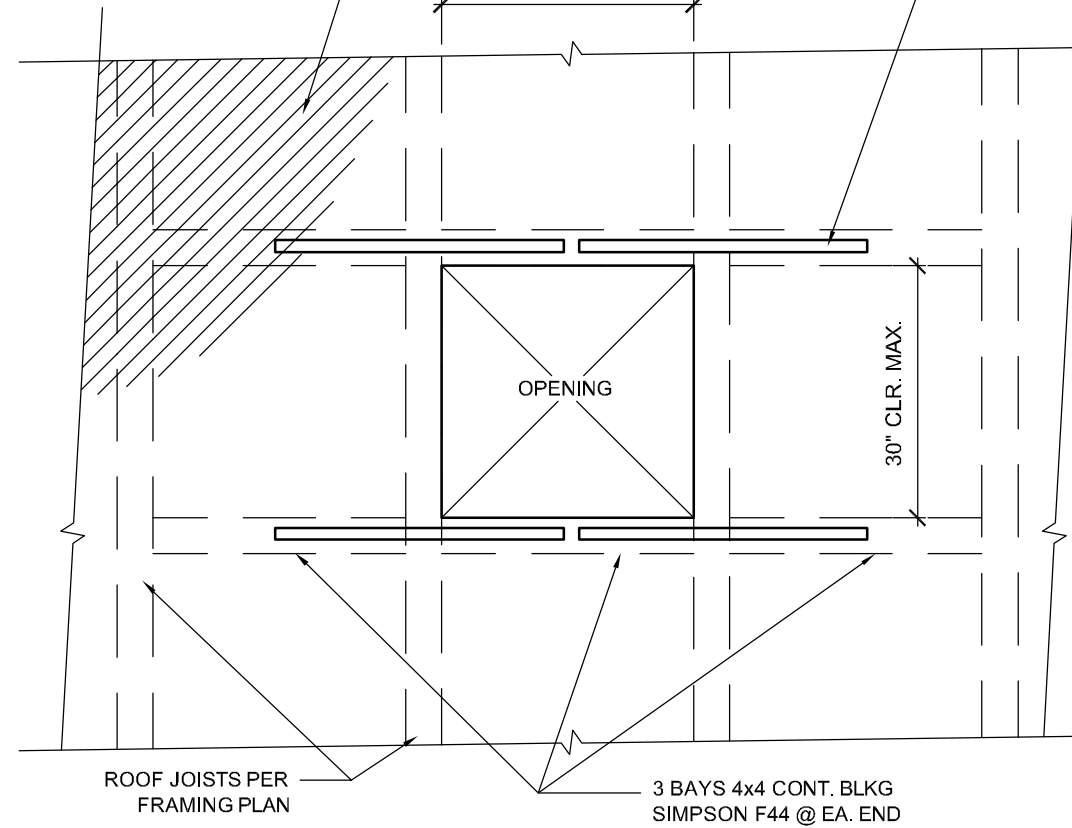


54 ROOF OPENING
3/4" = 1' - 0"

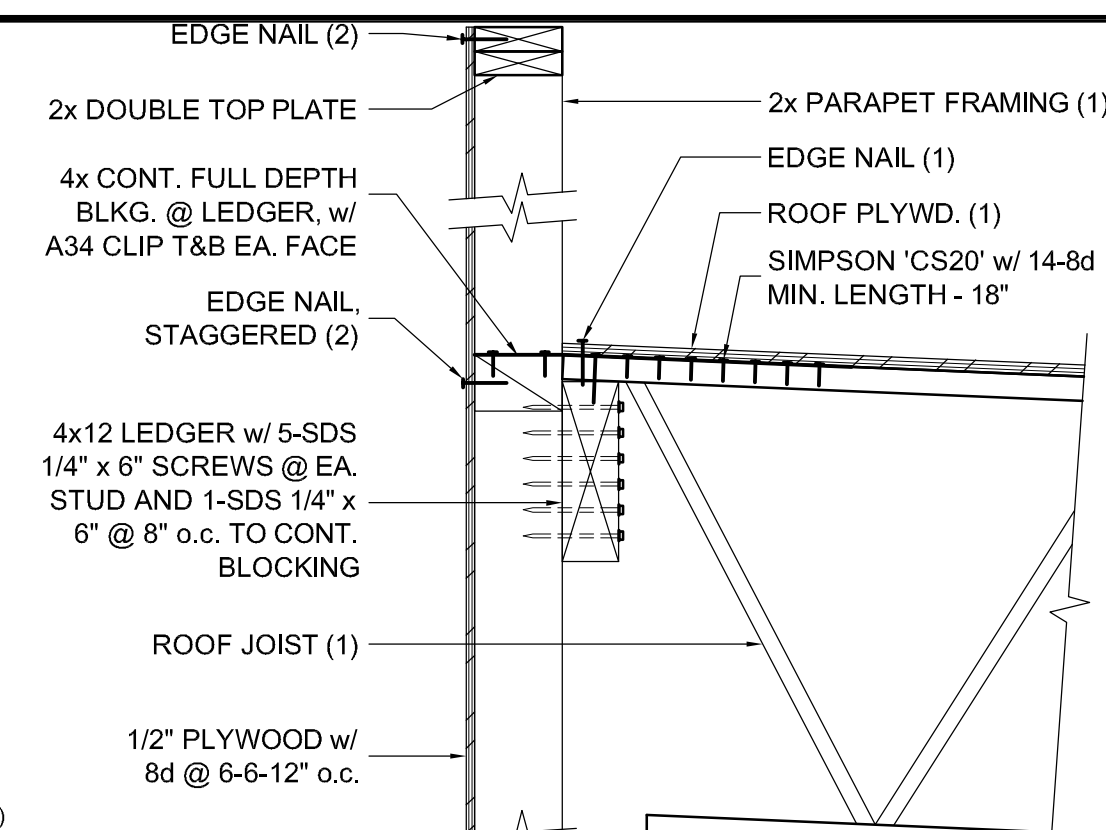


41 ROOF JOISTS AT PARAPET
1" = 1' - 0"

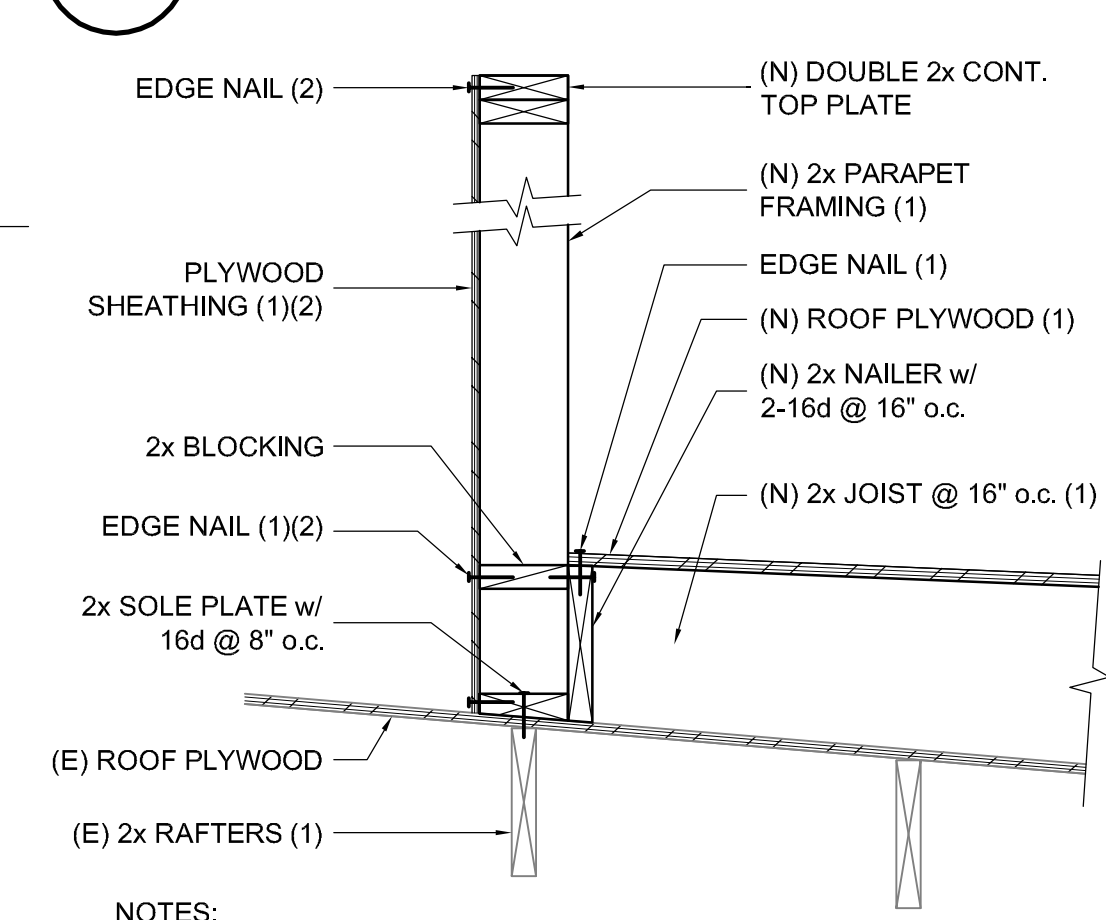


42 PARAPET WALL @ (E) ROOF
1" = 1' - 0"

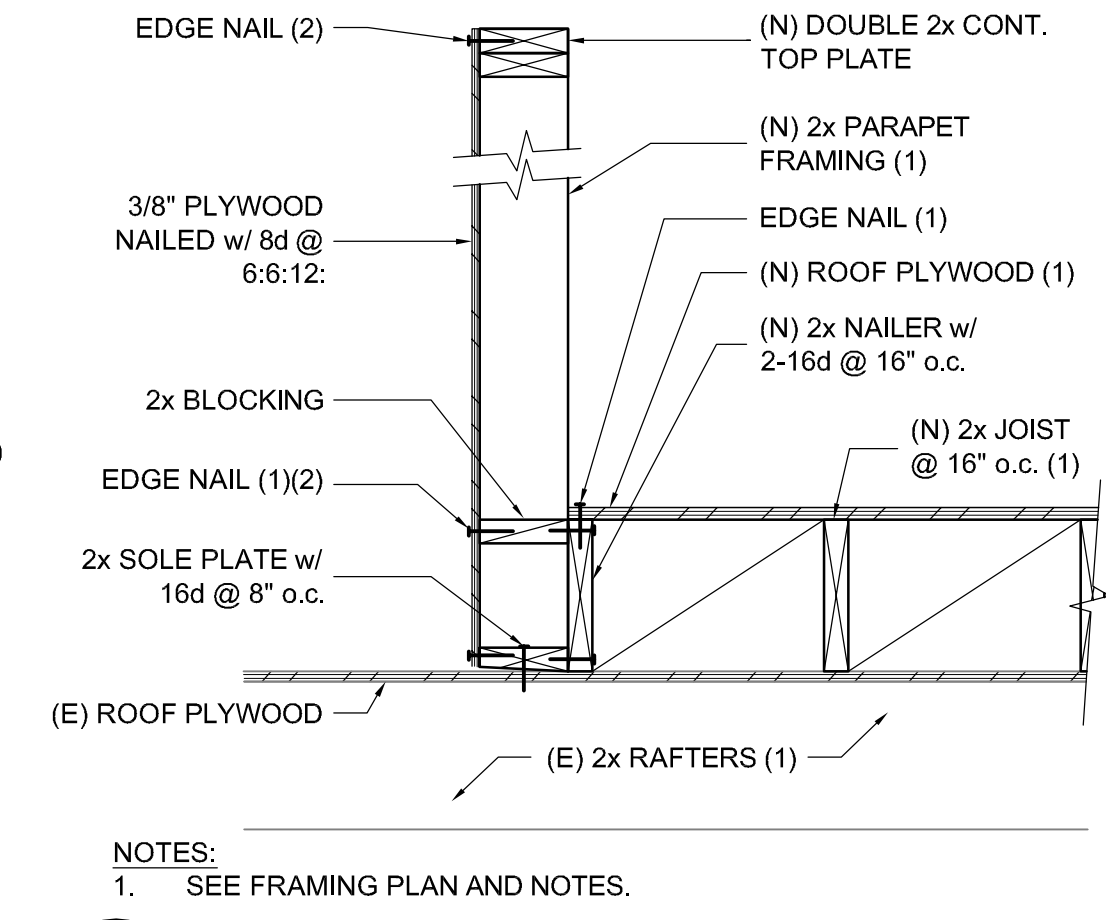


43 PARAPET WALL @ (E) ROOF
1" = 1' - 0"

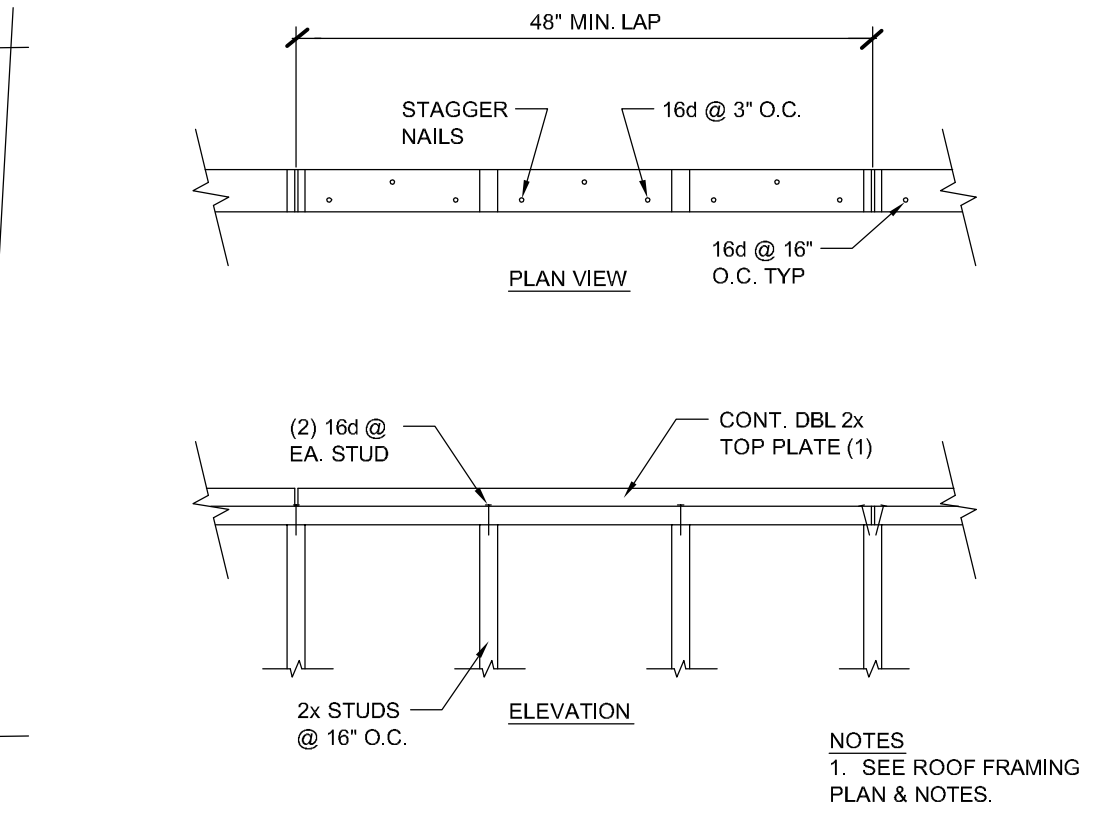


44 TYP. TOP PLATE SPLICE
3/4" = 1' - 0"

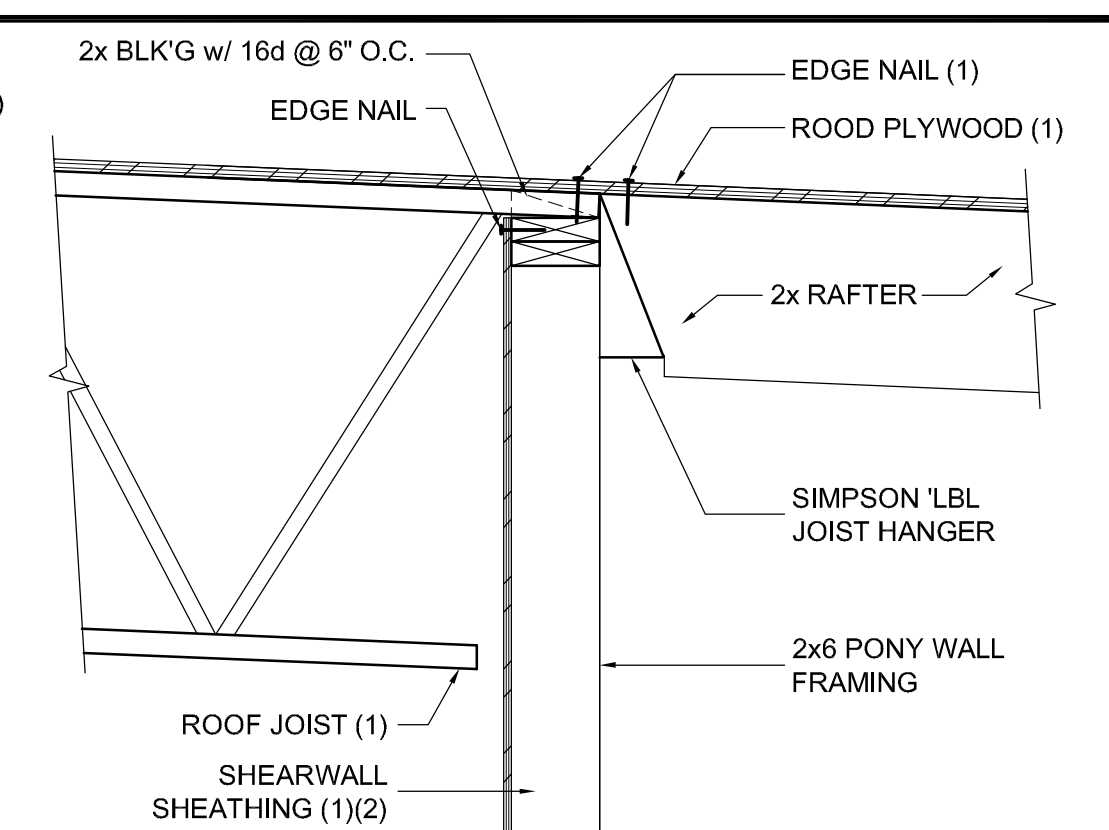


31 PONY WALL FRAMING
1" = 1' - 0"

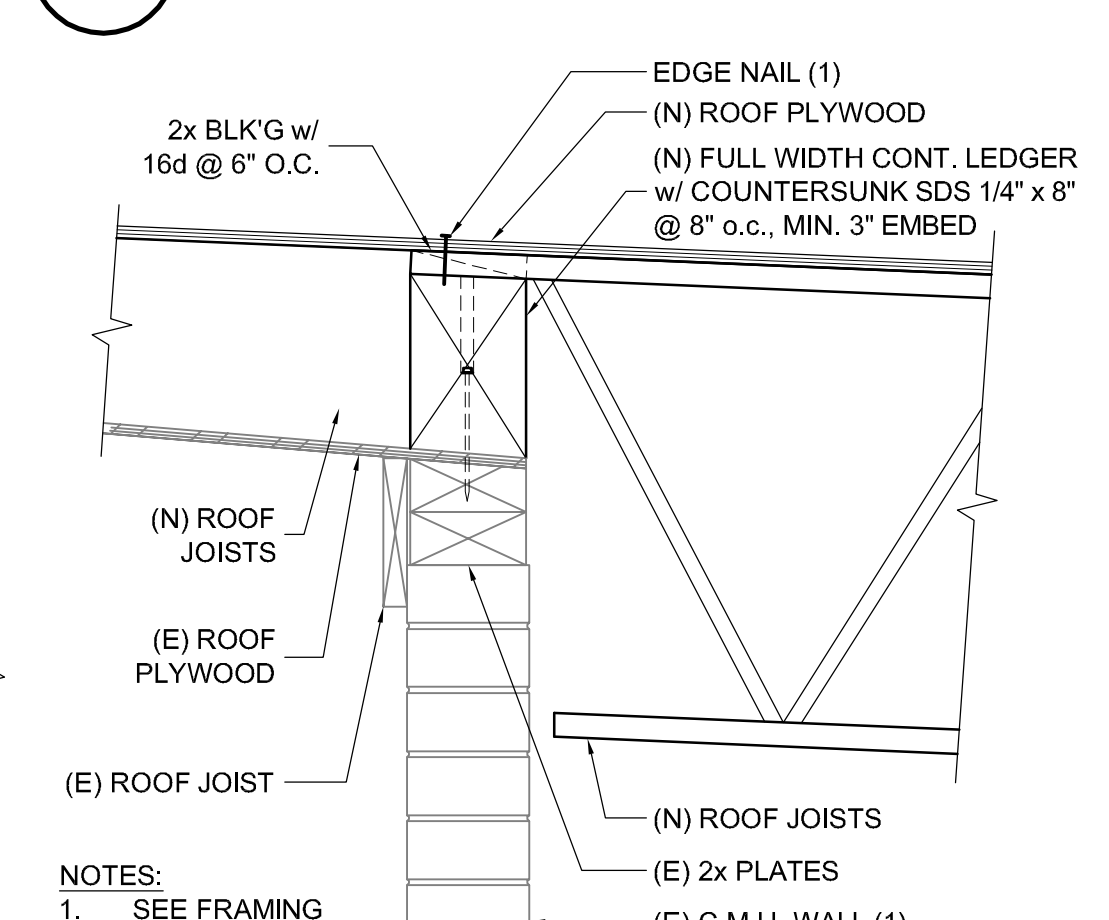


32 (N) JOISTS AT (E) WALL
1" = 1' - 0"

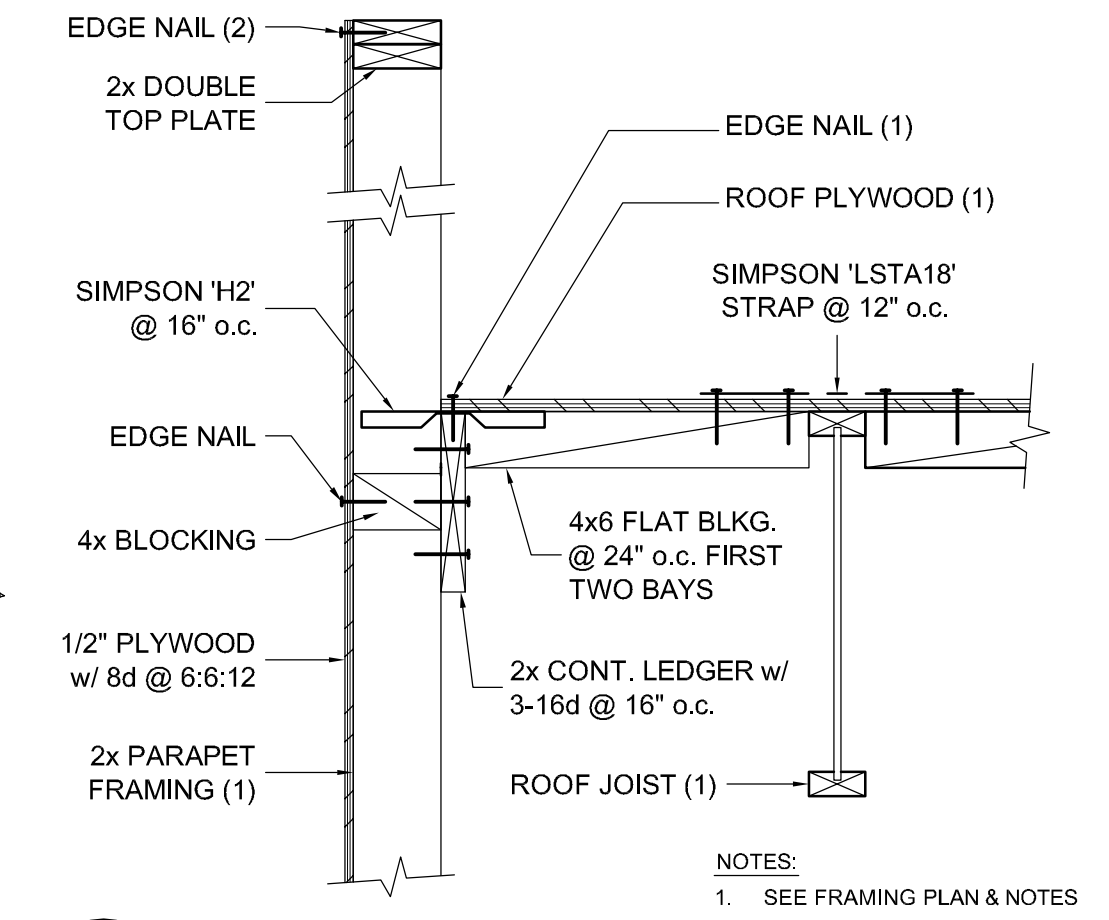


33 PARAPET FRAMING
1" = 1' - 0"

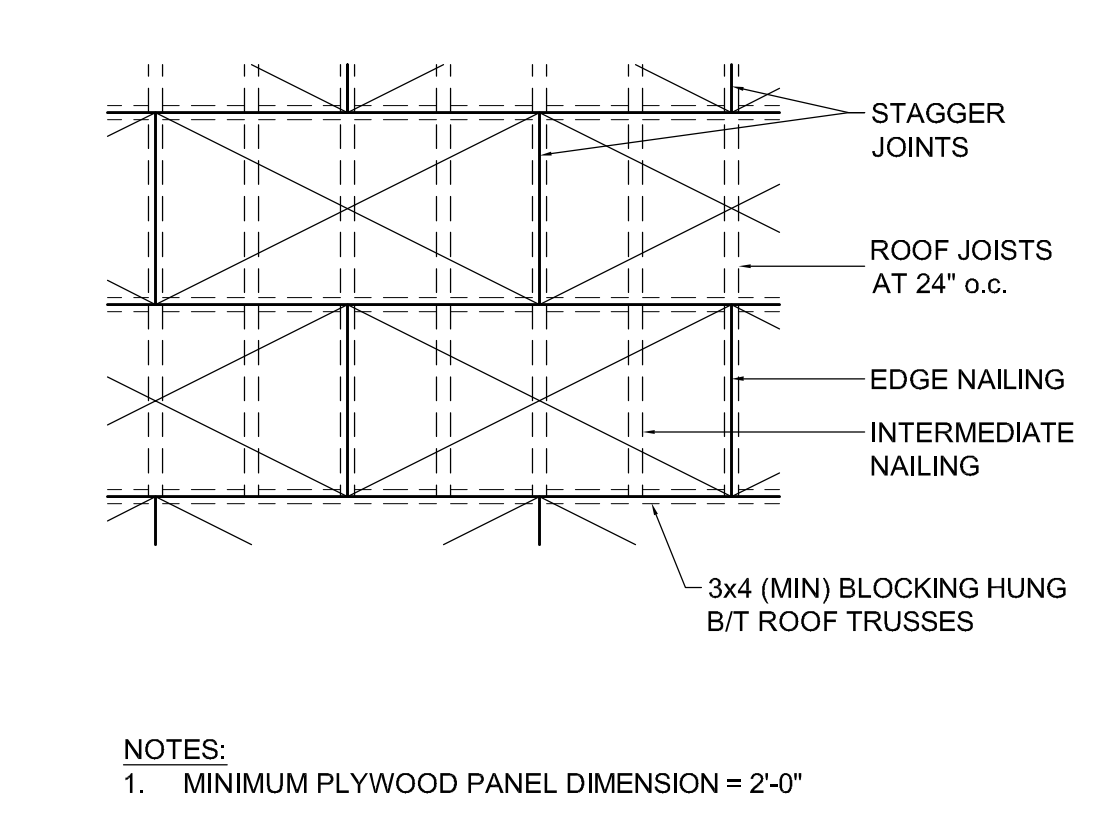


34 PLYWOOD SHEATHING
1/4" = 1' - 0"

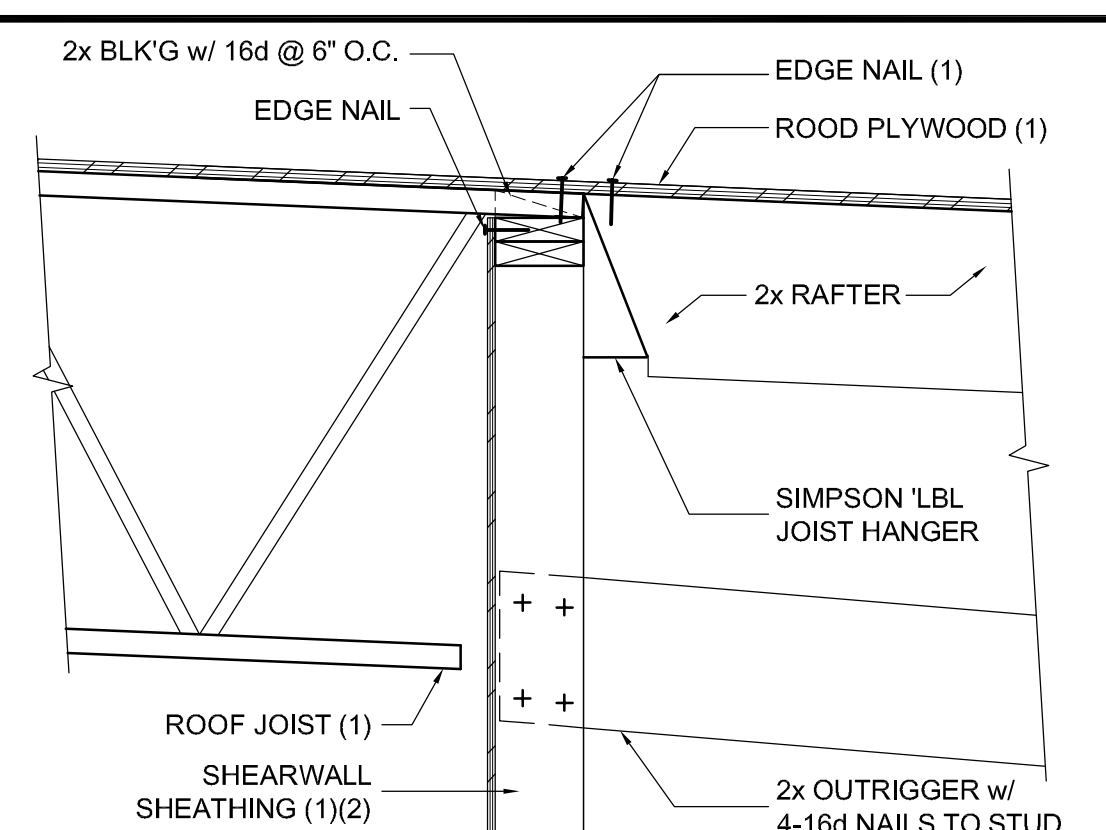


21 PONY WALL FRAMING
1" = 1' - 0"

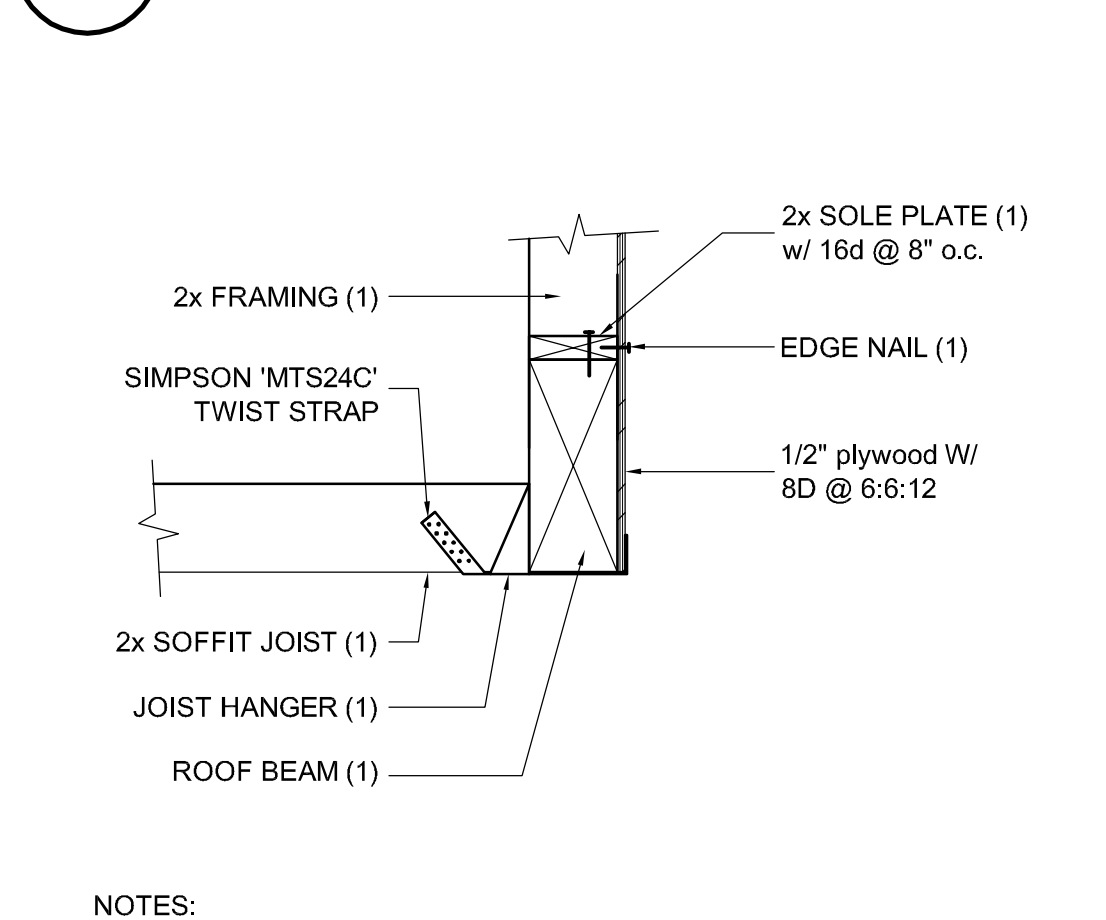


22 SOFFIT FRAMING
1" = 1' - 0"

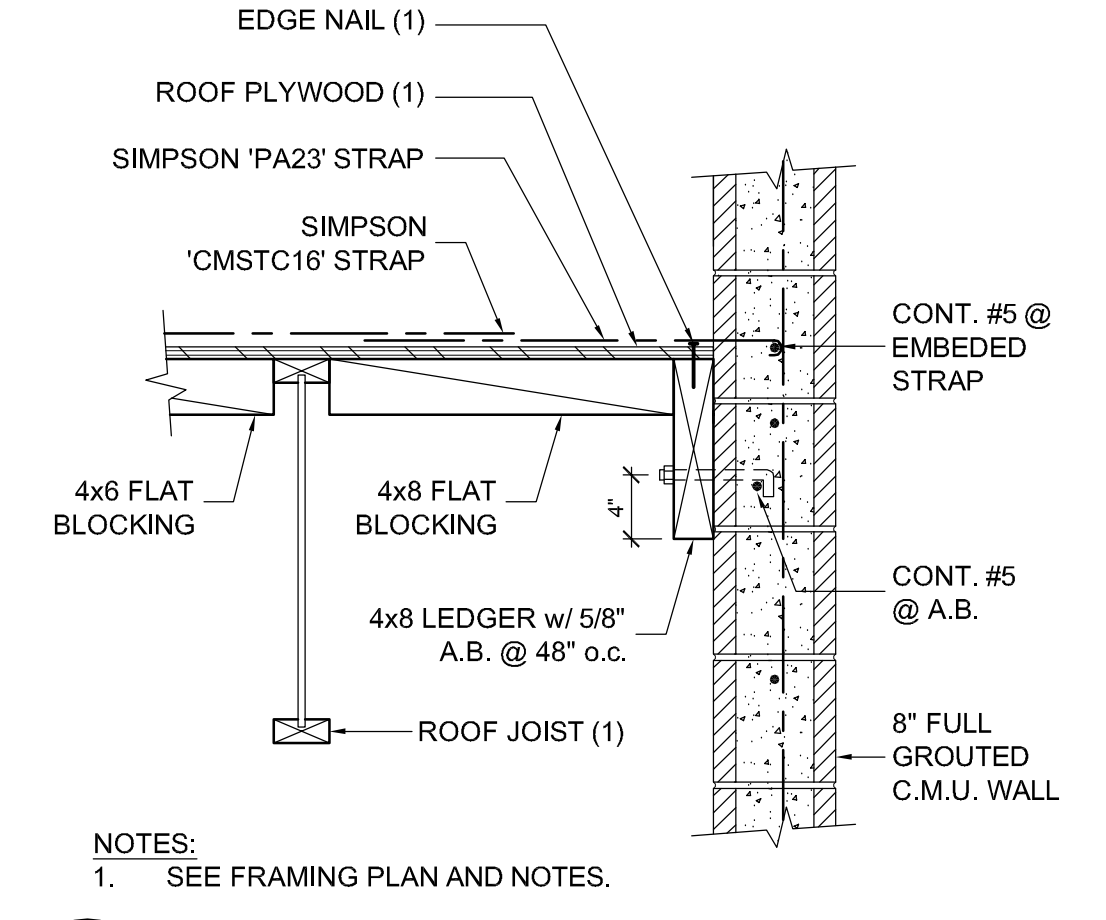


23 ROOF RAKE AT C.M.U.
1" = 1' - 0"

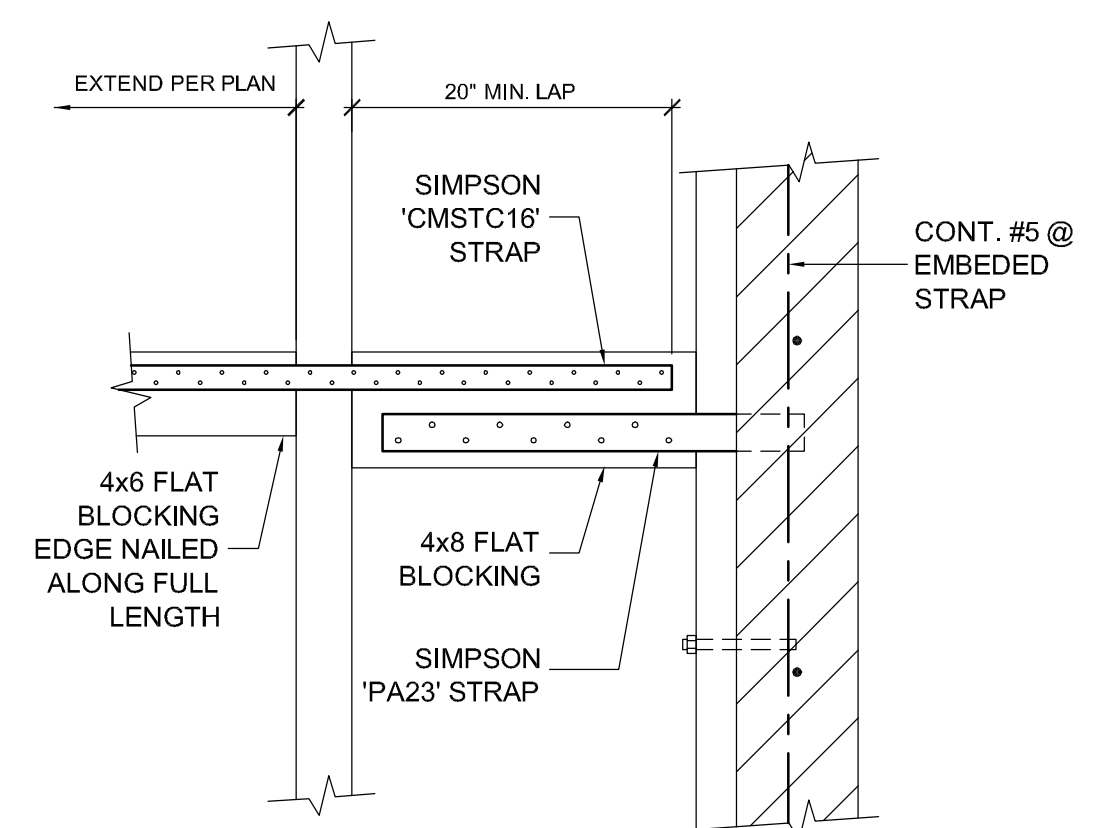


24 ROOF RAKE AT C.M.U. PLAN
1" = 1' - 0"

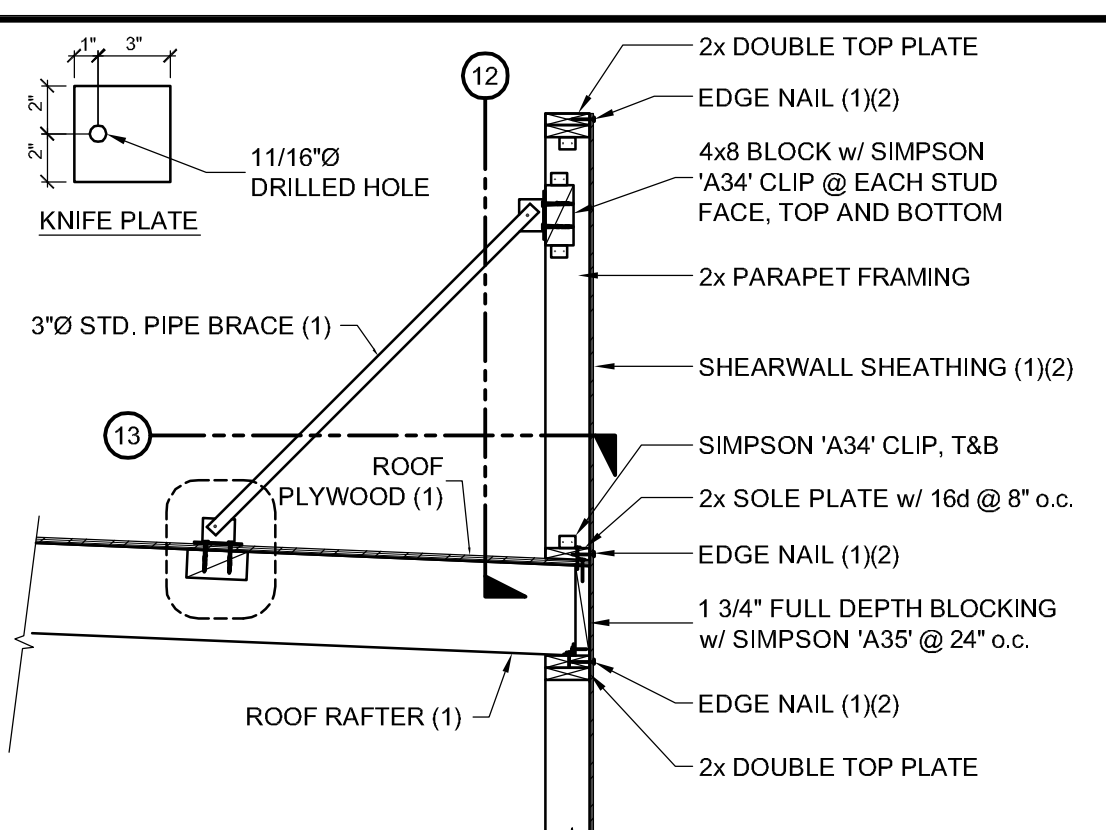


11 PARAPET BRACING
1/2" = 1' - 0"

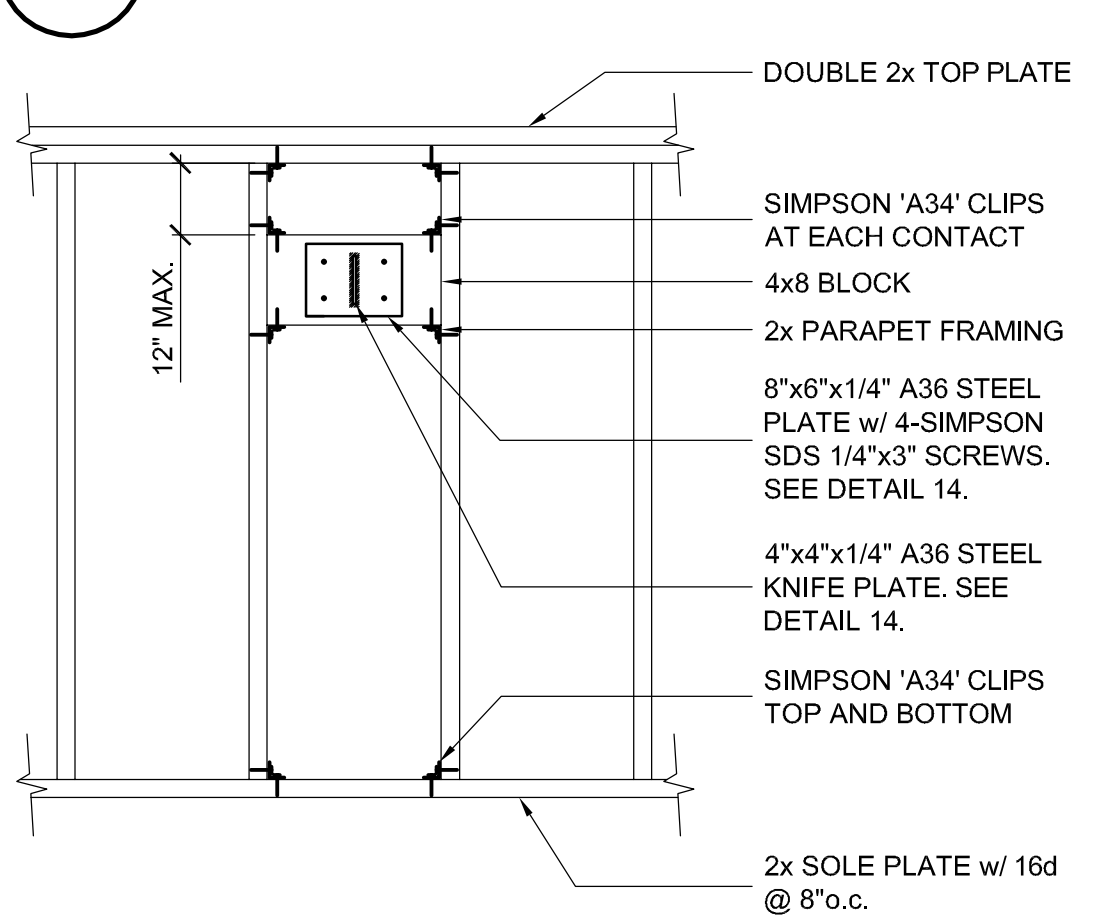

12 PARAPET BRACE ELEV.
3/4" = 1' - 0"

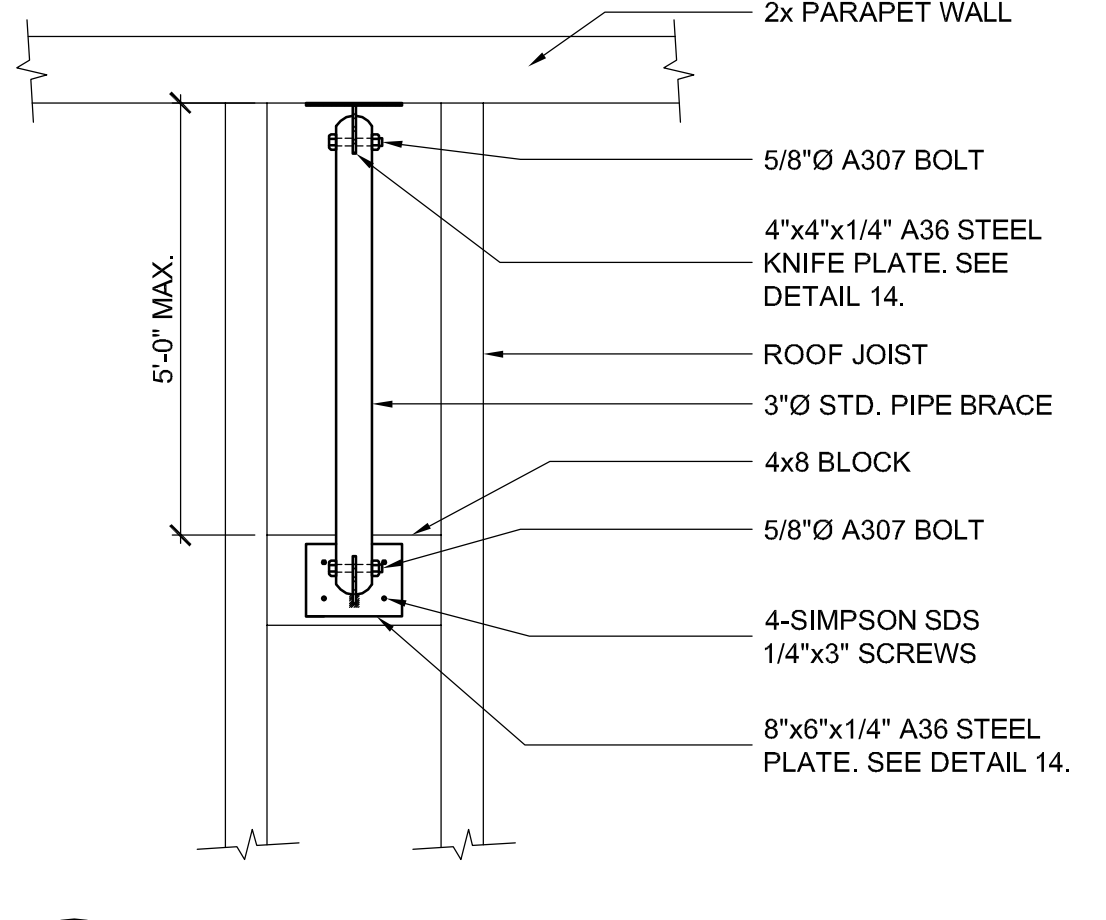

13 PARAPET BRACE PLAN
3/4" = 1' - 0"

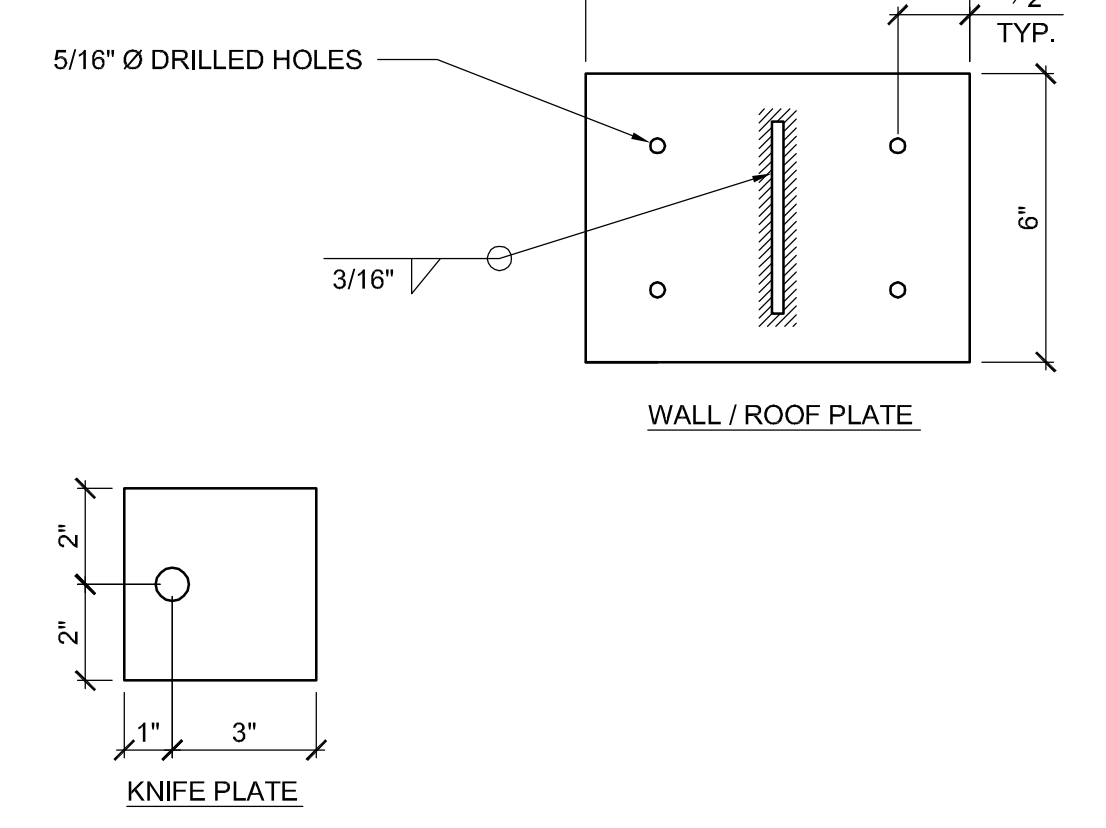

14 BRACE PLATES
3" = 1' - 0"

PROJECT

SUPERIOR COURT OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

FRASER SEIPLE ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805-544-6161

www.fraserseiplearchitects.com

PROJECT MANAGER BDF

DRAWN BY DL

DATES 05/05/11

SIGNED

BRUCE DOUGLAS FRASER
C 9787
EXPIRES 12/31/11
STATE OF CALIFORNIA

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

STRUCTURAL DETAILS

SHEET #

S4.3

GENERAL NOTES

MECHANICAL/PLUMBING WORK CONSISTS OF ALL LABOR, MATERIALS, EQUIPMENT, AND SERVICES NECESSARY FOR AND INCIDENTAL TO THE EXECUTION AND COMPLETION OF THE SYSTEMS AS INDICATED ON THESE DRAWINGS.

SUBMITTAL REQUIREMENTS:

- WITHIN 15 DAYS OF CONTRACT AWARD, THE MECHANICAL/PLUMBING CONTRACTOR SHALL SUBMIT COMPLETE APPLICABLE PRODUCT, EQUIPMENT, AND MATERIAL INFORMATION IN THE FORM OF AN ELECTRONIC SUBMITTAL (PDF). NO PRODUCT, EQUIPMENT, OR MATERIAL SHALL BE ORDERED OR INSTALLED UNTIL SUBMITTALS ARE APPROVED BY THE MECHANICAL ENGINEER. ANY ITEM NOT INCLUDED IN THE SUBMITTAL SHALL BE PROVIDED WITHOUT SUBSTITUTION. SUBMITTAL INFORMATION SHALL INCLUDE: MANUFACTURER'S NAME AND CATALOGUE NUMBERS, DIMENSIONS, CAPACITIES, PERFORMANCE CURVES, AND ALL OTHER CHARACTERISTICS AND ACCESSORIES AS LISTED IN THE CONTRACT DOCUMENTS. THE INFORMATION SHALL BE CURRENT MANUFACTURER'S SUBMITTALS AND BROCHURES.

- SUBMITTALS FOR ANY EQUIPMENT SUBSTITUTED AS EQUIVALENT TO THE SCHEDULED EQUIPMENT SHALL INCLUDE TABULATED COMPARISON DATA SO AS TO CLEARLY DEMONSTRATE EQUIVALENCY. THIS DATA SHALL SPECIFICALLY INCLUDE COMPARISONS BETWEEN SCHEDULED AND PROPOSED EQUIPMENT IN THE FOLLOWING AREAS:
 - WEIGHT (INCLUDING CURBS AND ACCESSORIES)
 - DIMENSIONS
 - ELECTRICAL AND GAS REQUIREMENTS (VOLTAGE, PHASE, FULL LOAD AMPS & BTU)
 - SOUND LEVELS (WHERE APPLICABLE)
 - PERFORMANCE (EFFICIENCIES, HEATING, COOLING, AIR FLOW, STATIC PRESS.)

- ALL WORK INDICATED ON THESE PLANS SHALL BE DONE IN COMPLIANCE WITH CURRENT STATE AND LOCAL CODES AND ALL APPLICABLE CALIFORNIA TITLE-24 REQUIREMENTS. IN THE EVENT OF CONFLICT BETWEEN CODES, THE MORE RESTRICTIVE REQUIREMENTS SHALL BE EXERCISED.

- NOTHING IN THESE DRAWINGS AND/OR SPECIFICATIONS SHALL BE INTERPRETED TO CONFLICT WITH ANY CITY OR STATE LAW, REGULATION, CODE, ORDINANCE, RULING, OR FIRE UNDERWRITER'S REQUIREMENT APPLICABLE TO THIS CLASS OF WORK.

- CONSTRUCTION AND/OR ENGINEERING COSTS RESULTING FROM PRODUCT SUBSTITUTIONS SHALL BE PAID BY THE MECHANICAL/PLUMBING CONTRACTOR. APPROVAL OF SUBSTITUTED PRODUCTS DOES NOT NEGATE THIS OBLIGATION.

- THE MECHANICAL/PLUMBING CONTRACTOR SHALL COORDINATE THE INSTALLATION OF AIR TERMINALS WITH THE REFLECTED CEILING PLAN, AND VERIFY CORRECT LOCATION OF EQUIPMENT, PIPING, AND PLUMBING SERVICES BEFORE PROCEEDING WITH INSTALLATION.

- ALL LOCATIONS OF DUCTWORK, EQUIPMENT AND PIPING ARE SHOWN DIAGMATICALLY. THE MECHANICAL/PLUMBING CONTRACTOR SHALL ADHERE TO LOCATIONS INDICATED ON THE DRAWINGS AS CLOSELY AS POSSIBLE, VARYING PIPE RUNS AS REQUIRED TO MEET STRUCTURAL AND OTHER INTERFERENCES AS REQUIRED BY THE PROJECT.

- THE MECHANICAL/PLUMBING CONTRACTOR SHALL PROVIDE ACCESS PANELS WHERE REQUIRED FOR ALL PLUMBING-RELATED EQUIPMENT, ACCESSORIES, AND CONTROLS.

- DUCT DIMENSIONS SHOWN ARE INTERNAL.

- ALL EQUIPMENT SHALL BE FURNISHED AND INSTALLED WITH AT LEAST THE MANUFACTURER'S MINIMUM RECOMMENDED CLEARANCE ALLOWANCE FOR SUFFICIENT ACCESS TO CONTROLS, FILTERS, ELECTRIC MOTORS, ETC. FOR MAINTENANCE AND PROPER OPERATION.

- ALL MECHANICAL/PLUMBING DUCTING, PIPING, AND EQUIPMENT SHALL BE PROVIDED WITH SEISMIC RESTRAINING SERVICES AS REQUIRED BY LOCAL BUILDING CODES.

- THE WORK UNDER THIS SECTION SHALL BE IN COOPERATION WITH THE WORK OF OTHER TRADES TO PREVENT CONFLICT OR INTERFERENCE AND TO AID RAPID COMPLETION OF THE OVERALL PROJECT.

- THE MECHANICAL/PLUMBING CONTRACTOR SHALL GUARANTEE THAT THE SYSTEMS INSTALLED ARE IN ACCORDANCE WITH THESE PLANS AND SPECIFICATIONS, AND WILL WARRANT ALL EQUIPMENT, MATERIALS, AND LABOR FURNISHED UNDER THIS CONTRACT TO BE FREE FROM DEFECTS FOR A PERIOD OF ONE (1) YEAR FROM THE DATE OF SUBSTANTIAL COMPLETION. THE MECHANICAL/PLUMBING CONTRACTOR SHALL REPAIR OR REPLACE ANY EQUIPMENT OR MATERIAL, WHICH IS DEFECTIVE OR IMPROPERLY INSTALLED. IN ADDITION, THE MECHANICAL/PLUMBING CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY DAMAGE TO THE BUILDINGS AND ITS CONTENTS OR OTHER EQUIPMENT, CAUSED BY DEFECTS OR IMPROPER INSTALLATION OF EQUIPMENT OR MATERIALS INSTALLED UNDER THIS SECTION OF THE SPECIFICATIONS. IN THE EVENT OF FAILURE TO COMPLY WITH THE ABOVE-MENTIONED CONDITIONS WITHIN TEN (10) DAYS AFTER BEING NOTIFIED IN WRITING, THE MECHANICAL/PLUMBING CONTRACTOR SHALL COLLECTIVELY OR SEPARATELY AUTHORIZE THE OWNER TO PROCEED TO HAVE SAID DEFECTS REPAIRED AND MADE GOOD AT THE CONTRACTORS EXPENSE. THE CONTRACTOR WILL HONOR AND PAY THE SAID COSTS AND CHARGES ON DEMAND.

- BY JVA MECHANICAL ENGINEERING ALL COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS RESERVED THESE DOCUMENTS AS ORIGINAL AND UNPUBLISHED WORK PRODUCT OF JVA MECHANICAL ENGINEERING AND THIS WORK SHALL NOT BE COPIED, DISCLOSED, OR USED IN CONNECTION WITH ANY WORK PRODUCT OTHER THAN THE SPECIFIC PRODUCT FOR WHICH IT HAS BEEN PREPARED OR ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF JVA MECHANICAL ENGINEERING VISUAL CONTACT WITH THIS DOCUMENT SHALL CONSTITUTE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS AND CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS OF THE JOB. UPON DISCOVERY OF ANY VARIATION, DISCREPANCY, OR OMISSIONS, PLEASE NOTIFY JVA MECHANICAL ENGINEERING AND PRIOR TO PROCEEDING WITH RELATED WORK OBTAIN WRITTEN RESOLUTION FROM JVA MECHANICAL ENGINEERING

- THE MECHANICAL/PLUMBING CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS OF THE JOB. UPON DISCOVERY OF ANY VARIATION, DISCREPANCY, OR OMISSIONS, NOTIFY JVA MECHANICAL ENGINEERING AND PRIOR TO PROCEEDING WITH RELATED WORK, OBTAIN WRITTEN RESOLUTION FROM JVA MECHANICAL ENGINEERING

MECHANICAL/PLUMBING: THE WORK UNDER THIS SECTION INCLUDES EVERYTHING NECESSARY FOR AND INCIDENTAL TO EXECUTING AND COMPLETING THE MECHANICAL/PLUMBING WORK, EXCEPT AS HEREINAFTER SPECIFICALLY EXCLUDED. WORK INCLUDED SHALL BE AS INDICATED ON THE DRAWINGS COMPLETELY INCLUDING BUT NOT LIMITED TO THE FOLLOWING:

- MECHANICAL EQUIPMENT
- AIR DISTRIBUTION
- CONTROLS
- START UP AND BALANCE
- SANITARY SOIL, WASTE, AND VENT SYSTEMS
- GAS PIPING
- CONDENSATE PIPING
- DOMESTIC WATER SYSTEMS
- PLUMBING FIXTURES AND EQUIPMENT
- REQUIRED SUPPORTS AND BLOCKING

RELATED WORK: THE FOLLOWING WORK SHALL NOT BE FURNISHED UNDER THIS SECTION OF THE SPECIFICATIONS BUT WILL BE INCLUDED IN OTHER SPECIFICATIONS SECTIONS:

- CUTTING, PATCHING, AND FURRING
- CONDUIT AND LINE VOLTAGE ELECTRICAL
- FINAL PAINTING
- ROOFING
- CONCRETE PLACEMENT

RIGID ROUND DUCTWORK AND FITTINGS:

- ALL RIGID ROUND DUCTWORK SHALL BE UNITED SHEET METAL SPIRAL LOCKSEAM DUCT, OR APPROVED EQUAL, MANUFACTURED FROM GALVANIZED STEEL MEETING THE ASTM A-527-71. ALL DUCT GAUGES SHALL CONFORM WITH CMC 2010 CHAPTER 6 & APPENDIX A

- ALL FITTINGS SHALL BE MANUFACTURER AS SEPARATE FITTINGS. NO BRANCH TAPS WILL BE ALLOWED.

RECTANGULAR DUCTWORK:

- ALL RECTANGULAR DUCTWORK, FITTINGS, AND ACCESSORIES SHALL BE FABRICATED AND INSTALLED IN STRICT ACCORDANCE TO THE SMACNA "HVAC DUCT CONSTRUCTION STANDARDS" HANDBOOK, AND SHALL BE PRIME GRADE GALVANIZED STEEL STEELS OF LOCK FORM QUALITY.

INTERIOR DUCTWORK SEALING:

- PROVIDE COMPLETE SEALING OF ALL DUCT CONNECTIONS WITH 'UNI-MASTIC 181' FIBER REINFORCED DUCT SEALER BY MCGILL ARSEAL PRODUCTS.'

DUCT INSULATION:

- EXTERNAL DUCT INSULATION SHALL BE APPLIED TO ALL HEATING AND/OR COOLING DUCTS NOT INTERNALLY INSULATED AND NOT WITHIN CONDITIONED SPACES. MANVILLE MICROUTE FSK 1-1/2", R-SERIES, ALUMINUM FOIL REINFORCED WITH FIBERGLASS, SCRIM LAMINATED TO U.L. RATED KRAFT, WITH R=4.8, SHALL BE USED OR APPROVED EQUAL. CIRCUMFERENTIAL AND LONGITUDINAL SEAMS SHALL BE LAPPED MINIMUM OF 2" AND SECURED WITH 3" WIDE PRESSURE SENSITIVE FOIL VAPOR BARRIER TAPE. FURTHER ATTACH INSULATION TO THE DUCTWORK BY SPIRALING WIRE AT 12" CENTERS ITS ENTIRE LENGTH. THE FINISHED PRODUCT SHALL BE VAPOR-PROOF AND FREE OF SAGS.

CONTROLS:

- THERMOSTATS SHALL BE AS INDICATED ON PLANS AND MOUNTED AT 48" ABOVE FINISHED FLOOR. ALL LOW VOLTAGE WIRE, WRING, AND CONNECTIONS ARE THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR. ALL THERMOSTATS SHALL BE PROGRAMMED TO PROVIDE ADEQUATE SETBACK DURING NON-OCCUPIED HOURS, AND FOR EVAPORATOR FANS TO RUN CONTINUOUSLY DURING OCCUPIED HOURS.

EXECUTION (MECHANICAL):

- BENDING OR FORCING OF DUCTWORK IS NOT ALLOWED. USE FITTINGS FOR ALL OFFSETS OR CHANGES IN ALIGNMENT OF DUCTING.

- DUCTING SHALL BE FIRMLY HELD IN PLACE BY ADJUSTABLE HANGERS & SUPPORTS. ALL HANGERS AND SUPPORTS SHALL BE OF DESIGN WHICH WILL SUPPORT WEIGHT OF DUCT, INSULATION, AND PREVENT SAGGING. MAKESHIFT DEVICES ARE NOT ACCEPTABLE. PLUMBER'S TAPE IS NOT APPROVED.

- WHERE APPLICATIONS ARE NOT SPECIFICALLY COVERED IN THIS SECTION, FOLLOW MANUFACTURER'S INSTRUCTIONS. ALL DISCREPANCIES MUST BE REPORTED TO THE ARCHITECT FOR APPROVAL BEFORE STARTING WORK.

- ALL EXPOSED DUCTWORK, TAPS AND REGISTERS SHALL BE LEVEL, STRAIGHT AND FREE OF DEFECTS. ALL DAMPERS AND REGISTERS MUST BE INSTALLED AS TO NOT WHISTLE OR RATTLE.

- TESTING AND BALANCING SHALL BE PERFORMED FOLLOWING AABC OR NEBB BALANCE CRITERIA. THE FOLLOWING INFORMATION SHALL BE SUBMITTED TO THE MECHANICAL ENGINEER: VOLTAGE (RATED AND ACTUAL)

FAN SPEEDS (RATED AND ACTUAL)
MOTOR CURRENT (RATED AND ACTUAL)
AIR QUANTITIES AT OUTLETS AND INLETS (RATED)
AIR QUANTITIES AT OUTLETS AND INLETS ADJUSTED TO WITHIN 10% OF DESIGN
SUPPLY AIR EXTERNAL STATIC PRESSURE ("W.G.)
RETURN AIR EXTERNAL STATIC PRESSURE ("W.G.)
TOTAL SUPPLY AIR CFM
TOTAL RETURN AIR CFM
TOTAL OUTSIDE AIR CFM
EQUIPMENT NAME/PLATE DATA

SPECIFICATIONS

PLUMBING, FITTINGS AND PIPING:

- SOIL, WASTE, AND VENT: ABOVE GRADE: PLASTIC ABS OR PVC PIPE AND FITTINGS WITH SOLVENT JOINTS.

- SOIL, WASTE, AND VENT: BELOW GRADE: CAST IRON SOIL PIPE AND FITTINGS WITH "NO-HUB" JOINTS.

- DOMESTIC WATER PIPING: ABOVE GRADE: TYPE 'L' COPPER TUBING HARD DRAWN WITH WROUGHT COPPER SOLDER FITTINGS. SOLDER WITH 95 - 5 TIN-ANTIMONY SOLDER.

- CONDENSATE AND DRAIN PIPING: TYPE 'L' COPPER TUBING HARD DRAWN WITH WROUGHT COPPER SOLDER FITTINGS. SOLDER WITH 95 - 5 TIN-ANTIMONY SOLDER.

- GAS PIPING ABOVE GRADE: SCHEDULE 40 BLACK MALLEABLE IRON THREADED PIPE AND FITTINGS

PLUMBING FIXTURES:

- PLUMBING FIXTURES SHALL BE AS PER PLUMBING FIXTURE SCHEDULES-SEE PLANS

PIPING SPECIALTIES:

- SHUT-OFF VALVES (WATER): APOLLO, OR EQUIVALENT, FULL PORT BALL VALVE.

- SUPPLIES: ANGLE TYPE WITH TEE HANDLE STOP AND RIGID RISERS "SPEEDWAY" R1700-S SERIES, ROBERT ML-600 SERIES OR EQUAL P-TRAPS: CHROME PLATED BRASS 17 GAUGE WITH CP TUBING DRAIN TO WALL AND CLEAN-OUT PLUG. TRAP ARMS UNDER LAVATORIES, SINK, AND ESCUTCHEON AT WALL ALSO TO BE CHROME-PLATE

- WALL CLEANOUTS (WCO): TERRI, PRIME-COATED WITH U.P.C. BRONZE PLUG IN "NO-HUB" TEST-TEE.

- SHUT-OFF VALVES (GAS): CRANE #1128, OR EQUIVALENT (2" AND SMALLER).

PIPING HANGERS, SUPPORTS, AND ACCESS PANELS:

- PROVIDE HANGER SPECIFIED HEREIN. EQUIVALENT MODELS BY ELCEN, FEE & MASON OR KIN-LINE ARE ACCEPTABLE.

- ADJUSTABLE HANGERS WITH MINIMUM 3/8" RODS, UPPER ATTACHMENTS: B-LINE #B3690. PROVIDE SHIELDS AT INSULATED PIPING.

- TRAPEZE HANGERS: B-LINE #B22 WITH PIPE CLAMPS AND GUIDES AS REQUIRED.

- RISER CLAMPS: B-LINE #B3373.

- OFFSET PIPE CLAMPS: B-LINE #B3148.

- WATER PIPE ISOLATION: INCLUDE WITH HANGERS, 1/4" FELT OR APPROVED EQUIVALENT.

- ACCESS PANEL FOR VALVES: MILCOR PAINTED STEEL SIZE AS REQUIRED FOR EASY ACCESS MINIMUM SIZE 12" X 12".

PIPING INSULATION:

- DOMESTIC HOT WATER AND HOT PIPING: ENGINEERED POLYMER FOAM INSULATION (EPFI) 3/4" WALL 'IMCOA' OR EQUIVALENT.

- LAVATORY TRAPS AND H. W. SUPPLIES: PROWRAP, PROTECTIVE KIT BY MCGUIRE OR EQUIVALENT.

EXCAVATION AND BACKFILL:

- EXECUTE ALL EXCAVATION TO GRADES TO ACCOMMODATE ELEVATIONS INDICATED AND WHERE INVERT ELEVATIONS ARE NOT INDICATED, PROVIDE MINIMUM COVERAGE FOR ANY PIPING UNDER BUILDING SLAB (TOP OF PIPE TO UNDERSIDE OF SLAB) OF 18 INCHES.

- EXCAVATION FOR PIPE SHALL BE CUT A MINIMUM OF SIX INCHES BELOW THE REQUIRED GRADE. A SIX-INCH BED OF SAND OR OTHER APPROVED MATERIAL SHALL BE THEN PLACED AND PROPERLY COMPACTED TO PROVIDE AN ACCURATE GRADE AND UNIFORM BEARING THROUGHOUT THE LENGTH OF THE PIPE.

- SAND USED SHALL BE WASHED RIVER SAND NORMALLY USED FOR BACKFILL PURPOSES, FREE OF CLODS OR LUMPS OF CLAY, ROCK, DEBRIS, AND RUBBISH.

- BACKFILL SHALL NOT BE PLACED UNTIL THE WORK HAS BEEN INSPECTED, TESTED, AND APPROVED.

- BACKFILL TO POINT 12 INCHES ABOVE TOP OF PIPING WITH FINE EARTH (EXCAVATED MATERIAL) FROM ONE OF SEVERAL DEPTHS OF EXCESSIVE AMOUNTS OF CLAY, DEBRIS, RUBBISH, ROCKS, OR CLODS, AS APPROVED BY THE ARCHITECT. BACKFILL ABOVE 12 INCHES FROM TOP OF PIPING MAY BE WITH EXCAVATED MATERIAL. APPLY BACKFILL BY HAND IN 6-INCH DEEP LAYERS THE FULL WIDTH OF THE TRENCH. MOISTEN EACH LAYER (DO NOT FLOOD OR PUDDLE), AND HAND TAMP TO MINIMUM 90 PERCENT COMPACTION BEFORE PROCEEDING WITH THE NEXT LAYER OF BACKFILL.

- CLODS OR LUMPS ONE INCH IN SIZE OR LARGER WILL NOT BE PERMITTED IN THE BACKFILL. IF THE EXCAVATED MATERIAL IS NOT SUITABLE, ADEQUATE MATERIAL SHALL BE PROVIDED BY HAULING IN FROM OTHER LOCATIONS.

- SURPLUS EARTH OR MATERIAL REMAINING AFTER BACKFILLING SHALL BE REMOVED FROM THE SITE AS INDICATED IN SECTION ENTITLED "EARTHWORK."

- DO NOT EXCAVATE UNDER OR NEAR FOUNDATIONS OR FOOTINGS EXCEPT IN MANNER PERMITTED AND APPROVED BY THE ARCHITECT. DO NOT BACKFILL UNTIL INSTALLED PIPING HAS BEEN SUCCESSFULLY TESTED AND APPROVED FOR BACKFILL BY THE JURISDICTIONAL INSPECTOR AND THE ARCHITECT.

- PROVIDE SLEEVES AT ALL PIPE PENETRATIONS OF FOOTING AND FOUNDATIONS.

EXECUTION (PLUMBING):

- SOIL, WASTE AND VENT PIPING IS TO BE ASSEMBLED, CONNECTED, AND SUPPORTED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. ENCASE BELOW GRADE SOIL, WASTE, AND VENT PIPING IN SAND, 6" ALL AROUND PIPE. WRAP PENETRATIONS OF CONCRETE SLAB WITH FOAMED PLASTIC SLEEVING MATERIAL. ALL SOIL, WASTE, AND VENT PIPING SHALL HAVE A SMOOTH AND UNIFORM INVERT, AND BACK-FILLED SO AS NOT TO DISTURB THE PIPE OR JOINTING.

- JOINTS IN COPPER TUBING SHALL BE MADE BY FIRST THOROUGHLY CLEANING THE SURFACE OF THE PIPE AND FITTINGS, APPLYING A COPPERIZED FLUX AND SWEAT WITH 95 - 5 TIN ANTIMONY SOLDER OR EQUIVALENT LEAD-FREE SOLDER.

- FLUSH OUT ALL WATER MAINS, CONDENSATE DRAINS, SANITARY, AND STORM PIPING WITH WATER SO AS TO OBTAIN FREE FLOW.

- ALL PIPING, EXCEPT WHERE NOTED OTHERWISE ON PLANS, SHALL BE CONCEALED IN WALLS OR ABOVE CEILINGS. COORDINATE PIPING LOCATION WITH DUCTWORK AND CONDUIT.

- BENDING OR FORCING OF PIPE IS NOT ALLOWED. USE FITTINGS FOR ALL OFFSETS OR CHANGES IN ALIGNMENT OF PIPING.

- CLEANOUTS SHALL BE ACCESSIBLE IN ALL CASES AND SHALL BE BROUGHT TO SURFACE ON "Y" BRANCHES. ALL CLEANOUTS SHALL BE PROVIDED WITH REMOVABLE FLOOR OR WALL PLATES.

- PIPING SHALL BE FIRMLY HELD IN PLACE BY ADJUSTABLE HANGERS, SUPPORTS, AND PIPE RESTS. ALL HANGERS AND SUPPORTS SHALL BE OF DESIGN WHICH WILL SUPPORT WEIGHT OF PIPE, FLUID, INSULATION, AND PREVENT SAGGING. MAKESHIFT DEVICES ARE NOT ACCEPTABLE. PLUMBER'S TAPE IS NOT APPROVED.

- PIPING SHALL BE ISOLATED FROM ALL DIRECT CONTACT WITH THE STRUCTURE BY THE USE OF MANUFACTURED HANGER ISOLATORS AND STUD ISOLATION DEVICES.

- INSTALL ALL FIXTURES AND EQUIPMENT PER MANUFACTURER'S ROUGH-IN AND INSTALLATION INSTRUCTIONS. INSTALL HANDICAPPED FIXTURES PER TITLE 24 AND A.D.A. REQUIREMENTS. PROVIDE 17 GAUGE CHROME PLATED P-TRAPS, ANGLE STOPS AND FLEXIBLE RISERS, SUPPORT PLATES, ETC., AS REQUIRED.

- PROVIDE FIRE STOPPING AND SLEEVES FOR PIPING PENETRATIONS OF FIRE-RATED WALLS, FLOORS, AND CEILINGS. METHOD OF SLEEVING AND FIRE STOPPING SHALL BE APPROVED BY FIRE MARSHALL.

PLUMBING TEST AND ADJUSTMENTS:

- ALL WORK SHALL BE COMPLETELY INSTALLED, SANITIZED, AND TESTED AS REQUIRED BY LOCAL CODE AND THE STATE ORDINANCES AND STATE SAFETY ORDERS, AND SHALL BE LEAK-TIGHT BEFORE INSPECTION IS REQUESTED. ALL TESTS SHALL BE REPEATED UPON REQUEST TO THE SATISFACTION OF THOSE MAKING THE INSPECTION.

HVAC LEGEND

SYMBOL	DESCRIPTION	ABBREV.	SYMBOL	DESCRIPTION	ABBREV.	SYMBOL	DESCRIPTION	ABBREV.
	SUPPLY AIR DIFFUSER	SA		RECTANGULAR DUCT	-		VOLUME DAMPER	VD
	RETURN AIR GRILLE	RA		LINED RECTANGULAR DUCT	-		FIRE DAMPER	FD
	EXHAUST AIR GRILLE	EA		RIGID ROUND DUCT	-		SMOKE DETECTOR	SD
	CEILING EXHAUST FAN	CEF		FLEXIBLE ROUND DUCT	-		FLEXIBLE CONNECTION	FC
	SIDEWALL GRILLE, REGISTER, OR LOUVER	-		POINT OF CONNECTION OR DISCONNECTION	POC/POD		THERMOSTAT SENSOR	-
	GRILLE, DIFFUSER, REGISTER, LOUVER TAG	-		DIAMETER	DIA		EQUIPMENT OR DUCTWORK TO BE REMOVED	-

HVAC ABBREVIATIONS


ABV	ABOVE	EDB	ENTERING DRY BULB	MER	MECHANICAL EQUIPMENT ROOM	SA	SUPPLY AIR
A/C	AIR CONDITIONING, CONDITIONER	EEF	ENERGY EFFICIENCY RATIO	MFR	MANUFACTURER	SP	STATIC PRESSURE
AD	ACCESS DOOR	ELC	ELECTRICAL	(N)	NEW	SEER	SEASONAL ENERGY EFFICIENCY RATIO
AFF	ABOVE FINISH FLOOR	ESP	EXTERNAL STATIC PRESSURE	N/A	NOT APPLICABLE	SHT	SHEET
ALUM	ALUMINUM	EWB	ENTERING WET BULB	NA	NET FREE AREA	SO	SQUARE
APD	AIR PRESSURE DROP	FA	FACE AREA	NIC	NOT IN CONTRACT	SSE	STEADY STATE EFFICIENCY
ARCH	ARCHITECTURAL, ARCHITECT	FAU	FORCED AIR UNIT	NO	NUMBER	TA	TRANSFER AIR
BLOC	BUILDING	FC	FLEXIBLE CONNECTION	NOM	NOMINAL	TO	TO BE REMOVED
BTU	BRITISH THERMAL UNIT	FCU	FAN COIL UNIT	NTS	NOT TO SCALE	TEMP	TEMPERATURE
BTUH	BTU PER HOUR	FD	FIRE DAMPER	OA	OUTSIDE AIR	TYP	TYPICAL
CAP	CAPACITY	FLA	FULL LOAD AMPS	OA	OUTSIDE AIR INTAKE	UL	UNDERWRITER'S LABORATORIES
CFD	CEILING FIRE DAMPER	FPM	FEET PER MINUTE	OB	OPPOSED BLADE DAMPER	UN	UNLESS OTHERWISE NOTED
CFM	CUBIC FEET PER MINUTE	FSD	COMBINATION FIRE/SMOKE DAMPER	OD	OUTSIDE DIAMETER	UP	UP THROUGH ROOF
CONN	CONNECTION	OPER	OPERATING	PLMG	PLUMBING CONTRACTOR	VO	VOLUME DAMPER
CSE	CALIFORNIA SEASONAL EFFICIENCY	OS	OFFICE OF STATE ARCHITECT	POC	POINT OF CONNECTION	W	WITH
CTE	CAP TO EXISTING	PC	GENERAL CONTRACTOR	POD	POINT OF DISCONNECTION	W/O	WITHOUT
CU	CUBIC FEET	PS	PRESSURE	PRESS	PRESSURE	WB	WET BULB
DET	DETAIL	GSM	GALVANIZED SHEET METAL	POC	POINT OF CONNECTION	WG	WATER GAUGE
DM	DAMPER	HP	HORSEPOWER	POD	POINT OF DISCONNECTION	WMS	WIRE MESH SCREEN
DIV	DIVISION	INS	INSIDE DIAMETER	PSI	POUNDS PER SQUARE INCH	WT	WEIGHT
DN	DOWN	HVAC	HEATING, VENTILATING, AIR CONDITIONING	RA	RETURN AIR	WFB	WALL FIRE DAMPER
DWG	DRAWING	LB	POUNDS	REV	REVISION	(X2)	TYPICAL OF 2
(E)	EXISTING	LBS	BTU PER HOUR (THOUSANDS)	RND	ROUND		
EA	EXHAUST AIR	KBH	KBtu	RPM	REVOLUTIONS PER MINUTE		
EC	ELECTRICAL CONTRACTOR	MC	MECHANICAL CONTRACTOR				

PLUMBING LEGEND


SYMBOL	DESCRIPTION	ABB.	SYMBOL	DESCRIPTION	ABB.	SYMBOL	DESCRIPTION	ABB.
	SOIL, WASTE, OR SEWER	W		PIPE CONNECTION	-		POINT OF CONNECTION/DIS.	POC/POD
	GREASE WASTE	GW		CAPPED OR PLUGGED PIPE	-		FIXTURE GAS SUPPLY	-
	STORM/OVERFLOW DRAIN	SD/OD		PIPE OR EQUIP. T.B.R.	-		WATER HAMMER ARRESTOR	WHA
	VENT	V		HOSE BIB	HB		GATE VALVE	-
	CONDENSATE DRAIN	COND		RECESSED HOSE BIB	RHB		BALL VALVE	-
	COLD WATER	CW		FIRE RISER	-		GLOBE VALVE	-
	COLD WATER TRAP PRIMER	-		FIRE DEPARTMENT CONNECTION	FDC		GAS COCK	-
	HOT WATER SUPPLY	HW		FLOOR CLEAN OUT	FCO		CHECK VALVE	-
	HOT WATER RECIRCULATION	HWR		CLEAN OUT TO GRADE	COTG		DOUBLE CHECK VALVE	-
	GAS LINE	G		WALL CLEAN OUT	WCO		VALVE IN RISER	-
	PIPE UP	-		FLOOR SINK	-		AUTOMATIC AIR VENT	AAV
	PIPE DOWN	-		FLOOR DRAIN	-		VALVE IN YARD BOX	-

PLUMBING ABBREVIATIONS


AA	AREA ALARM	ESH	EMERGENCY SHOWER	LBS	POUNDS	SOV	SHUT OFF VALVE
ABV	ABOVE	EW	ELECTRIC WATER COOLER	MBTUH	BTU PER HOUR (THOUSANDS)	TA	TEMPERATURE
ADA	AMERICAN DISABILITIES ACT	EXP	EXPOSED	MFR	MANUFACTURE, MANUFACTURER	TV	ALARM TEMPERING VALVE
AFF	ABOVE FINISH FLOOR	FD	FLOOR DRAIN	NI	MANHOLE	TV	THERMOSTATIC EXPANSION VALVE
ARCH	ARCHITECTURAL, ARCHITECT	FF	FINISH FLOOR	(N)	NEW	TYP	TYPICAL
B	BATHTUB	FG	FLOOR GRADE	NTS	NOT IN CONTRACT	URN	URINAL
BEH	BEHIND	FS	FLOOR SINK	NO	NOT TO SCALE	UN	UNLESS OTHERWISE NOTED
BEL	BELOW	FT	FLUSH TANK OR FEET	P	PUMP	UP	UP THROUGH ROOF
BLOC	BUILDING	FIX	FIXTURE UNITS	PH	PHASE	VS	VACUUM SWITCH
CD	CONDENSATE DRAIN	FV	FLUSH VALVE	PV	POST INDICATOR VALVE	VTR	VENT THROUGH ROOF
CFH	CUBIC FEET PER HOUR	GA	GAUGE (OR GAGE)	PSI	POUNDS PER SQUARE INCH	W	WASTE
CI	CAST IRON	GALV	GALVANIZED	RD	ROUGH DRAIN	WC	WATER CLOSET
CLG	CEILING	GO	GAS OUTLET	RH	RIGHT HAND	WCH	WATER CLOTH
CP	CHROME PLATED	GPM	GALLONS PER MINUTE	RHC	ROUGH IN AND CONNECT	WH	WATER HEATER
DCW	DOMESTIC COLD WATER	HOSE BIBB	HOSE BIBB	RPM	REVOLUTIONS PER MINUTE	W	WEIGHT
DF	DRINKING FOUNTAIN	HOREPOWER	HOREPOWER	ROOM	ROOM	WTH	WITH
DN	DOWN	LH	LEFT HAND	S	SINK	W/O	WITHOUT
E	EXISTING	LAVATORY	LAVATORY	SD	STORM DRAIN	WV	W/ZONE VALVE
ELEC	ELECTRICAL	LW	KILLOWATTS	SH	SHOWER		

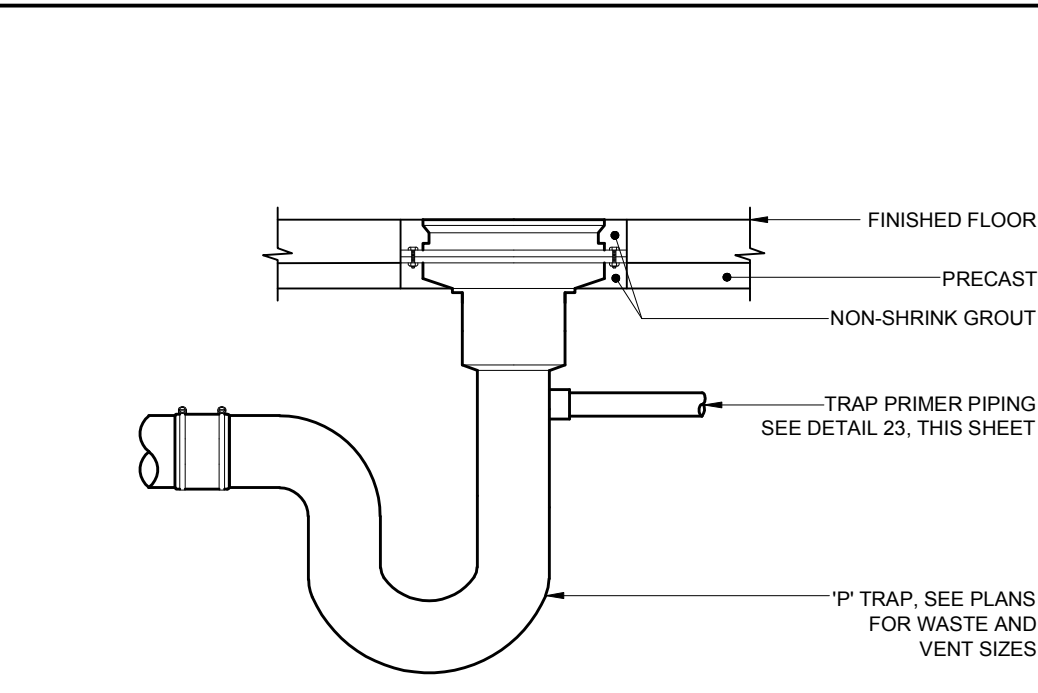


51 FLOOR DRAIN W/ TRAP PRIMER
NO SCALE

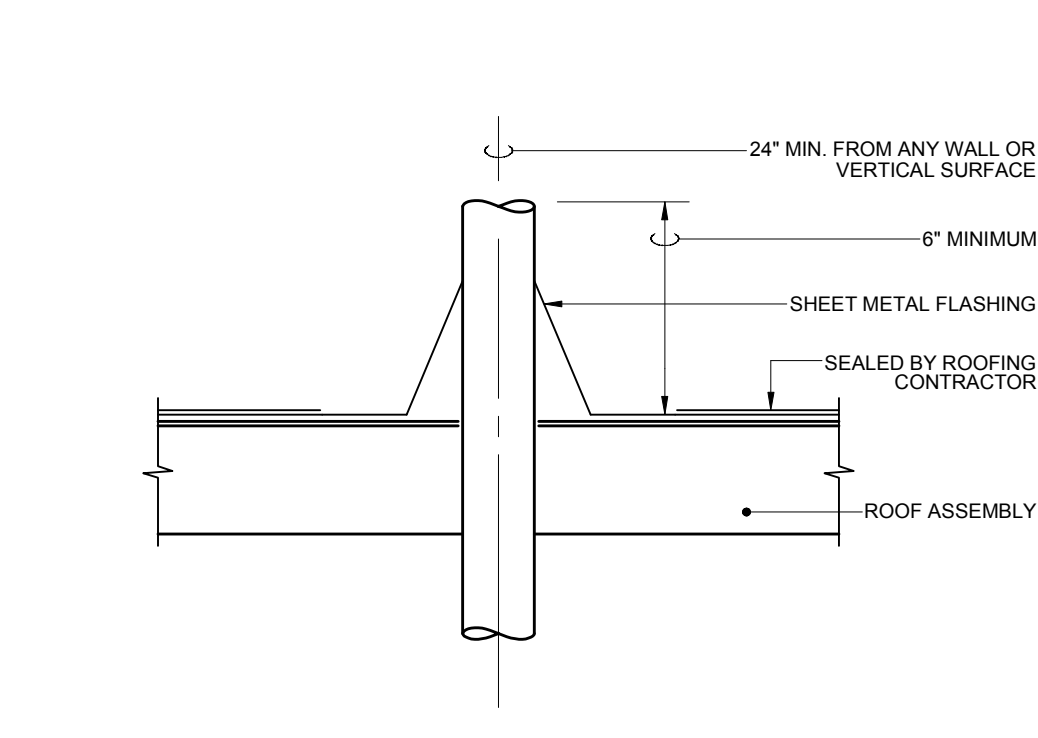


52 VENT THROUGH ROOF
NO SCALE

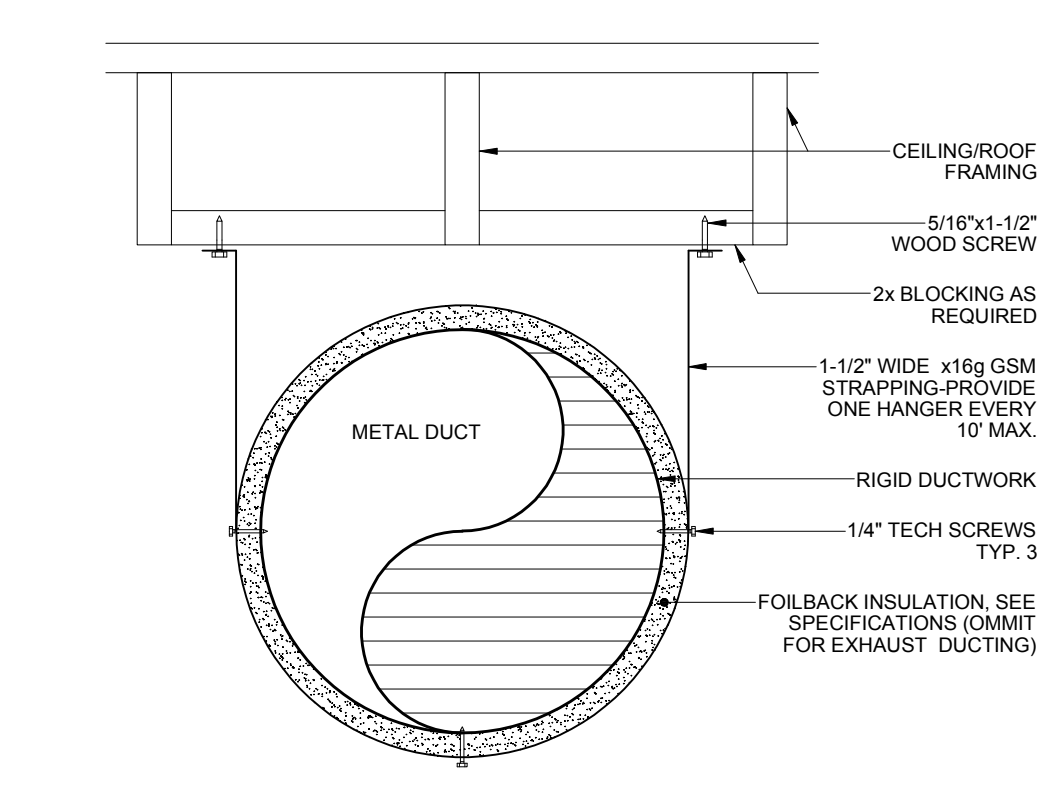

53 RIGID DUCT SUPPORT
NO SCALE

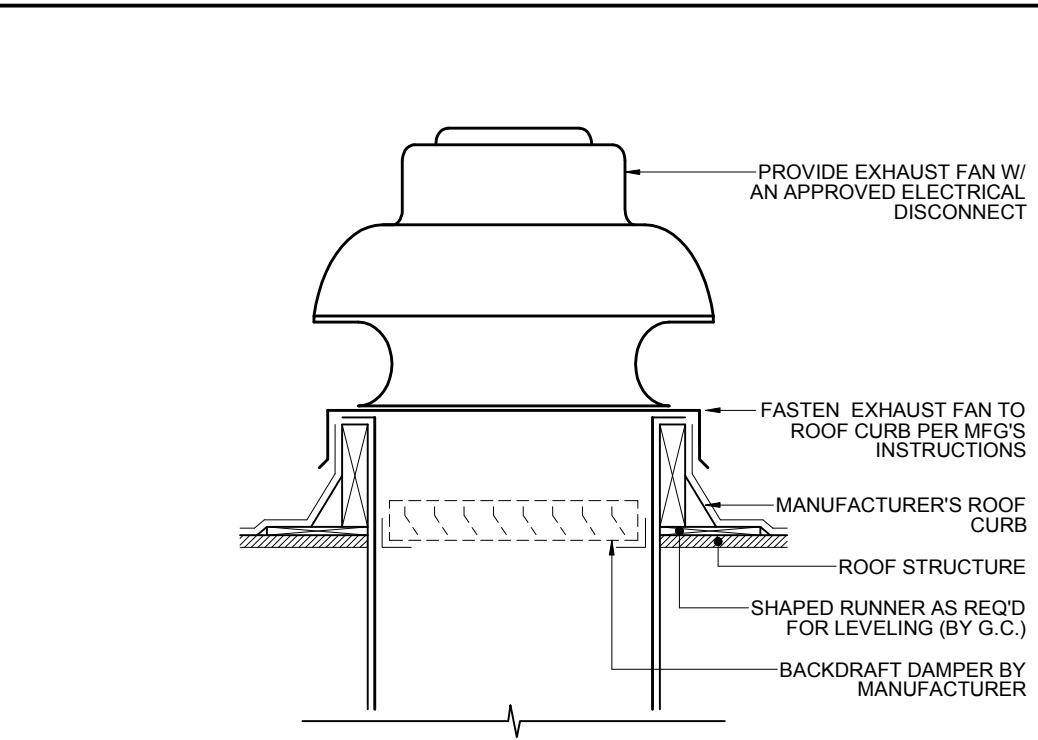


41 ROOF MOUNTED EXHAUST FAN
NO SCALE

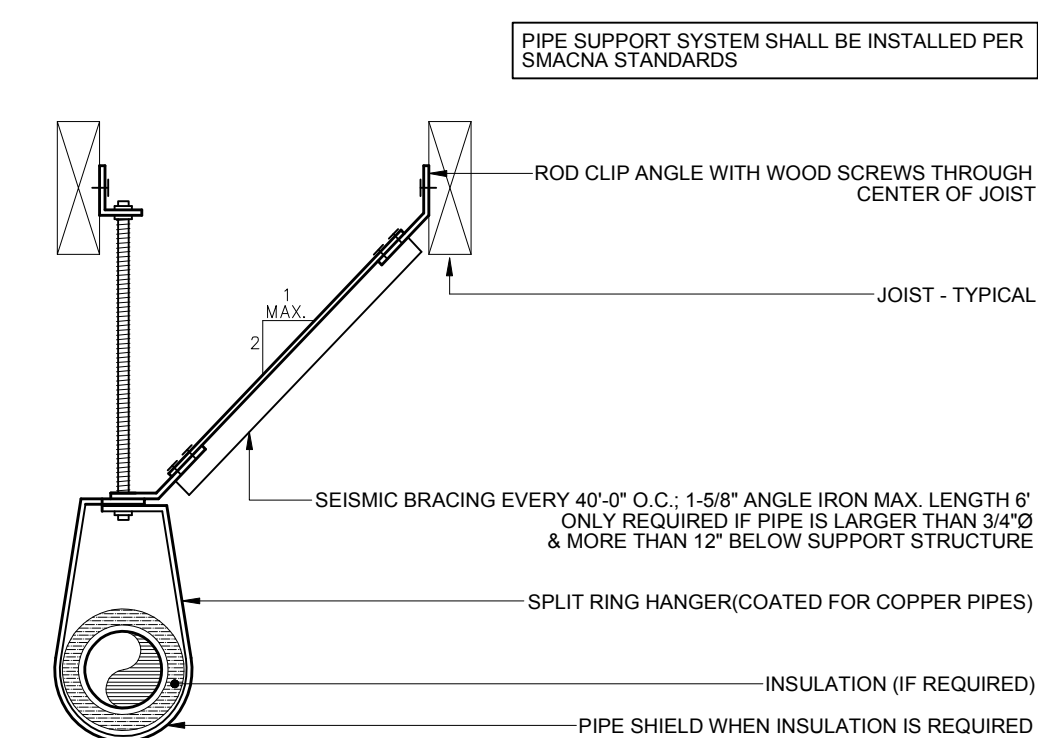


44 TYPICAL PIPING SUPPORT
NO SCALE

HANGER RODS - SIZE AND SPACING SCHEDULE					
MAXIMUM HANGER SPACING					
WATER AND WASTE					NATURAL GAS
PIPE SIZE	MIN. HANGER ROD SIZE	COPPER	STEEL SCH. 40	CAST IRON STD.	PLASTIC DWV/SCH. 40
1/2"	1/4"	6 FT.	6 FT.	-	4 FT.
3/4"	1/4"	6 FT.	8 FT.	-	4 FT.
1"	1/4"	6 FT.	8 FT.	-	4 FT.
1-1/4"	3/8"	6 FT.	10 FT.	-	4 FT.
1-1/2"	3/8"	6 FT.	10 FT.	-	4 FT.
2"	3/8"	10 FT.	10 FT.	10 FT.	4 FT.
2-1/2"	1/2"	10 FT.	10 FT.	10 FT.	4 FT.
3"	1/2"	10 FT.	10 FT.	10 FT.	4 FT.
4"	1/2"	10 FT.	10 FT.	10 FT.	4 FT.

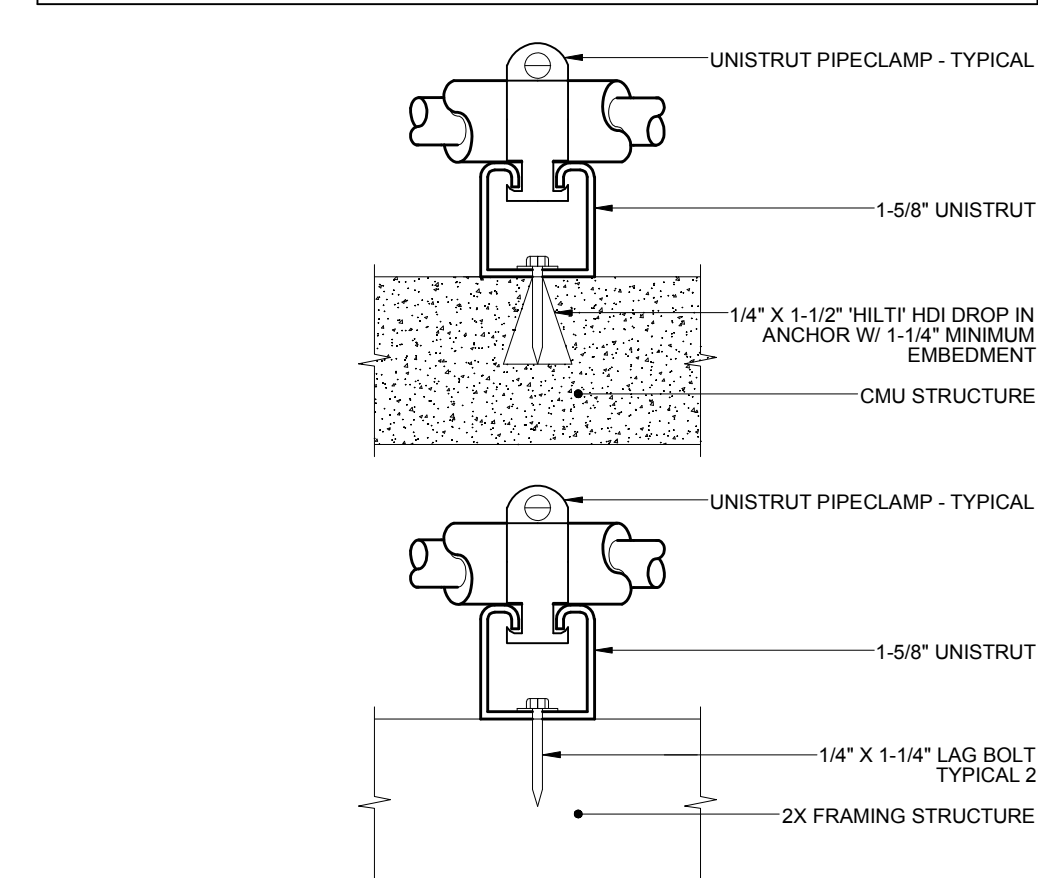


SIZE AND SPACING SCHEDULE					
MAXIMUM HANGER SPACING					
WATER, WASTE, AND VENT					NATURAL GAS
PIPE SIZE	COPPER	PLASTIC DWV/SCH. 40	SCH. 40 IRON		
1/2"	6 FT.	4 FT.	6 FT.		
3/4"	6 FT.	4 FT.	8 FT.		
1"	6 FT.	4 FT.	8 FT.		
1-1/4"	6 FT.	4 FT.	10 FT.		
1-1/2"	6 FT.	4 FT.	10 FT.		
2"	10 FT.	4 FT.	10 FT.		
2-1/2"	10 FT.	4 FT.	10 FT.		
3"	10 FT.	4 FT.	10 FT.		
4"	10 FT.	4 FT.	10 FT.		


44 TYPICAL PIPING SUPPORT
NO SCALE

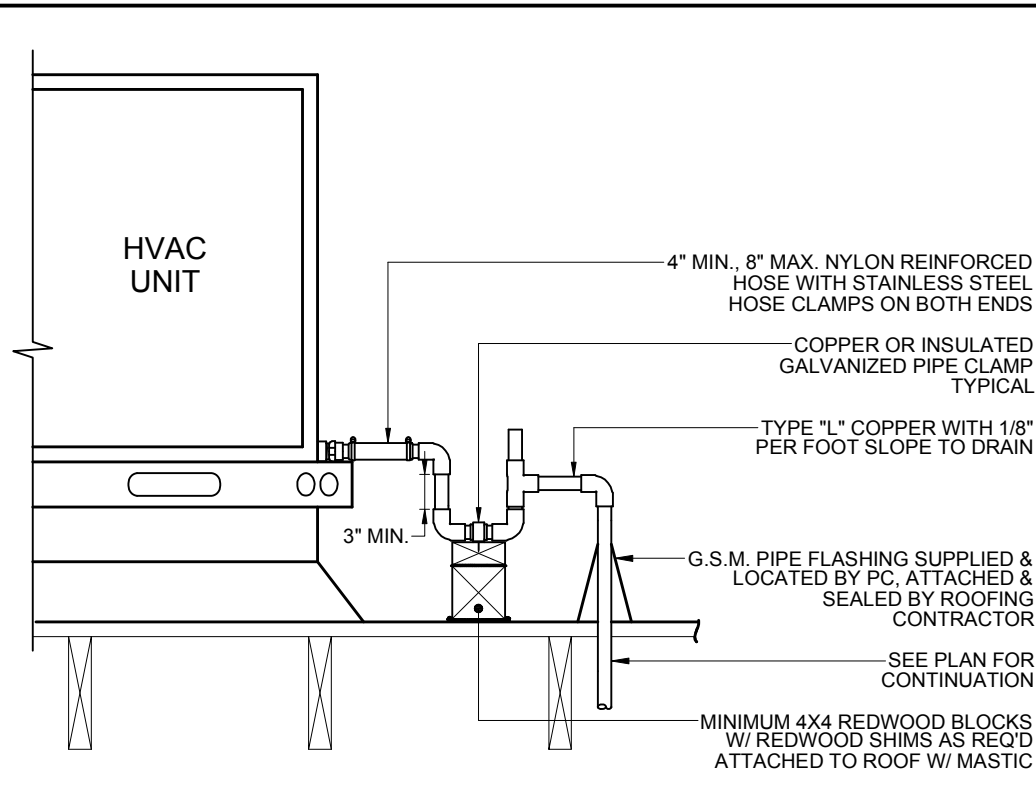


31 HVAC UNIT CONDENSATE DRAIN
NO SCALE

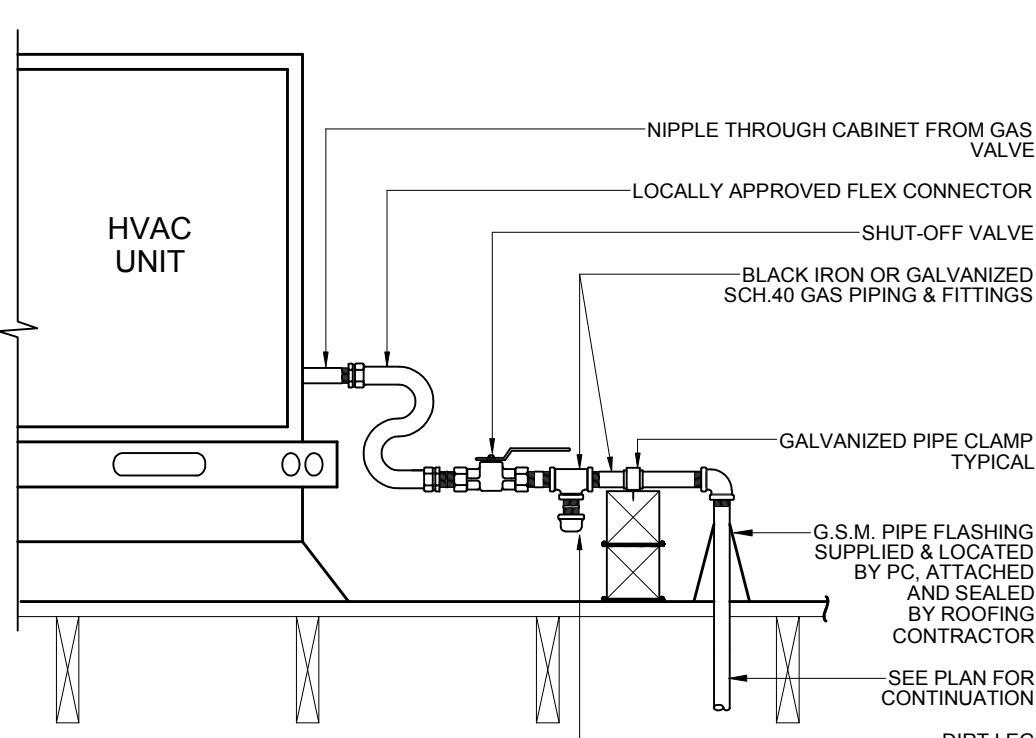

32 GAS PIPING CONNECTION
NO SCALE

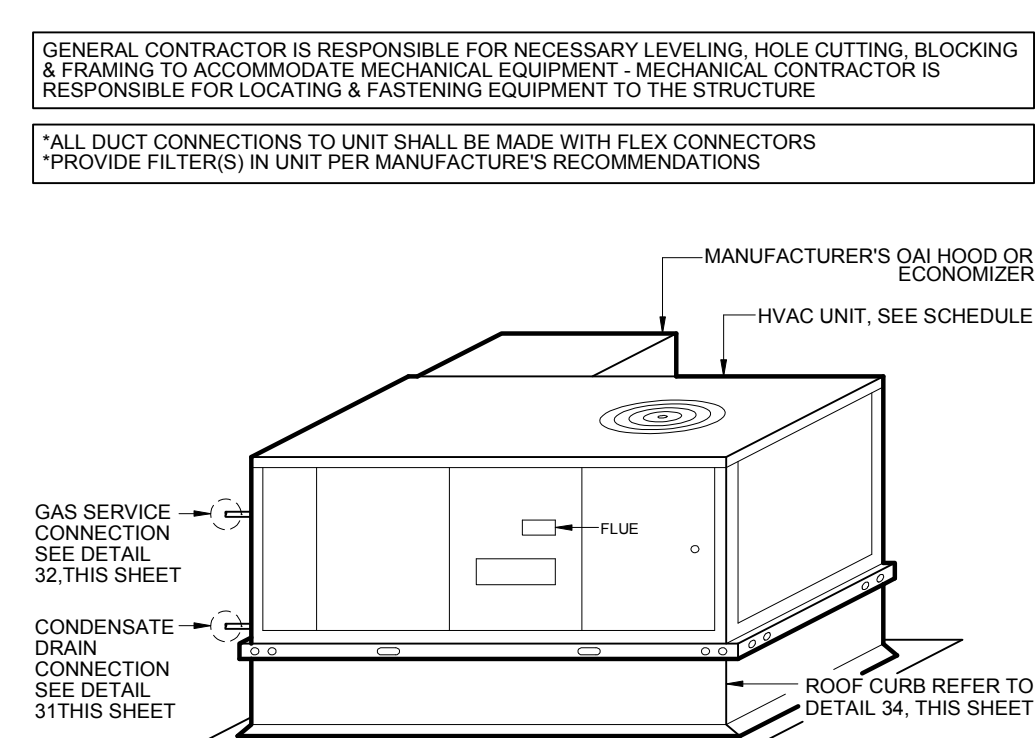

33 ROOF MOUNTED HVAC UNIT
NO SCALE

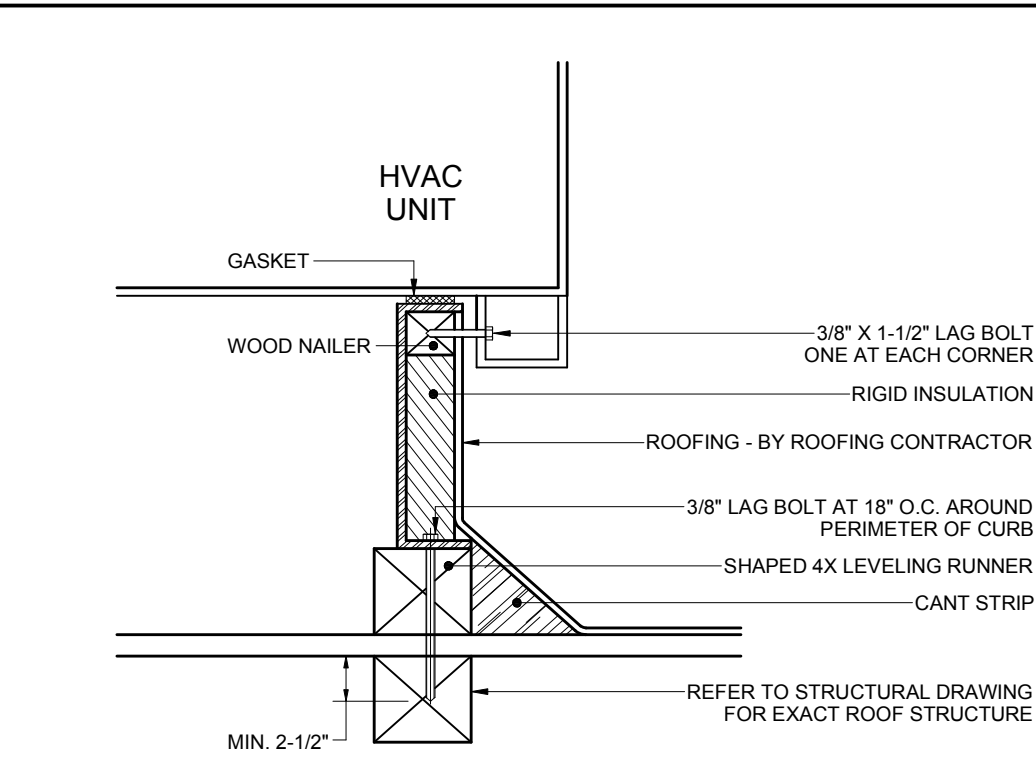


34 TYPICAL ROOF CURB
NO SCALE

PACKAGED HVAC UNIT SCHEDULE													
SYMBOL	MFG	MODEL	COOLING CAPACITY (BTUH)	SEER	EER	POWER	MCA (AMPS)	MOC (AMPS)	CFM	OAI CFM	E.S.P. "W.C.	ID BLOWER MOTOR HP	GAS INPUT (BTUH)
AC-1	YORK	ZF048N06	47,500	13.0	11.0	208/230-3-60	29.9	40	1200	510	0.6	1.0 BELT	75,000


EXHAUST FAN SCHEDULE													
SYMBOL	MFG	MODEL	STYLE	LOCATION	POWER	DRIVE	CFM	E.S.P. "W.C.	HP	BHP	RLA	FRPM	WEIGHT (LBS)
EF-1	GREENHECK	GB-081	DOME	ROOF	115/120-1-60	BELT	510	0.75	1/6	0.14	-	1,548	50

AIR TERMINAL SCHEDULE													
SYMBOL	MFG	MODEL	NECK SIZE	BORDER	CONST.	FINISH	OBD	NOTES	LEGEND				
CSD-1	TITUS	SG-PR	10"x10"	BORDER TYPE 1	STEEL	SOFT WHITE	YES	2	C	CEILING	E	EXHAUST	D
CSD-2	TITUS	MCD	12"x12"	BORDER TYPE 1	STEEL	SOFT WHITE	YES	2	D	DUCT	R	RETURN	G
WSD-1	TITUS	TBF-AA	SIZE 6	BORDER TYPE 1	ALUMINUM	SOFT WHITE	-	-	Dr	DOOR	S	SUPPLY	R
CRG-1	TITUS	350RL	12"x18"	BORDER TYPE 1	STEEL	SOFT WHITE	YES	1	W	WALL	I	INTAKE	L
CEG-1	TITUS	SG-PR	10"x10"	BORDER TYPE 1	STEEL	SOFT WHITE	YES	1	F	FLOOR	V	VENTILATION	S


PLUMBING FIXTURE SCHEDULE								
SYMBOL	MAKE & MODEL	DESCRIPTION	ROUGH IN SIZES				FITTINGS OR ACC.	NOTES
			HW	CW	W	V		
WC-1	ACORN #1418-FA-CT-2-BP-4 STAINLESS STEEL	FLOOR MOUNTED, VANDAL/SUICIDE RESISTANT COMBINATION WATER CLOSET/LAVATORY	1/2"	1-1/4"	3"	2"	PUSH BUTTON FLUSH VALVE BY OTHERS, AIR-TROL HW & CW LAVATORY VALVE, & SHOKTROL WATER HAMMER ARRESTOR	ALL APPLY
FD-1	J.R. SMITH SERIES # 2005Y02-A05PB-U	5"Ø, CAST IRON FLOOR DRAIN WITH BRONZE STRAINER	-	1/2"	2"	1-1/2"	PROVIDE WITH "PRECISION PRODUCTS" PRIME-RITE TRAP PRIMER EXPOSED MOUNT IN PLUMBING CHASE	-
NOTES:								
1. ALL FIXTURES DESIGNATED TO BE ACCESSIBLE TO INDIVIDUALS WITH DISABILITIES SHALL BE IN ACCORDANCE WITH THE "AMERICANS WITH DISABILITIES ACT OF 1990" FIXTURES AND THEIR INSTALLATION SHALL ALSO COMPLY WITH AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI) PUBLICATION A117.1 - "PROVIDING ACCESSIBILITY AND USABILITY FOR PHYSICALLY HANDICAPPED PEOPLE" AND/OR GOVERNING CODES.								
2. ALL PLUMBING FIXTURES, EQUIPMENT, TRIM, AND FITTINGS SHALL COMPLY WITH LOCAL, STATE, AND FEDERAL REGULATIONS AND CODES, INCLUDING BUT NOT LIMITED TO WATER AND ENERGY CONSERVATION CODES. THE SCHEDULED AND/OR SPECIFIED PLUMBING FIXTURES AND EQUIPMENT REPRESENT THE MINIMUM CRITERIA AND SHALL BE THE BASIS FOR THE CONTRACTORS BASE BID. IF THE SCHEDULED OR SPECIFIED FIXTURES OR EQUIPMENT DO NOT COMPLY WITH THE GOVERNING CODES OR REGULATIONS IN ALL RESPECTS, THE CONTRACTOR SHALL PROVIDE AN ALTERNATE BID FOR THE COMPLYING FIXTURES, EQUIPMENT, TRIM, OR FITTINGS. THE ABSENCE OF AN ALTERNATE BID SHALL BE CONSTRUED TO MEAN THAT THE CONTRACTORS BID INCLUDES ALL COSTS NECESSARY TO MEET ALL REGULATIONS AND CODES.								
3. SEE PLAN FOR TOILET ANGLE CONFIGURATION								

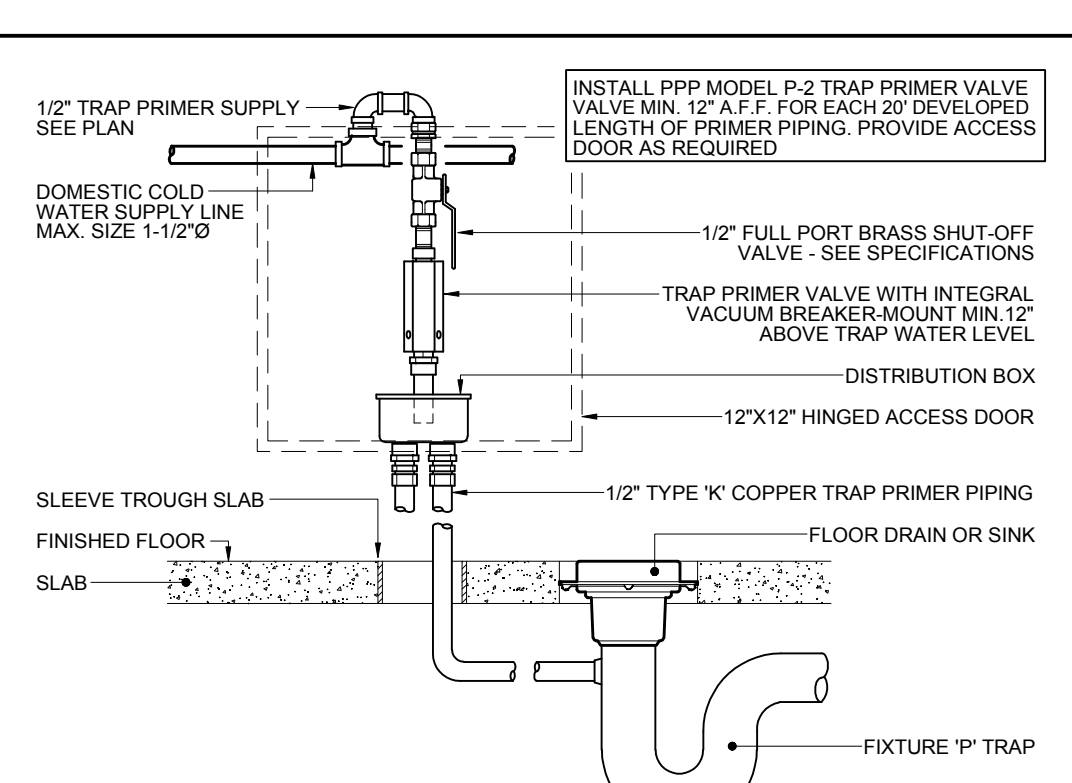


23 TRAP SEAL PRIMER
NO SCALE

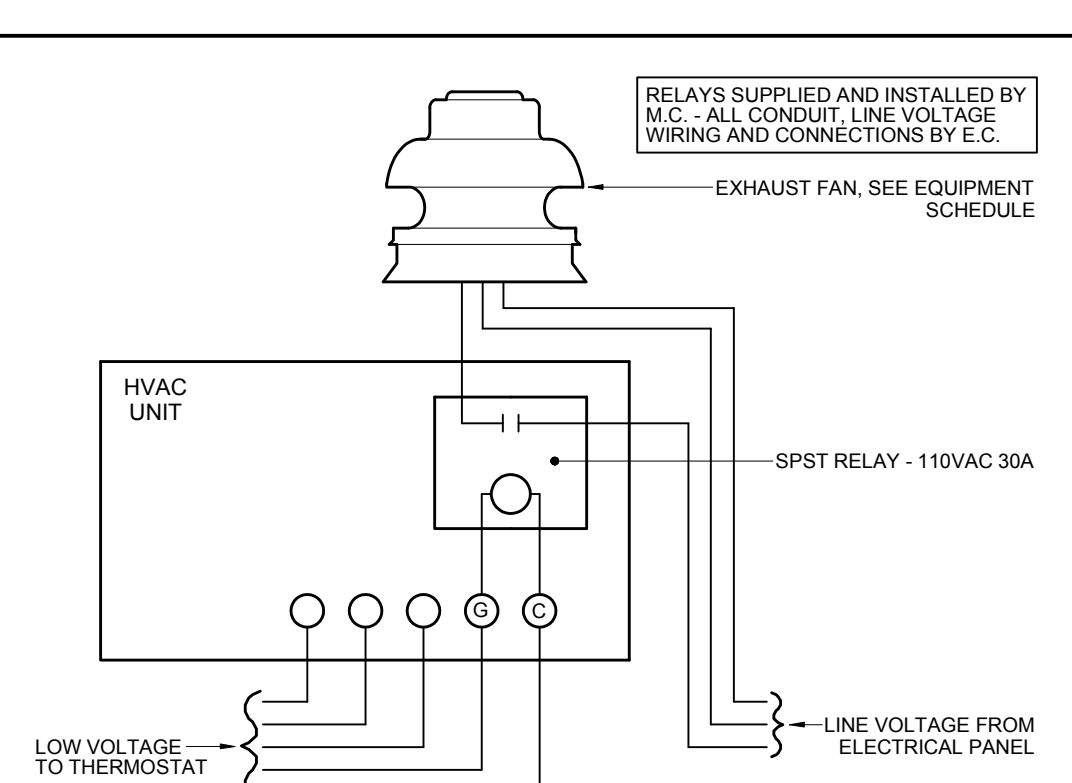

13 EF/AC INTERLOCK
NO SCALE

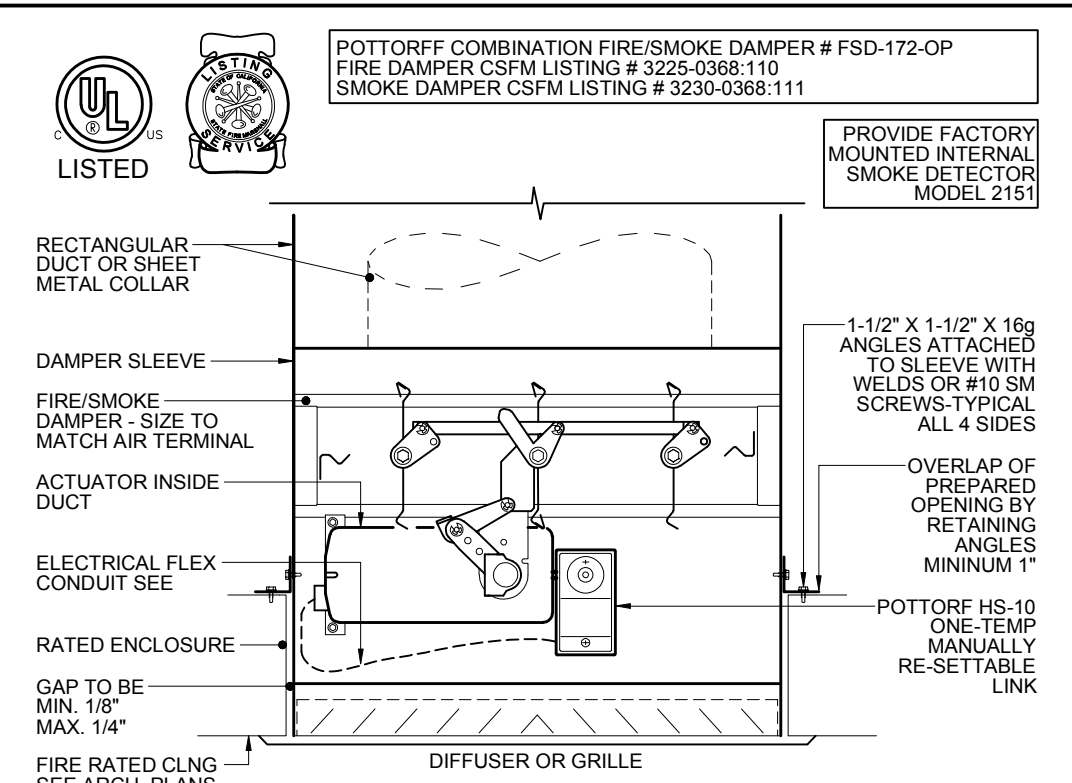

24 1-1/2 HOUR CEILING FIRE/SMOKE DAMPER
NO SCALE

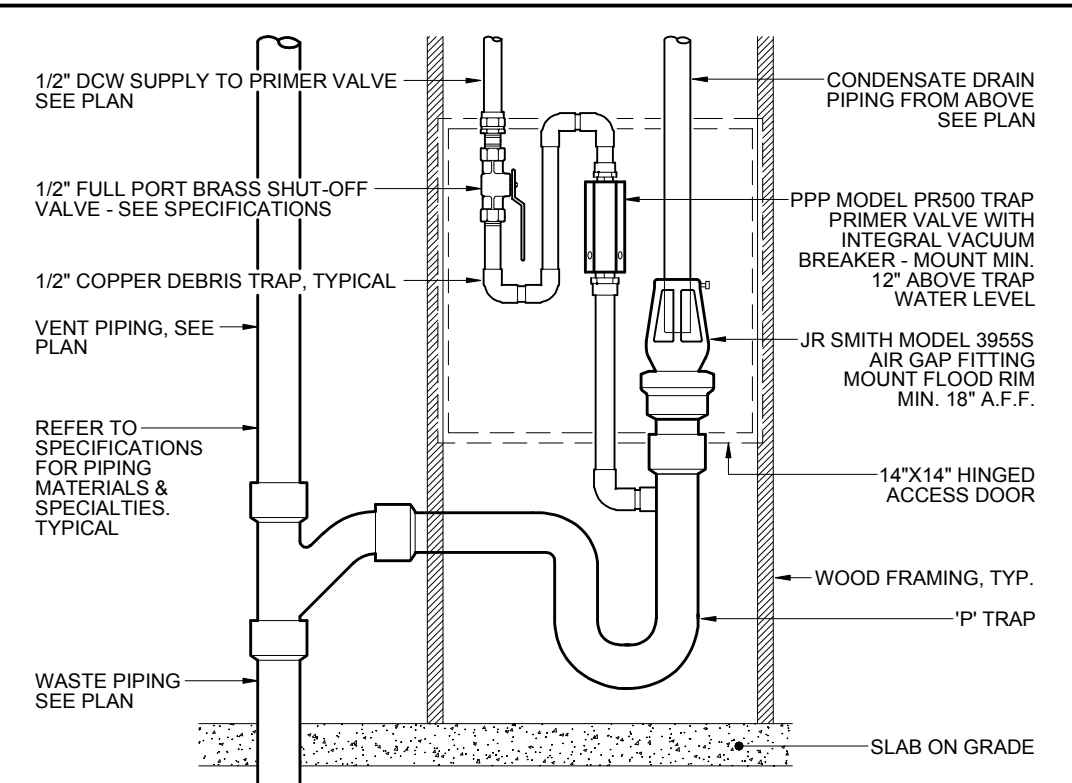

14 CONDENSATE DRAIN CONNECTION
NO SCALE

PROJECT

SUPERIOR COURT OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # JVA JOB # M11014

FRASER SEIPLE ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

JVA
MECHANICAL ENGINEERING

JAMES L. VAN DE VANTER, P.E. & ASSOCIATES

1023 NIPOMO STREET, SUITE 200
SAN LUIS OBISPO
CALIFORNIA 93401

805 543-3190

PROJECT MANAGER TDR

DRAWN BY TDR

DATES 05/05/11
06/20/11 INTERWEST PC

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE


PHASE I SCHEDULES & DETAILS

SHEET #


MP2.1

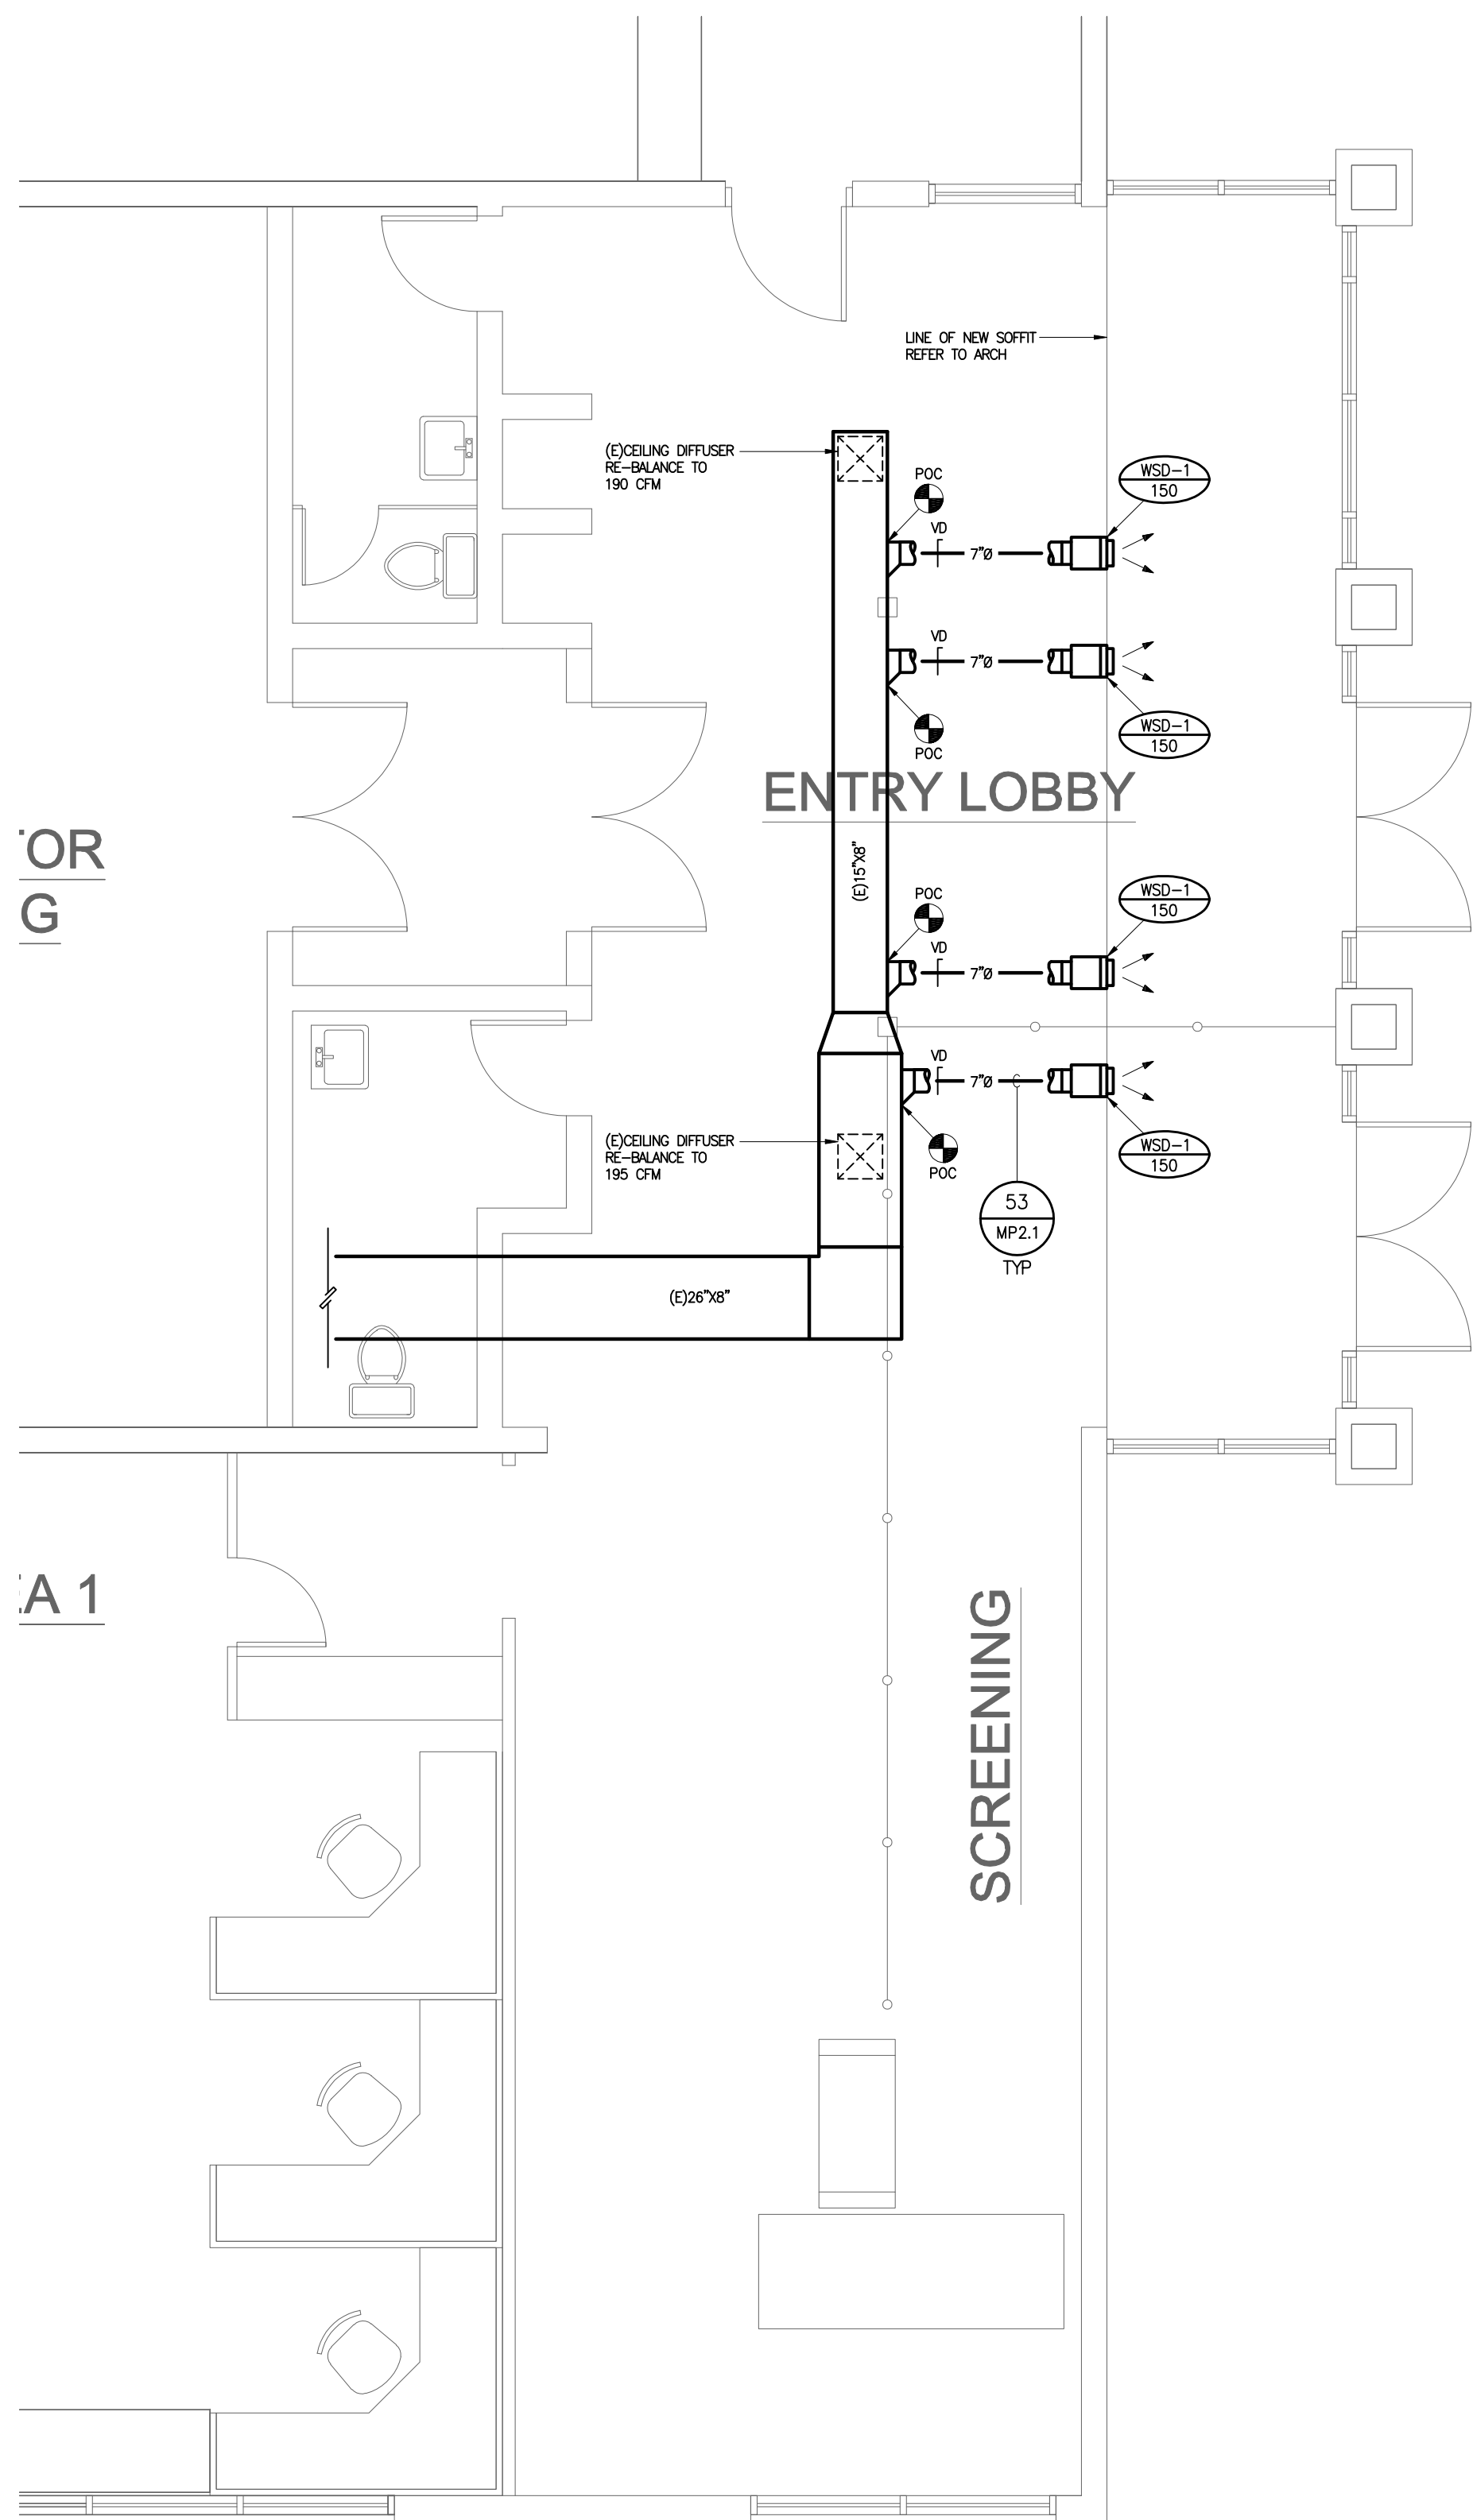

PARTIAL FLOOR PLAN
1/4" = 1'-0"

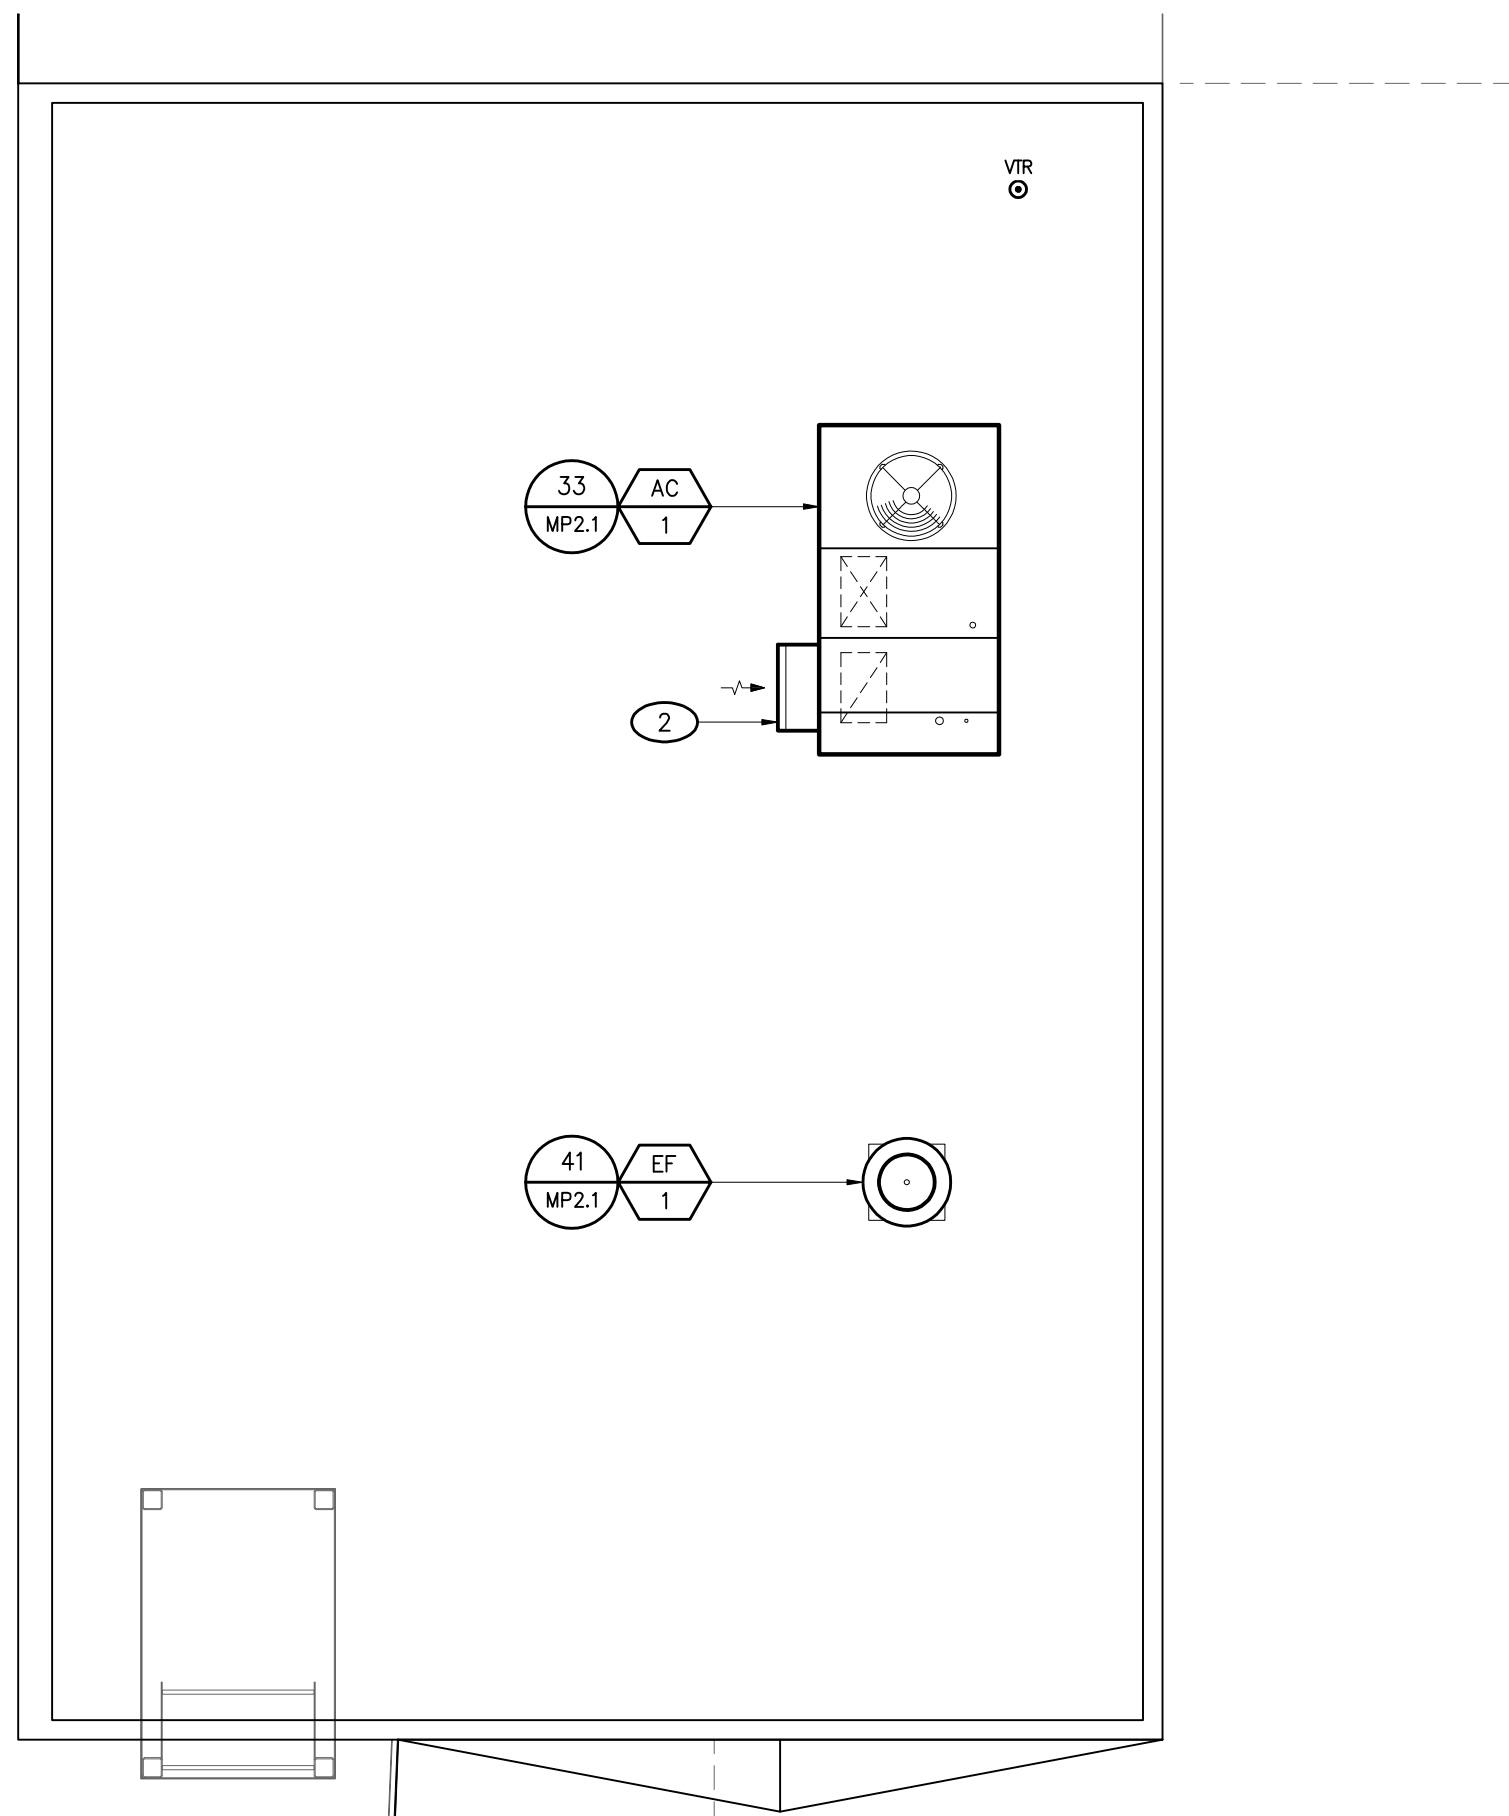


PARTIAL ROOF PLAN
1/4" = 1'-0"

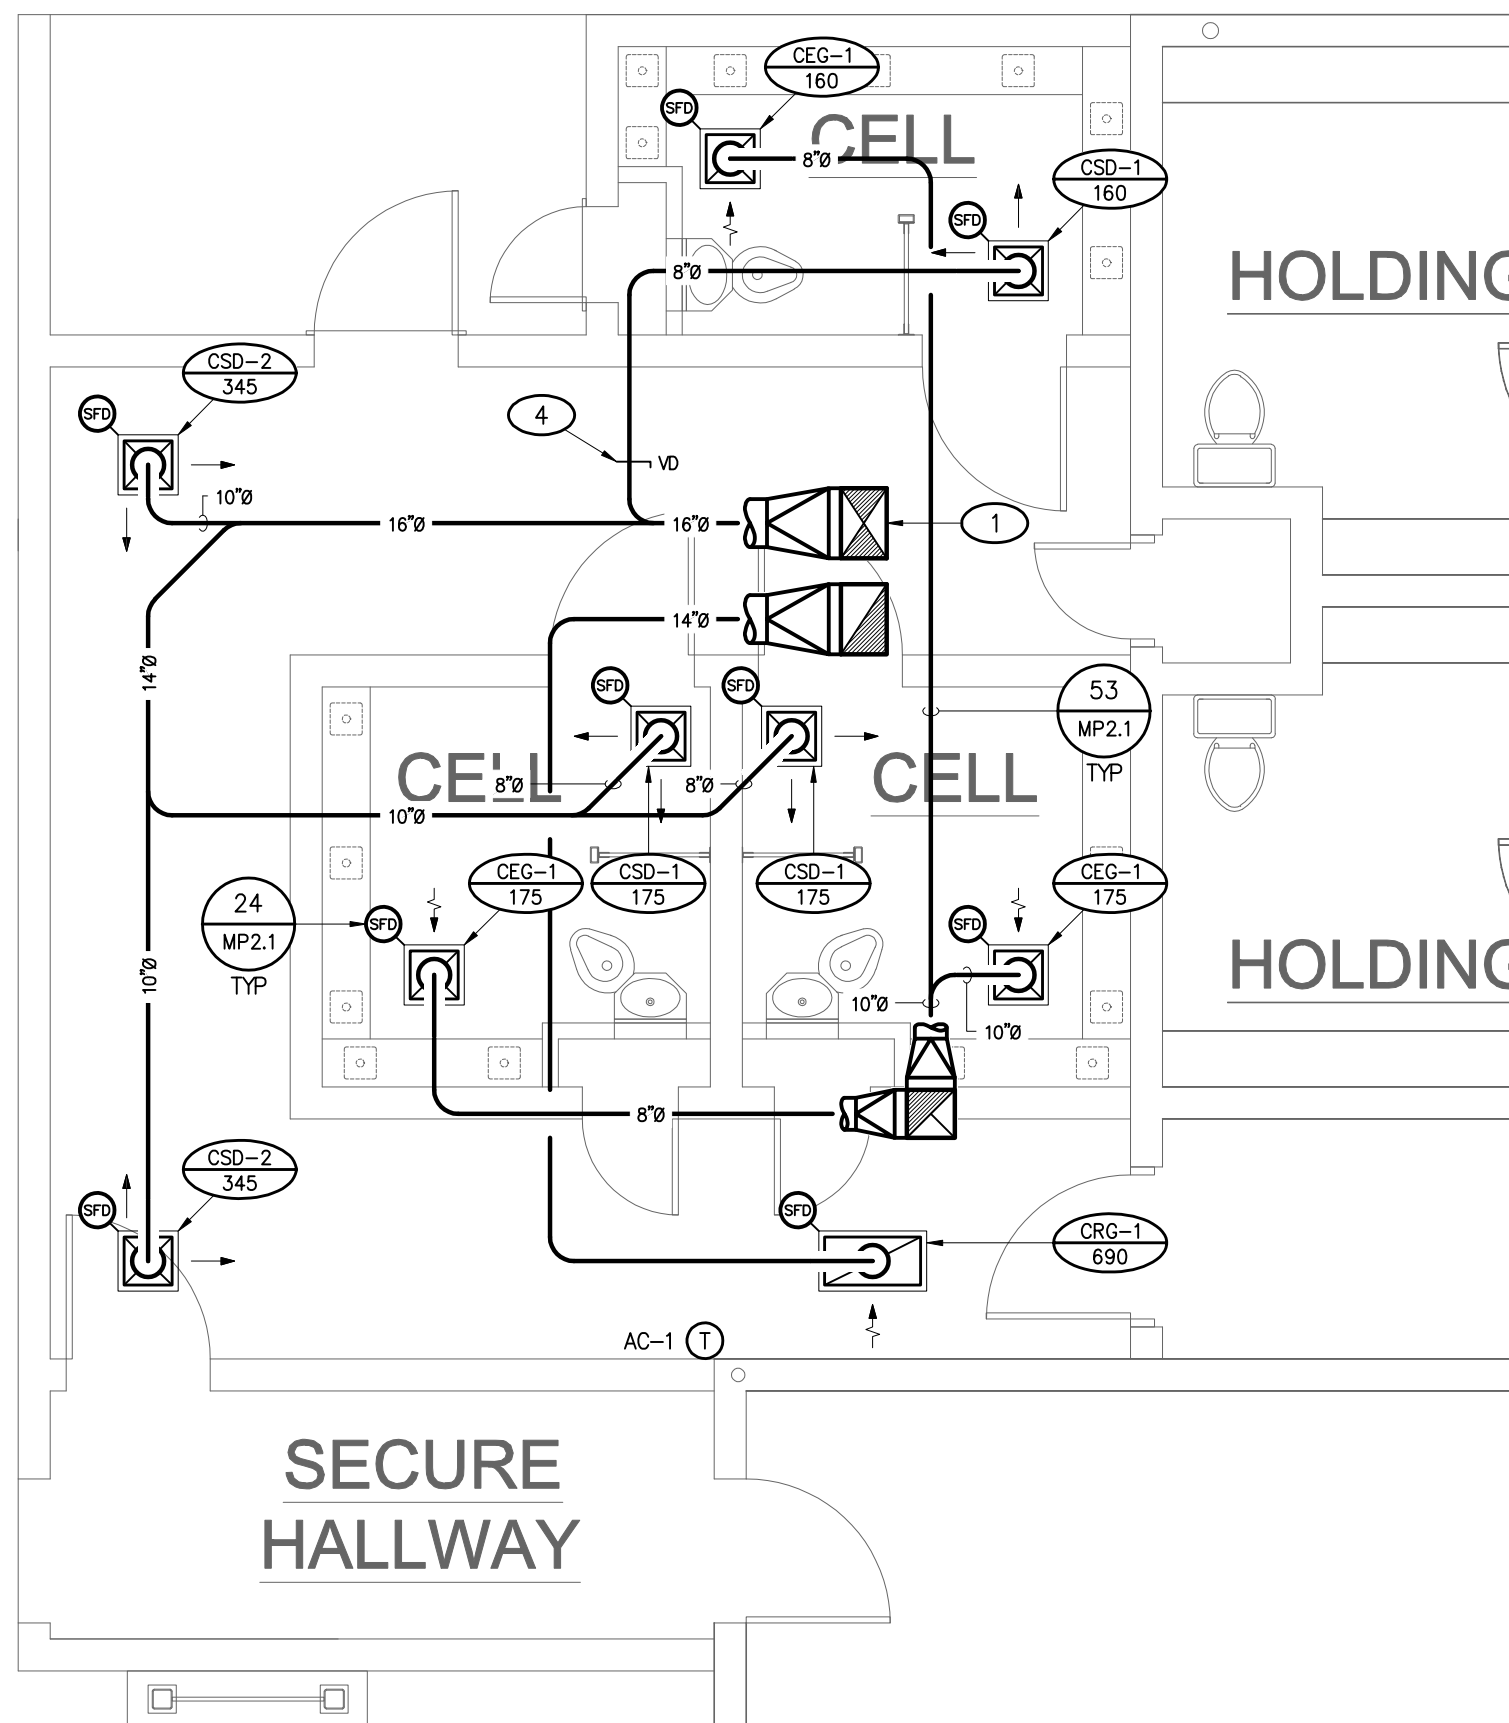

PARTIAL FLOOR PLAN
1/4" = 1'-0"

NOTE
SEE SHEET T-5 FOR WALL RATINGS LEGEND

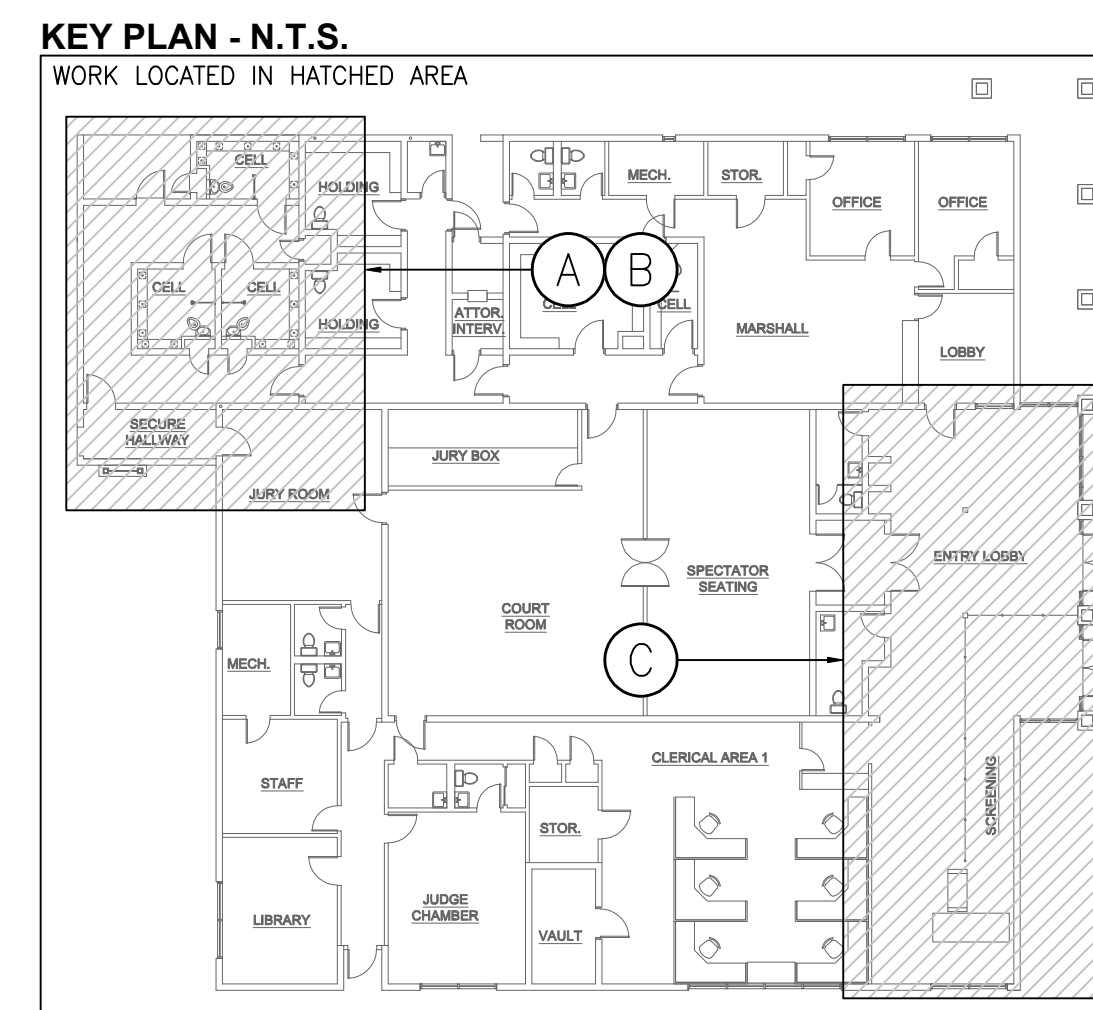

- REFERENCE NOTES**
- UNIT CONNECTION SIZE. PLENUM DROP. PROVIDE TURNING VANE WITH SQUARE TO ROUND ADAPTOR
 - OUTSIDE AIR INTAKE. REFER TO SCHEDULE FOR AIR FLOW RATE. MAINTAIN 10' CLEAR FROM ALL PLUMBING VENTS AND FLUES, & 3' CLEAR FROM ALL ENVIRONMENTAL AIR EXHAUST TERMINATIONS
 - NOT USED
 - VOLUME DAMPER. TYPICAL ALL BRANCH DUCTS, SUPPLY RETURN & EXHAUST

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # JVA JOB #
M11014

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

JVA
MECHANICAL ENGINEERING

JAMES L. VAN DE VANTER, P.E. &
ASSOCIATES

1023 NIPOMO STREET, SUITE 200
SAN LUIS OBISPO
CALIFORNIA 93401


805 543-3190

PROJECT MANAGER TDR

DRAWN BY TDR

DATES 05/05/11
06/20/11 INTERWEST PC

SIGNED

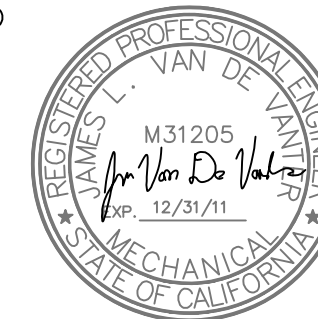

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE


**PHASE I
MECHANICAL
ROOF & FLOOR
PLANS**

SHEET #


MP3.1

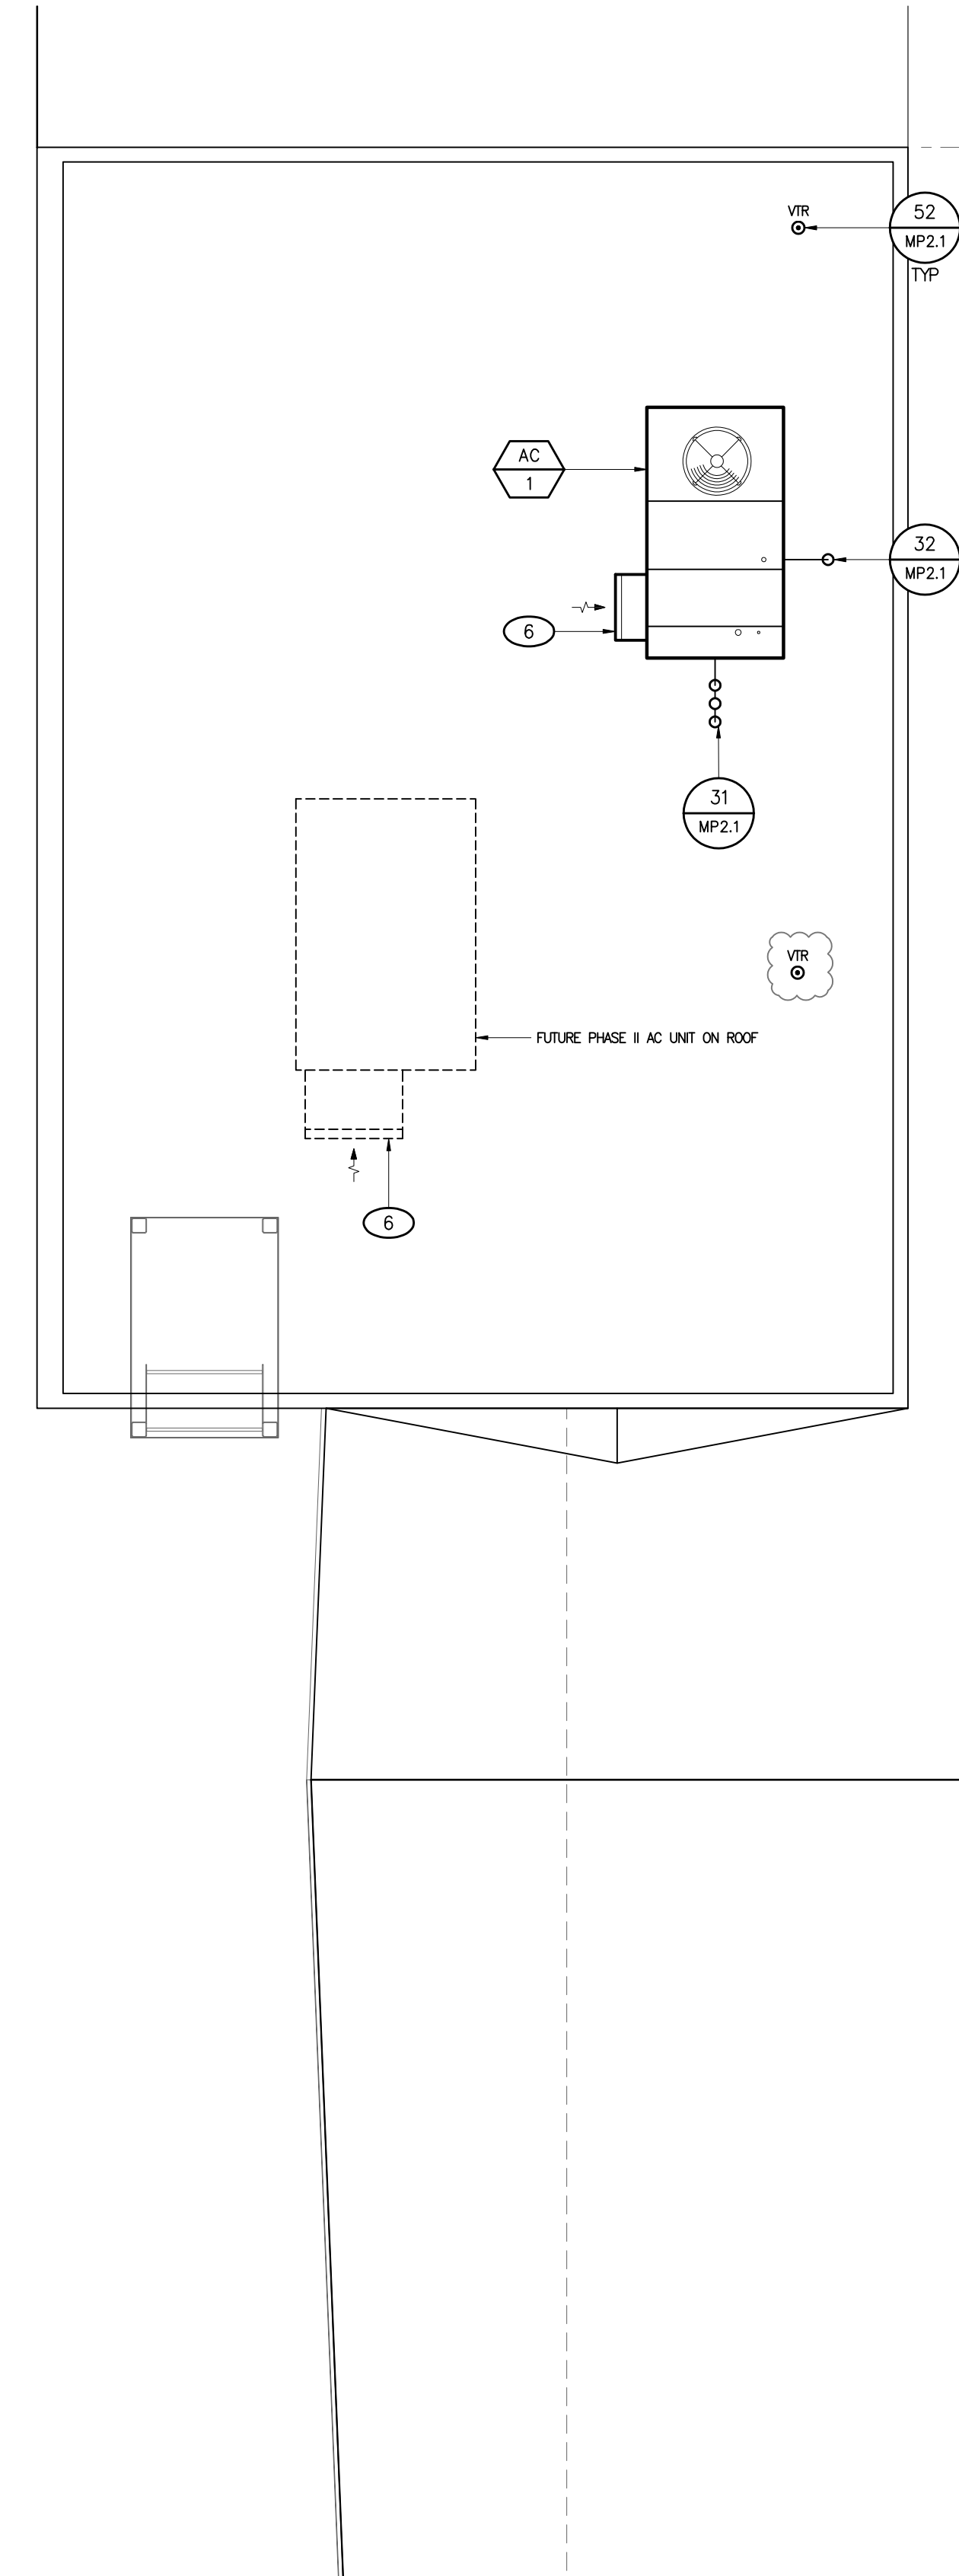

PLUMBING - PARTIAL ROOF PLAN
1/4" = 1'-0"

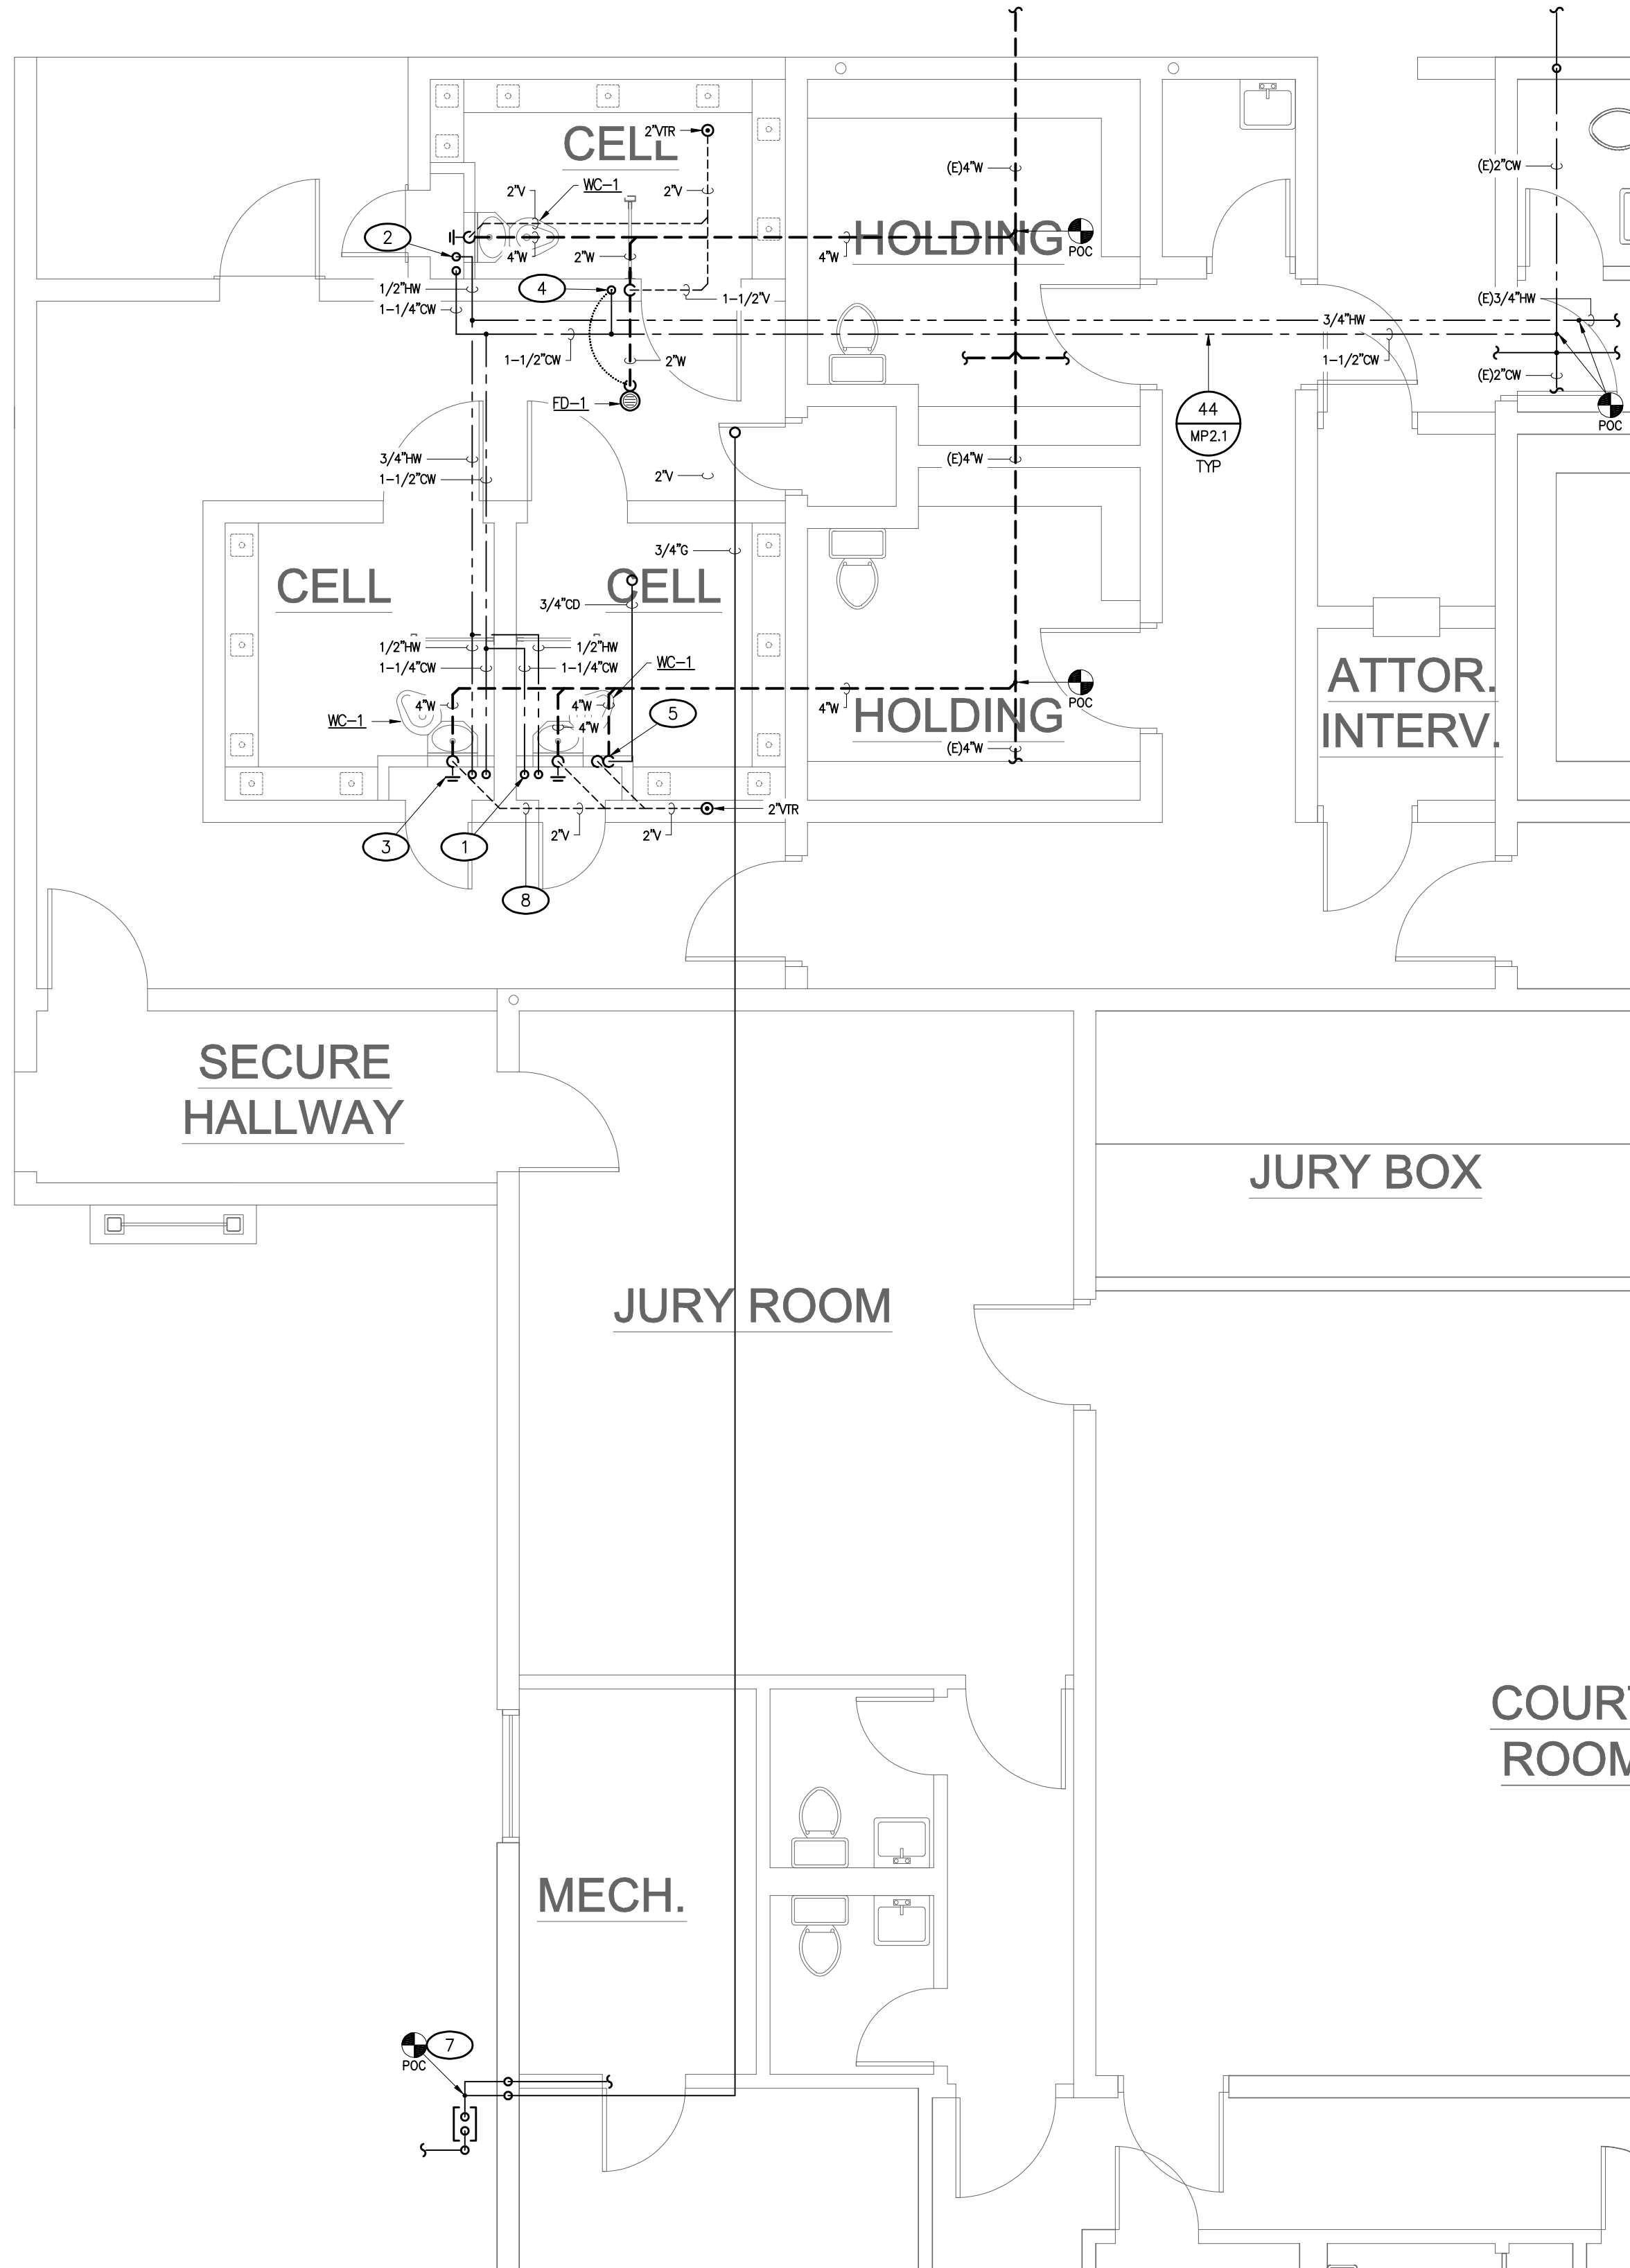

PLUMBING - PARTIAL FLOOR PLAN
1/4" = 1'-0"

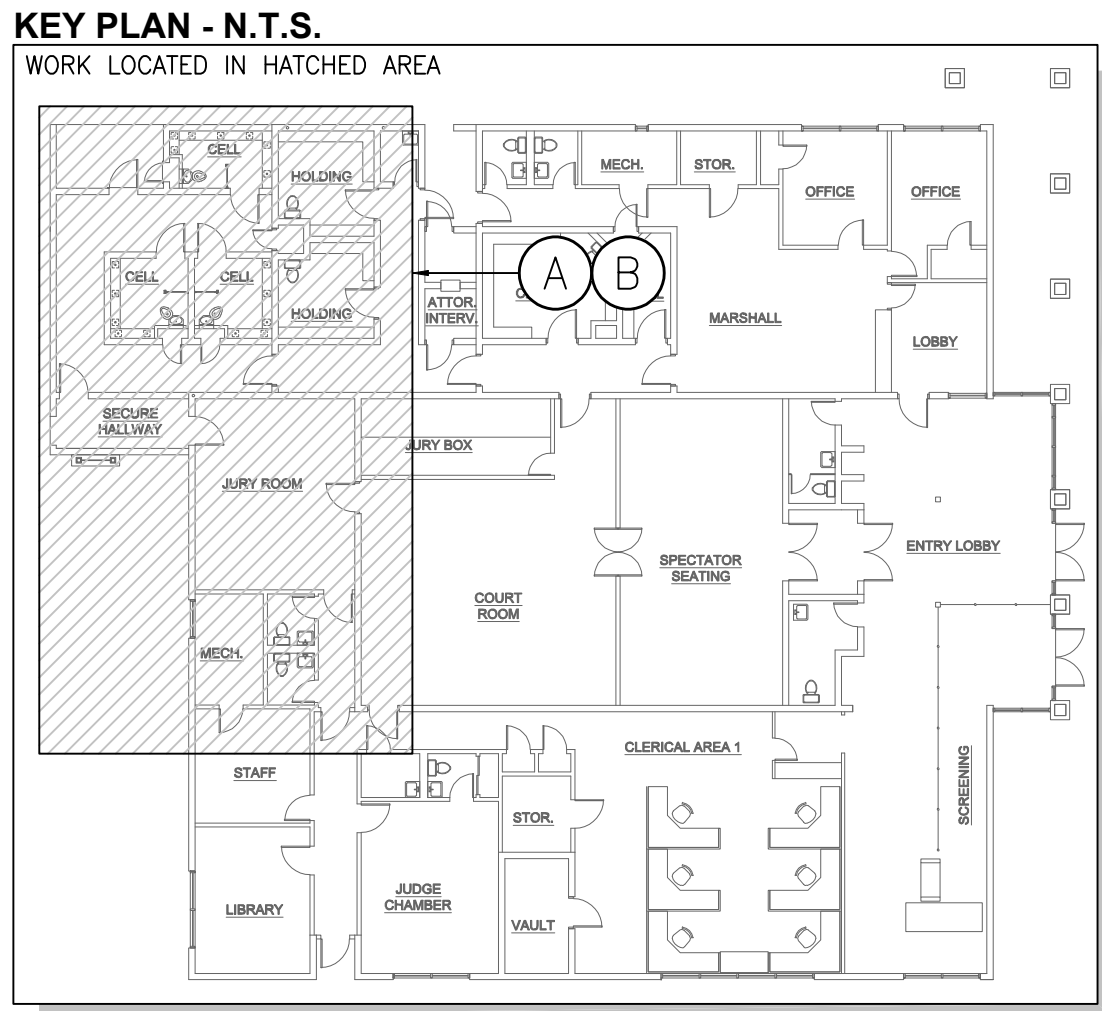

UTILITY LINE SIZING						
DOMESTIC WATER SERVICE						
NEW WSFU	EXISTING WSFU	TOTAL WSFU	TOTAL GPM	FLUSH TANK/ FLUSH VALVE	METER SIZE	PIPE SIZE
15.0	76.0	91.0	65.0	VALVE	(E)2"	(E)2"
STREET PRESSURE	AVAILABLE PRESSURE	REQ'D RESIDUAL PSI AT FURTHEST FIXTURE	TOTAL DEVEL'D LENGTH [D+(X0.26)]	ALLOWABLE FRICTION LOSS		
60.0psi	51.0psi	20.0	315'	9.8psi/100'		
MAXIMUM ALLOWABLE WSFU (TYPE 'L' COPPER)						
PIPE SIZE	1/2"	3/4"	1"	1-1/4"	1-1/2"	2"
COLD WATER (MAX. 8 FPS)	7	15	29	56	97	245
HOT WATER (MAX. 5 FPS)	3	8	18	28	45	115
SIZED PER APPENDIX 'A', 2010 CPC						
GAS SERVICE						
SPACE BTU	WATER BTU	OTHER BTU	TOTAL BTU	TOTAL CFH	FURTHEST DISTANCE FROM METER	PIPE SIZE
75,000	-	-	75,000	75.0	80'	3/4"
SIZED PER TABLE 12-7, 2010 CPC						
SANITARY SEWER						
NEW DFU	EXISTING DFU	TOTAL DFU	BUILDING SLOPE	PIPE SIZE		
12.0	56.0	68.0	1/4" PER 1'-0"	(E)4"		
SIZED PER TABLE 7-5, 2010 CPC						

- REFERENCE NOTES
- 1-1/4" CW DOWN PLUMBING CHASE. PROVIDE FULL PORT BRASS SOV & WATER HAMMER ARRESTOR, 1" TO COMBINATION WATER CLOSET LAVATORY UNIT, & 1/2" TRAP PRIMER TO FLOOR DRAIN "P" TRAP WITH SHUTOFF VALVE AHEAD OF PRIMER VALVE & AN APPROVED AIR-GAP ON THE OUTLET SIDE OF THE TRAP PRIMER VALVE - TYPICAL
 - 1/2" HW DOWN PLUMBING CHASE TO LAVATORY CONNECTION. PROVIDE FULL PORT BRASS SOV - TYPICAL
 - 4" CLEANOUT ON EXPOSED WASTE PIPING
 - 1/2" TRAP PRIMER TO FLOOR DRAIN "P" TRAP - PROVIDE ACCESS PANEL & SHUTOFF VALVE AHEAD OF PRIMER VALVE & PROVIDE AN APPROVED AIR-GAP ON THE OUTLET SIDE OF THE TRAP PRIMER VALVE, REFER TO DETAILS 51 & 23, SHEET MP2.1 - TYPICAL
 - 3/4" TYPE 'L' COPPER CONDENSATE PIPING TO AIR GAP FITTING. SLOPE MINIMUM 1/4" PER FOOT TOWARD OUTLET ON ANY HORIZONTAL SECTION OF PIPING. PROVIDE 1/2" TRAP PRIMER TO FITTING "P" TRAP WITH ACCESS PANEL & SHUTOFF VALVE AHEAD OF PRIMER VALVE & PROVIDE AN APPROVED AIR-GAP ON THE OUTLET SIDE OF THE TRAP PRIMER VALVE, REFER TO DETAIL 14/MP2.1 - TYPICAL
 - OUTSIDE AIR INTAKE. REFER TO SCHEDULE FOR AIR FLOW RATE. MAINTAIN 10' CLEAR FROM ALL PLUMBING VENTS AND FLUES, & 3' CLEAR FROM ALL ENVIRONMENTAL AIR EXHAUST TERMINATIONS
 - RUN NEW DEDICATED GAS LINE BACK TO METER. POINT OF CONNECTION SHALL BE MADE IMMEDIATELY DOWN-STREAM OF METER OUTLET. EXISTING GAS PIPING SYSTEM TO REMAIN UNCHANGED
 - THE TOTAL PERMITTED LENGTH OF ANY VENT MAY BE INSTALLED IN A HORIZONTAL POSITION NOT EXCEEDING ONE-THIRD ITS VERTICAL LENGTH

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # JVA JOB #
M11014

**FRASER
SEI'LE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

JVA
MECHANICAL ENGINEERING

JAMES L. VAN DE VANTER, P.E. &
ASSOCIATES

1023 NIPOMO STREET, SUITE 200
SAN LUIS OBISPO
CALIFORNIA 93401

805 543-3190

PROJECT MANAGER TDR

DRAWN BY TDR

DATES 05/05/11
06/20/11 INTERWEST PC

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**PHASE I
PLUMBING
ROOF & FLOOR
PLANS**

SHEET #
MP4.1

GENERAL NOTES

1. CODE COMPLIANCE: ALL WORK SHALL CONFORM TO AND BE PERFORMED IN ACCORDANCE WITH CODES, STANDARDS, AND ORDINANCES AS SET FORTH BY THE AUTHORITIES HAVING JURISDICTION AND THEIR LATEST ADOPTED EDITIONS (IN EFFECT AT TIME OF BUILDING PERMIT APPLICATION) OF THE FOLLOWING PUBLICATIONS:
- A. CALIFORNIA CODE OF REGULATIONS TITLE 24; INCLUDES 2010 CALIFORNIA ELECTRICAL CODE AND 2009 CALIFORNIA BUILDING CODE, CALIFORNIA FIRE CODE, ETC. WITH CALIFORNIA AND OTHER LOCAL AMENDMENTS AS APPLICABLE.
- B. AMERICANS WITH DISABILITIES ACT (ADA).
2. SAFETY: THE ELECTRICAL CONTRACTOR IS RESPONSIBLE TO MAINTAIN ALL EQUIPMENT IN A SAFE AND RESPONSIBLE MANNER. KEEP DEAD FRONT EQUIPMENT IN PLACE WHILE EQUIPMENT IS ENERGIZED. CONDUCT ALL CONSTRUCTION OPERATIONS IN A SAFE MANNER FOR EMPLOYEES AS WELL AS OTHER WORKPERSONS OR ANYONE VISITING THE JOB SITE. PROVIDE BARRIERS, FLAGS, TAPE, ETC. AS REQUIRED FOR SAFETY. THE CONTRACTOR SHALL HOLD ALL PARTIES HARMLESS OF NEGLIGENT SAFETY PRACTICES, WHICH MAY CAUSE INJURY TO OTHERS ON OR NEAR THE JOB SITE.
3. FIRE RATED ASSEMBLIES SHALL MAINTAIN RATINGS AS SPECIFIED IN THE CALIFORNIA BUILDING CODE CHAPTER 7. CONTRACTOR SHALL PROVIDE AND INSTALL PHYSICAL ENCLOSURE AROUND FIXTURES, PANELS, ETC. AS REQUIRED. ALL ASSEMBLIES TO BE PENETRATED SHALL BE INSTALLED WITH APPLICABLE THROUGH-PENETRATION FIRESTOP SYSTEM AS DETERMINED BY UL CLASSIFICATION. BEFORE CONSTRUCTION, VERIFY AND COMPLY WITH REQUIREMENTS OF LOCAL AUTHORITY HAVING JURISDICTION. REFER TO ARCHITECTURAL PLANS FOR PENETRATION DETAILS.
4. MOUNTING HEIGHTS SHALL BE AS FOLLOWS:
- +15" AFF: RECEPTACLES, TELEPHONE, TV & DATA OUTLETS. (MEASURED TO BOTTOM OF OUTLET BOX).
- +48" AFF: LIGHT SWITCHES. (MEASURED TO TOP OF OUTLET BOX).
- +48" AFF: FIRE ALARM MANUAL PULL STATIONS, T-STATS. (MEASURED TO TOP OF OUTLET BOX).
- THE LOWER OF +80" AFF OR 6" BELOW CEILING: FIRE ALARM VISUALS.

BEFORE ROUGH-IN, VERIFY ALL MOUNTING HEIGHTS AND EXACT LOCATIONS FOR ALL EQUIPMENT ELECTRICAL CONNECTIONS, STUB-UPS, RECEPTACLES, OUTLETS, ETC. WITH ARCHITECT OR OWNER. PLACE DEVICES LOCATED ABOVE COUNTERS, SHELVING, ETC. AND IN BATHROOMS SO AS NOT TO CONFLICT WITH EDGES OF WAINSCOTING, COUNTER SPLASH, SHELVING, ETC. ARCHITECTURAL SHEETS SHALL GOVERN.

5. LABEL PANELS, CABINETS, BACKBOARDS, MAIN DEVICES, SAFETY SWITCHES, CONTACTORS AND OTHER SPECIFICALLY DESIGNATED EQUIPMENT SHOWN ON PLANS. USE ENGRAVED LAMINATED PLASTIC NAMEPLATES ATTACHED BY SCREWS OR RIVETS. FOR FEEDERS, NEATLY AND INDELIBLY LABEL CONDUIT DESTINATIONS ON BOTH VISIBLE ENDS OF CONDUIT RUNS WHERE CONDUITS TERMINATE AT DESIGNATED ENCLOSURES, STRUCTURES OR EQUIPMENT (INCLUDING PULL AND SPLICE BOXES).
6. EQUIPMENT ANCHORAGE NOTE
ALL MECHANICAL AND ELECTRICAL EQUIPMENT SHALL BE ANCHORED OR BRACED TO MEET THE HORIZONTAL AND VERTICAL FORCES PRESCRIBED IN THE 2010 CBC.

THE ATTACHMENT OF THE FOLLOWING ITEMS SHALL BE DESIGNED TO RESIST THE FORCES PRESCRIBED ABOVE, BUT NEED NOT BE DETAILED ON THE PLANS:

- A. EQUIPMENT WEIGHING LESS THAN 400 POUNDS SUPPORTED DIRECTLY ON THE FLOOR OR ROOF.
- B. FURNITURE REQUIRED TO BE ATTACHED IN ACCORDANCE WITH PART 2, TITLE 24, C.C.R..
- C. TEMPORARY OR MOVABLE EQUIPMENT.
- D. EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUPPORTED BY VIBRATION ISOLATORS.
- E. EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE MECHANICAL/ELECTRICAL ENGINEER AND THE FIELD REPRESENTATIVE OF THE DIVISION OF THE STATE ARCHITECT.

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO RESIST THE FORCES PRESCRIBED IN ASCE 7-05 SECTION 13.3 AS DEFINED IN ASCE 7-05 SECTION 13.6.8, 13.6.7, AND 13.6.5.5, ITEM 6, RESPECTIVELY.

THE BRACING AND ATTACHMENTS TO THE STRUCTURE SHALL COMPLY WITH ONE OF THE OSHPD PRE-APPROVALS WITH AN OPA#, SUCH AS MASON INDUSTRIES (OPA 349), OR ISAT (OPA 485) AS MODIFIED TO SATISFY ANCHORAGE REQUIREMENTS OF ACI 318, APPENDIX D.

COPIES OF THE MANUAL SHALL BE ON THE JOBSITE PRIOR TO STARTING HANGING AND BRACING OF THE PIPE, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS.

THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

MECHANICAL SYSTEMS

1. MECHANICAL UNIT CONDUITS: TO PREVENT DAMAGE DUE TO VIBRATION, BOTH POWER AND CONTROL WIRING CONDUITS FEEDING EXTERIOR MECHANICAL UNITS SHALL BE PROVIDED AND INSTALLED BY ELECTRICAL CONTRACTOR WITH LIQUID TIGHT FLEXIBLE TYPE AT FINAL CONNECTION TO UNIT AND BETWEEN ROOF JACK AND DISCONNECT SWITCH WHERE DISCONNECT IS MOUNTED ON UNIT.
2. EXHAUST FANS SHALL BE PROVIDED & INSTALLED BY MECHANICAL CONTRACTOR WITH WIRING CONNECTIONS MADE BY ELECTRICAL CONTRACTOR.
3. MECHANICAL EQUIPMENT CONTROLS: MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL LOW VOLTAGE WIRE AND CONNECTIONS (BELOW 120 VOLT) TO AND FROM ALL MECHANICAL CONTROL DEVICES. ALL LOW VOLTAGE CONTROL WIRE SHALL BE IN CONDUIT, UNLESS OTHERWISE NOTED.
4. PULLROPES: ANY RACEWAY WITHOUT CABLE OR WIRE SHALL BE INSTALLED WITH MINIMUM 200 POUND TEST PULL LINE AND LARGER IF REQUIRED BY SERVING UTILITY COMPANY. ANY NEW OR EXISTING COMMUNICATION OR SIGNAL RACEWAY ROUTED BETWEEN BUILDINGS, SIGNAL CABINETS, AND/OR SIGNAL CLOSETS WITH FUTURE CAPACITY SHALL BE INSTALLED WITH MINIMUM 200 POUND TEST PULL LINE AS WELL AS THE CALLED FOR CABLE.

EXISTING FIRE ALARM SYSTEM

1. FIRE ALARM SYSTEM IS EXISTING TO REMAIN, NO WORK BEING PERFORMED WILL EFFECT THIS SYSTEM.

LEGEND

NOTE: INTERPRET IN CONTEXT

LIGHT FIXTURES

- CEILING SURFACEMOUNT
○ WALL SURFACEMOUNT
○ PENDANT MOUNT
⊞ RECESSED DOWNLIGHT
⊞ RECESSED WALLWASH
⊞ RECESSED FLUOR.
⊞ SURFACE FLUOR.
⊞ FLUOR. STRIP UON
⊞ TRACK LIGHT
⊞ DIRECTIONAL FLOOD
⊞ EMERGENCY FIXTURE
⊞ POLE LIGHT
⊞ POLE LIGHT- DECORATIVE
⊞ TANDEM-WIRED LAMPS
⊞ BOLLARD
⊞ EXIT LIGHT- WALL
⊞ EXIT LIGHT- CEILING (ARROW INDICATES DIRECTION)
⊞ LETTER ADJACENT INDICATES FIXTURE TYPE

POWER/COMM.

- ⊞ SINGLE RECEPT.
⊞ DUPLEX RECEPT.
⊞ ** INDICATES TO MOUNT DEVICE ABOVE COUNTER PER ARCHITECTURAL
⊞ DUPLEX- HALF SWITCHED
⊞ DOUBLE DUPLEX
⊞ SPECIAL CONFIGURATION
⊞ DUPLEX- FLOOR OUTLET
⊞ JUNCTION BOX
▼ TELEPHONE OUTLET
▼ DATA OUTLET
▼ PHONE/DATA COMBO OUTLET
⊞ SAFETY DISCONNECT
⊞ TELEVISION OUTLET

MISCELLANEOUS

- MOTOR
○ THERMOSTAT
⊞ CIRCUIT BREAKER
⊞ FUSIBLE SWITCH
⊞ PHASE
⊞ GROUND

CONDUIT/WIRE

- NEW
--- UNDERGROUND
--- NEW POWER HOMERUN (3 HOTS & NEUT SHOWN)
--- ISOLATED GROUND
--- EXISTING TO REMAIN
--- (E) POWER HOMERUN
--- CONDUIT STUB (W/MARKER)
--- VERTICAL CONDUIT RUN
--- CONDUIT SEAL
--- FLEXIBLE CONNECTION
--- LOW VOLTAGE
--- SURFACEMOUNT RACEWAY

SWITCHES


- \$ SPST
\$ DPST
\$ 3-WAY
\$ 4-WAY
\$ DIMMER
\$ TIMER SWITCH
\$ W/THERMAL OVERLOAD
\$ W/PILOT LIGHT
\$ KEY OPERATED
\$ DUAL LEVEL SWITCHING
\$ SWITCHLEG DESIGNATION
\$ OCCUPANCY SENSOR
\$ OCCUPANCY SENSOR WITH PHOTOSENSOR

FIRE ALARM

- ⊞ HORN- AUDIBLE DEVICE
⊞ VISUAL- VISUAL DEVICE
⊞ AUDIBLE/VISUAL
⊞ FLOW SWITCH
⊞ TAMPER SWITCH
⊞ MANUAL PULL STATION
⊞ SMOKE DETECTOR
⊞ DUCT SMOKE DETECTOR
⊞ HEAT DETECTOR
⊞ BELL
⊞ END OF LINE RESISTOR

ABBREVIATIONS

- A AMPERE
AF AMP FUSE RATING
AFF ABOVE FINISH FLOOR
AFG ABOVE FINISH GRADE
AIC AMPERES INTERRUPT CAPACITY
AS AMP SWITCH RATING
BFG BELOW FINISH GRADE
CB CIRCUIT BREAKER
CEC CA. ELECTRICAL CODE
CKT CIRCUIT
C CONDUIT
(E) EXISTING
EC ELECTRICAL CONTRACTOR
EF-# EXHAUST FAN
(EXN) (E) IN (N) LOCATION
(EXR) (E) TO BE (R)
(F) FUTURE
FA FIRE ALARM
FACP FIRE ALARM CONTROL PANEL
G GROUNDING CONDUCTOR
GC GENERAL CONTRACTOR
GFI GROUND FAULT CKT INTERRUPTER
GND GROUND
GRS GALVANIZED RIGID STEEL
GWS GANGED WITH SWITCH
IG ISOLATED GROUND
LTG LIGHTING
MC MECHANICAL CONTRACTOR
MCB MAIN CIRCUIT BREAKER
MLO MAIN LUGS ONLY
MSB MAIN SWITCHBOARD
MTTB MAIN TELEPHONE TERMINAL BOARD
(N) NEW
NIC NOT IN CONTRACT
NL NIGHT LIGHT
P POLE
(R) RELOCATE(D)
TBR TO BE REMOVED
TYP TYPICAL
UC UNDERCABINET
UG UNDERGROUND
UON UNLESS OTHERWISE NOTED
V VOLT
VA VOLT AMPERES
W WATT, WIRE
WP WEATHERPROOF (NEMA 3R)

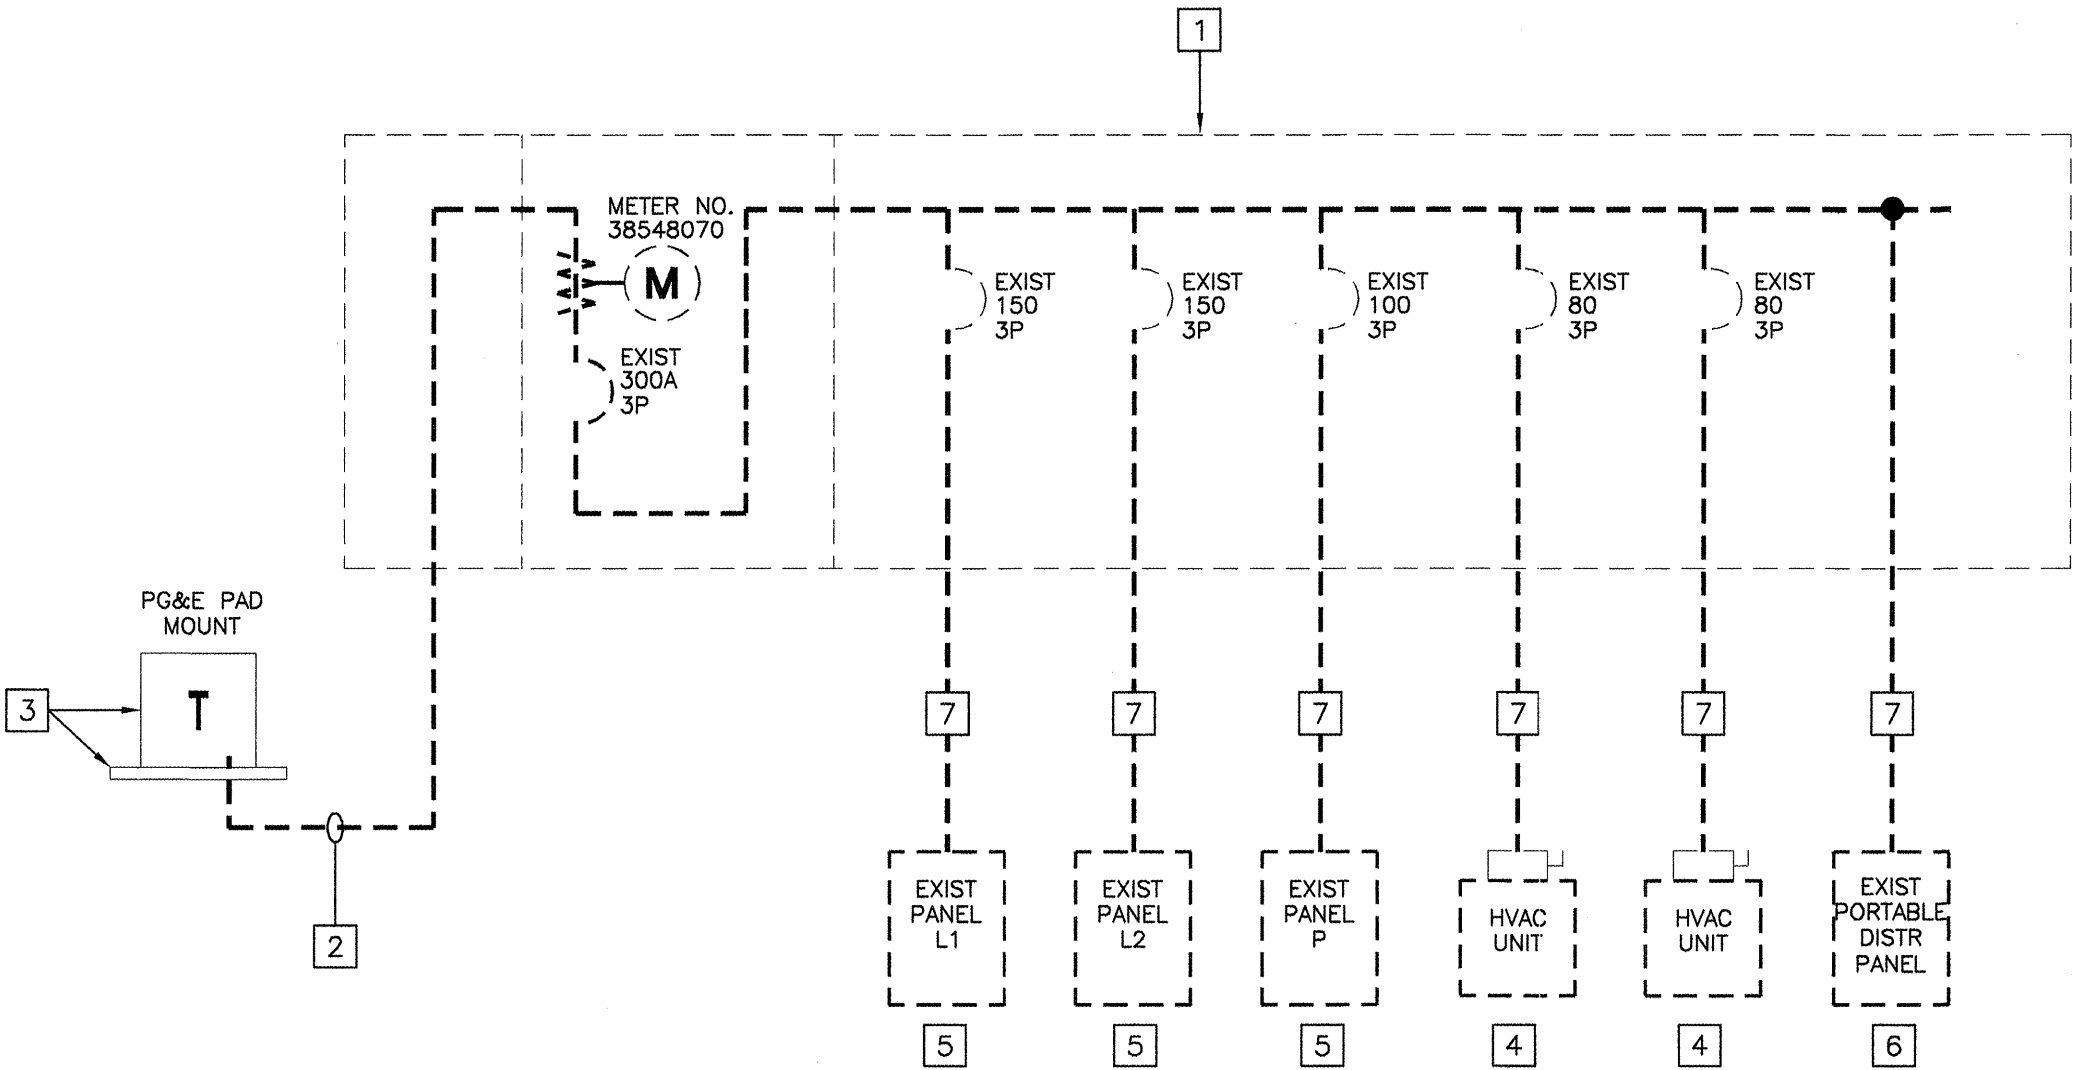

SINGLE LINE DIAGRAM

REFERENCE NOTES

1. EXISTING 400AMP SERVICE TO REMAIN.
2. EXISTING PG&E SECONDARY CONDUIT TO REMAIN.
3. EXISTING CONCRETE PAD / PG&E TRANSFORMER #T-610 TO REMAIN.
4. EXISTING HVAC UNITS, TO REMAIN.
5. EXISTING ELECTRICAL PANEL TO REMAIN.
6. EXISTING PORTABLE DISTRIBUTION PANEL REMAIN.
7. EXISTING FEEDER TO REMAIN.

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

FRASER
SEIPLE
ARCHITECTS

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

thoma
ENGINEERING
THOMA ELECTRIC, INC.

P.O. Box 1167 — 3562 Empleo St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
Fax: (805) 543-3829
cad@thomaelec.com



EXPIRES: 06/30/13
THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

GENERAL NOTES,
LEGEND AND
ABBREVIATIONS

SHEET #

E1.0

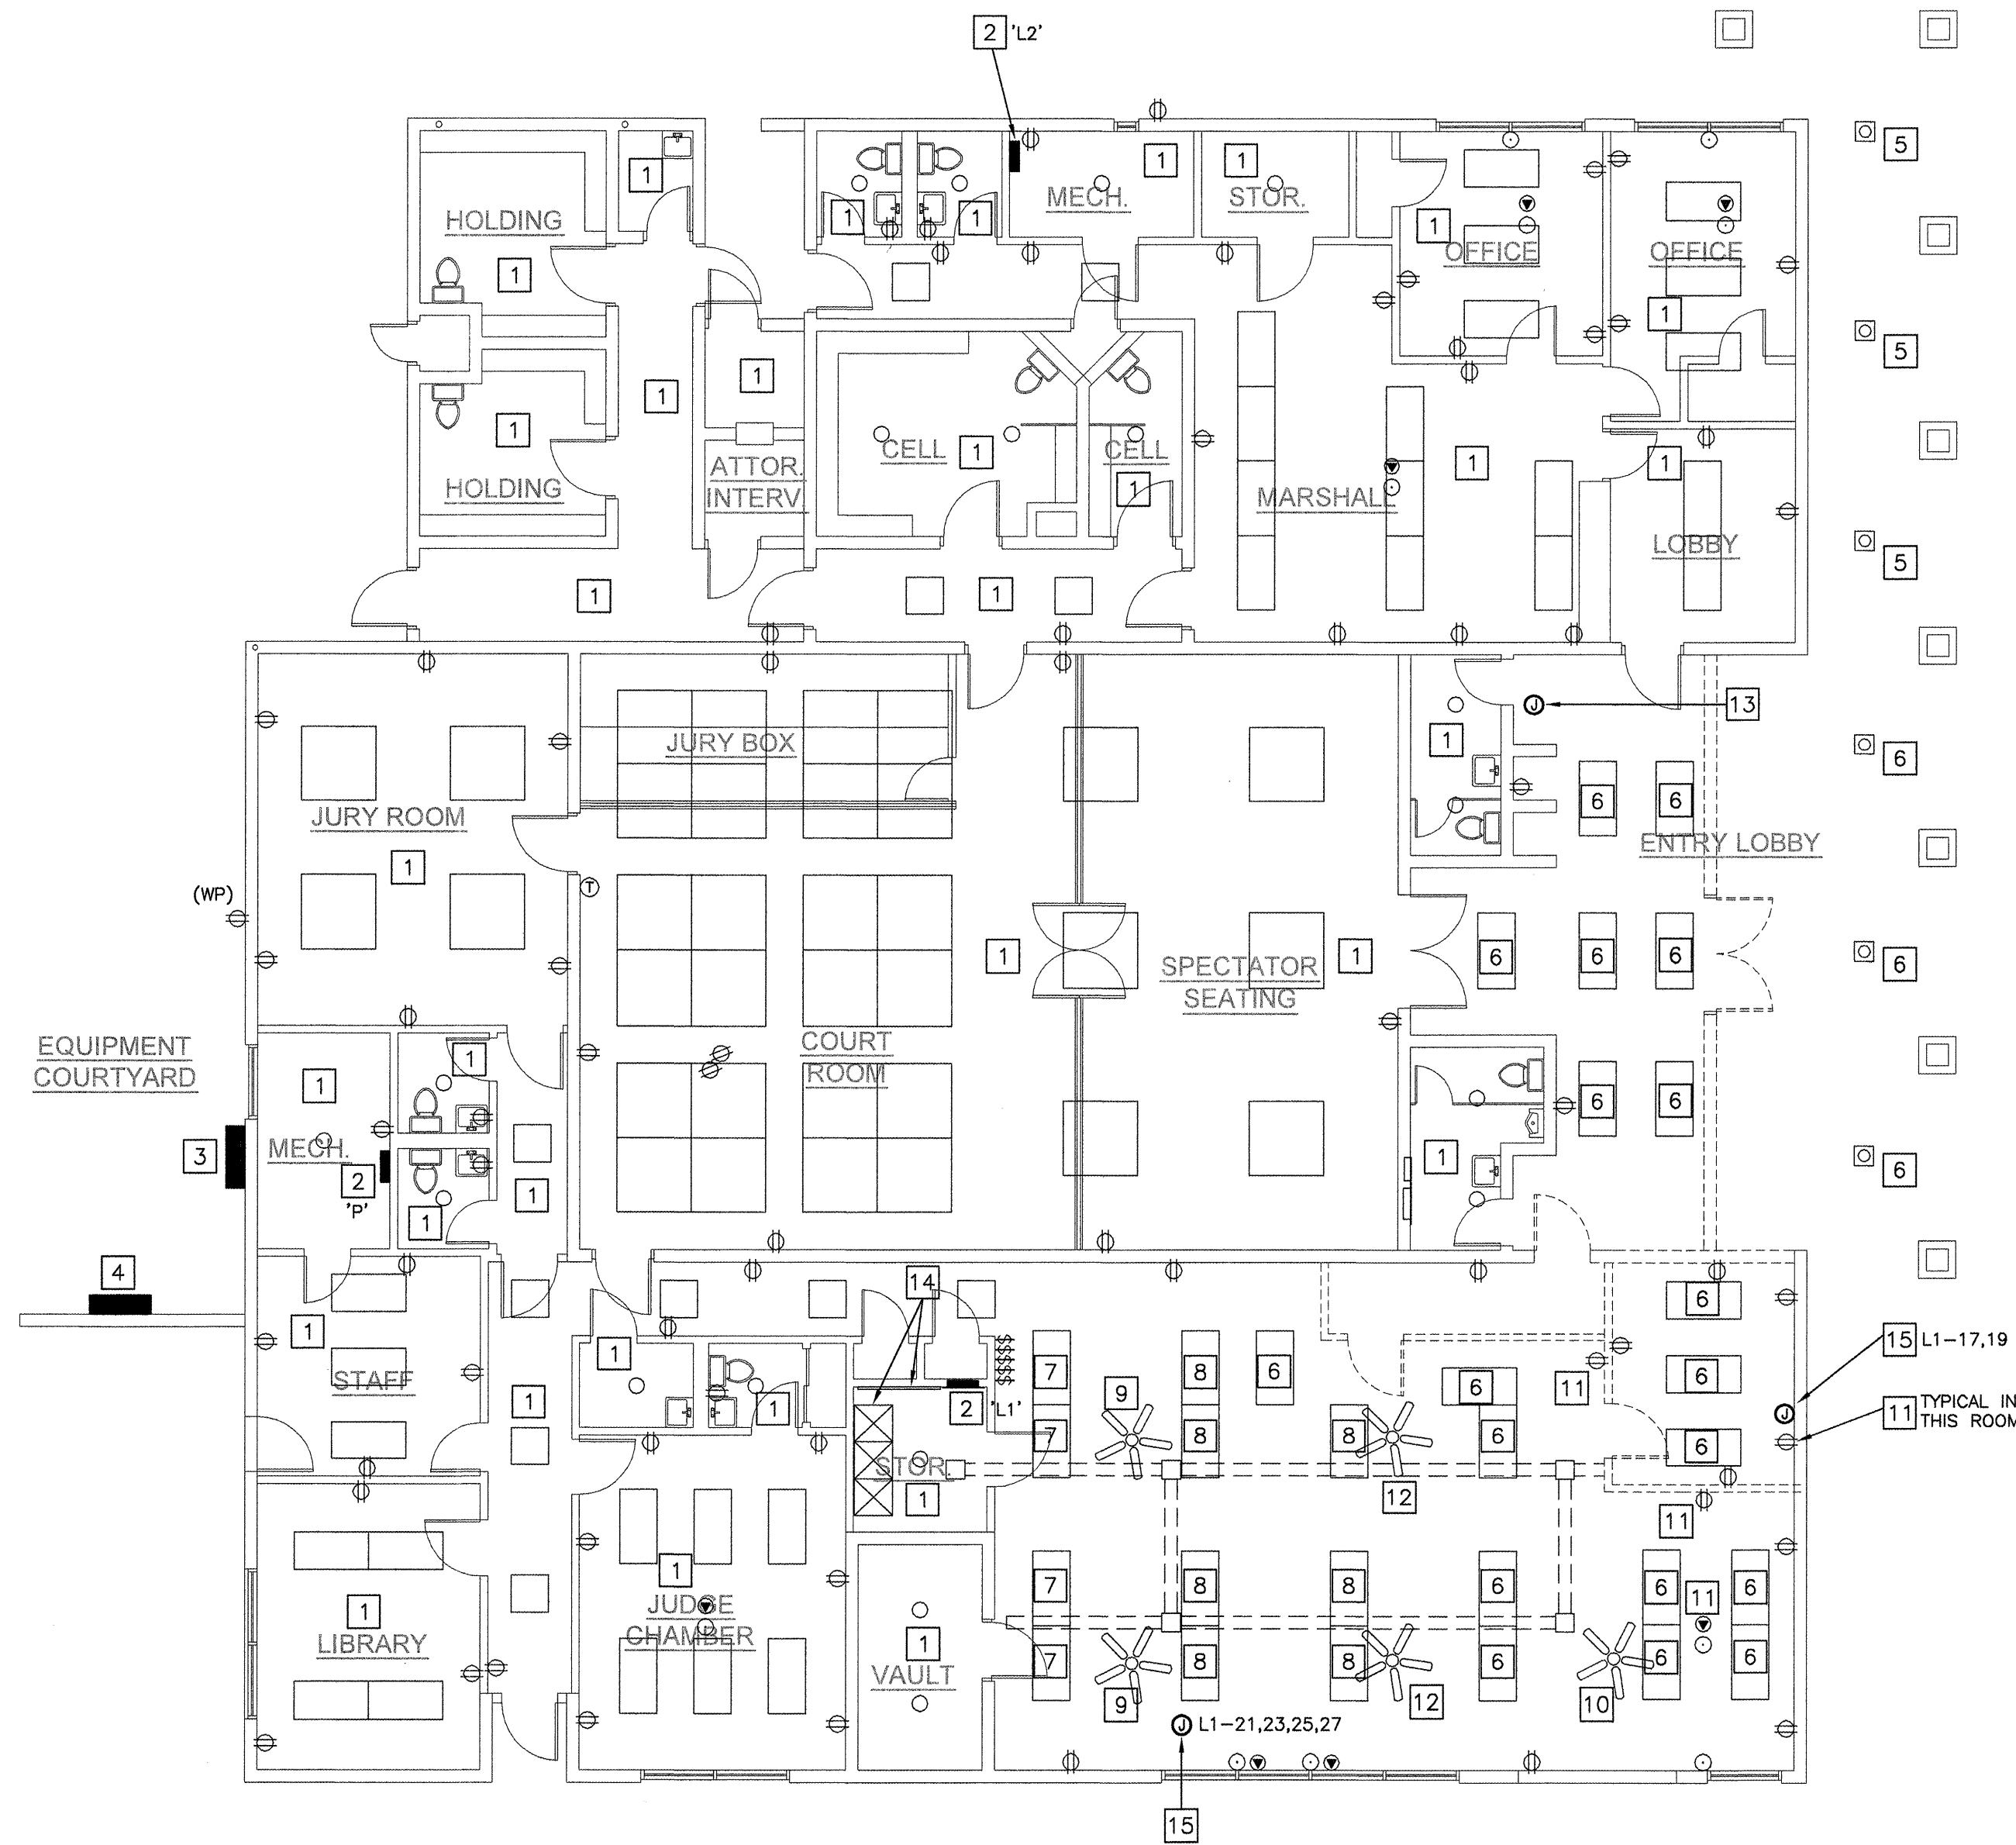

ELECTRICAL DEMOLITION FLOOR PLAN

SCALE: 1/8" = 1'-0"

REFERENCE NOTES

- EXISTING ELECTRICAL EQUIPMENT IN THIS ROOM / AREA TO REMAIN.
- EXISTING ELECTRICAL PANEL TO REMAIN, SEE PANEL SCHEDULES.
- EXISTING MAIN ELECTRICAL SERVICE TO REMAIN.
- EXISTING DISTRIBUTION PANEL TO REMAIN.
- EXISTING RECESSED DOWNLIGHT TO REMAIN, CLEAN AND RELAMP.
- EXISTING LIGHTING FIXTURE TO BE REMOVED.
- EXISTING LIGHTING FIXTURE TO REMAIN, CLEAN, RELAMP AND PROVIDE NEW LENSE.
- EXISTING LIGHTING FIXTURE TO BE RELOCATED, SEE LIGHTING PLAN FOR NEW LOCATION.
- EXISTING PADDLE FAN TO REMAIN.
- EXISTING PADDLE FAN TO BE REMOVED.
- EXISTING OUTLET TO BE REMOVED.
- EXISTING PADDLE FAN TO BE RELOCATED, SEE LIGHTING PLAN FOR NEW LOCATION.
- TERMINATE EXISTING LIGHTING BRANCH 'L2-10' IN CEILING AS REQUIRED FOR EXTENSION TO NEW LOBBY LIGHTING, SEE LIGHTING FLOOR PLAN.
- EXISTING TELEPHONE BACKBOARD AND DATA EQUIPMENT TO REMAIN.
- TERMINATE EXISTING RECEPTACLE BRANCH CIRCUITS AS REQUIRED FOR EXTENSION TO NEW MODULAR FURNITURE/RECEPTACLES, SEE ELECTRICAL FLOOR PLAN.

GENERAL DEMOLITION PLAN NOTES

- REFER TO ARCHITECTURAL DEMOLITION SHEETS FOR ADDITIONAL INFORMATION.
- EQUIPMENT SHOWN TO BE REMOVED IS SHOWN FOR REFERENCE ONLY. INFORMATION WAS OBTAINED FROM ORIGINAL BUILDING DRAWINGS AND LIMITED FIELD INVESTIGATION AND MAY NOT REPRESENT ALL ELECTRICAL DEMOLITION. FIELD VERIFY CONDITIONS AND DISCONNECT/REMOVE ALL EQUIPMENT AS REQUIRED TO MEET THE INTENT OF THAT SHOWN ON THE LIGHTING AND POWER/SIGNAL DRAWINGS.
- ALL ELECTRICAL EQUIPMENT SHOWN ON DRAWING (OR REQUIRED) TO BE DEMOLISHED SHALL BE DISCONNECTED, REMOVED AND DISPOSED OF BY ELECTRICAL CONTRACTOR. NO EQUIPMENT (RACEWAYS, BOXES, CABLING, ETC.) SHALL BE ABANDONED IN PLACE AND COVERED BY NEW CONSTRUCTION.
- CLEAN, REPAIR (AS REQUIRED) AND RELAMP ALL EXISTING LIGHT FIXTURES THAT ARE TO REMAIN AND BE RE-USED TO ASSUME ALL FIXTURE ARE OPERATIONAL UPON COMPLETION OF PROJECT.
- ANY LIGHT SWITCHES THAT ARE NO LONGER IN USE, WHETHER SHOWN ON THE DEMOLITION PLAN OR NOT, ARE TO HAVE THE DEVICE AND WIRING REMOVED, AND A BLANK COVER PLATE INSTALLED.
- SCHEDULE ANY OUTAGES WITH OWNER PRIOR TO DE-ENERGIZATION OF ANY BRANCH CIRCUITS OR FEEDERS.
- DISCONNECTION/REMOVAL OF EXISTING COMMUNICATIONS SYSTEMS COMPONENTS SHALL BE SCHEDULED WITH OWNER AND COORDINATED WITH THEIR VENDORS.
- SALVAGE ALL REMOVED COMPONENTS (SPEAKERS, GRILLES, TELEPHONE INSTRUMENTS, RADIO HANDSETS, ETC.) SHALL BE SALVAGED TO THE OWNER.
- INFORMATION SHOWN FOR LOAD DESCRIPTIONS ON EXISTING PANELS WAS GAINED FROM ORIGINAL BUILDING ELECTRICAL PLANS AND SHALL BE FIELD VERIFIED. CONFIRM LOAD ON EACH CIRCUIT OF ALL EXISTING PANELS AND PROVIDE UPDATED TYPEWRITTEN CIRCUIT DIRECTORY (IN PLASTIC SLEEVE) FOR EACH EXISTING PANELBOARD.
- ANY LOADS REMOVED DURING DEMOLITION SHALL HAVE CONDUCTORS REMOVED BACK TO NEXT REMAINING DEVICE OR TO EXISTING PANELS. ABANDONED BREAKERS SHALL BE LABELED "SPARE".

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE**
ARCHITECTS


971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

thoma
ENGINEERING
THOMA ELECTRIC, INC.

P.O. Box 1167 — 3562 Empleo St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
Fax: (805) 543-3829
cad@thomalec.com



EXPIRES: 06/30/13
THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

ELECTRICAL DEMOLITION FLOOR PLAN

SHEET #

E2.0

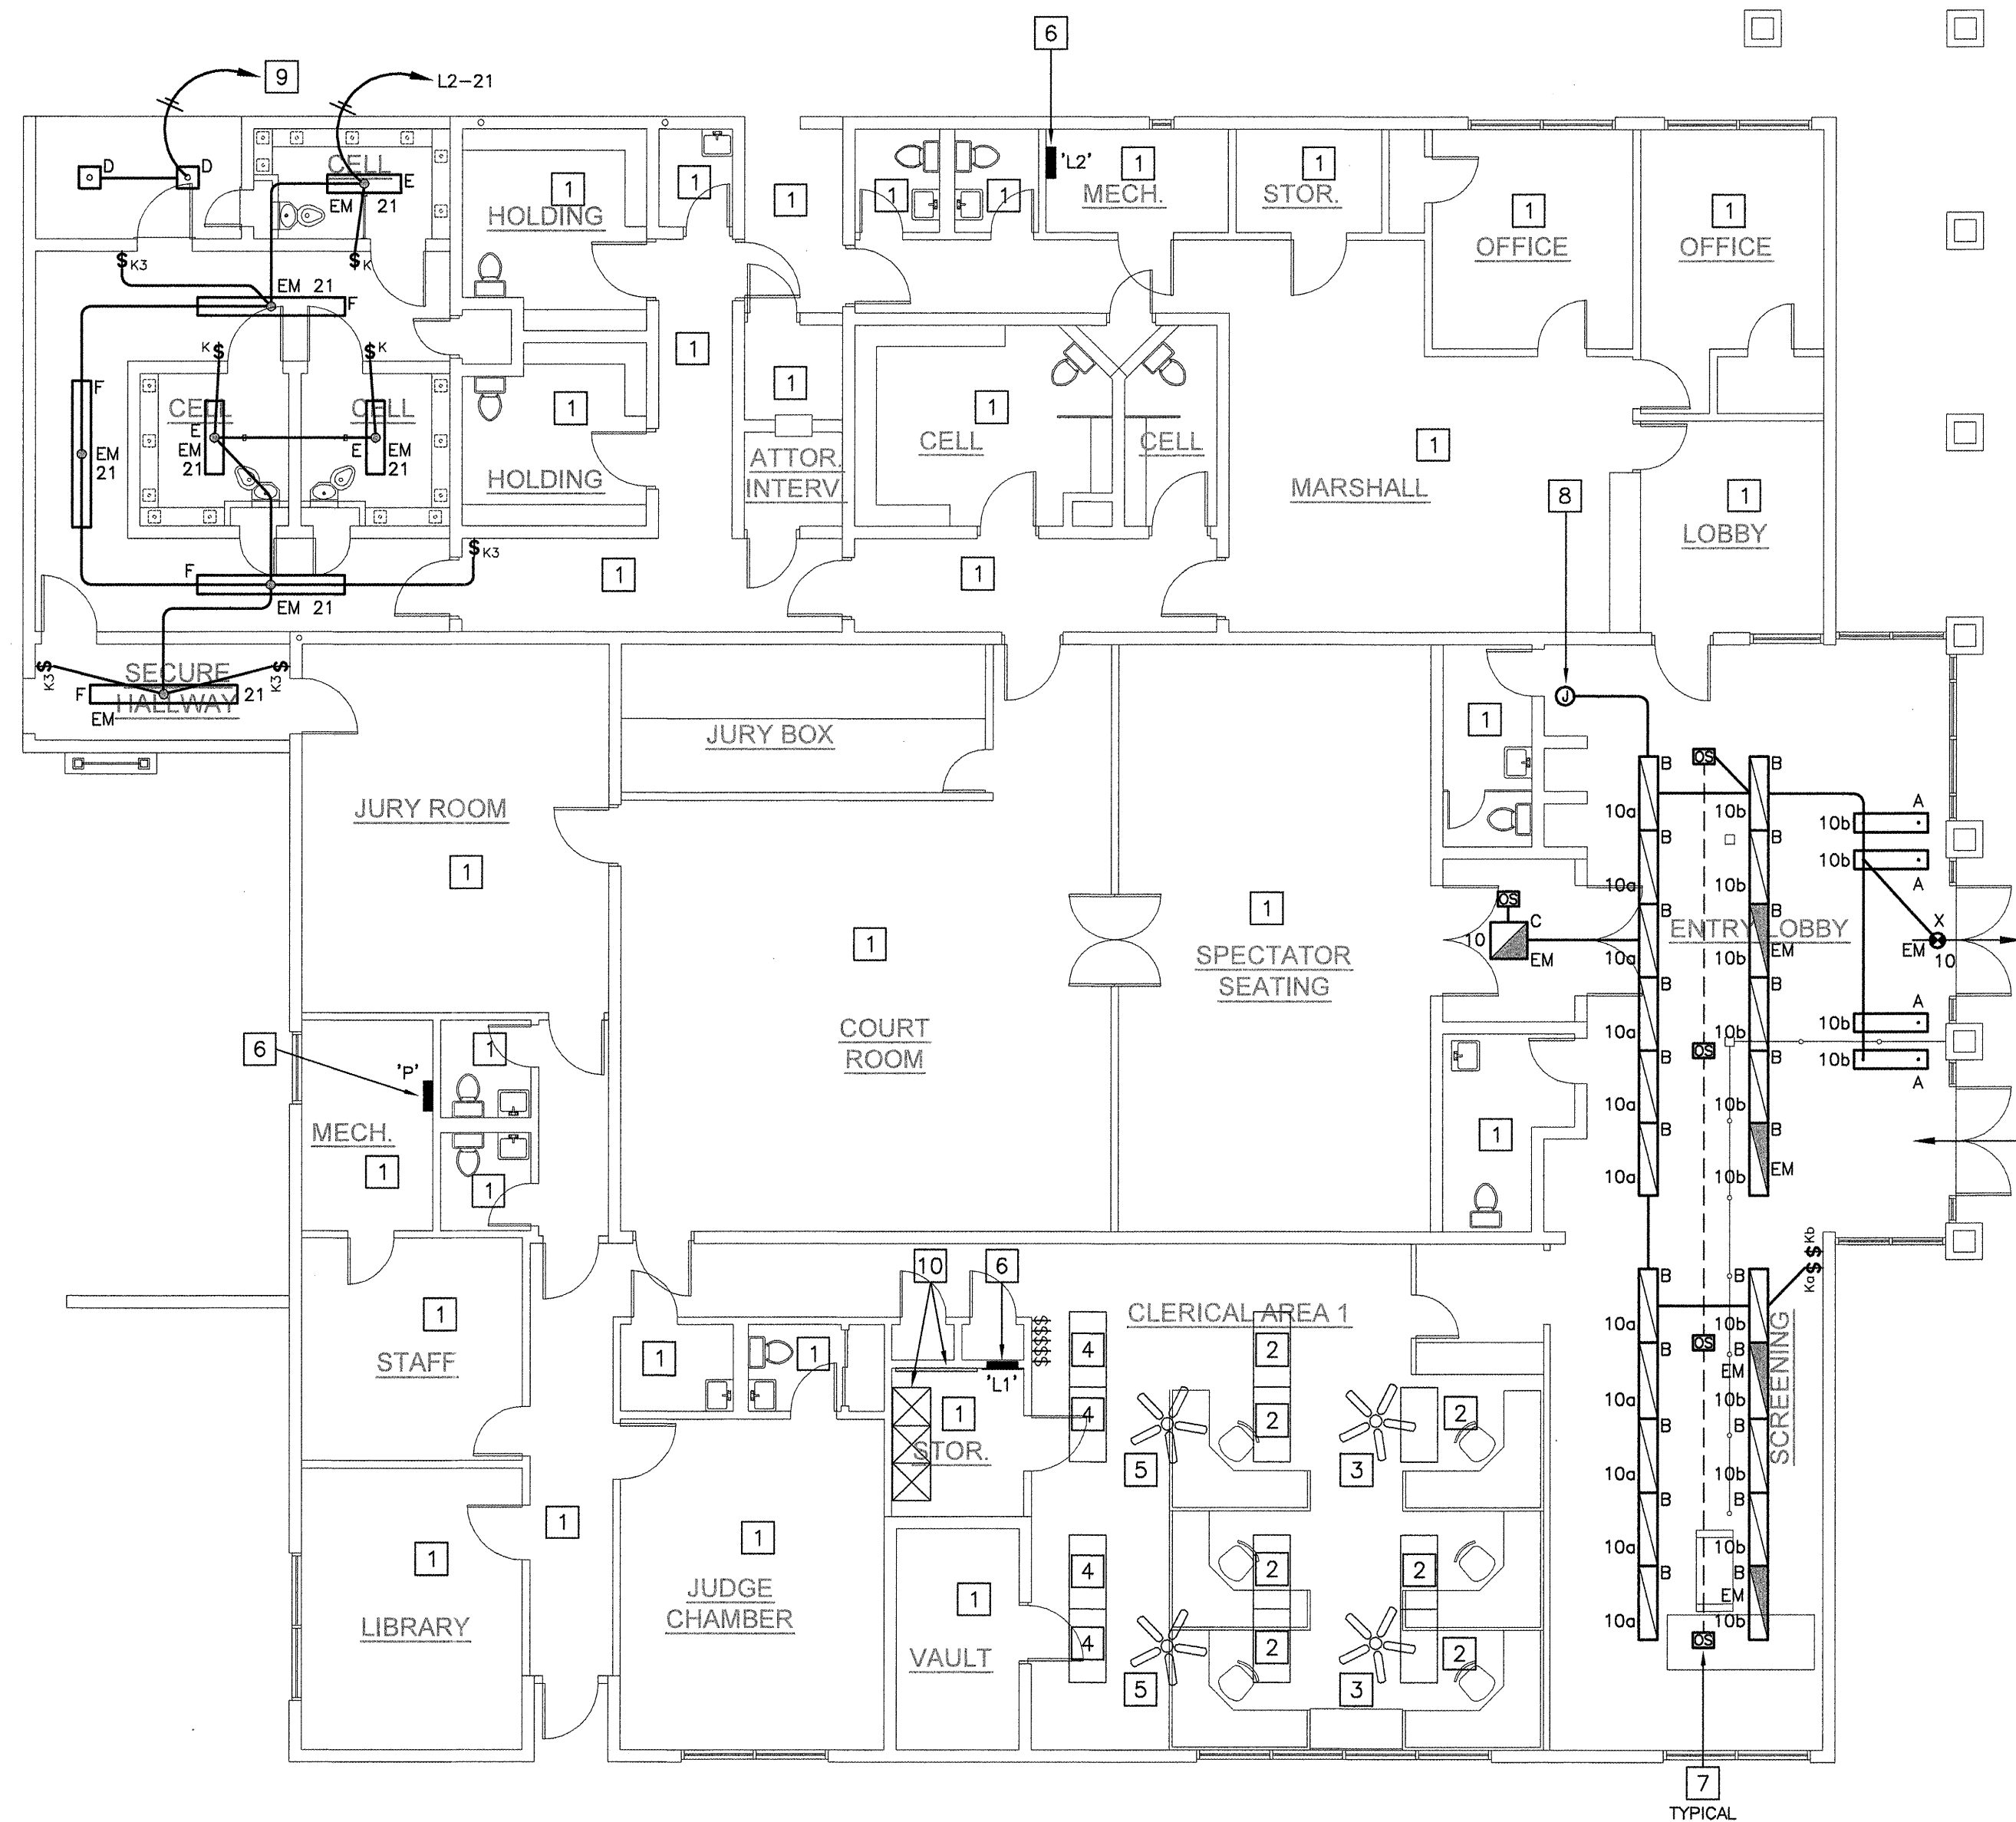

ELECTRICAL LIGHTING FLOOR PLAN

SCALE: 1/8" = 1'-0"


REFERENCE NOTES

- EXISTING LIGHTING FIXTURES AND CONTROL IN THIS ROOM / AREA TO REMAIN.
- EXISTING LIGHTING FIXTURE RELOCATED TO THIS POSITION, SEE DEMO PLAN.
- EXISTING PADDLE FAN RELOCATED TO THIS POSITION, SEE DEMO PLAN.
- EXISTING LIGHTING FIXTURE TO REMAIN.
- EXISTING PADDLE FAN TO REMAIN.
- EXISTING ELECTRICAL PANEL TO REMAIN.
- DUAL TECH OCCUPANCY SENSOR, SEE WIRING DIAGRAM ON SHEET E3.0.
- EXTEND EXISTING LIGHTING BRANCH CIRCUIT 'L2-10' AND CONNECT TO NEW LIGHTING AS SHOWN.
- CONNECT TO EXISTING EXTERIOR LIGHTING BRANCH CIRCUIT 'L2-3' AND CONTROLS.
- EXISTING TELEPHONE BACKBOARD AND DATA EQUIPMENT TO REMAIN.

GENERAL LIGHTING PLAN NOTES

- DUAL LEVEL SWITCHING: IN ROOMS 100 SQ. FT. OR LARGER, OR WHERE INDICATED ON PLANS, CONTROL INBOARD LAMPS BY ONE SWITCH AND OUTBOARD LAMPS BY OTHER SWITCH.
- LIGHTING FIXTURE LOCATIONS SHOWN ARE SCHEMATIC. REFER TO ARCHITECTURAL PLANS (REFLECTED CEILING, ELEVATIONS, ETC.) FOR EXACT LOCATIONS AND MOUNTING HEIGHTS PRIOR TO ROUGH-IN.
- REFER TO ARCHITECT'S REFLECTED CEILING PLAN(S) FOR CEILING HEIGHTS, TYPES, FINISHES, ETC. IN EACH AREA. VERIFY FLANGE TYPES, TRIM KITS, STEM LENGTHS, ETC. FOR ALL FIXTURES PRIOR TO SUBMITTALS.
- CONFIRM LOCATION OF ALL DOORS SWINGS WITH ARCHITECTURAL PLANS PRIOR TO ROUGH-IN OF SWITCHES.
- PROVIDE UNSWITCHED HOT LEG OF ROOM LIGHTING BRANCH CIRCUIT TO EACH BATTERY POWERED EMERGENCY LIGHT AND EXIT SIGN FOR CONTINUOUS CHARGING.
- REFER TO DETAIL 34 / A8.4 FOR CONDUIT THROUGH 2 HOUR CONCRETE LID REQUIREMENTS.
- REFER TO SHEET T.5 FOR ALL RATED WALL AND CEILING LOCATIONS.

CIRCUITING LEGEND

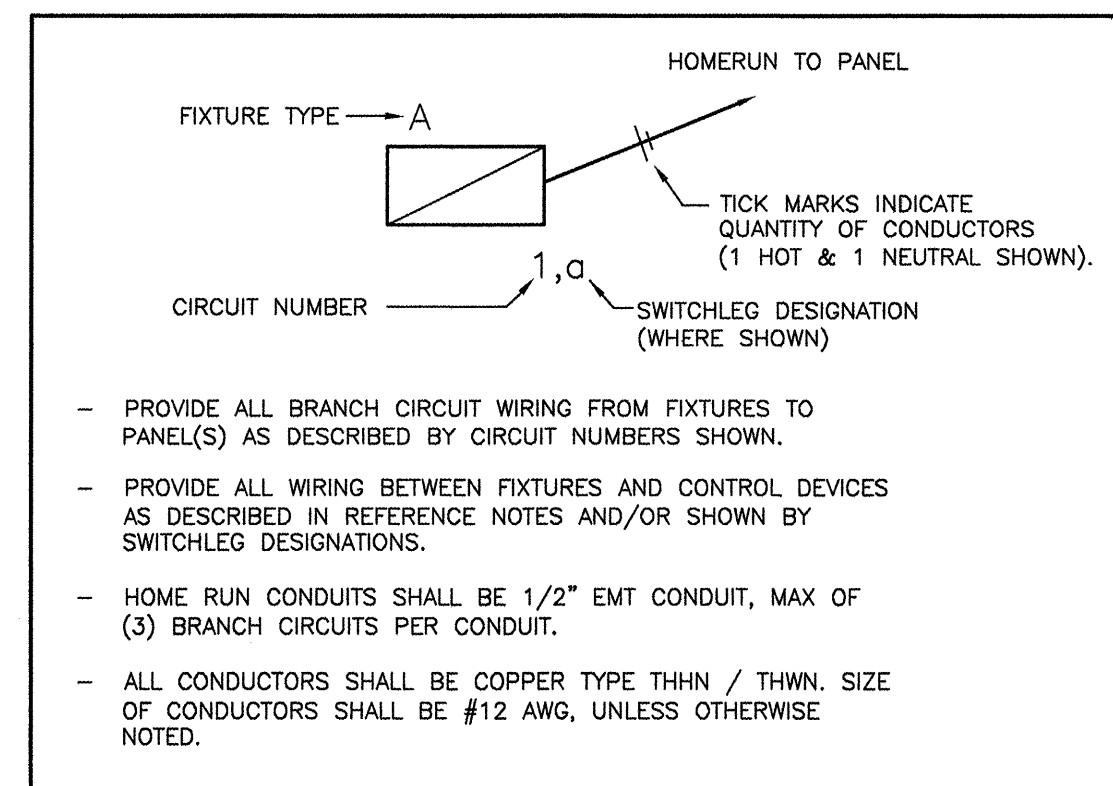

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

**thoma
ENGINEERING**
THOMA ELECTRIC, INC.

P.O. Box 1167 - 3562 Emilee St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
Fax: (805) 543-3829
csd@thomaelec.com



EXPIRES: 06/30/13
THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

ELECTRICAL LIGHTING FLOOR PLAN

SHEET #

E2.1

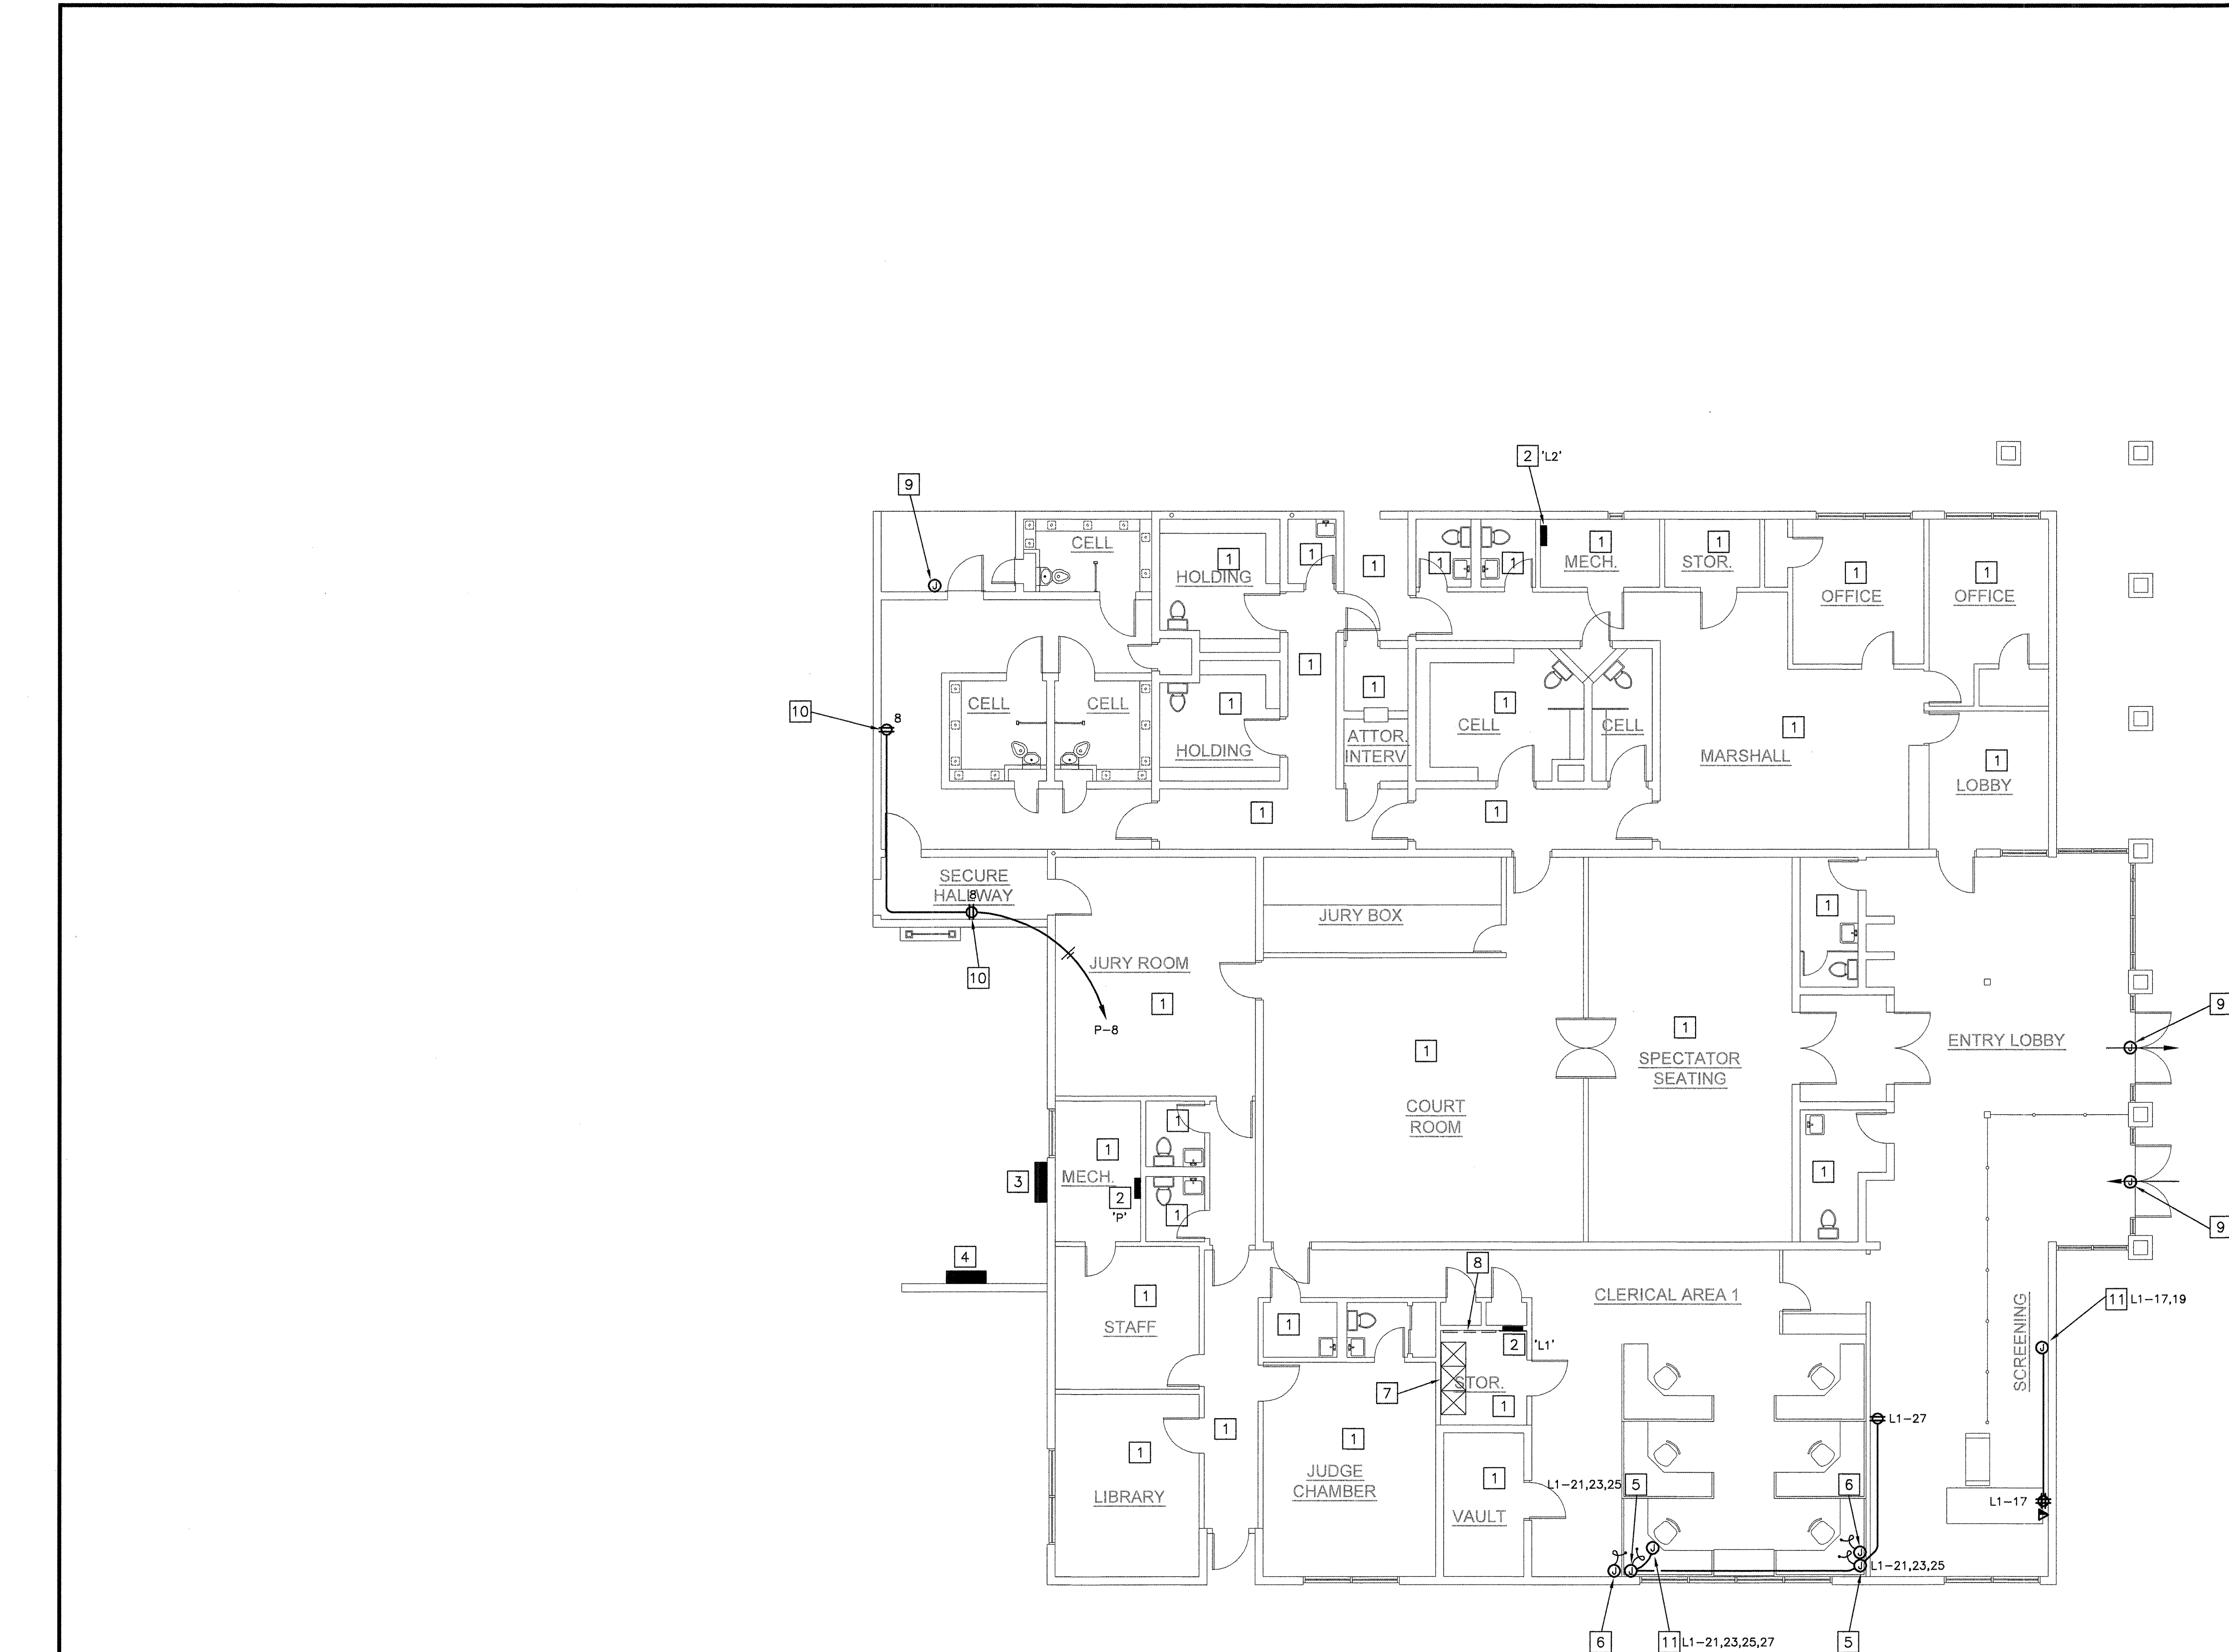

ELECTRICAL POWER FLOOR PLAN
SCALE: 1/8" = 1'-0"
NORTH


REFERENCE NOTES

- EXISTING OUTLETS IN THIS ROOM / AREA TO REMAIN.
- EXISTING ELECTRICAL PANEL TO REMAIN, SEE PANEL SCHEDULES.
- EXISTING MAIN ELECTRICAL SERVICE TO REMAIN.
- EXISTING DISTRIBUTION PANEL TO REMAIN.
- J-BOX WITH FLEXIBLE ELECTRICAL CONNECTION TO MODULAR FURNITURE.
- J-BOX WITH FLEXIBLE LOW VOLTAGE SYSTEMS CONNECTION TO MODULAR FURNITURE.
- EXISTING DATA RACK AND EQUIPMENT TO REMAIN.
- EXISTING MAIN TELEPHONE BKBD TO REMAIN.
- J-BOX WITH 3/4" C.O. STUB TO ACCESSIBLE CEILING SPACE FOR DOOR ACCESS CONTROL / SECURITY SYSTEM EQUIPMENT.
- TAMPERPROOF OUTLET WITH VANDAL RESISTANT COVER.
- EXTEND EXISTING BRANCH CIRCUIT AND CONNECT TO NEW MODULAR FURNITURE/RECEPTACLES AS SHOWN.

GENERAL POWER PLAN NOTES

- FUSING: ALL FUSIBLE SAFETY DISCONNECT SWITCHES SHALL BE PROVIDED WITH DUAL-ELEMENT TIME DELAY TYPE FUSES SIZED AND RATED PER EQUIPMENT MANUFACTURERS' RECOMMENDATIONS. VERIFY WITH EQUIPMENT NAMEPLATE BEFORE INSTALLATION.
- MOTOR OVERLOAD PROTECTION: WHERE REQUIRED BY NEC ARTICLE 430 PART C AND NOT SHOWN ON PLAN OR PROVIDED INTEGRAL WITH EQUIPMENT, PROVIDE AND INSTALL THERMAL OVERLOAD PROTECTION FOR ALL MOTORS.
- DEVICE LOCATIONS SHOWN ARE SCHEMATIC AND APPROXIMATE. EXACT LOCATIONS SHALL BE FIELD VERIFIED DURING ROUGH-IN WITH ARCHITECTURAL ELEVATIONS, CASEWORK SHOP DRAWINGS, FURNITURE, ETC. AND SHALL BE COORDINATED WITH OTHER TRADES TO AVOID CONFLICT WITH OTHER EQUIPMENT.
- ELECTRICAL AND COMMUNICATIONS OUTLETS SHOWN IN THE SAME LOCATION, SHALL BE MOUNTED ON OPPOSITE SIDES OF THE SAME STUD. COORDINATE BETWEEN ELECTRICAL AND COMMUNICATIONS PLANS.
- SIGNAL AND COMMUNICATIONS SYSTEMS RACEWAYS AND BOXES: PROVIDE AND INSTALL 4" SQUARE RECESSED JUNCTION BOX WITH 1-GANG RING AND (1) 3/4" CONDUIT STUB TO ACCESSIBLE CEILING SPACE ABOVE AT EACH WALL TELEPHONE (VOICE), TELEVISION AND DATA OUTLET LOCATION SHOWN ON THE PLANS UNLESS OTHERWISE NOTED. FOR EACH COMBINATION VOICE/DATA OUTLET, PROVIDE AND INSTALL (1) 1-1/4" CONDUIT STUBS TO ACCESSIBLE CEILING SPACE.
- REFER TO DETAIL 34 / A8.4 FOR CONDUIT THROUGH 2 HOUR CONCRETE LID REQUIREMENTS.
- REFER TO SHEET T.5 FOR ALL RATED WALL AND CEILING LOCATIONS.

CIRCUITING LEGEND

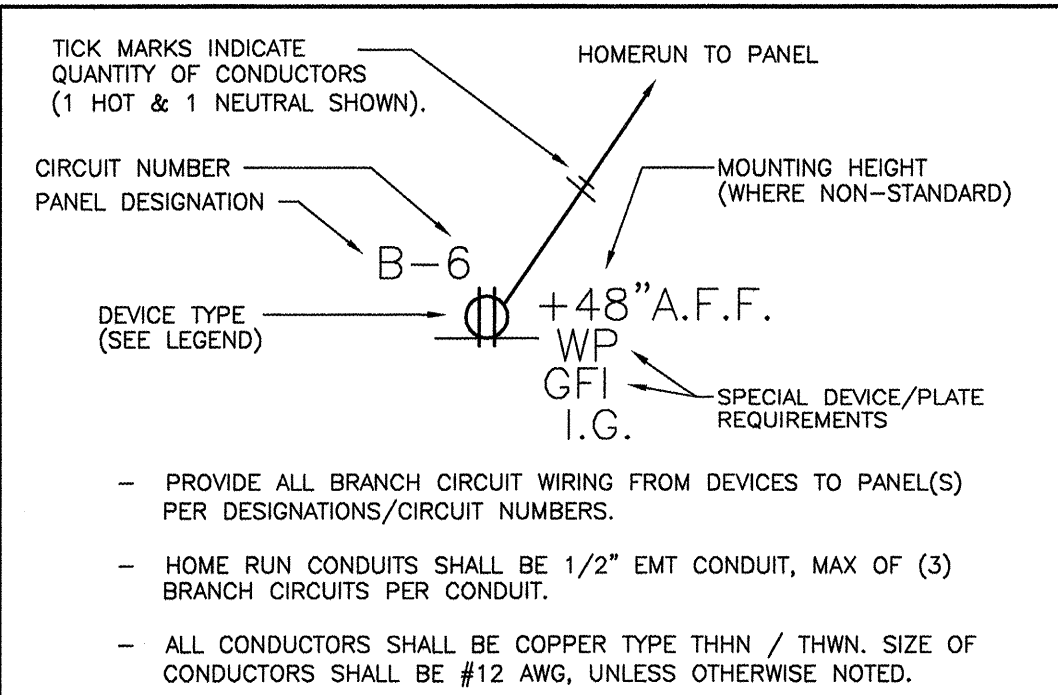

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**

971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

**Thoma
ENGINEERING**
THOMA ELECTRIC, INC.

P.O. Box 1167 — 3562 Empleo St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
Fax: (805) 543-3829
cad@thomalec.com



EXPIRES: 06/30/13
THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remains with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**ELECTRICAL
POWER FLOOR
PLAN**

SHEET #

E2.2

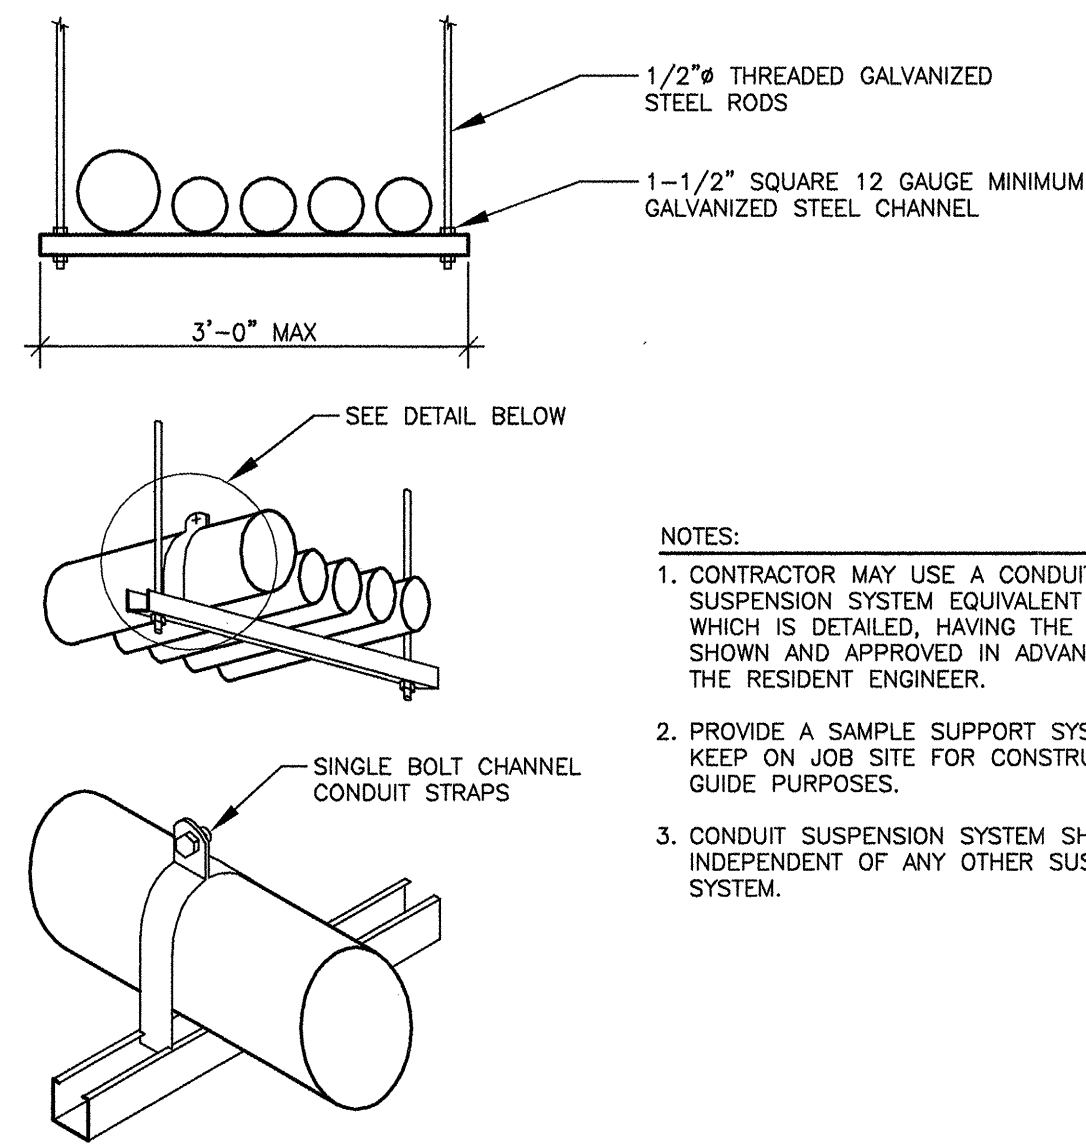


- NOTES:
1. CONTRACTOR MAY USE A CONDUIT SUSPENSION SYSTEM EQUIVALENT TO THAT WHICH IS DETAILED, HAVING THE FEATURES SHOWN AND APPROVED IN ADVANCE BY THE RESIDENT ENGINEER.
 2. PROVIDE A SAMPLE SUPPORT SYSTEM TO KEEP ON JOB SITE FOR CONSTRUCTION GUIDE PURPOSES.
 3. CONDUIT SUSPENSION SYSTEM SHALL BE INDEPENDENT OF ANY OTHER SUSPENSION SYSTEM.

TYPICAL CONDUIT SUPPORT SYSTEM DETAIL

5


NTS

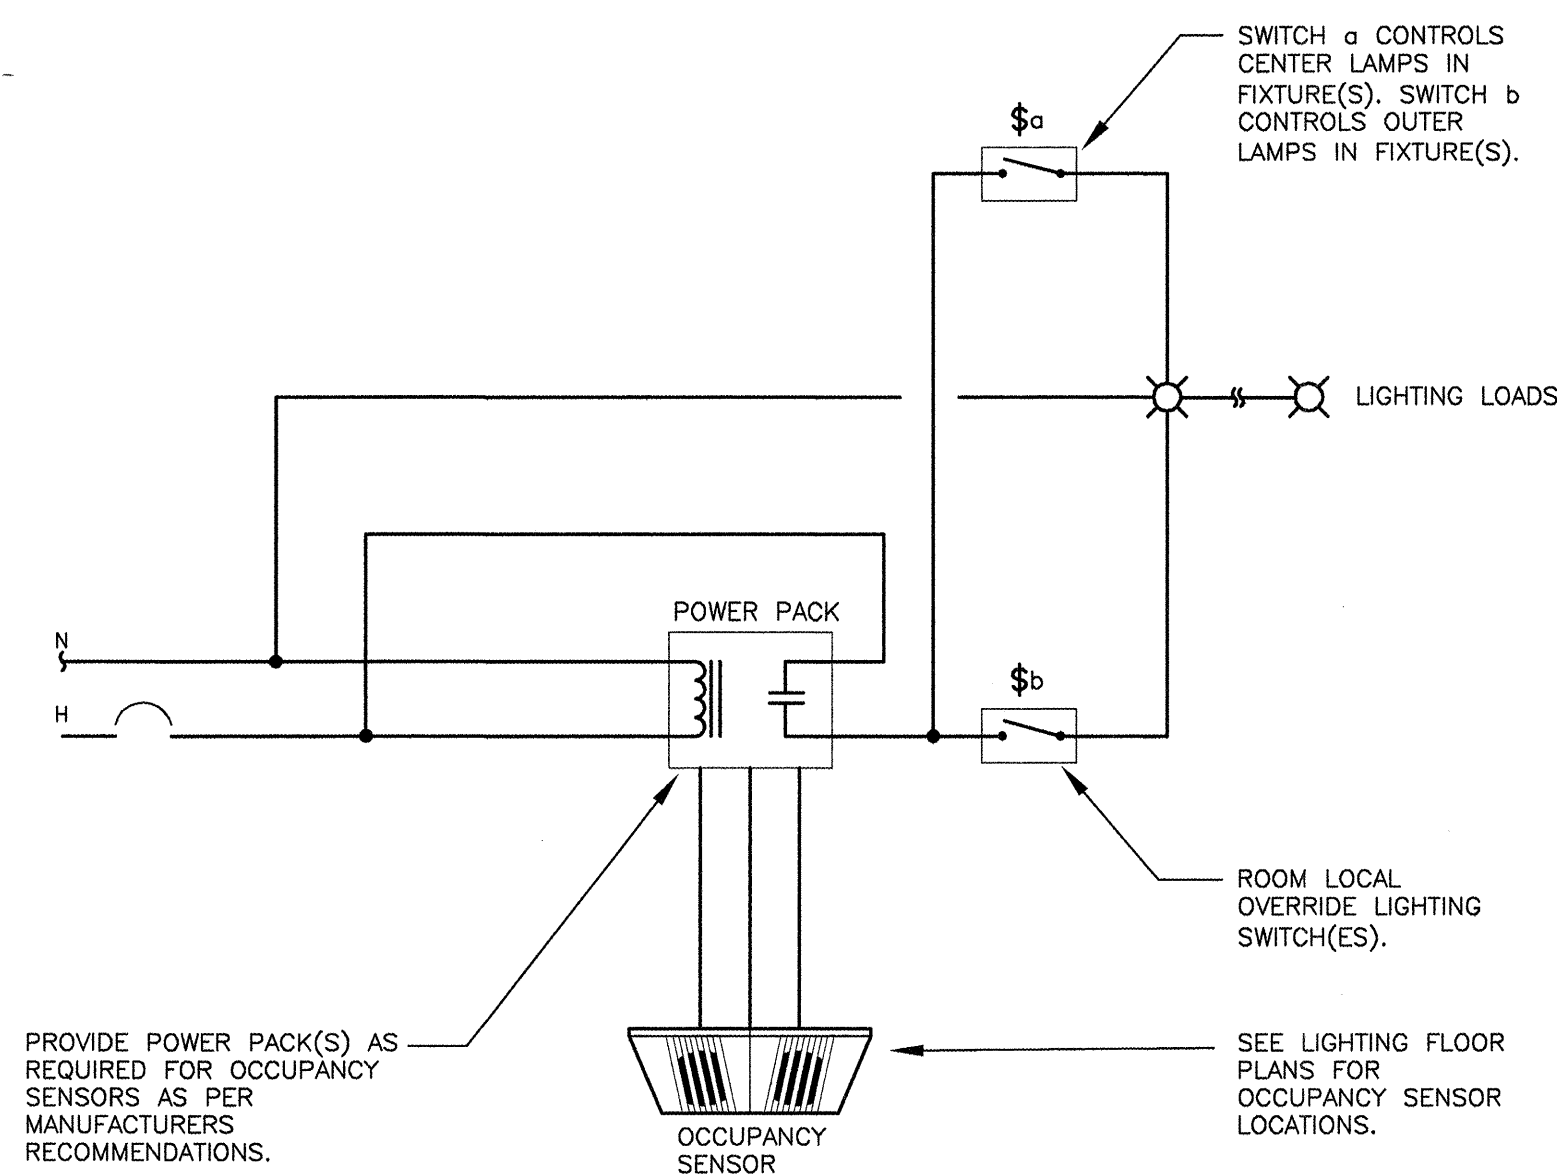

OCCUPANCY SENSOR WIRING DIAGRAM

6


NTS

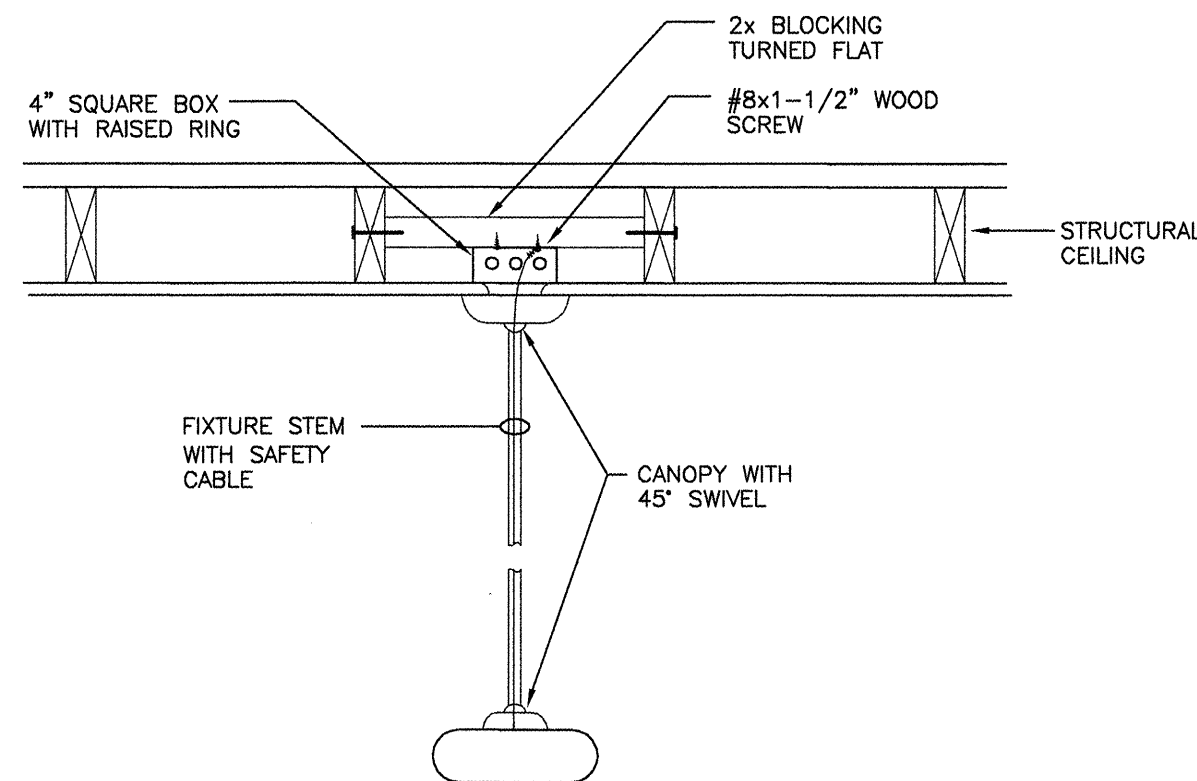

PENDANT FIXTURE SEISMIC BRACING DETAIL

3


NTS

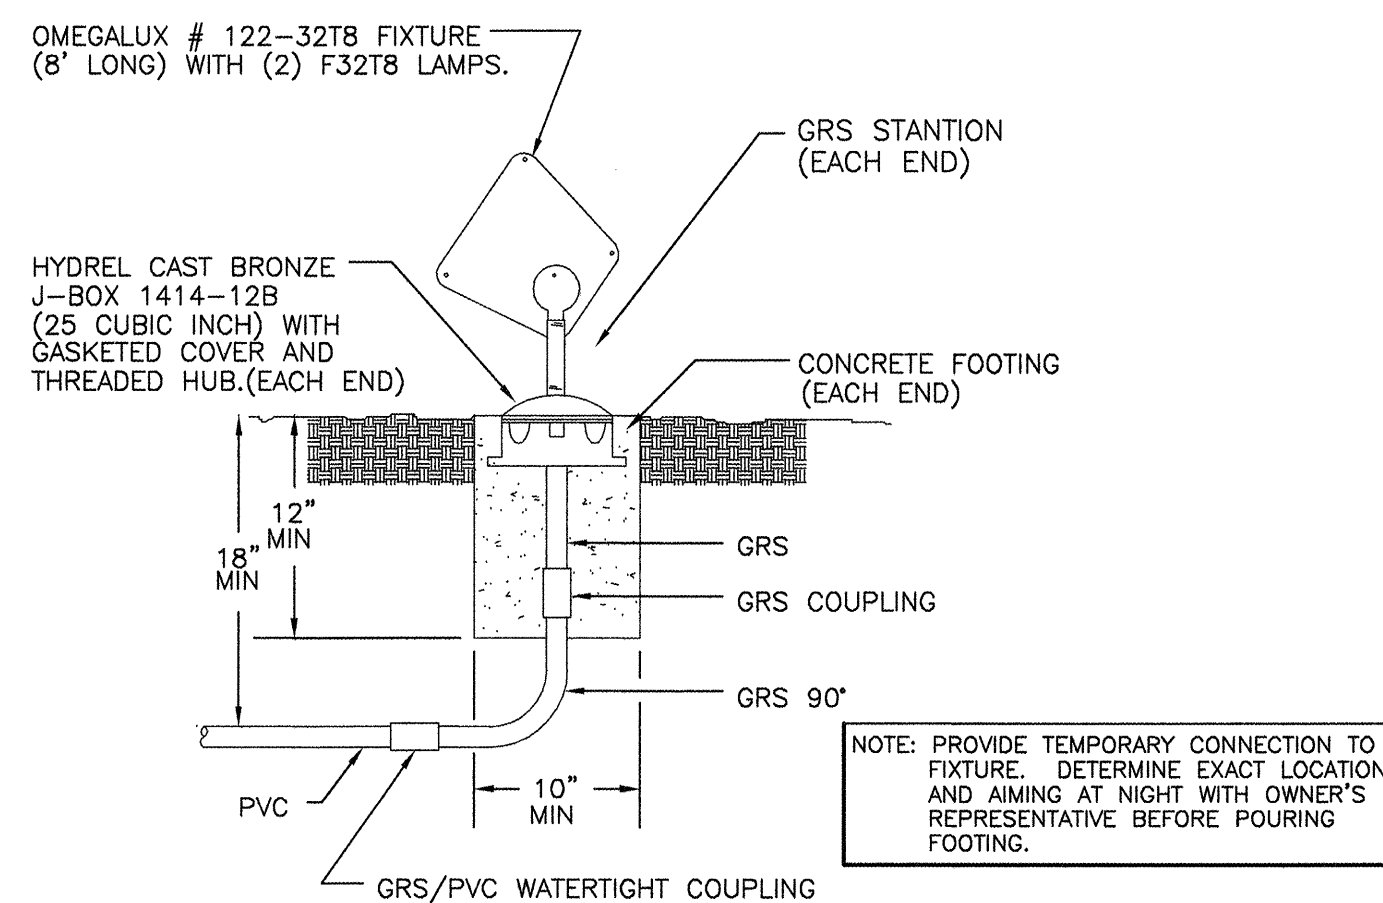

SIGN FLOOD FIXTURE MOUNTING DETAIL

4


NTS

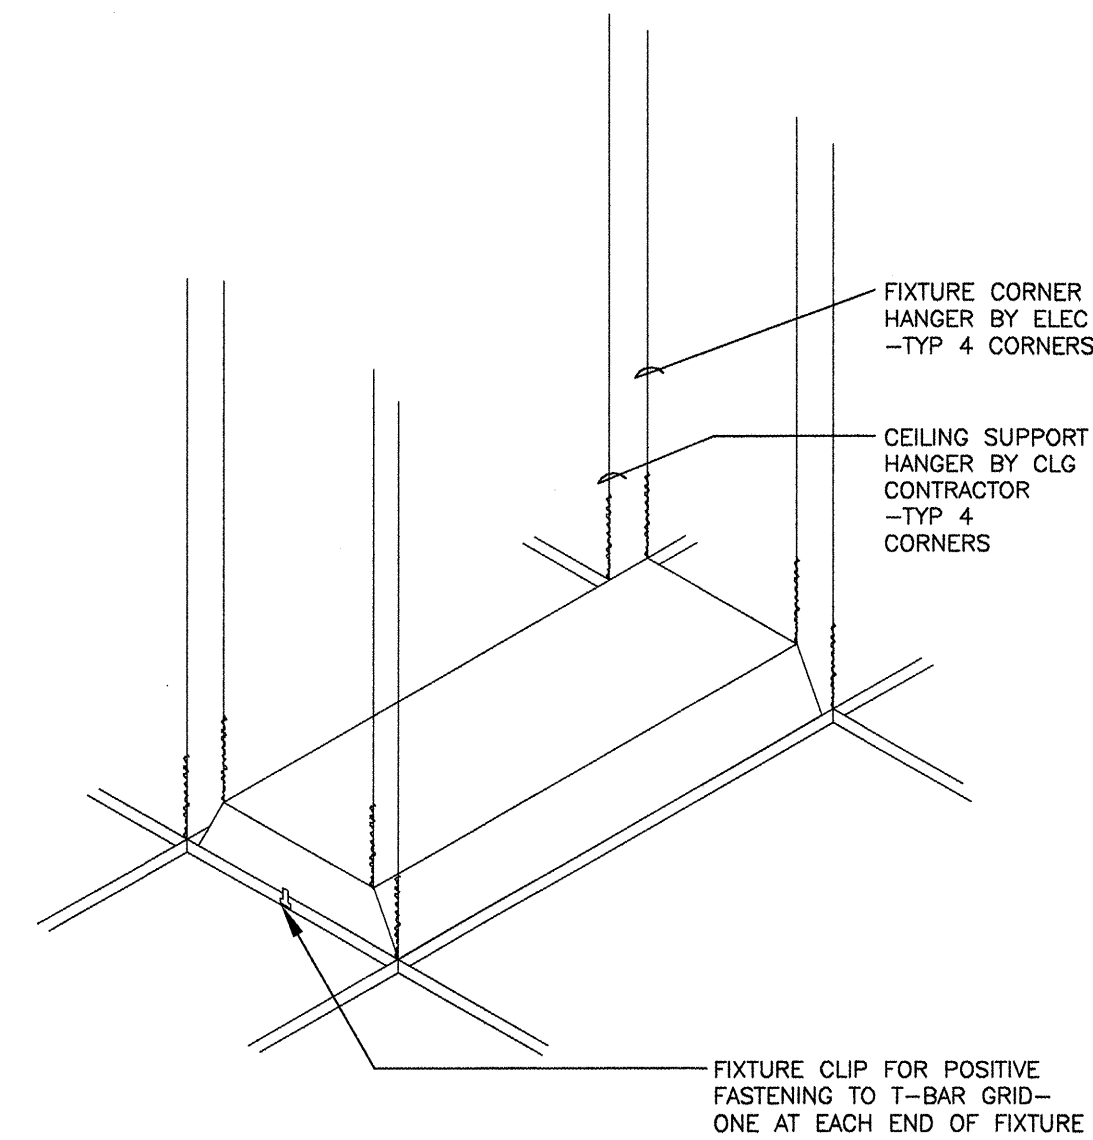

TROFFER SUPPORT

1

NTS

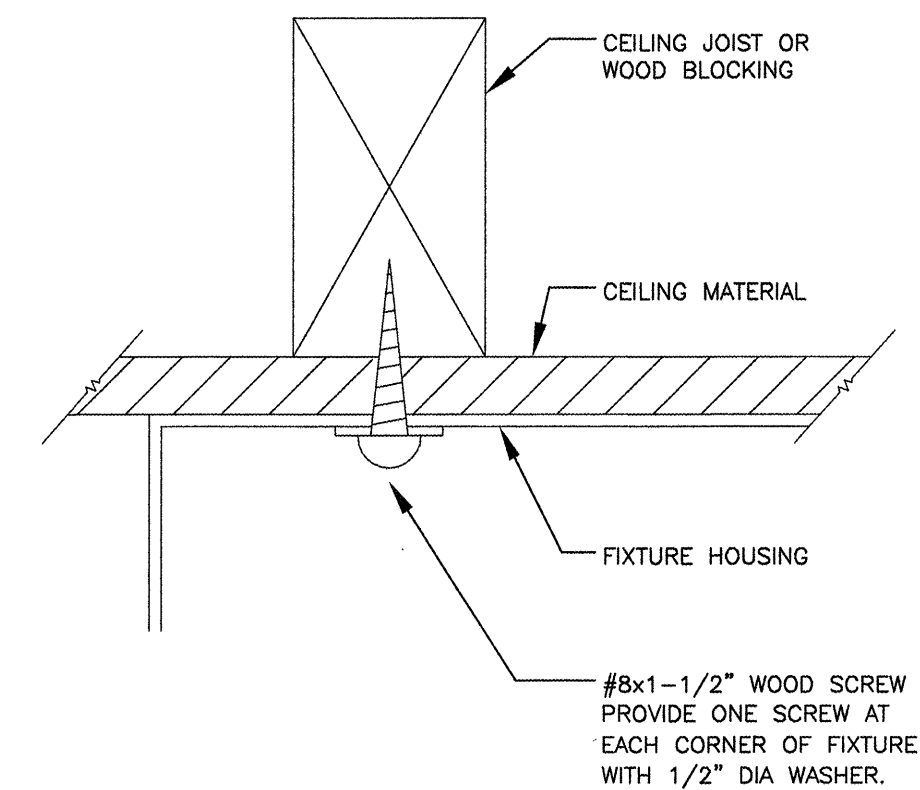

SURFACE FIXTURE MOUNTING DETAIL

2

NTS

PROJECT

**SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN**

**MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS**

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

**FRASER
SEIPLE
ARCHITECTS**


971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

**thoma
ENGINEERING**
THOMA ELECTRIC, INC.

P.O. Box 1167 - 3562 Empleo St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
Fax: (805) 543-3829
ced@thomaelec.com



EXPIRES: 06/30/13
THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Void contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

**ELECTRICAL
DETAILS**





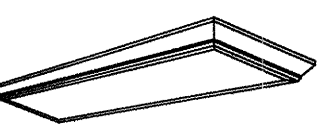
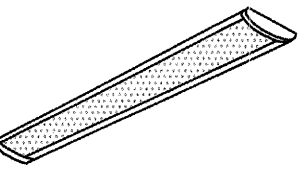

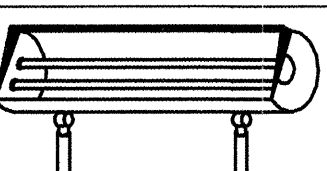

SHEET #

E3.0

LIGHTING FIXTURE SCHEDULE NOTES

- ILLUSTRATIONS AND/OR DIMENSIONS ARE APPROXIMATIONS ONLY INTENDED TO REPRESENT BASIC FIXTURE TYPE; DO NOT USE AS EXACT INFORMATION SOURCE. REFER TO MANUFACTURER CUT SHEETS.
- EXACT LOCATIONS: BEFORE CONSTRUCTION, VERIFY WITH ARCHITECT EXACT LOCATIONS AND MOUNTING HEIGHTS OF ALL LIGHT FIXTURES. SEE ARCHITECTURAL REFLECTED CEILING PLANS AND ELEVATIONS AS APPLICABLE.
- EMERGENCY FIXTURES: PROVIDE "EM" DESIGNATED FIXTURES (SEE PLAN) AND FIXTURES WITH "E" AS LAST CHARACTER IN TYPE DESIGNATION WITH INTEGRAL EMERGENCY POWER PACK. WHEN USED WITH 4' FLUORESCENT LAMPS, PROVIDE AS MINIMUM 1100 LUMEN OUTPUT.
- FIXTURE BRANCH CIRCUIT THROUGH-WIRING: VERIFY AND COMPLY WITH FIXTURE MANUFACTURER RESTRICTIONS AS DETERMINED BY UL & NEC.
- FINAL PLACEMENT AND AIMING OF EXTERIOR ADJUSTABLE FLOOD OR SPOT FIXTURES SHALL BE DETERMINED AFTER DARK WITH OWNER OR ARCHITECT PRESENT. PREARRANGE TIME AND PROVIDE TEMPORARY POWER AS REQUIRED.
- PROVIDE IN-GRADE UPLIGHTS WITH SURROUNDING SLEEVE AND CRUSHED ROCK FOR PROPER WATER DRAINAGE AS RECOMMENDED BY MANUFACTURER, FIXTURES SHALL BE SEALED (HOT) PER MANUFACTURER'S REQUIREMENTS TO MINIMIZE CONDENSATE IN FIXTURE.
- ALL STRAIGHT FLUORESCENT LAMPS SHALL BE SP41 OR EQUAL.
- ALL COMPACT FLUORESCENT LAMPS SHALL BE SPX41 OR EQUAL.
- ALL FLUORESCENT BALLASTS SHALL BE ELECTRONIC.
- VERIFY CEILING TYPES/FINISHES FOR ALL RECESSED FIXTURES PRIOR TO FORWARDING SUBMITTALS.
- ALL FLAT PRISMATIC LENSES IN FLUORESCENT FIXTURES SHALL BE MINIMUM .125" THICK.
- BALLASTS AND LAMPS SHALL BE COMPATIBLE FOR THE APPLICATION IN WHICH THEY ARE BEING USED FOR THIS PROJECT. EACH BALLAST SHALL BE COMPATIBLE WITH THE CONTROL DEVICES USED FOR THIS JOB. BALLASTS NOT RECOMMENDED FOR USE WITH CONTROL DEVICES SHALL NOT BE USED AND THE APPROPRIATE BALLAST SHALL BE USED.
- FLUORESCENT LUMINAIRES THAT UTILIZE DOUBLE-ENDED LAMPS AND CONTAIN BALLAST SHALL BE PROVIDED WITH A FACTORY INSTALLED, INTERNAL, DISCONNECTING MEANS (SWITCH OR CONNECTOR), WHICH MEETS THE REQUIREMENTS OF 2010 CEC ARTICLE 410.73(G).

LIGHTING FIXTURE SCHEDULE

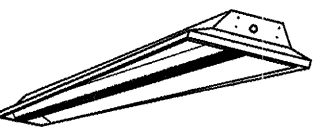TYPE	ILLUSTRATION	MANUFACTURER	CATALOG NO.	VOLTAGE	MAX. VA.	LAMPING	MOUNTING	DESCRIPTION
A		AMETRIC	ARROWLINER	120	58	(2)28W T5	PENDANT	1'X4' DIRECT/INDIRECT SUSPENDED FLUORESCENT
			AC SERIES					
B		PHILLIPS	LIGHTOLIER	120	58	(2)28W T5	RECESSED GRID	1'X4' DIRECT/INDIRECT RECESSED FLUORESCENT
			HP90					
C		PHILLIPS	LIGHTOLIER	120	38	(2)14W T5	RECESSED GRID	2'X2' DIRECT/INDIRECT RECESSED FLUORESCENT
			AFTER DOME					
D		KENALL	MILLENIUM SQUARE	120	50	(1)42W CFL	SURFACE	SQUARE CEILING MOUNTED ABUSE RESISTANT FLUORESCENT
			MS11FL-DB					
E		KENALL	MIGHTY MAC	120	58	(2)28W T5	SURFACE	4' CEILING MOUNTED CORRECTIONAL FLUORESCENT
			SDSAT5					
EM		BODINE	B50 SERIES	120	-	-	IN FIXTURE WIREWAY	FLUORESCENT EMERGENCY BATTERY PACK, PROVIDE FOR 90 MINUTE OPERATION UPON LOSS OF NORMAL POWER
F		KENALL	MILLENIUM	120	120	(4)28W T5	SURFACE	8' CEILING MOUNTED ABUSE RESISTANT FLUORESCENT
			STRETCH SDSAT5					
G		BEGA	2095LED	120	10	2W LED	RECESSED	RECESSED EXTERIOR WALL FIXTURE
H		PHILLIPS	ALLSCAPE	120	40	(1)F32 T8 FLUOR.	STANCHION	GROUND MOUNTED SIGN-LIGHTER FIXTURE
			FL-18					
X		KENALL	MILLENIUM METREX	120	5	(1) 5W LED	SURFACE	CEILING OR HIGH WALL MOUNTED CORRECTIONAL EXIT LIGHT WITH EMERGENCY BATTERY PACK
			METSU					

SEE NOTE	200A, 120/208V, 3Ø, 4W		(E) PANEL			SURFACE MOUNT, NEMA 1		SEE NOTE	
	24 EXIST. CB SPACES		<div>P</div>			LOCATION: MECHANICAL ROOM			
	EXIST. WESCO NQB TYPE					WITH EQUIP'T GND BUS			
	PANEL								
CKT #	DESCRIPTION	AMP CB # WIRE SIZE	PHASE A VA	PHASE B VA	PHASE C VA	WIRE SIZE	AMP CB # WIRE SIZE	DESCRIPTION	CKT #
1	EXISTING BRANCH CIRCUITS	20 1	(E)			(E)	20 1	EXISTING BRANCH CIRCUIT	2
3	EXISTING BRANCH CIRCUITS	20 1	(E)			(E)	20 1	EXISTING BRANCH CIRCUIT	4
5	EXISTING BRANCH CIRCUITS	20 1	(E)				20 1	EXISTING BRANCH CIRCUIT	6
7	SPACE			360		12	20 1	SECURE HALLWAY RECEPTACLES	8
9	EXISTING BRANCH CIRCUITS	20 1	(E)			(E)	20 1	EXISTING BRANCH CIRCUIT	10
11	SPACE					(E)		SPACE	12
13	SPACE					(E)		SPACE	14
15	EXISTING BRANCH CIRCUITS	20 1	(E)			(E)	20 1	EXISTING BRANCH CIRCUIT	16
17	SPACE					(E)		SPACE	18
19	EXISTING BRANCH CIRCUITS	20 1	(E)			(E)	20 1	EXISTING BRANCH CIRCUIT	20
21	SPACE					(E)		SPACE	22
23	SPACE					(E)		SPACE	24
25									26
27									28
29									30
31									32
33									34
35									36
37									38
39									40
41									42
CONNECTED LOAD (VA) =				0	0	0			
25% OF CONTINUOUS LOAD =				0	0	0			
TOTAL (VA) =				0	0	0			
TOTAL ÷ 120 VOLT =				0 A	0 A	0 A			

SEE NOTE	225A, 120/208V, 3Ø, 4W			(E) PANEL L 2			SURFACE MOUNT, NEMA 1			SEE NOTE	
	42 EXIST. CB SPACES						LOCATION: MECHANICAL ROOM				
	EXIST. WESCO NQB TYPE						WITH EQUIPT GND BUS				
	PANEL										
1,2	CKT #	DESCRIPTION	AMP CB # / POLE	WIRE SIZE	PHASE A VA	PHASE B VA	PHASE C VA	WIRE SIZE	AMP CB # / POLE	DESCRIPTION	CKT #
	1	EXISTING BRANCH CIRCUITS	20 1	(E)				(E)	20 1	EXISTING BRANCH CIRCUIT	2
	3	EXISTING BRANCH CIRCUITS	20 1	(E)				(E)	20 1	EXISTING BRANCH CIRCUIT	4
	5	EXISTING BRANCH CIRCUITS	20 1	(E)				(E)	20 1	EXISTING BRANCH CIRCUIT	6
	7	EXISTING BRANCH CIRCUITS	20 1	(E)				(E)	20 1	EXISTING BRANCH CIRCUIT	8
	9	EXISTING BRANCH CIRCUITS	20 1	(E)				(E)	20 1	EXISTING BRANCH CIRCUIT	10
	11	EXISTING BRANCH CIRCUITS	20 1	(E)				(E)	20 1	EXISTING BRANCH CIRCUIT	12
	13	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	14
	15	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	16
	17	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	18
	19	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	20
	21	CELL / SECURE HALLWAY LIGHTING	20 1	12		654		(E)	40 1	EXISTING BRANCH CIRCUIT	22
	23	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	24
	25	SPACE						(E)	3	EXISTING BRANCH CIRCUIT	26
	27	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	28
	29	EXISTING BRANCH CIRCUITS	20 1	(F)				(E)	20 1	EXISTING BRANCH CIRCUIT	30
	31	EXISTING BRANCH CIRCUITS	20 1	(F)						SPACE	32
	33	SPACE								SPACE	34
	35	SPACE								SPACE	36
	37	SPACE								SPACE	38
39	SPACE								SPACE	40	
41	SPACE								SPACE	42	
CONNECTED LOAD (VA) =					0	0	0				
25% OF CONTINUOUS LOAD =					0	0	0				
TOTAL (VA) =					0	0	0				
TOTAL ÷ 120 VOLT =					0 A	0 A	0 A				

SEE NOTE	225A, 120/208V, 3Ø, 4W		(E) PANEL			FLUSH MOUNT, NEMA 1			SEE NOTE
	42 EXIST. CB SPACES		L1			LOCATION: STORAGE ROOM			
	EXIST. WESCO NQB TYPE					WITH EQUIP'T GND BUS			
	PANEL								
CKT #	DESCRIPTION	AMP CB # WIRE SIZE POLE	PHASE A VA	PHASE B VA	PHASE C VA	WIRE SIZE POLE	DESCRIPTION	CKT #	
1	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	2	
3	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	4	
5	EXISTING BRANCH CIRCUITS	20 1	(E)				SPACE	6	
7	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	8	
9	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	10	
11	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	12	
13	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	14	
15	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	16	
17	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	18	
19	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	20	
21	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	22	
23	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	24	
25	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	26	
27	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	28	
29	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	30	
31	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	32	
33	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING BRANCH CIRCUIT	34	
35	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING A/C UNIT	36	
37	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 2 2		38	
39	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 20 1	EXISTING HAND DRYER	40	
41	EXISTING BRANCH CIRCUITS	20 1	(E)			(E) 2 2		42	
CONNECTED LOAD (VA) =			0	0	0				
25% OF CONTINUOUS LOAD =			0	0	0				
TOTAL (VA) =			0	0	0				
TOTAL ÷ 120 VOLT =			0 A	0 A	0 A				

PROJECT

SUPERIOR COURT
OF CALIFORNIA
COUNTY OF SAN JOAQUIN

MANTECA BRANCH
SITE AND BUILDING
IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB #
1007

FRASER
SEIPLE
ARCHITECTS


971 OSOS STREET
SAN LUIS OBISPO
CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com

Thoma
ENGINEERING
THOMA ELECTRIC, INC.

P.O. Box 1167 — 3562 Empleo St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
Fax: (805) 543-3829
cad@thomaelec.com



EXPIRES: 06/30/13
THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

ELECTRICAL
SCHEDULES

SHEET #

E4.0

OUTDOOR LIGHTING WORKSHEET (Part 2 of 3) OLTG-2C
Project Name: SAN JOAQUIN CO. SUPERIOR COURT
Date: 3/28/2011
D. SPECIFIC APPLICATION LIGHTING WATTAGE ALLOWANCE PER APPLICATION
Table with columns: A (Specific Lighting Application), B (Number of Applications), C (Specific Application Allowance (watts)), D (Wattage Allowance (B X C)), E (Luminaire Symbol), F (Luminaire Type), G (Lumin QTY), H (Watts Per Luminaire), I (Design Watts (G X H)), J (Allowed Watts Minimum of D or I)
E. SPECIFIC APPLICATION LIGHTING WATTAGE ALLOWANCE PER AREA
Table with columns: A (Specific Lighting Application), B (Illuminated Area of Application), C (Specific Application Allowance (watts per sq. ft.)), D (Wattage Allowance (B X C)), E (Code for Luminaire Type), F (Luminaire Type), G (Lumin QTY), H (Watts Per Luminaire), I (Design Watts (G X H)), J (Allowed Watts Minimum of D or I)
EnergyPro 5.1 by EnergySoft User Number: 6405 RunCode: 2011-03-28T16:21:20 ID: 11-8014 Page 9 of 11

CERTIFICATE OF COMPLIANCE (Part 3 of 4) OLTG-1C
Project Name: SAN JOAQUIN CO. SUPERIOR COURT
Date: 3/28/2011
A. OUTDOOR LIGHTING ZONE
OUTDOOR LIGHTING ZONE: [] OLZ 1 [] OLZ 2 [x] OLZ 3 [] OLZ 4
Is the Outdoor Lighting Zone: [x] Default in accordance with §10-114, or [] Amended by JHA
B. ADDITIONAL LIGHTING POWER ALLOWANCE FOR ORDINANCE REQUIREMENTS
Are additional lighting power allowances for ordinance in Table 147-C used? [] Yes [x] No
C. ACCEPTANCE FORMS
Required Acceptance Tests
Designer:
This form is to be used by the designer and attached to the plans. Listed below is the acceptance test for the Lighting system, OLTG-2A. The designer is required to check the acceptance tests and list all control devices serving the building or space shall be certified as meeting the Acceptance Requirements for Code Compliance. If all the lighting system or control of a certain type requires a test, list the different lighting and the number of systems. The NA7 Section in the Appendix of the Nonresidential Reference Appendices Manual describes the test. Since this form will be part of the plans, completion of this section will allow the responsible party to budget for the scope of work appropriately. Forms can be grouped by type of Luminaire controlled.
Enforcement Agency:
Systems Acceptance: Before Occupancy Permit is granted for a newly constructed building or space or when ever new lighting system with controls is installed in the building or space shall be certified as meeting the Acceptance Requirements. The OLTG-2A form is not considered a complete form and is not to be accepted by the enforcement agency unless the boxes are checked and/or filled and signed. In addition, a Certificate of Acceptance forms shall be submitted to the enforcement agency that certifies plans, specifications, installation certificates, and operating and maintenance information meet the requirements of §10-103(b) of Title 24 Part 6. The field inspector must receive the properly filled out and signed forms before the building can receive final occupancy. A copy of the OLTG-2A for each different lighting luminaire control(s) must be provided to the owner of the building for their records.
Certificate of Acceptance
OLTG-2A
Equipment Requiring Testing Description Qty. of Units Location Outdoor Lighting Acceptance Tests
1. Insert: OMS for Outdoor Motion Sensor; OLSO for Outdoor Lighting Shutoff Controls; OP for Outdoor Photocontrol; ATS for Astronomical Time Switch; and, STS for Standard (non-astronomical) Time Switch acceptance.
EnergyPro 5.1 by EnergySoft User Number: 6405 RunCode: 2011-03-28T16:21:20 ID: 11-8014 Page 9 of 11

CERTIFICATE OF COMPLIANCE (Part 1 of 4) OLTG-1C
Project Name: SAN JOAQUIN CO. SUPERIOR COURT
Date: 3/28/2011
Project Address: 316 E. Center St. Manteca, CA 95336
Total Illuminated Area: 0
GENERAL INFORMATION
Phase of Construction: [] New Construction [] Addition [] Alteration
Documentation Author's Declaration Statement
I certify that this Certificate of Compliance documentation is accurate and complete.
Name: William Thome Signature: [Signature] Date: 3/28/2011
Company: Thome Electric, Inc. Phone: 805-543-3850
Address: 3562 Empleo Street CEA # CEPE #
City/State/Zip: San Luis Obispo, CA 93401 Phone: 805-543-3850
Principal Lighting Designer's Declaration Statement
I am eligible under Division 3 of the California Business and Professional Code to accept responsibility for the lighting design.
This Certificate of Compliance identifies the lighting features and performance specifications required for compliance with Title 24, Pages 1 and 6 of the California Code of Regulations.
The design features represented on this Certificate of Compliance are consistent with the information provided to document this design on the other applicable compliance forms, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
Name: William Thome Signature: [Signature]
Company: Thome Electric, Inc. Phone: 805-543-3850
Address: 3562 Empleo St. License # 10757
City/State/Zip: San Luis Obispo, CA 93401 Date: 5/5/2011
Principal Lighting Designer's Declaration
I certify that this Certificate of Compliance documentation is accurate and complete, and accounts for all outdoor lighting power, including building mounted, pole mounted, as well as all other lighting designed for the site, and that Additional Lighting Power Allowances for Specific Applications or Additional Lighting Power Allowances for Ordinance Requirements have not been counted more than one time for the same area, in accordance with Section 147 of the Standards.
Outdoor Lighting Mandatory Measures
Indicate location on building plans of Mandatory Measures Note Block: E5.0
LIGHTING COMPLIANCE FORMS & WORKSHEETS (check box if worksheets are included)
[] OLTG-1C Certificate of Compliance. All 4 pages required on plans for all submittals.
[] OLTG-2C (Pages 1 of 3) Lighting Wattage Allowances for General Hardscape, Sides Frontage, or Ornamental Lighting. Optional on plans.
[] OLTG-2C (Pages 2 of 3) Lighting Wattage Allowance for Per Application or Per Area. Optional on plans.
[] OLTG-2C (Pages 3 of 3) Additional Lighting Power Allowance for Ordinance Requirements. Optional on plans.
EnergyPro 5.1 by EnergySoft User Number: 6405 RunCode: 2011-03-28T16:21:20 ID: 11-8014 Page 7 of 11

CERTIFICATE OF COMPLIANCE (Part 4 of 4) OLTG-1C
Project Name: SAN JOAQUIN CO. SUPERIOR COURT
Date: 3/28/2011
ALLOWED AND INSTALLED OUTDOOR LIGHTING POWER
Table with columns: A (Lighting power allowance for general hardscape (from OLTG-2C Page 1 of 3)), B (Specific application lighting wattage allowance per unit length (from OLTG-2C Page 1 of 3)), C (Specific application lighting wattage allowance for ornamental lighting (from OLTG-2C Page 1 of 3)), D (Specific application lighting wattage allowance per application (from OLTG-2C Page 2 of 3)), E (Specific application lighting wattage allowance per area (from OLTG-2C Page 2 of 3)), F (Specific application lighting wattage allowance for ordinance requirements (from OLTG-2C Page 3 of 3)), G (Total Allowed Wattage = Sum of rows A through F), H (Total installed watts (from Compliance Fixture Schedule, (from OLTG-2C Page 1 of 3)))
Complies if wattage in row H is less than or equal to the wattages in row G [x] Yes [] No
EnergyPro 5.1 by EnergySoft User Number: 6405 RunCode: 2011-03-28T16:21:20 ID: 11-8014 Page 10 of 11

CERTIFICATE OF COMPLIANCE (Part 2 of 4) OLTG-1C
Project Name: SAN JOAQUIN CO. SUPERIOR COURT
Date: 3/28/2011
COMPLIANCE FIXTURE / LIGHTING CONTROL SCHEDULE and FIELD INSPECTION CHECKLIST
INSTALLATION CERTIFICATE, OLTG-1INST (Retain a copy and verify form is completed and signed.) Field Inspection []
CERTIFICATE OF ACCEPTANCE, OLTG-2A (Retain a copy and verify form is completed and signed.) Field Inspection []
Table with columns: A (Name or Item Tag), B (Luminaire Description), C (Control Description), D (Watts per Luminaire), E (Special Features), F (How wattage was determined), G (Number of Luminaires), H (Installed Watts (D X G)), I (Field Inspector)
Enter total into OLTG-1C, Page 4 of 4, Row H, Total Installed Watts: 96
1. Type of luminaire (e.g., post top, wall pack, surface, shoe box), for non-incandescent luminaires, indicate nominal lamp wattage and lamp type (i.e., fluorescent, incandescent, HID, ballast type (e.g., electronic or magnetic), number of lamps and number of ballasts per luminaire. For incandescent luminaires, the luminaire wattage listed in column D shall be the maximum allowable rated wattage on a permanent factory-installed label on the luminaire. NOT the wattage of the lamp (bulb) used, in accordance with Section 130(d) of e).
2. If fail then describe on Page 2 of the Inspection Checklist Form and take appropriate action to correct. Verify building plans if necessary.
EXEMPT LUMINAIRES Field Inspection []
Name or Symbol Description of exempt luminaires in accordance with §147
MANDATORY CONTROLS Field Inspection []
Description Location # Description Location
SPECIAL FEATURES INSPECTION CHECKLIST (See Page 2 of 4 of OLTG-1C)
The local enforcement agency should pay special attention to the items specified in this checklist. These items require special written justification and documentation, and special verification. The local enforcement agency determines the adequacy of the justification, and may reject a building or design that otherwise complies based on the adequacy of the special justification and documentation submitted.
Filed Inspector Notes or Discrepancies:
EnergyPro 5.1 by EnergySoft User Number: 6405 RunCode: 2011-03-28T16:21:20 ID: 11-8014 Page 8 of 11

PROJECT

SUPERIOR COURT OF CALIFORNIA COUNTY OF SAN JOAQUIN

MANTECA BRANCH SITE AND BUILDING IMPROVEMENTS

PHASE 1

CLIENT JOB # ARCHITECT JOB # 1007




971 OSOS STREET SAN LUIS OBISPO CALIFORNIA 93401

805 544-6161

www.fraserseiplearchitects.com



P.O. Box 1167 - 3562 Empleo St. San Luis Obispo, CA 93406 Phone: (805) 543-3850 Fax: (805) 543-3829 csa@thomalec.com

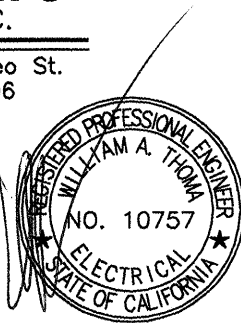

EXPIRES: 06/30/13 THOMA #11-8014

PROJECT MANAGER RP

DRAWN BY LB

DATES 06/20/11

SIGNED

The use of these plans and specifications shall be restricted to the original site for which they were prepared and publication thereof is expressly limited to such use. Reproduction or publication by any method, in whole or in part, is prohibited. Title to these plans and specifications remain with the architect without prejudice. Visual contact with these plans and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

Written dimensions on these drawings shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and existing conditions on the job and shall report any discrepancies to the architect for resolution prior to commencing work.

SHEET TITLE

EXTERIOR TITLE 24 COMPLIANCE FORMS

SHEET #

E5.1